

MITSUBISHI

QnA SERIES

Model Q2AS (H) CPU (S1)

User's Manual



Mitsubishi Programmable Controller

● SAFETY PRECAUTIONS ●

(Be sure to read these instructions before use.)

Before using the product, read this and relevant manuals carefully and handle the product correctly with full attention to safety.

In this manual, ●SAFETY PRECAUTIONS● are classified into 2 levels: "DANGER" and "CAUTION".



Indicates that incorrect handling may cause hazardous conditions, resulting in death or severe injury.



Indicates that incorrect handling may cause hazardous conditions, resulting in minor or moderate injury and/or property damage.

Under some circumstances, failure to observe the ⚠ CAUTION level instructions may also lead to serious results.

Be sure to observe the instructions of both levels to ensure the safety.

Please keep this manual in a safe place for future reference and also pass this manual on to the end user.

[DESIGN PRECAUTIONS]

⚠ DANGER

- Create a safety circuit outside the programmable controller to ensure the whole system will operate safely even if an external power failure or a programmable controller failure occurs. Otherwise, incorrect output or malfunction may cause an accident.
 - (1) When creating an emergency stop circuit, a protection circuit or an interlock circuit for incompatible actions such as forward/reverse rotation or for damage prevention such as the upper/lower limit setting in positioning, create it outside the programmable controller. Install the emergency stop switch outside the control panel so that workers can operate it easily.
 - (2) When the programmable controller detects the following error conditions, it stops the operation and turn off all the outputs.
 - The overcurrent or overvoltage protector of the power supply module is activated.
 - The programmable controller CPU detects an error such as a watchdog timer error by the self-diagnostics function.In the case of an error undetectable by the programmable controller CPU, such as an I/O control part error, all the outputs may turn on. In order to make all machines operate safely in such a case, set up a fail-safe circuit or a specific mechanism outside the programmable controller. For fail safe circuit example, refer to "LOADING AND INSTALLATION" of this manual.
 - (3) Depending on the failure of the output module's relay or transistor, the output status may remain ON or OFF incorrectly. For output signals that may lead to a serious accident, create an external monitoring circuit.

[DESIGN PRECAUTIONS]

DANGER

- If load current more than the rating or overcurrent due to a short circuit in the load has flowed in the output module for a long time, it may cause a fire and smoke. Provide an external safety device such as a fuse.
- Design a circuit so that the external power will be supplied after power-up of the programmable controller.
Activating the external power supply prior to the programmable controller may result in an accident due to incorrect output or malfunction.
- For the operation status of each station at a communication error in data link, refer to the respective data link manual.
Otherwise, incorrect output or malfunction may cause an accident.
- When controlling a running programmable controller (data modification) by connecting a peripheral device to the CPU module or a PC to a special function module, create an interlock circuit on sequence programs so that the whole system functions safely all the time.
Also, before performing any other controls (e.g. program modification, operating status change (status control)), read the manual carefully and ensure the safety.
In these controls, especially the one from an external device to a programmable controller in a remote location, some programmable controller side problem may not be resolved immediately due to failure of data communications.
To prevent this, create an interlock circuit on sequence programs and establish corrective procedures for communication failure between the external device and the programmable controller CPU.
- When setting up the system, do not allow any empty slot on the base unit.
If any slot is left empty, be sure to use a blank cover (A1SG60) or a dummy module (A1SG62) for it.
When using the extension base unit, A1S52B(S1), A1S55B(S1) or A1S58B(S1), attach the included dustproof cover to the module in slot 0.
Otherwise, internal parts of the module may be fried in the short circuit test or when an overcurrent or overvoltage is accidentally applied to the external I/O section.

CAUTION

- Do not install the control lines or communication cables together with the main circuit or power lines, or bring them close to each other.
Keep a distance of 100mm (3.94inch) or more between them.
Failure to do so may cause malfunctions due to noise.
- If having read register R outside the allowable range with the MOV instruction, the file register data will be FFFFH. Using this as it is may cause malfunctions. Pay attention not to use any out-of-range file register when designing sequence programs. For instruction details, refer to the programming manual.
- When an output module is used to control the lamp load, heater, solenoid valve, etc., a large current (ten times larger than the normal one) may flow at the time that the output status changes from OFF to ON. Take some preventive measures such as replacing the output module with the one of a suitable current rating.

[INSTALLATION PRECAUTIONS]

CAUTION

- Use the programmable controller under the environment specified in the user's manual.
Otherwise, it may cause electric shocks, fires, malfunctions, product deterioration or damage.
- Install the module after inserting the pegs on the bottom of the module securely into the base unit peg holes.
Not doing so could cause a malfunction, failure or fall.
Tightening the screw excessively may damage the screw and/or the module, resulting in a drop of the module, a short circuit or malfunctions.
- Connect the extension cable to the connector of the base unit or module.
Check for incomplete connection after installing it.
Poor electrical contact may cause incorrect inputs and/or outputs.
- Insert the memory card and fully press it to the memory card connector.
Check for incomplete connection after installing it.
Poor electrical contact may cause malfunctions.
- Be sure to shut off all the phases of the external power supply used by the system before mounting or removing the module.
Failure to do so may damage the module.
- Do not directly touch the conductive part or electronic components of the module.
Doing so may cause malfunctions or a failure of the module.

[WIRING PRECAUTIONS]

DANGER

- Be sure to shut off all phases of the external power supply used by the system before wiring.
Failure to do so may result in an electric shock or damage of the product.
- Before energizing and operating the system after wiring, be sure to attach the terminal cover supplied with the product.
Failure to do so may cause an electric shock.

CAUTION

- Always ground the FG and LG terminals to the protective ground conductor.
Failure to do so may cause an electric shock or malfunctions.
- Wire the module correctly after confirming the rated voltage and terminal layout.
Connecting a power supply of a different voltage rating or incorrect wiring may cause a fire or failure.
- Do not connect multiple power supply modules to one module in parallel.
The power supply modules may be heated, resulting in a fire or failure.
- Press, crimp or properly solder the connector for external connection with the specified tool.
Incomplete connection may cause a short circuit, fire or malfunctions.
- Tighten terminal screws within the specified torque range.
If the screw is too loose, it may cause a short circuit, fire or malfunctions.
If too tight, it may damage the screw and/or the module, resulting in a short circuit or malfunctions.
- Carefully prevent foreign matter such as dust or wire chips from entering the module.
Failure to do so may cause a fire, failure or malfunctions.
- Install our programmable controller in a control panel for use.
Wire the main power supply to the power supply module installed in a control panel through a distribution terminal block.
Furthermore, the wiring and replacement of a power supply module have to be performed by a maintenance worker who acquainted with shock protection.
(For the wiring methods, refer to Section 19.7.)

[START AND MAINTENANCE PRECAUTIONS



DANGER

- Do not touch any terminal during power distribution.
Doing so may cause an electric shock.
- Properly connect batteries.
Do not charge, disassemble, heat or throw them into the fire and do not make them short-circuited and soldered.
Incorrect battery handling may cause personal injuries or a fire due to exothermic heat, burst and/or ignition.
- Be sure to shut off all phases of the external power supply used by the system before cleaning or retightening the terminal screws or module mounting screws.
Failure to do so may result in an electric shock.
If they are too loose, it may cause a short circuit or malfunctions.
Tightening the screw excessively may damage the screw and/or the module, resulting in a drop of the module, a short circuit or malfunctions.

CAUTION

- When performing online operations (especially, program modification, forced output or operating status change) by connecting a peripheral device to the running CPU module, read the manual carefully and ensure the safety.
Incorrect operation will cause mechanical damage or accidents.
- Do not disassemble or modify each of modules.
Doing so may cause failure, malfunctions, personal injuries and/or a fire.
- When using a wireless communication device such as a mobile phone, keep a distance of 25cm (9.84inch) or more from the programmable controller in all directions.
Failure to do so may cause malfunctions.
- Be sure to shut off all the phases of the external power supply used by the system before mounting or removing the module.
Failure to do so may result in failure or malfunctions of the module.
- Do not drop or apply any impact to the battery.
Doing so may damage the battery, resulting in electrolyte spillage inside the battery.
If any impact has been applied, discard the battery and never use it.
- Do not install/remove the terminal block more than 50 times after the first use of the product.
(IEC 61131-2 compliant)
- Before handling modules, touch a grounded metal object to discharge the static electricity from the human body.
Failure to do so may cause failure or malfunctions of the module.

[DISPOSAL PRECAUTIONS]

CAUTION

- When disposing of the product, treat it as an industrial waste.
When disposing of batteries, separate them from other wastes according to the local regulations.
(For details of the battery directive in EU member states, refer to Appendix 11.)

[TRANSPORTATION PRECAUTIONS]

CAUTION

- When transporting lithium batteries, make sure to treat them based on the transportation regulations.
(Refer to Appendix 10 for details of the relevant models.)

REVISIONS

*The manual number is noted at the lower left of the back cover.

Print Date	*Manual Number	Revision
Sep.1996	SH (NA)-3599-A	First printing
Feb,1999	SH(NA)-3599-B	<p>Additional model</p> <p>SW□5□-GPPW GPP Function Software Package for Windows</p> <p>Addition</p> <p>The contents of the function version B has been added. Section 2.2, Section 7.2, Sections 8.2.1, 8.2.2, Section 19.8, Appendix 7, 8</p> <p>Partial correction</p> <p>Safety Precautions, Contents, Section 1.2, Section 3.3.1, Chapter 4, Section 5.3, Section 6.1, Section 8.10.1, Section 15.2, Section 16.1, Section 19.7.1, Section 21.3.1, Appendix 1.6, Appendix 2</p>
Dec., 2002	SH(NA)-3599-C	<p>Equivalent to Japanese version D</p> <p>Partial correction</p> <p>SAFETY PRECAUTIONS, Section 3.1.2, Section 3.3.1, Section 3.3.2, Section 3.3.3, Section 8.2.1, Section 8.5, Section 12.1.5, Section 12.1.6, Chapter 13, Section 14.3, Section 15.1, Section 15.3, Section 16.1, Section 16.2, Section 17.2, Section 17.3, Section 19.1, Section 22.3.2, Appendix 3</p>
Dec., 2003	SH(NA)-3599-D	<p>Additional model</p> <p>A1SY42P</p> <p>Addition</p> <p>Appendix 9, 9.1, 9.2</p> <p>Partial correction</p> <p>Section 3.3.1, Section 14.3, Section 18.3, Section 19.4.1, Section 19.8, Section 20.1.4, Section 21.3</p>

Japanese Manual Version SH-3587-I

This manual does not imply guarantee or implementation right for industrial ownership or implementation of other rights. Mitsubishi Electric Corporation is not responsible for industrial ownership problems caused by use of the contents of this manual.

Print Date	*Manual Number	Revision
Oct., 2006	SH(NA)-3599-E	<p>Partial correction</p> <p>SAFETY PRECAUTIONS, Section 1.1, Section 1.2, Section 2.1, 3.1.1, Section 3.1.2, Section 3.3.1, Section 3.3.2, Chapter 4, Section 5.3, Section 7.1, Section 7.2, Section 8.1, Section 8.2.1, Section 8.3, Section 8.4.3, Section 8.6, Section 8.8, Section 8.9, Section 8.10.1, Section 9.3, Section 9.4, Section 10.1, Section 10.5, Section 10.6.3, Section 10.8, Section 12.1, Section 12.1.3, Section 12.1.5, Section 12.4, Chapter 13, Section 14.2, Section 15.1, Section 15.3, Section 16.1.1, Section 16.2, Section 16.3, Section 17.1, Section 17.2, Section 17.3, Section 17.5, Section 18.1, Section 18.2, Section 18.3, Section 19.1, Section 19.4.1, Section 19.4.2, Section 19.5, Section 19.6, Section 19.7, Section 19.7.1, Section 19.7.2, 20, Section 20.2.4, Section 20.2.6, Section 21.2, Section 21.3, Section 21.4, Section 21.5, Section 22.2.5, Section 22.2.6, Section 22.2.8, Section 22.3.3, Section 22.5.2, Appendix 1.1, Appendix 1.6, Appendix 2, Appendix 3, Appendix 4.1, Appendix 4.2, Appendix 5.1, Appendix 5.2,</p> <p>Deletion</p> <p>Section 14.2</p> <p>Chapter change</p> <p>Section 14.3→ Section 14.2</p>
Apr.,2007	SH(NA)-3599-F	<p>Partial correction</p> <p>Section 3.1.1, 3.3.1, 3.3.2, 17.1, 19.7.1, 19.7.2, 20.1.3, 20.2.7, 22.5.1, 22.5.2, Appendix 2, Appendix 3, Appendix 6.3</p> <p>Addition</p> <p>Section 20.1.8</p>
Sep.,2008	SH(NA)-3599-G	<p>Partial correction</p> <p>SAFETY PRECAUTIONS, Section 5.2, 5.4, 8.2, 8.2.1, 8.5, 9.2, 9.3, 10.1, 10.3, 10.4, 10.5, 10.6.1, 12.1, 12.1.1, 12.1.7, 12.2, 12.3, 12.4, Chapter 13, Section 15.1, 15.3, 16.1.1, 16.2, 19.1, 19.2, 19.3, 19.4.1, 19.4.2, 19.7.1, 19.8, 20.1, 20.1.2, 20.1.3, 20.2, 20.2.1, 20.2.2, 20.2.3, 20.2.4, 20.2.6, 20.2.7, Chapter 21, Section 21.3.1, 21.3.2, 21.4, 21.5, 22.1, 22.2.2, 22.2.5, 22.3, 22.5.1, Appendix 2</p> <p>Addition</p> <p>Appendix 11, Appendix 11.1, Appendix 11.2</p>

Introduction

Thank you for purchasing the Mitsubishi programmable logic controller MELSEC-QnA series.

Before using your new PLC, please read this manual thoroughly to gain an understanding of its functions so that you can use it properly.

Please forward a copy of this manual to the end user.

Table of Contents

1	ABOUT THIS MANUAL	1 - 1 to 1 - 2
1.1	About this Manual.....	1 - 1
1.2	Abbreviations and Generic Terms Used in this Manual	1 - 2
2	OVERVIEW	2 - 1 to 2 - 8
2.1	Features	2 - 1
2.2	Additional Functions of Q2ASCPU	2 - 5
2.2.1	Overview of added functions.....	2 - 7
3	SYSTEM CONFIGURATION	3 - 1 to 3 - 23
3.1	System Configuration	3 - 1
3.1.1	Equipment configuration in a stand-alone system	3 - 1
3.1.2	Configuration of peripheral devices capable of Q2ASCPU	3 - 2
3.2	System Configuration Overview	3 - 3
3.3	System Equipment	3 - 5
3.3.1	System equipment list	3 - 5
3.3.2	Precautions when configuring the system.....	3 - 19
3.3.3	Q2ASCPU memory block diagram.....	3 - 23
4	PERFORMANCE SPECIFICATIONS	4 - 1 to 4 - 3
5	I/O NUMBER ASSIGNMENT	5 - 1 to 5 - 13
5.1	I/O Numbers	5 - 1
5.2	I/O Number Assignment Concept.....	5 - 2
5.3	I/O Assignment with GPP Function	5 - 4
5.4	Example of I/O Number Assignment.....	5 - 9
6	DATA COMMUNICATIONS WITH SPECIAL FUNCTION MODULES	6 - 1 to 6 - 5
6.1	Reading/Writing Data from/to the Q2ASCPU Using the FROM/TO Instruction	6 - 2
6.2	Reading/Writing Data from/to the Q2ASCPU Using Special Direct Devices.....	6 - 3
6.3	Processing for Data Communication Requests from a Special Function Module	6 - 5
7	AUTO REFRESH FUNCTION	7 - 1 to 7 - 14
7.1	For MELSECNET/MINI-S3.....	7 - 1
7.2	Auto Refresh Setting of CC-Link	7 - 8

8	DEBUGGING FUNCTION	8 - 1 to 8 - 64
----------	---------------------------	------------------------

8.1	Function List.....	8 - 1
8.2	Monitor Function.....	8 - 2
8.2.1	Monitoring condition setting	8 - 2
8.2.2	Monitor test of local device (function version B or later)	8 - 12
8.3	Write During RUN.....	8 - 15
8.4	Execution Time Measurement.....	8 - 19
8.4.1	Program monitor list	8 - 19
8.4.2	Interrupt program monitor list	8 - 22
8.4.3	Scan time measurement	8 - 23
8.5	Sampling Trace Function	8 - 25
8.6	Status Latch Function.....	8 - 35
8.7	Step Operation	8 - 41
8.7.1	Step execution	8 - 42
8.7.2	Partial execution.....	8 - 44
8.7.3	Skip function.....	8 - 47
8.8	Program Trace Function.....	8 - 48
8.9	Simulation Function.....	8 - 57
8.10	Debugging by Several People.....	8 - 61
8.10.1	Simultaneous monitoring by several people	8 - 62
8.10.2	Simultaneous execution of write during RUN by several people	8 - 63

9	MAINTENANCE FUNCTION	9 - 1 to 9 - 19
----------	-----------------------------	------------------------

9.1	Function List.....	9 - 1
9.2	Watchdog Timer	9 - 2
9.3	Self-diagnostics Function	9 - 4
9.3.1	Interruption due to error detection.....	9 - 8
9.3.2	LED indication due to an error	9 - 8
9.3.3	Resetting error	9 - 9
9.4	Error History	9 - 10
9.5	System protect	9 - 11
9.6	Password Registration	9 - 12
9.7	System Display.....	9 - 14
9.8	LED indication	9 - 15
9.8.1	LED indication	9 - 15
9.8.2	Priority setting	9 - 17

10	OTHER FUNCTIONS	10 - 1 to 10 - 24
-----------	------------------------	--------------------------

10.1	Function List.....	10 - 1
10.2	Constant Scan.....	10 - 2
10.3	Latch Function.....	10 - 5
10.4	Setting of the Output (Y) Status When Switching from STOP to RUN.....	10 - 7
10.5	Clock Function.....	10 - 8
10.6	Remote Operation	10 - 12
10.6.1	Remote RUN/STOP	10 - 12
10.6.2	Remote STEP-RUN	10 - 15

10.6.3 Remote PAUSE	10 - 16
10.6.4 Remote RESET.....	10 - 18
10.6.5 Remote latch clear	10 - 19
10.6.6 Relationship between remote operation and CPU module RUN/STOP key switch	10 - 20
10.7 Terminal Operation.....	10 - 21
10.7.1 Operation for message display	10 - 21
10.7.2 Key input operation	10 - 22
10.8 Reading Module Access Time Intervals	10 - 23

11 COMMENTS THAT CAN BE STORED IN Q2ASCPU	11 - 1 to 11 - 8
--	-------------------------

11.1 Function List.....	11 - 1
11.2 PLC name	11 - 2
11.3 Drive Title	11 - 3
11.4 File Title.....	11 - 4
11.5 Device Comment.....	11 - 5
11.6 Statements/Notes.....	11 - 7
11.7 Initial Device Value Comment	11 - 8

12 OVERVIEW OF PROCESSING PERFORMED BY THE Q2ASCPU	12 - 1 to 12 - 28
---	--------------------------

12.1 Program Execution Types	12 - 1
12.1.1 Initial execution type programs	12 - 4
12.1.2 Scan execution type program	12 - 7
12.1.3 Low-speed execution type program	12 - 9
12.1.4 Standby type program.....	12 - 16
12.1.5 Initial processing	12 - 22
12.1.6 Refresh processing of I/O module.....	12 - 22
12.1.7 END processing	12 - 23
12.2 Operation Processing of RUN, STOP, PAUSE, and STEP-RUN.....	12 - 24
12.3 Operation Processing for Instantaneous Power Failure.....	12 - 26
12.4 Data Clear Processing	12 - 27

13 PARAMETER LIST	13 - 1 to 13 - 10
--------------------------	--------------------------

14 SELECTING MEMORY CARD MODELS	14 - 1 to 14 - 4
--	-------------------------

14.1 Applications of Memory Cards	14 - 2
14.2 Selecting Memory Card Capacity.....	14 - 3

15 HARDWARE SPECIFICATIONS OF CPU MODULES	15 - 1 to 15 - 6
--	-------------------------

15.1 SPECIFICATIONS	15 - 1
15.2 Part Names	15 - 2
15.3 Relationship between Switch Operations and LEDs/LED Display	15 - 4

16 POWER SUPPLY MODULE	16 - 1 to 16 - 6
-------------------------------	-------------------------

16.1 Specifications	16 - 1
16.1.1 Power supply module specifications	16 - 1

16.1.2	Power supply module selection.....	16 - 3
16.2	Precautions for Handling	16 - 4
16.3	Part Names	16 - 5

17	BASE UNIT AND EXTENSION CABLE	17 - 1 to 17 - 9
-----------	--------------------------------------	-------------------------

17.1	Base Unit Specifications.....	17 - 1
17.1.1	Main base unit for high-speed access (A1S38HB/A1S38HBEU).....	17 - 2
17.2	Extension Cable Specification List	17 - 3
17.3	Application Standards of Extension Base Unit (A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B, A58B).....	17 - 4
17.4	Handling Precautions	17 - 6
17.5	Part Names	17 - 7

18	MEMORY CARDS AND BATTERIES	18 - 1 to 18 - 9
-----------	-----------------------------------	-------------------------

18.1	Memory Card Specifications	18 - 1
18.2	Handling Memory Cards.....	18 - 3
18.3	Battery Specifications (CPU Module and Memory Card Batteries)	18 - 4
18.4	Handling Precautions	18 - 5
18.5	Part Names of Memory Card.....	18 - 6
18.6	Installing Batteries (CPU Module and Memory Card Batteries)	18 - 7
18.7	Installing/Removing A Memory Card.....	18 - 8

19	LOADING AND INSTALLATION	19 - 1 to 19 - 23
-----------	---------------------------------	--------------------------

19.1	Fail-Safe Circuit Concept	19 - 1
19.2	Installation Environment.....	19 - 7
19.3	Calculation of Heat Generated by the programmable controller	19 - 8
19.4	Installing the Base Units.....	19 - 10
19.4.1	Installation precautions	19 - 10
19.4.2	Installation	19 - 11
19.5	Installation and Removal of Modules	19 - 12
19.6	Installation and Removal of the Dustproof Cover.....	19 - 15
19.7	Wiring	19 - 17
19.7.1	Wiring instructions.....	19 - 17
19.7.2	Wiring to module terminals.....	19 - 22
19.8	Precautions When Connecting Uninterruptible Power Supply Module (UPS).....	19 - 23

20	EMC AND LOW VOLTAGE DIRECTIVES	20 - 1 to 20 - 13
-----------	---------------------------------------	--------------------------

20.1	Requirements for Compliance with EMC Directives.....	20 - 1
20.1.1	EMC standards	20 - 1
20.1.2	Installation inside the control panel	20 - 2
20.1.3	Cables	20 - 3
20.1.4	Power supply module.....	20 - 8
20.1.5	Base unit	20 - 8
20.1.6	Ferrite core	20 - 8
20.1.7	Noise filter (power supply line filter)	20 - 9
20.1.8	Power line for external power supply terminal	20 - 9

20.2	Requirements for Compliance with Low Voltage Directives	20 - 10
20.2.1	Standard applied for MELSEC-QnA series programmable controller	20 - 10
20.2.2	Precautions when using the QnA series programmable controller	20 - 10
20.2.3	Power supply.....	20 - 11
20.2.4	Control panel.....	20 - 12
20.2.5	Module installation	20 - 13
20.2.6	Grounding	20 - 13
20.2.7	External wiring.....	20 - 13

21	MAINTENANCE AND INSPECTION	21 - 1 to 21 - 12
-----------	-----------------------------------	--------------------------

21.1	Daily Inspection	21 - 1
21.2	Periodic Inspection	21 - 2
21.3	Battery Replacement.....	21 - 3
21.3.1	Battery life	21 - 5
21.3.2	Battery replacement procedure.....	21 - 7
21.4	When Reoperating a programmable controller After Storing it with a Battery Unconnected.....	21 - 11
21.5	When a programmable controller is Reoperated After Stored with the Battery Over the Battery Life	21 - 12

22	TROUBLESHOOTING	22 - 1 to 22 - 79
-----------	------------------------	--------------------------

22.1	Fundamentals of Troubleshooting.....	22 - 1
22.2	Troubleshooting.....	22 - 2
22.2.1	Troubleshooting flowchart.....	22 - 2
22.2.2	Flow for actions when the "POWER" LED is turned OFF	22 - 3
22.2.3	Flow for actions when the "RUN" LED is turned OFF	22 - 4
22.2.4	When the "RUN" LED is flashing	22 - 5
22.2.5	Flow for actions when the "ERROR LED" is turned ON/flashing	22 - 6
22.2.6	When the "USER" LED is turned ON	22 - 7
22.2.7	Flow for actions when the "BAT.ARM" LED is turned ON.....	22 - 7
22.2.8	Flow for actions when the output module's output load does not turn ON	22 - 8
22.2.9	Flow for actions when the program cannot be written.....	22 - 9
22.2.10	Flow for actions when booting from a memory card is not possible.....	22 - 11
22.2.11	Flow chart used when the CPU module is not started up	22 - 13
22.3	Error Code List	22 - 15
22.3.1	Error Codes.....	22 - 16
22.3.2	Procedure to read an error code	22 - 16
22.3.3	Error code list (1000 to 1999).....	22 - 17
22.3.4	Error code list (2000 to 2999).....	22 - 29
22.3.5	Error code list (3000 to 3999).....	22 - 43
22.3.6	Error code list (4000 to 4999).....	22 - 51
22.3.7	Error code list (5000 to 5999).....	22 - 63
22.3.8	Error code list (6000 to 6999).....	22 - 65
22.3.9	Error code list (7000 to 10000).....	22 - 69
22.3.10	Canceling of Errors	22 - 71
22.4	Resetting Errors	22 - 72
22.5	Fault Examples with I/O Modules.....	22 - 73
22.5.1	Faults with the input circuit and the corrective actions.....	22 - 73

APPENDICES

App - 1 to App - 165

APPENDIX 1	INSTRUCTION LIST	App - 1
Appendix 1.1	Sequence Instructions	App - 1
Appendix 1.2	Basic Instructions	App - 5
Appendix 1.3	Application Instructions	App - 17
Appendix 1.4	Data Link Instructions	App - 38
Appendix 1.5	PID Control Instructions	App - 41
Appendix 1.6	Special Function Module Instructions	App - 42
APPENDIX 2	Special Relay List	App - 48
APPENDIX 3	Special Register List	App - 72
APPENDIX 4	PRECAUTIONS FOR UTILIZING THE EXISTING MELSEC-A SERIES PROGRAM FOR Q2ASCPU	App - 110
Appendix 4.1	Instructions.....	App - 110
Appendix 4.2	Device	App - 118
Appendix 4.3	Parameters	App - 120
Appendix 4.4	Timer and Interrupt Counter Operations	App - 121
Appendix 4.5	Sequence Programs, Statements, Notes.....	App - 122
Appendix 4.6	Microcomputer programs	App - 124
Appendix 4.7	Comments.....	App - 125
Appendix 4.8	Constant Scan Function, Error Check Function.....	App - 126
Appendix 4.9	I/O control mode	App - 127
Appendix 4.10	Data Link System.....	App - 128
Appendix 4.11	Index Register Processing	App - 129
Appendix 4.12	CHK Instruction, IX Instruction.....	App - 130
Appendix 4.13	Accessing File Register R with Instructions	App - 131
APPENDIX 5	ERROR CODES RETURNED TO THE REQUEST SOURCE IN GENERAL DATA PROCESSING	App - 132
Appendix 5.1	Error Codes.....	App - 132
Appendix 5.2	Error Contents of Error Codes Detected by the CPU Module (4000H to 4FFFH)	App - 133
APPENDIX 6	EXTERNAL DIMENSIONS	App - 141
Appendix 6.1	Q2AS(H)CPU(S1) module	App - 141
Appendix 6.2	A1S61PN, A1S62PN and A1S63P power supply modules	App - 142
Appendix 6.3	Main Base Unit.....	App - 143
Appendix 6.4	Extension Base Unit.....	App - 145
APPENDIX 7	USE OF LOCAL DEVICE FOR SUBROUTINE/INTERRUPT PROGRAM STORAGE FILE (FUNCTION VERSION B OR LATER)	App - 151
APPENDIX 8	NETWORK RELAY FROM ETHERNET MODULE (FUNCTION VERSION B OR LATER)	App - 155
APPENDIX 9	Q2AS(H)CPU(S1) PROCESSING TIME	App - 158
Appendix 9.1	Overview of the Q2AS(H)CPU(S1) Scan Time.....	App - 158
Appendix 9.2	Causes of Increasing Scan Time	App - 159
APPENDIX 10	TRANSPORTATION PRECAUTIONS	App - 162
Appendix 10.1	Relevant Models	App - 162
Appendix 10.2	Transportation Guidelines.....	App - 163

APPENDIX 11 Handling of Batteries and Devices with Built-in Batteries in EU Countries	App - 164
Appendix 11.1 Disposal precautions.....	App - 164
Appendix 11.2 Exportation precautions	App - 165

INDEX

Index - 1 to Index - 5

ABOUT THIS MANUAL

The following are manuals related to this product.

Request for the manuals as needed according to the chart below.

RELATED MANUALS

Manual Name	Manual No. (Type code)
QnACPU GUIDEBOOK For the first-time user of QnACPU, describes steps on creating a program, writing the program in the CPU module, and debugging. Describes usage of QnACPU features. (Sold separately)	IB-66606 (13JF10)
QnACPU PROGRAMMING MANUAL (Fundamentals) Describes programming methods, device names and program types that are necessary in program creation. (Sold separately)	IB-66614 (13JF46)
QCPU (Qmode)/QnACPU PROGRAMMING MANUAL (Common Instructions) Describes how to use sequence instructions, basic instructions and application instructions. (Sold separately)	SH-080039 (13JF58)
QnACPU PROGRAMMING MANUAL (Special Functions) Describes dedicated instructions used in special-function modules. (Sold separately)	IB-66616 (13JF48)
QnACPU PROGRAMMING MANUAL (AD57 Instructions) Describes dedicated instructions used to control the A D57(S1)-type CRT controller module. (Sold separately)	IB-66617 (13JF49)
QCPU (Q mode)/QnACPU PROGRAMMING MANUAL (PID Control Instructions) Describes dedicated instructions used for PID control in Q2ACPU(S1), Q3ACPU and Q4ACPU. (Sold separately)	SH-080040 (13JF59)
QCPU (Q mode)/QnACPU PROGRAMMING MANUAL (SFC) Describes system components, performance specifications, functions, programming debug going and error codes of MELSAP (Sold separately)	SH-080041 (13JF60)
AnS Module Type I/O User's Manual Describes specification of AnS module as I/O module. (Sold separately)	IB-66541 (13JE81)
Type QnA/Q4AR MELSECNET/10 Network System Reference Manual Describes MELSECNET/10 overview, specifications, part names and settings. (Sold separately)	IB-66620 (13JF77)
Type MELSECNET, MELSECNET/B Data Link System Reference Manual Describes MELSECNET(II) and MELSECNET/B overview, specifications, part names and settings. (Sold separately)	IB-66350 (13JF70)
GX Developer Version 8 Operating Manual Describes the online functions of GX Developer including the programming procedure, printing out procedure, and debugging procedure. (Included with product)	SH-080373 (13JU41)
Type SW2IVD-GPPQ GPP Software package OPERATING MANUAL (Offline) Describes SW2IVD-GPPQ's offline functions such as program creation, printout method and file maintenance. (Included with product)	IB-66774 (13J921)

Manual Name	Manual No. (Type code)
Type SW2IVD-GPPQ GPP Software package OPERATING MANUAL (Online) Describes SW2IVD-GPPQ's online functions such as monitoring and debugging methods. (Included with product)	IB-66775 (13J922)
Type SW2IVD-GPPQ GPP Software package OPERATING MANUAL (SFC) Describes MWLSAP-3 system components, performance specifications, functions, system start-up procedure, SFC program editing method, monitoring method, printout method and error messages. (Included with product)	IB-66776 (13J923)
Type SW2IVD-GPPQ GPP Software package OPERATING MANUAL (Q6TEL) Describes Q6TEL system configuration, operating methods, etc. (Included with product)	IB-66777 (13J924)

USER PRECAUTIONS

PRECAUTIONS WHEN USING THE QNA SERIES

When using a CPU module, format the memory using a peripheral device.

For details of memory format, refer to the following manuals.

- GX Developer Operating Manual
- SW□IVD-GPPQ Software package Operating Manual (Online)

PRECAUTIONS FOR BATTERY

- (1) The operation after removal of a battery
After removing a battery of the CPU module, format the memory using a peripheral device to start next operation. (Refer to Section 21.4)
- (2) The operation after excess of a battery life
After removing a battery of the CPU module due to its excess life, format the memory using a peripheral device to start next operation. (Refer to Section 21.5)

[illegible]

1 ABOUT THIS MANUAL

1.1 About this Manual

This manual serves to explain the specifications and functions of the Q2ASCPU, Q2ASCPU-S1, Q2ASHCPU and Q2ASHCPU-S1 (abbreviated as Q2ASCPU hereafter), the specifications of other modules, and the maintenance required for smooth system operation, to users of MELSEC-QnA series programmable controllers.

It is divided into the following three main parts:

- (1) Sections 2 and 3 These sections give the general description and system configuration for the Q2ASCPU.
Read them to learn the features of Q2ASCPU, and the modules that can be used and points to note when configuring a system.
- (2) Sections 4 to 15 These sections give the specifications and functions of Q2ASCPU.
They describe each Q2ASCPU function to enable you to use the Q2ASCPU effectively.
- (3) Sections 16 to 18 These sections describe the specifications and handling of units/modules other than the CPU module (power supply module, base units, etc.)
Read them to learn how to handle the power supply module, base units, memory cards, etc.
- (4) Section 19 to 20 These section describes the loading and installation, EMC, and low voltage directives.
- (5) Section 21 to 22 These sections describe all aspects of maintenance, from installing the Q2ASCPU to daily inspections and troubleshooting.
Read them to learn how to install the Q2ASCPU so as to ensure smooth operation, and how to carry out daily inspections and corrective action in the event of trouble.

REMARK

This manual does not cover MELSECNET(II) data link systems, MELSECNET/B data link systems, MELSECNET/10 networks, or the SFC function.

For details on each function, refer to the following manuals.

- MELSECNET(II), MELSECNET/B Data Link
MELSECNET, MELSECNET/B Data Link System Reference Manual
- MELSECNET/10 Network
MELSECNET/10 Network System Manual for QnA/Q4AR
- SFC Function
QCPU (Q Mode)/QnACPU Programming Manual (SFC)

1.2 Abbreviations and Generic Terms Used in this Manual

The following abbreviations and generic terms are used in this manual.

- | | |
|--|---|
| (1) Q2ASCPU..... | Abbreviation for Q2ASCPU, Q2ASCPU-S1, Q2ASHCPU, and Q2ASHCPU-S1 type CPU modules. |
| (2) Network module..... | Abbreviation of A1SJ71QLP21, and A1SJ71QBR11 type MELSECNET/10 network modules. |
| (3) Ethernet module..... | Abbreviation of A1SJ71QE71N-B2 and A1SJ71QE71N-B5T type Ethernet interface modules. |
| (4) Serial communication module.... | Abbreviation of A1SJ71QC24(N), A1SJ71QC24(N)-R2 type serial communication module. |
| (5) CC-Link..... | Abbreviation of Control & Communication Link |
| (6) GPP function..... | Abbreviations for the SW□IVD-GPPQ type GPP function software package, GX Developer. |
| (7) Personal computer..... | IBM's PC/AT or completely compatible computers. |
| (8) Peripheral device capable of GPP functions | Generic term for a peripheral device capable of running the GPP function software, for example an IBM PC/AT. |
| (9) Q6PU..... | Abbreviation for Q6PU programming unit. |
| (10) Peripheral device..... | Generic term for a device that is connected to a QnACPU and can be used to operate it, for example a personal computer or Q6PU. |
| (11) Built-in RAM..... | A RAM incorporated in the Q2AS CPU that stores sequence programs and other data. |
| (12) Memory card..... | Abbreviation for Q1MEM-□□□ type memory card |
| (13) ACPU..... | Generic term for a MELSEC-A series programmable controller |

2 OVERVIEW

2.1 Features

Q2ASCPU has the following features.

- (1) Large memory capacity
 - (a) Q2AS(H)CPU-S1 has a program capacity of 60k steps, which means that 60k steps can be used for a single program (Q2AS(H)CPU: 28k steps).
 - (b) The device memory capacity is 29k words and the user can change the number of points as required.
For example, the default number of points for internal relays (M) is 8k points, but this can be expanded up to 32k points.
 - (c) One memory card of a maximum of 2M bytes can be installed.
Memory cards are used to store programs, comments, statements, and file registers.
(Programs can be stored in the CPU module itself, so a memory card is not essential to run a CPU module.)

- (2) High-speed processing

- (a) Higher operation processing speeds have been achieved for basic instructions and application instructions.

	A2USCPU(S1)	Q2ASHCPU(S1)
Basic instructions	0.2 μ s	→ 0.075 μ s
Application instructions	1.2 μ s	→ 0.225 μ s

- (b) The access time for expansion data memory (file registers: R) has been conformed with the internal devices of the Q2ASCPU (data registers: D, and link registers: W).
- (c) Reading/writing of the buffer memories of special function modules dedicated to QnA (serial communication modules) have been realised processing speed-up by six times compared to AnUCPU.
(The processing speed of the existing special function modules for ACPU use is about the same as that when using AnUCPU.)
- (d) A high-speed access base unit (A1S38HB/A1S38HBEU) is available to speed up the processing time for accessing special function modules such as network modules and serial communication modules that handle large quantities of data. Simply by mounting the special function module on the high-speed access base unit, the access processing speed is increased when the Q2ASCPU accesses the special function module.

- (3) Selection of program execution type that is appropriate for the control has been realised.

There are four program execution types to be selected as follows.

- (a) Initial execution type

This program type is executed once only when the Q2ASCPU is set to RUN.

- (b) Scan execution type

This program type is run continually while the Q2ASCPU is in the RUN status.

This is equivalent to a conventional program that runs from step 0 to END instruction. It is possible to create subroutine programs and interrupt programs for this type of program.

- (c) Low-speed execution type

This is a program type which is executed only during the surplus constant scan time (process to preset the program execution time for constant scan time) or during the set execution time of the low-speed execution program.

- (d) Stand-by type

This type of program consists entirely of a subroutine program or interrupt program.

- (4) The SFC language MELSAP3 has been supplied.


With enhancement of step attributes and SFC control instructions, MELSAP3 makes SFC programming even easier.

- (5) A software development environment that improves program productivity has been realized.


- (a) In order to enable the design of structured programs, a file format has been adopted for programs.

What would conventionally have been a single continuous program can now be handled in a structured way as a number of files.

This allows for design work to be shared by several designers, and allows management of programs in accordance with functions, processes, or designers, etc.

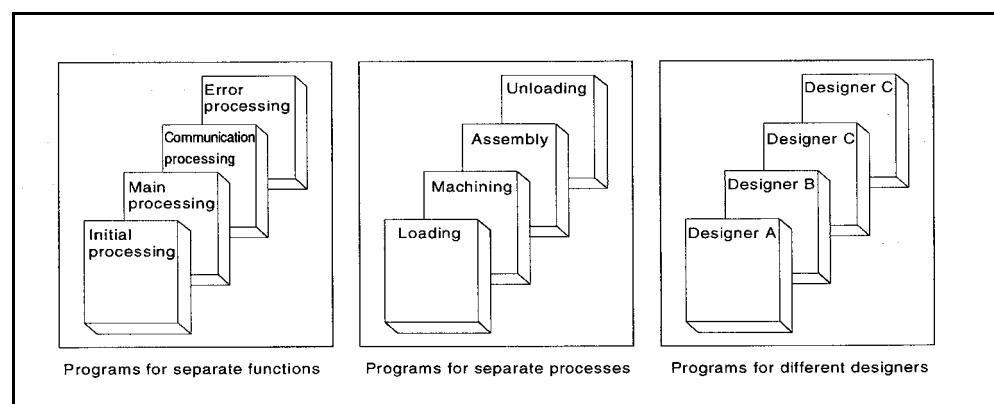

- (b) The user can standardize and simplify programs by creating and using macro instructions corresponding to functions.

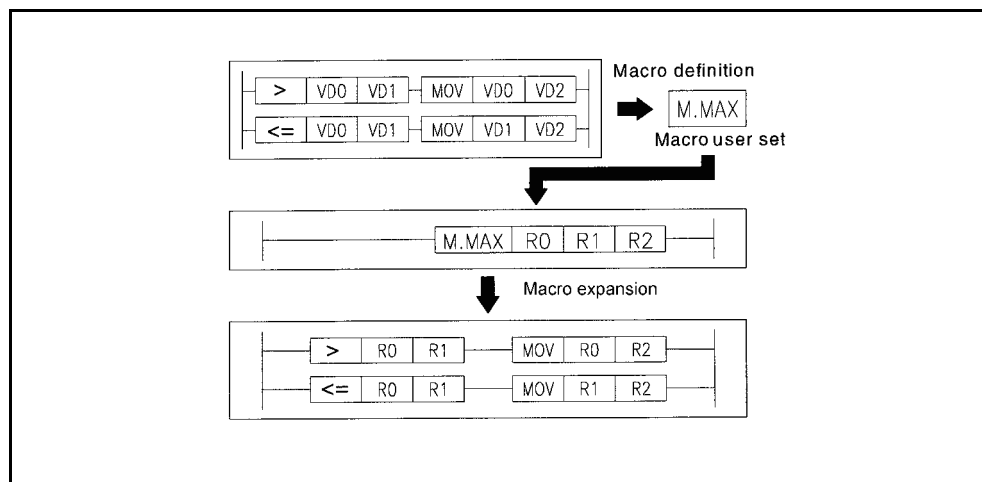

- (c) Devices can be used without restrictions.
- 1) Word device bit operations are possible.
 - 2) Differential contacts can be used.
 - 3) Buffer memories of special function modules can be accessed directly from a program as devices.
 - 4) The link data of network modules can be accessed directly from a program as devices.
- (d) Ease of operation for GPP function program editing has been improved.
- 1) Up to four programs, data, etc., can be edited simultaneously.
Programs and data can be cut and pasted between edited objects.
 - 2) Ladder editing is possible while the ladder is displayed with comments.
 - 3) Familiar operations can be performed with pull-down menus and dialog boxes.
- (e) The debugging function at start-up has been perfected.
- 1) Ladder modification while performing monitoring is possible.
 - 2) Coil ON/OFF causes can be searched for.
 - 3) The timing for monitoring can be set using a step number or device status, allowing debugging to be conducted under the optimum conditions.
 - 4) Devices for which index qualifications have been set can be monitored.
- (f) The GPP function document creation function has been strengthened.
- 1) Since comments can now comprise 32 characters, they can be more detailed than before.
 - 2) Comments can now be set for all devices.
 - 3) The statements and notes appended to programs can now be managed as an integral part of the program, which makes program modifications and utilization easier.
 - 4) Printout data can be stored in a file.

- (g) A powerful array of support software packages is available for program creation.
 - 1) Data conversion package
Comment data, device data, etc., which is created with spreadsheet software and text editors available on the market, can be converted to files for GPP function use.
Conversely, files created for GPP function use can be converted to data for spreadsheets or text editors.
 - 2) Macro/library package
The basic programs for accessing special function modules, and standard programs for error detection, alarm processing, etc., have been brought together as a package of macro and library data.
 - 3) Ladder sequence linking package
This package is used to link multiple programs to make a single program.
This has an automatic allocation function that ensures that devices from each program without duplicating in the created program.
 - 4) CAD interface program
This package is used to handle sequence ladders, instruction lists, comment data and SFC diagrams as CAD data and communicate these data to CAD systems.

2.2 Additional Functions of Q2ASCPU

New functions and instructions for special function module are added to the Q2ASCPU.

[Additional functions]

- Variety of local devices..... Refer to Section 2.2.1 (1)
 - Monitor test of local device..... Refer to Section 8.2.2
 - Use of local device at the subroutine/interrupt
program storage destination..... Refer to Appendix 7
- Auto refresh setting of CC-Link..... Refer to Section 2.2.1 (2),
Section 7.2.
- MELSECNET/10 relay communication from the
Ethernet module (Network relay)..... Refer to Section 2.2.1 (3),
Appendix 8.
- Addition of AJ71QC24N-compatible commands
..... Section 2.2.1 (4)

[Added instructions for special function module]

The following instructions have been added for function version "B" of the Q2ASCPU:

- A1SJ61QBT11 control instructions 13
- A1SD75 control instructions 19
- A1SJ71ID□-R4 control instructions 12
- A1SJ71QE71 control instructions 10

Additional function/special function module instructions can be used for the Q2ASCPU described function version B in the date column of the rating plate.

Check that function version B is described on the Q2ASCPU rating plate before using the additional function/special function module instructions.

If your Q2ASCPU does not have indication of function version B, skip this item and the description of additional functions.



Date of manufacture

Function version

When using additional function/special function module instructions of the Q2ASCPU, it is necessary to match the GPP function model and the function version/version of the applicable special function module. (Refer to Table 2.1.)

Table 2.1 List of combination between Q2ASCPU and function version/version of special function module

Module/package Name		QnACPU	SW0IVD- GPPQ SW1IVD- GPPQ	SW2IVD- GPPQ	A1SJ71QE7 1(B2), (B5)	A1SD75P- S3	A1SJ71 ID□-R4	A1SJ61QBT 11	A1SJ71QC2 4(N)(R2)
Condition	Function version	9707B and later	–	ÑüÑü	9707B and later	–	–	9707B and later	–
	Version	–	No restriction	No restriction	–	No restriction	BC and later	–	No restriction
Local device monitor test		○	×	○	–	–	–	–	–
Local device switching of subroutine/interrupt program		○	–		–	–	–	–	–
Auto refresh function of CC-Link		○	×	○	–	–	–	○	–
A1SJ61QBT11 control instructions		○	○		–	–	–	○	–
MELSECNET/10 relay communication from Ethernet		○	×	△	○	–	–	–	–
A1SJ71QE71 control instruction		○	○		○	–	–	–	–
A1SD75 control instructions		○	○	○	–	○	–	–	–
ID interface module instructions		○	○		–	–	○	–	–
Compatibility with A1SJ71QC24N commands		○	–		–	–	–	–	○

REMARK

- 1) Marks ○, –, △ and × in Table 2.1 indicate as follows:
 ○: Essential for use of function and instruction
 –: Irrelevant to function and instruction
 △: Required in the case of access to the QnACPU in other stations from the peripheral device via Ethernet
 ×: Not available on peripheral devices.
- 2) GX Developer supports functions of function version B.

2.2.1 Overview of added functions

This section shows an overview of the added functions.

- (1) Variety of local device
 - (a) The device set as the local device at "Device" in Parameter can be monitored and tested with a peripheral device.

This function allows checking and debug of the local device in the program monitored with a peripheral device.
 - (b) The local device of the file where the subroutine program/interrupt program is stored has made it possible to be used during execution of the subroutine program/interrupt program.

For this function, even if an operation using the local device of the subroutine program is carried out, the original local device cannot be overwritten. In addition, even if an operation using the local device of the interrupt program, the local device which is executed before starting up the interrupt program cannot be overwritten.
 - (c) The following GPP function software packages are required to perform the monitor test of the local device:
 - Personal computer
 - GX Developer, SW□IVD-GPPQ type GPP function software package
- (2) Auto Refresh Setting of CC-Link
 - (a) When setting auto refresh of the CC-Link on the peripheral function, cyclic communication with other stations connected to the CC-Link can be automatically performed according to the set auto refresh data.
 - Remote I/O station (Communication in ON/OFF data)
 - Remote device station (Communication in ON/OFF data and Word data)
 - Intelligent device station (Communication in ON/OFF data and Word data)
 - Local station/master station (Communication in ON/OFF data and Word data)

The auto refresh setting of the CC-Link allows communication with other stations using the FROM/TO instruction without communicating with the master station of the CC-Link.
 - (b) Auto refresh is available for up to 8 CC-Link modules for each unit of Q2ASCPU. Communication for 9th CC-Link modules and more can be performed with the CC-Link module using the FROM/TO instruction.
 - (c) The following GPP function software packages are required to perform the auto refresh setting of the CC-Link:
 - Personal computer
 - GX Developer, SW□IVD-GPPQ type GPP function software package

It is necessary to upgrade the master station•local station module of CC-Link to function version B or later.

- (3) Network relay from Ethernet module
 - (a) In the network system with mixture of Ethernet and MELSECNET/10, data can be communicated with the Q2ASCPU of other stations via multiple Ethernets or MELSECNET/10 modules.
 - (b) For the network relay from the Ethernet module, the function version of the Ethernet module should be upgraded to "B" or later.
- (4) A1SJ71QC24N-compatible commands are possible.
 - (a) The following A1SJ71QC24N commands are available:
 - Multiple blocks batch read: Command "0406"
 - Multiple blocks batch write: Command "1406"
 - (b) Multiple blocks batch read/batch write is available with A1SJ71QC24N(-R2, R4). Multiple blocks batch read/batch write is not available with A1SJ71QC24(-R2, R4).

For commands of multiple blocks batch read/batch write, refer to the following manual:

 - Corresponding Additional Explanation for A1SJ71QC24N [-R2/R4]


3 SYSTEM CONFIGURATION

This section describes the system configurations that can be used for a system centered on a Q2ASCPU, cautions on configuring the system, and the system equipment.

3.1 System Configuration

The following shows the configuration of equipment and peripheral device when a Q2ASCPU is used in a stand-alone system.


3.1.1 Equipment configuration in a stand-alone system

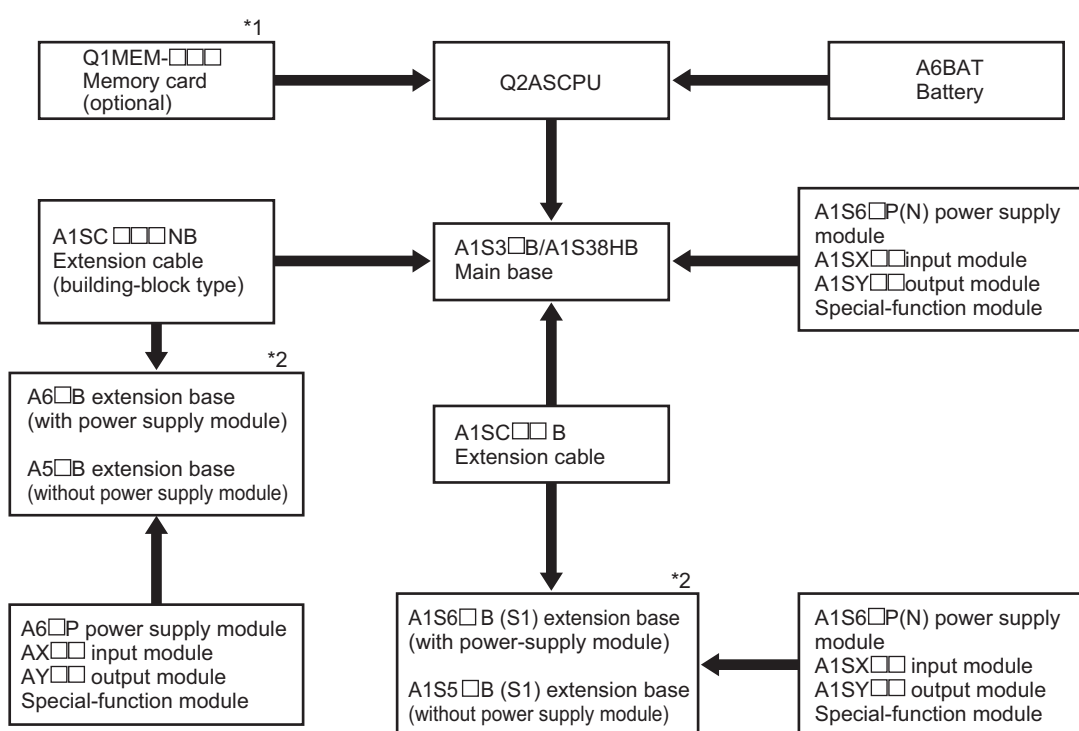

POINT

- *1 Up to one memory card can be installed, if required.
SRAM and E²PROM memory cards allow file read/write when mounted on the CPU module.
- *2 When using an A1S5□B(S1), A5□B extension base unit, pay particular attention to the power supply capacity of the main base unit. In the case of I/O modules and the special function module with a high internal current consumption, mounting on an A1S6□B(S1), A6□ extension base unit is recommended.
(Refer to Section 16.1 and Section 17.3 for details.)

3.1.2 Configuration of peripheral devices capable of Q2ASCPU

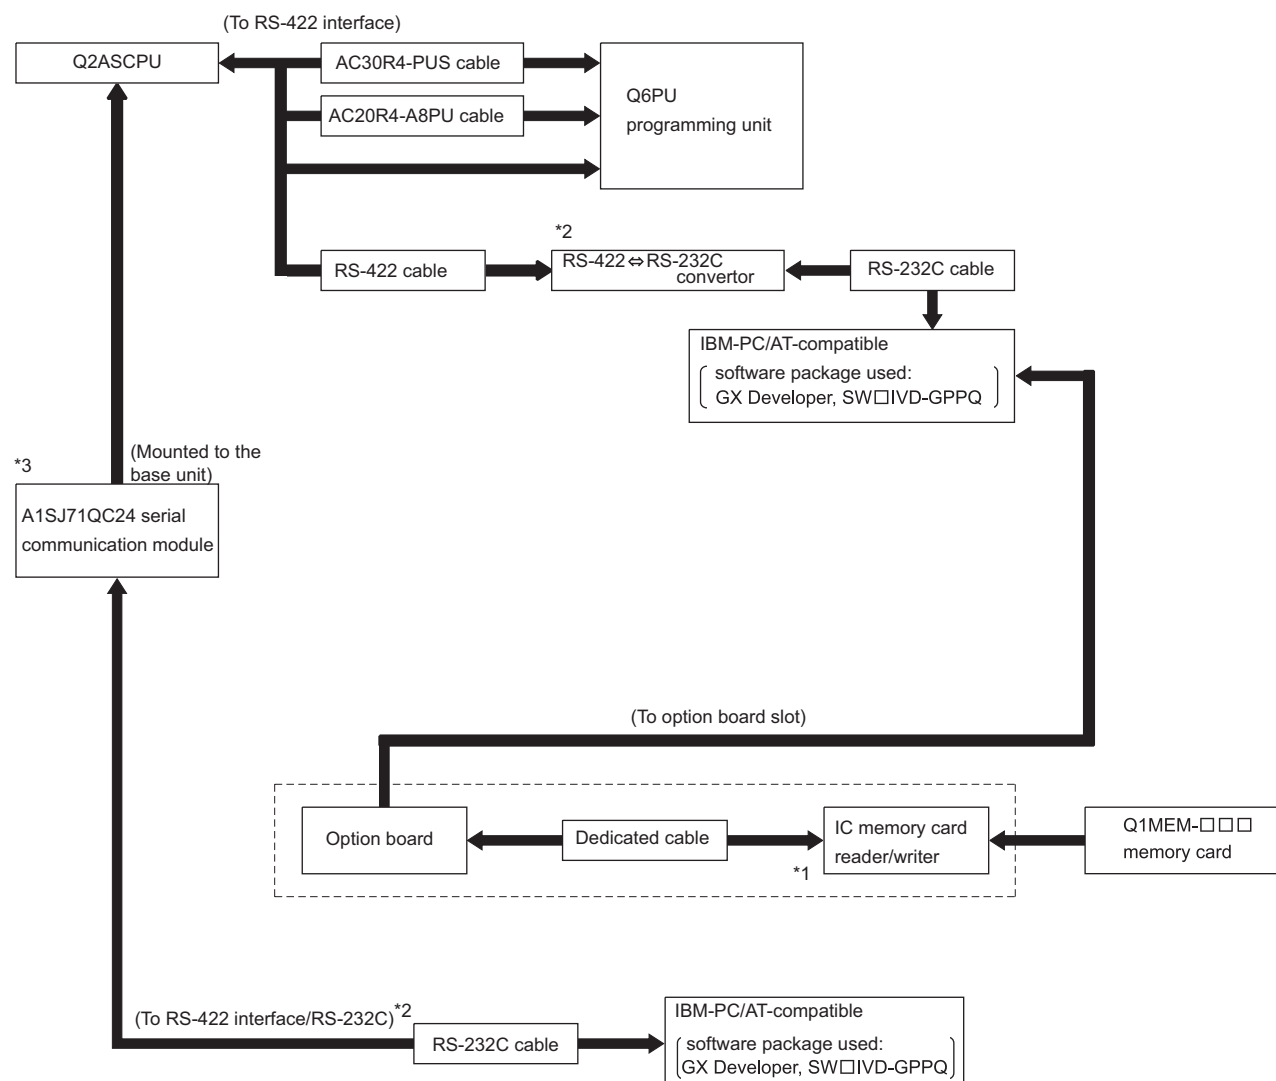

*1 For details on the IC memory card reader/writer setting, refer to Operating Manual for the peripheral device capable of GPP functions.

*2 For connection to RS-422 interface, use the RS-422 ⇔ /RS-232C converter.

*3 When connecting the serial communication module and the peripheral devices capable of GPP function, see User's Manual of the serial communication modules.

REMARK



1. For details on the system configuration for each peripheral device, refer to the Operating Manual for each.
2. Q2ASCPU can connect a peripheral device capable of ACPU only when accessing an ACPU in another station via a MELSECNET/10 or MELSECNET data link. (However, Q2ASCPU cannot be accessed.) In this case, set SW1 of system setting switch 2 on the CPU module ON.

3.2 System Configuration Overview

(a) Q2ASCPU, Q2ASHCPU system

System configuration	<p>[When the A1S6□B(S1), A1S5□B(S1) extension base is used]</p> <p>The following shows an example that the 16-point module is installed to each slot.</p>	<p>[When the A6□B, A5□B extension base is used]</p> <p>The following shows an example that the 64-point module is installed to each slot.</p>
Maximum number of extension stages	3rd extension stage	1st extension stage
Maximum number of I/O modules	16 modules	
Maximum number of I/O points	512 points	
Main base unit model name	A1S32B, A1S33B, A1S35B, A1S38B, A1S38HB, A1S38HBEU	
Extension base unit model name	A1S65B(S1), A1S68B(S1), A1S52B(S1), A1S55B(S1), A1S58B(S1)	A62B, A65B, A68B, A52B, A55B, A58B
Extension cable model name	A1SC03B, A1SC07B, A1SC12B, A1SC30B, A1SC01B (right-side installation), A1SC60B	A1SC05NBA1SC07NBA1SC30NBA1SC50NB
Precautions	<p>(1) Only one A6□B, A5□B extension base can be used. (The second extension module cannot be used.)</p> <p>(2) When the extension base A1S52B(S1), A1S55B(S1), A58B(S1) or A52B, A55B, A58B are used, the 5VDC power is supplied from the power supply module of the main base unit. Before use, refer to Section 17.3 and examine if it can be used.</p> <p>(3) Limit the length of extension cable to 6m (236inch) or shorter.</p> <p>(4) When using the extension cable, do not install it with the main circuit cables, which has high voltage, large current, or install them close together.</p>	
I/O number assignment (When I/O assignment is not performed)	<p>(1) Assign I/O numbers to the main base unit first, then to the extension base unit.</p> <p>(2) Assign I/O numbers as if both main base unit and extension base unit have 8 slots each. When the A1S32B/A1S33B/A1S35B for 2/3/5 slots are used as the main base unit, add 6/5/3 slots (96 points/80 points/48 points) and assign the extension base unit I/O numbers.</p> <p>(3) 16 points are assigned to an empty slot.</p> <p>(4) When A6□B or A5□B is used, be sure to set to a single extension level. If it is set to the number of skipped stages, 16 points/slot are assigned to all of skipped stages×8 slots, and thus it does not work.</p> <p>(5) Items (2) to (3) can be changed by the I/O assignment. (Refer to Section 5.3)</p>	

(b) Q2ASCPU-S1, Q2ASHCPU-S1 system

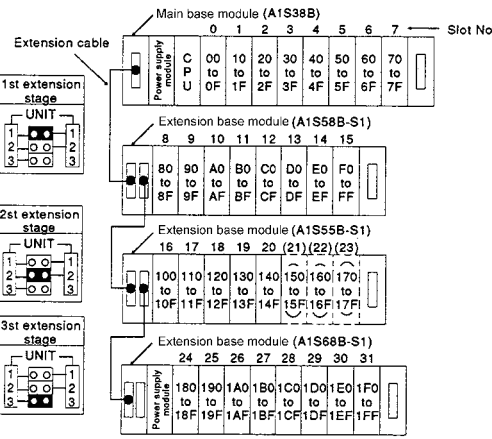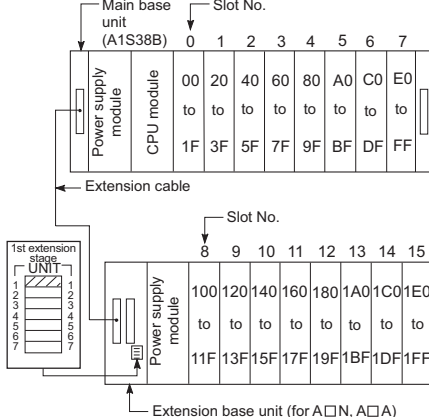System configuration	<p>[When the A1S6□B(S1), A1S5□B(S1) extension base is used]</p> <p>The following shows an example that the 16-point module is installed to each slot.</p> 	<p>[When the A6□B, A5□B extension base is used]</p> <p>The following shows an example that the 32-point module is installed to each slot.</p> 
Maximum number of extension stages	3rd extension stage	1st extension stage
Maximum number of I/O modules	16 modules	
Maximum number of I/O points	1024 points	
Main base unit model name	A1S32B, A1S33B, A1S35B, A1S38B, A1S38HB, A1S38HBEU	
Extension base unit model name	A1S65B(S1), A1S68B(S1), A1S52B(S1), A1S55B(S1), A1S58B(S1)	A62B, A65B, A68B, A52B, A55B, A58B
Extension cable model name	A1SC03B, A1SC07B, A1SC12B, A1SC30B, A1SC01B (right-side installation), A1SC60B	A1SC05NBA1SC07NBA1SC30NBA1SC50NB
Precautions	<p>(1) Only one A6□B, A5□B extension base can be used. (The second extension module cannot be used.)</p> <p>(2) When the extension base A1S52B(S1), A1S55B(S1), A58B(S1) or A52B, A55B, A58B are used, the 5VDC power is supplied from the power supply module of the main base unit. Before use, refer to Section 17.3 and examine if it can be used.</p> <p>(3) Limit the length of extension cable to 6m (236inch) or shorter.</p> <p>(4) When using the extension cable, do not install it with the main circuit cables, which has high voltage, large current, or install them close together.</p>	
I/O number assignment (When I/O assignment is not performed)	<p>(1) Assign I/O numbers to the main base unit first, then to the extension base unit.</p> <p>(2) Assign I/O numbers as if both main base unit and extension base unit have 8 slots each. When the A1S32B/A1S33B/A1S35B for 2/3/5 slots are used as the main base unit, add 6/5/3 slots (96 points/80 points/48 points) and assign the extension base unit I/O numbers.</p> <p>(3) 16 points are assigned to an empty slot.</p> <p>(4) When A6□B or A5□B is used, be sure to set to a single extension level. If it is set to the number of skipped stages, 16 points/slot are assigned to all of skipped stages×8 slots, and thus it does not work.</p> <p>(5) Items (2) to (3) can be changed by the I/O assignment. (Refer to Section 5.3)</p>	

3. SYSTEM CONFIGURATION

3.3 System Equipment

3.3.1 System equipment list

The following shows the system equipment (modules and peripheral devices) that can be used in a Q2ASCPU system.

(1) For QnA module

Product Name	Model Name	Description		Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
					5VDC (A)	24VDC (A)	
CPU module	Q2ASCPU	Number of I/O points: 512, built-in RAM: 28k steps		—	0.3	—	Memory card procured separately. Including memory card current consumption.
	Q2ASHCPU	Number of I/O points: 512, built-in RAM: 28k steps			0.7	—	
	Q2ASCPU-S1	Number of I/O points: 1024, built-in RAM: 60k steps			0.3	—	
	Q2ASHCPU-S1	Number of I/O points: 1024, built-in RAM: 60k steps			0.7	—	
Memory card	Q1MEM-64S	SRAM, 64k bytes		—	—	—	
	Q1MEM-128S	SRAM, 128k bytes					
	Q1MEM-256S	SRAM, 256k bytes					
	Q1MEM-512S	SRAM, 512k bytes					
	Q1MEM-1MS	SRAM, 1M bytes					
	Q1MEM-2MS	SRAM, 2M bytes					
	Q1MEM-64SE	SRAM, 32k bytes, E ² PROM, 32k bytes					
	Q1MEM-128SE	SRAM, 64k bytes, E ² PROM, 64k bytes					
	Q1MEM-256SE	SRAM, 128k bytes, E ² PROM, 128k bytes					
	Q1MEM-512SE	SRAM, 256k bytes, E ² PROM, 256k bytes					
	Q1MEM-1MSE	SRAM, 512k bytes, E ² PROM, 512k bytes					
Power supply module	A1S61PN	5VDC, 5A	100/200VAC input	—	—	—	For power supply slots of main base and extension base
	A1S62PN	5VDC, 3A/24VDC, 0.6A					
	A1S63P	5VDC, 5A	24VDC input				

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
Input module	A1SX10	16-point 100 to 120 VAC input module	16 (16 inputs)	0.05	–	
	A1SX10EU	16-point 100 to 120 VAC input module	16 (16 inputs)	0.05	–	
	A1SX20	16-point 200 to 240 VAC input module	16 (16 inputs)	0.05	–	
	A1SX20EU	16-point 200 to 240 VAC input module	16 (16 inputs)	0.05	–	
	A1SX30	16 points 12/24VDC, 12/24VAC input module	16 (16 inputs)	0.05	–	
	A1SX40	16 points 12/24VDC input module	16 (16 inputs)	0.05	–	
	A1SX40-S1	16 points 24VDC input module	16 (16 inputs)	0.05	–	
	A1SX40-S2	16 points 24VDC input module	16 (16 inputs)	0.05	–	
	A1SX41	32 points 12/24VDC input module	32 (32 inputs)	0.08	–	
	A1SX41-S1	32 points 24VDC input module	32 (32 inputs)	0.12	–	
	A1SX41-S2	32 points 24VDC input module	32 (32 inputs)	0.08	–	
	A1SX42	64-input 12/24VDC input module	64 (64 inputs)	0.09	–	
	A1SX42-S1	64 points 24VDC input module	64 (64 inputs)	0.16	–	
	A1SX42-S2	64 points 24VDC input module	64 (64 inputs)	0.09	–	
	A1SX71	32 points 5/12/24VDC input module	32 (32 inputs)	0.075	–	
	A1SX80	16 points 12/24VDC Sink/source input module	16 (16 inputs)	0.05	–	
	A1SX80-S1	16 points 24VDC Sink/source input module	16 (16 inputs)	0.05	–	
	A1SX80-S2	16 points 24VDC Sink/source input module	16 (16 inputs)	0.05	–	
	A1SX81	32 points 12/24VDC Sink/source input module	16 (16 inputs)	0.08	–	
	A1SX81-S2	32 points 24VDC Sink/source input module	32 (32 inputs)	0.08	–	
	A1SX82-S1	64 points 24VDC Sink/source input module	32 (32 inputs)	0.16	–	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
Output module	A1SY10	16-output relay contact output module (2A)	16 (16 outputs)	0.12	0.09	
	A1SY10EU	16-output relay contact output module (2A)	16 (16 outputs)	0.12	0.10	
	A1SY14EU	12-output relay contact output module (2A)	16 (16 outputs)	0.12	0.10	
	A1SY18A	8 points Relay contact output module (2A) for independent contact	16 (16 outputs)	0.24	0.075	
	A1SY18AEU	8 points Relay contact output module (2A) for independent contact	16 (16 outputs)	0.24	0.075	
	A1SY22	16 points triac output module (0.6A)	16 (16 outputs)	0.27	(200VAC) 0.002	
	A1SY28A	8 points triac output module (1A) all points independent	16 (16 outputs)	0.13	–	
	A1SY40	16-output 12/24VDC transistor output module (0.1A) sink type	16 (16 outputs)	0.27	0.008	
	A1SY40P	16-output 12/24VDC transistor output module (0.1A) sink type	16 (16 outputs)	0.08	0.011	
	A1SY41	32-output 12/24VDC transistor output module (0.1A) sink type	32 (32 outputs)	0.50	0.008	
	A1SY41P	32-output 12/24VDC transistor output module (0.1A) sink type	32 (32 outputs)	0.14	0.012	
	A1SY42	64-output 12/24VDC transistor output module (0.1A) sink type	64 (64 outputs)	0.93	0.008	
	A1SY50	16-output 12/24VDC transistor output module (0.5A) sink type	16 (16 outputs)	0.12	0.06	
	A1SY60	16 points 24VDC transistor output module (2A) sink type	16 (16 outputs)	0.12	0.015	
	A1SY60E	16 points 5/12/24VDC transistor output module (2A) source type	16 (16 outputs)	0.20	0.01	
	A1SY68A	8 points 5/12/24/48VDC transistor output module sink/source type all points independent	16 (16 outputs)	0.11	–	
	A1SY71	32 points 5/12VDC transistor output module (0.016A) sink type	32 (32 outputs)	0.40	0.15	
	A1SY80	16-output 12/24VDC transistor output module (0.8A) source type	16 (16 outputs)	0.12	0.02	
	A1SY81	32-output 12/24VDC transistor output module (0.1A) source type	32 (32 outputs)	0.50	0.008	
	A1SY82	64-output 12/24VDC transistor output module (0.1A) source type	64 (64 outputs)	0.93	0.008	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
I/O module	A1SH42	32 points 12/24VDC input module 32-output 12/24VDC transistor output module (0.1A) sink type	32 (32 outputs)	0.50	0.008	
	A1SH42-S1	32 points 24VDC input module 32-output 12/24VDC transistor output module (0.1A) sink type	32 (32 outputs)	0.50	0.008	
	A1SX48Y18	8 points 24VDC input module 8 points Relay contact output module (2A)	16 (16 outputs)	0.085	0.045	
	A1SX48Y58	8 points 24VDC input module 8-output 12/24VDC transistor output module (0.5A)	16 (16 outputs)	0.06	0.06	
Dynamic input module	A1S42X	16/32/48/64 points 12/24VDC dynamic input module	Specified points [Input <small>(Set number of points)</small>]	0.08	—	
Dynamic output module	A1S42Y	16/32/48/64 points 12/24VDC dynamic output module	Specified points [Output <small>(Set number of points)</small>]	0.18	0.055	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
Blank cover	A1SG60	Dust-proof cover for unused slot	16 [Empty]	—	—	
Dummy module	A1SG62	16 point, 32 point, 48 point, 64 point selectable module	Specified points [Input <small>[Set number of points]</small>]	—	—	
Pulse catch module	A1SP60	Pulse input module with short pulse duration (minimum pulse duration:0.5 ms) Input 16 points	16 (16 outputs)	0.055	—	
Analog timer module	A1ST60	Allows for different set timer value (0.1 to 1.0 s, 1 to 10 s, 10 to 60 s, 60 to 600 s) depending on volume Analog timer 8 points	16 (16 outputs)	0.055	—	
Interrupt module	A1SI61	For interrupt program execution Interrupt module (Interrupt input:16 points)	32 [Special 32 points]	0.057	—	
High-speed counter module	A1SD61	32 bit signed binary 50 KPPS, 1 channel	32 [Special 32 points]	0.35	—	
	A1SD62	24 bit signed binary, 2 channels 100 KPPS, Transistor output (sink type)	32 [Special 32 points]	0.1	—	
	A1SD62D	24 bit signed binary, 2 channels 200 KPPS, Transistor output (sink type)	32 [Special 32 points]	0.25	—	
	A1SD62D-S1	24 bit signed binary, 2 channels 200 KPPS, Transistor output (sink type)	32 [Special 32 points]	0.27	—	
	A1SD62E	24 bit signed binary, 2 channels 100 KPPS, Transistor output (source type)	32 [Special 32 points]	0.1	—	
A/D converter module	A1S64AD	4 to 20mA/0 to 10V 4 analog channels	32 [Special 32 points]	0.4	—	
	A1S68AD	4 to 20mA/0 to 10V 8 analog channels	32 [Special 32 points]	0.4	—	
D/A converter module	A1S62DA	4 to 20mA/0 to 10V Analog output, 2 channels	32 [Special 32 points]	0.8	—	
	A1S68DAV	-10 to 10V input Analog output, 8 channels	32 [Special 32 points]	0.65	—	
	A1S68DAI	4 to 20mA input Analog output, 8 channels	32 [Special 32 points]	0.85	—	
Analog I/O module	A1S63ADA	Analog input, Two channels Controllable simplified loop, Analog output. 1 channel	32 [Special 32 points]	0.8	—	
	A1S66ADA	Analog input, Four channels Controllable simplified loop, Analog output, 2 channels	64 (64 outputs)	0.21	0.16	
Temperature digital converter module	A1S62RD3	For connecting Pt 100 (3-wire type) Temperature input 2 channels	32 [Special 32 points]	0.49	—	
	A1S62RD4	For connecting Pt 100 (4-wire type) Temperature input 2 channels	32 [Special 32 points]	0.39	—	
	A1S68TD	Temperature input 8 channels	32 [Special 32 points]	0.32	—	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
Temperature adjustment module	A1S62TCTT-S2	Transistor output, temperature input 2 channels/module PID control : ON/OFF pulse	32 [Special 32 points]	0.19	–	
	A1S62TCTTB W-S2	Transistor output, temperature input 2 channels/module PID control : ON/OFF pulse, heater wire breakage detection function	32 [Special 32 points]	0.28	–	
	A1S62TCRT-S2	Transistor output, platinum temperature-measuring resistor input 2 channels/module PID control : ON/OFF pulse	32 [Special 32 points]	0.19	–	
	A1S62TCRTB W-S2	Transistor output, platinum temperature-measuring resistor input 2 channels/module PID control : ON/OFF pulse, heater wire breakage detection function	32 [Special 32 points]	0.28	–	
	A1S64TCTT-S1	Transistor output, temperature input 4 channels/module PID control : ON/OFF pulse or 2- position control	32 [Special 32 points]	0.33	–	
	A1S64TCTTB W-S1	Transistor output, temperature input 4 channels/module PID control : ON/OFF pulse or 2- position control Heater wire breakage detection function	32 [Special 32 points]	0.42	–	
	A1S64TCRT-S1	Transistor output, temperature input 4 channels/module PID control : ON/OFF pulse or 2- position control	32 [Special 32 points]	0.33	–	
	A1S64TCRTB W-S1	Transistor output, temperature input 4 channels/module PID control : ON/OFF pulse or 2- position control Heater wire breakage detection function	32 [Special 32 points]	0.42	–	
Computer link module	A1SJ71QC24	Computer link function 300 to 19,200bps RS-232C 1 channel, RS-422/485 1 channel	32 [Special 32 points]	0.24	–	• Dedicated to QnACPU
	A1SJ71QC24-R2	Computer link & printer function RS-232C 2 channel 300 to 19,200bps	32 [Special 32 points]	0.155	–	
	A1SJ71QC24 N	Computer link function 300 to 115,200bps RS-232C 1 channel, RS-422/485 1 channel	32 [Special 32 points]	0.35	–	
	A1SJ71QC24 N1			0.38		
	A1SJ71QC24 N-R2	Computer link & printer function RS-232C 2 channel 300 to 115,200bps	32 [Special 32 points]	0.3	–	
	A1SJ71QC24 N1-R2			0.3		
	A1SJ71UC24-R2	Computer link function RC-232C 1 channel	32 [Special 32 points]	0.1	–	
	A1SJ71UC24-PRF	Computer link & printer function RS-232C 1 channel	32 [Special 32 points]	0.1	–	
	A1SJ71UC24-R4	Computer link function, multidrop link function RS-422 / RS-485 1 channel	32 [Special 32 points]	0.1	–	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
Ethernet interface module	A1SJ71E71N3-T	10 BASE-T	32 [Special 32 points]	0.69	—	Only the device range equivalent to that of AnACPU can be accessed.
	A1SJ71E71N-B2	10 BASE2	32 [Special 32 points]	0.66	—	
	A1SJ71E71N-B5	10BASE5	32 [Special 32 points]	0.57	—	
	A1SJ71QE71N-B2	10 BASE2	32 [Special 32 points]	0.53	—	<ul style="list-style-type: none"> • Dedicated to QnACPU • Maximum 4 units including the network module can be used for one CPU module.
	A1SJ71QE71N-B5	10BASE5	32 [Special 32 points]	0.40	—	
	A1SJ71QE71N-3-T	10 BASE-T	32 [Special 32 points]	0.53	—	
Intelligent communication module	A1SD51S	Interpreter BASIC, Compiler BASIC. RS-232C 2 channel. RS-422/485 1 channel	32 [Special 32 points]	0.4	—	
Positioning module	A1SD70	1-axis positioning control, speed control and speed-positioning control, analog voltage output for speed-positioning control (0 to ± 10V)	48 <div> <div>First half empty 16 points</div> <div>Second half special 32 points</div> </div>	0.3	—	
	A1SD75P1-S3	For positioning control, Pulse chain output, One axis	32 [Special 32 points]	0.7	—	
	A1SD75P2-S3	Used for positioning control Pulse output, 2 axes (independent, dual-axis simultaneous, linear interpolation, circular interpolation)	32 [Special 32 points]	0.7	—	
	A1SD75P3-S3	Used for positioning control Pulse output, 3 axes (independent, triple-axis simultaneous, dual-axis linear interpolation, dual-axis circular interpolation)	32 [Special 32 points]	0.7 *	—	* When Differential driver is connected: 0.78
	A1SD75M1	Used for positioning control, Digital output. For MR-H-B/MR-J-B/MR-J2-B.	32 [Special 32 points]	0.7	—	
	A1SD75M2	Used for positioning control, Digital output. For MR-H-B/MR-J-B/MR-J2-B. (independent, dual-axis simultaneous, linear interpolation, circular interpolation)	32 [Special 32 points]	0.7	—	
	A1SD75M3	Used for positioning control, Digital output. For MR-H-B/MR-J-B/MR-J2-B. (independent, triple-axis simultaneous, dual-axis linear interpolation, dual-axis circular interpolation)	32 [Special 32 points]	0.7	—	
ID interface module	A1SD35ID1	ID interface module Connectable reader/writer unit: one	32 [Special 32 points]	0.25	0.17	
	A1SD35ID2	ID interface module Connectable reader/writer units: two	32 [Special 32 points]	0.25	0.33	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
MELSECNET (II) data link module	A1SJ71AP21	For MELSECNET(II) data link system master station and local station	32 [Special 32 points]	0.33	—	Accessible in the AnACPU device range
	A1SJ71AP21-S3	For MELSECNET(II) data link system master station and local station (for G1-type optical fiber cable)	32 [Special 32 points]	0.33	—	
	A1SJ71AR21	For MELSECNET(II) data link system master station and local station (for coaxial cable)	32 [Special 32 points]	0.8	—	
MELSECNET/B data link module	A1SJ71AT21B	For MELSECNET/B data link system master station and local station	32 [Special 32 points]	0.66	—	
	A1SJ72T25B	For MELSECNET/B data link system remote I/O station	—	0.3	—	
B/NET interface module	A1SJ71B62-S3	Master module for B/NET	32 [Special 32 points]	0.08	—	
MELSECNET/10 data link module	A1SJ71QLP21	For control station , master station , and local station of the MELSECNET/10 data link module system (For SI type optical fiber cable, double loop)	32 [Special 32 points]	0.40	—	
	A1SJ71QLP21GE	For control station , master station, and local station of the MELSECNET/10 data link module system (For GI type optical fiber cable, double loop)	32 [Special 32 points]	0.47	—	
	A1SJ71QLP21S	For control station , master station , and local station of the MELSECNET/10 data link module system With external power supply function (For SI type optical fiber cable, double loop)	48 First half empty 16 points Second half special 32 points	0.40	0.17	
	A1SJ71QBR11	For control station , master station, and local station of the MELSECNET/10 data link module system (For the single bus coaxial cable)	32 [Special 32 points]	0.80	—	
	A1SJ71QLR21	For control station , master station, and local station of the MELSECNET/10 data link module system (For the coaxial cable dual loop)	32 [Special 32 points]	1.14	—	
CC-Link system master module	A1SJ61QBT11	For the master and local stations of the CC-Link data link system (For the twisted pair shield cable only)	32 [Special 32 points]	0.40	—	
MELSECNET/MINI-S3 master module	A1SJ71PT32-S3	For MELSECNET/MINI-S3 master station, 64 stations maximum, Controls remote I/O with a total of 512 I/O points, and remote terminal	I/O dedicated mode 32 (special 32 points)	0.35	—	
			Expanded mode 48 (special 48 points)			
MELSEC - I/O LINK master module	A1SJ51T64	For MELSECNET - I/O master station, 16 stations maximum, Controls I/O LINK with a total of 128 I/O points, and remote I/O module If only a few remote I/O units are used, perform I/O assignment with a peripheral device to decrease the number of occupied I/O points to 16, 32, or 48.	64 [Output 64 points]	0.115	0.09	
S-LINK interface module	A1SJ71SL92N	Master module for S-LINK I/O total 128 points	32 [Special 32 points]	0.20	—	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]		Current consumption		Remark
					5VDC (A)	24VDC (A)	
AS-I interface module	A1SJ71AS92	Master module for AS-I, total I/O: 496 points	32	[Special 32 points]	0.15	–	
Position detection module	A1S62LS	Absolute detection system	32	[Special 32 points]	0.55	–	
PLC easier monitoring module	A1SS91	PC easier monitoring module	32	[Output 32 points]	0.08	–	
Memory card interface module	A1SD59J-S2	Memory card interface module	32	[Special 32 points]	0.05	–	Power consumption assumes connection of A1SD59J-MIF.
Simulation module	A6SIM-X64Y64	I/O simulation module for connection to the main base, Allows desk debugging without connecting I/O module to the base module. Use an expansion cable of the AnS series ↔ between the main base of the AnS series and the A6SIM-X64Y64.	64 64	(64 inputs) (64 outputs)	TYP. 0.3 (When all points "ON")	–	
PROFIBUS Interface Module	A1SJ71PB92D	PROFIBUS-DPmaster module	32	[Special 32 points]	0.56	–	
	A1SJ71PB96F	PROFIBUS-FMSinterface module	32	[Special 32 points]	0.56	–	
DeviceNet Interface Module	A1SJ71DN91	Device Net master module	32	[Special 32 points]	0.24	–	
MODBUS Interface Module	A1SJ71UC24-R2-S2	RS-232Ctype MODBUS interface module	32	[Special 32 points]	0.1	–	
	A1SJ71UC24-R4-S2	RS-422/485type MODBUS interface module	32	[Special 32 points]	0.1	–	

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
Graphic operation terminal	A985GOT	Large-size graphic operation terminal 256 colors, TFT color, 800×600 dots, high intensity	32 [Special 32 points]*	0.22 *	—	*When bus connected
	A975GOT	Large-size graphic operation terminal 256 colors, TFT color, 640×480 dots, high intensity				
	A970GOT	Large-size graphic operation terminal 16 colors, TFT color, 640×480 dots, high intensity/ 16 colors, TFT color, 640×480 dots, wide viewing angle/ 8 colors, STN color, 640×480 dots/ 2 colors, STN monochrome, 640×480 dots				
	A960GOT	Large-size graphic operation terminal 2 colors, EL, 640×400 dots				
	A956GOT	Medium-size graphic operation terminal 8 colors, STN color, 320×240 dots/ STN monochrome, 320×240 dots/ 256 colors, STN color, 320×240 dots				
	A956WGOT	Medium-size graphic operation terminal 256 colors, TFT color, 480×234 dots				
	A953GOT	Medium-size graphic operation terminal 8 colors, STN color, 320×240 dots/ STN monochrome, 320×240 dots/ 256 colors, STN color, 320×240 dots	—	—	—	For RS-232C connected only
	A951GOT	Medium-size graphic operation terminal 8 colors, STN color, 320×240 dots/ STN monochrome, 320×240 dots/ 256 colors, STN color, 320×240 dots	32 [Special 32 points]*	0.22 *	—	*When bus connected
	A950GOT	Medium-size graphic operation terminal 8 colors, STN color, 320×240 dots/ STN monochrome, 320×240 dots/ 256 colors, STN color, 320×240 dots	—	—	—	For RS-422 connected only
	GT1565-VTBA	Large-size graphic operation terminal 8.4" 256/65536 colors, TFT color, 640×480 dots (When installing a multi color display board, 65536 colors can be displayed.)	32 [Special 32 points]*	0.12	—	*When bus connected
	GT1575-VTBA	Large-size graphic operation terminal 10.4" 256/65536 colors, TFT color, 640×480 dots (When installing a multi color display board, 65536 colors can be displayed.)				
Main Base Unit	A1S32B	2 I/O modules can be installed.	—	—	—	Extension connector attached to one on each side
	A1S33B	3 I/O modules can be installed.				
	A1S35B	5 I/O modules can be installed.				
	A1S38B	8 I/O modules can be installed.				

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Number of Occupied Points (points) [I/O Assignment Module Type]	Current consumption		Remark
				5VDC (A)	24VDC (A)	
Extension Base Unit	A1S52B	2 I/O modules can be installed.	-	-	-	Does not take power supply module. (Power supplied from the main base module).
	A1S52B-S1					
	A1S55B	5 I/O modules can be installed.				
	A1S55B-S1					
	A1S58B	8 I/O modules can be installed.	-	-	-	
	A1S58B-S1					
	A1S65B	5 I/O modules can be installed.	-	-	-	The power supply module is required.
	A1S65B-S1					
	A1S68B	8 I/O modules can be installed.				
	A1S68B-S1					
Extension Cables	A1SC01B	Flat cable, 55 mm (2.17 inch) long	-	-	-	For extension to right side
	A1SC03B	330mm (118.11in) long	-	-	-	Extension base module connecting cable
	A1SC07B	Extension base module connecting cable				
	A1SC12B	1200 mm (47.24 inch) long				
	A1SC30B	1200 mm (47.24 inch) long				
	A1SC60B	6000 mm (236.22 inch) long	-	-	-	Cable for A □ N and A □ A extension bases
	A1SC05NB	450 mm (17.72 inch) long				
	A1SC07NB	Extension base module connecting cable				
	A1SC30NB	1200 mm (47.24 inch) long				
	A1SC50NB	5000 mm (197.1 inch) long				

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name		Model Name	Description	Applicable Model
Memory cassette	E ² PROM	A2SNMCA-30KE	With 30k-step E ² PROM (direct connection)	Direct writing to and reading from a peripheral device is feasible.
Battery		A6BAT	IC-RAM memory backup	Installed in the Q2ASCPU, Q2ASHCPU, Q2ASCPU-S1, Q2ASHCPU-S1 main module
Connector/ terminal block conversion module	A6TBXY36		For sink type input module and sink type output module (standard type)	A1SX41(S1/S2), A1SX42(S1/S2), A1SY41, A1SY41P, A1SY42, A1SY82, A1SH42(S1)
	A6TBXY54		For sink type input module and sink type output module (2 wire type)	
	A6TBX70		For sink type input module (3 wire type)	A1SX41(S1/S2), A1SX42(S1/S2), A1SH42(S1)
	A6TBX36-E		For source-type input module (standard type)	A1SX71, A1SX82-S1, A1SX81(S2)
	A6TBY36-E		For source-type output module (standard type)	A1SY81, A1SY82
	A6TBX54-E		For source type input module (2 wire type)	A1SX71, A1SX82-S1, A1SX81(S2)
	A6TBY54-E		For source type input module (2 wire type)	A1SY81, A1SY82
	A6TBX70-E		For source type input module (3 wire type)	A1SX71, A1SX82-S1, A1SX81(S2)
Cable for connector/ terminal block conversion module	AC05TB		0.5 m (1.64 ft.) long, for sink module	A6TBXY36 A6TBXY54 A6TBX70
	AC10TB		1 m (3.28 ft.) long, for sink module	
	AC20TB		2 m (6.56 ft.) long, for sink module	
	AC30TB		3 m (9.84 ft.) long, for sink module	
	AC50TB		5 m (16.4 ft.) long, for sink module	
	AC80TB		5 m (16.4 ft.) long, for sink module	
	AC100TB		10 m (32.8 ft.) long, for sink module	
	AC05TB-E		0.5 m (1.64 ft.) long, for source module	A6TBX36-E A6TBY36-E A6TBX54-E A6TBY54-E A6TBX70-E
	AC10TB-E		1 m (3.28 ft.) long, for source module	
	AC20TB-E		2 m (6.56 ft.) long, for source module	
	AC30TB-E		3 m (9.84 ft.) long, for source module	
	AC50TB-E		5 m (16.4 ft.) long, for source module	
Relay terminal module	A6TE2-16SRN		For sink-type output module	A1SY41, A1SY41P, A1SY42, A1SH42(S1)
Cable for relay terminal module connection	AC06TE		0.6 m (1.97 ft.) long	A6TE2-16SRN
	AC10TE		0.6 m (1.97 ft.) long	
	AC30TE		3 m (9.84 ft.) long	
	AC50TE		5 m (16.4 ft.) long	
	AC100TE		10 m (32.8 ft.) long	
Terminal block cover for A1S I/O module and special module	A1STEC-S		Slim type terminal block cover for A1S I/O module and special module	All terminal block connector type modules

3. SYSTEM CONFIGURATION

MELSEC-QnA

Product Name	Model Name	Description	Applicable Model
IDC terminal block adapter	A1S-TA32	IDC terminal block adapter for 32 points 0.5mm ² (AWG20)	A1SX41(S1/S2), A1SX71, A1SY41, A1SY41P, A1SY71
	A1S-TA32-3	IDC terminal block adapter for 32 points 0.3mm ² (AWG22)	
	A1S-TA32-7	IDC terminal block adapter for 32 points 0.75mm ² (AWG18)	
Terminal block adapter	A1S-TB32	For 32 points, conversion into Europe type terminal block	A1SX41(S1/S2), A1SX71, A1SY41, A1SY41P, A1SY71
40-pin connector	A6C0N1	Soldering-type, straight out	Sink type (40p FCN)
	A6C0N2	Solderless-type, straight out	
	A6C0N3	Press-fit type, flat cable	
	A6C0N4	Soldering-type, straight/diagonal out	
3-pin D-sub connector	A6C0N1E	Soldering-type, straight out	Source type (37p D-sub)
	A6C0N2E	Solderless-type, straight out	
	A6C0N3E	Press-fit type, flat cable	

REMARK

Toa Electric Industrial CO., LTD. provides I/O cables with connectors, which can connect to 40-pin connector (A1SX41,A1SX42,A1SY41,A1SY41P,A1SY42, etc.) or 37-pin D-sub connector (A1SX81,A1SY81) of I/O modules.

Contact:

TOA ELECTRIC INDUSTRIAL CO., LTD.

(2) Peripheral device

Product Name	Model Name	Remark
Programming unit	Q6PU	Connected to the CPU module by an RS-422 cable (AC30R4-PUS, AC20R4-A8PU); for program writing and reading. (5VDC 0.4A)
RS-422 cable	AC30R4-PUS	Cable for connection between CPU module and Q6PU 3 m (9.84 ft.) long
	AC20R4-A8PU	Cable for connection between CPU module and Q6PU 2m (78.74 in) long

3.3.2 Precautions when configuring the system

The following shows the hardware and software packages which can be used for Q2ASCPU.

(1) Hardware

- (a) The number of modules that can be mounted is restricted depending on the module type.

Applicable Module	For Q2ASCPU only	For AnSCPU	Remark
I/O module	–	No limit	–
Special function module	No limit	No limit	–
Intelligent special function module	No limit	Total 6 modules	Including GOT-A900 Series (Only when the bus connection is used.), and GOT1000 Series (Only when the bus connection is used.)
Interrupt module	–	Only 1 module	–
Link module Ethernet module	Ethernet module for network, total of 4 units	Total 2 for data link use	Total 4 for network, Ethernet and data link use

REMARK

The modules described above are categorized as follows.

- | | |
|---|---|
| 1) I/O module: | Standard input modules and output modules |
| 2) Special function module: | Special function modules that perform processing in accordance with FROM/TO instructions from the Q2ASCPU (for example: A1S64AD, A1S62DA, etc.) |
| 3) Intelligent special function module: | Special function modules that can process not only by executing FROM/TO instruction of Q2ASCPU but also by accessing Q2ASCPU from special function module (Example: A1SJ71UC24-R2, A1SJ71QC24N, etc.) |
| 4) Interrupt module: | Modules that issue interrupts to the Q2ASCPU (A1SI61) |
| 5) Link module: | Special function modules for MELSECNET II, /B data links and MELSECNET/10 networks. (Example: A1SJ71AP21, A1SJ71QLP21, etc.) |
| 6) Ethernet module: | Dedicated Ethernet interface modules for Q2ASCPU (A1SJ71QE71N-B2, A1SJ71QE71N-B5) |

(b) The following shows special function modules that cannot be used with Q2ASCPU:

- AJ71C23 (Host controller high-speed link module)
- AD57-S2 (A6MD controller module)
- AJ71C24 (Computer link module): Manufactured through February 1987.
 (Products manufactured in March 1987 or later,
 and products marked "H" (corresponding to A3H
) can be used.
- AD51 (Intelligent communication module)
 : Manufactured through March 1987.
 (Products manufactured in April 1987 or later,
 and products marked "H" (corresponding to A3H
) can be used.
- A7GT-BUS (Bus connection interface module for A77GOT and A870GOT):
 Manufactured through January 1996.
 (Products manufactured in February 1996 or
 later, and products marked "C" (corresponding to
 A3H) can be used.
- AJ71LP21(G), AJ71BR11, AJ71LR21, A1SJ71LP21, A1SJ71BR11,
 A1SJ71LR21 (MELSECNET/10 network modules)

(c) When using a special function module with Q2ASCPU, the device range to be used is depending on models of special function modules.

Device	Model			
	AD51(S3), AJ71C24-S3, AJ71P41 *1	A1SD51S, A1SJ71UC24, AD51H(S3), AD51FD-S3, AJ71C23-S3AJ71C24-S6/S8, AJ71UC24, AJ71ME81 *2	AJ71E71, A1SJ71E71 *2	
			Q2AS(H)	Q2AS(H)-S1
I/O device (X/Y)	X/Y0 to X/Y7FF	X/Y0 to X/Y7FF	X/Y0 to X/Y1FF	X/Y0 to X/Y3FF
Internal relays (M, L, S) *3	M0 to M2047	M0 to M8191	M0 to M8191	
Link relay (B)	B0 to B3FF	B0 to BFFF	B0 to BFFF	
Timer (T)	T0 to T255	T0 to T2047	T0 to T2047	
Counter (C)	C0 to C255	C0 to C1023	C0 to C1023	
Data register (D)	D0 to D1023	D0 to D6143	D0 to D6143	
Link register (W)	W0 to W3FF	W0 to WFFF	W0 to WFFF	
Annunciator (F)	F0 to F255	F0 to F2047	F0 to F2047	

*1 Only the device range equivalent to that of A3HCPU can be accessed.
 Reading/Writing of file registers, programs, etc. are not possible.

*2 Only the device range equivalent to that of AnACPU can be accessed. Reading/Writing of file registers, programs, etc. are not possible.

*3 Even when L or S is specified, the device becomes M.
 (Example: Even when L10 is specified, the device becomes M10.)

- (d) When a QnACPU is mounted on a main base unit for A1S38HB/A1S38HBEU high-speed access, the Q2ASCPU can access special function modules, intelligent special function modules and link modules to write/read at greater speeds.
QnACPU cannot input/output to the I/O module at greater speed.
- (e) The following shows how to connect graphic operation terminal units to a Q2ASCPU.

Model	Connection Method	Accessible Device Range
GOT1000 series	Direct connection to CPU Computer link connection CC-Link connection MELSECNET/10 connection Bus connection	Access is available for all device ranges of Q2ASCPU. (Refer to the GT Works2/GT Designer2 Reference Manual for details.)
GOT-A900 series	Direct connection to CPU Computer link connection CC-Link connection MELSECNET(II), /B, /10 connection Bus connection	Access is available for all device ranges of Q2ASCPU. (Refer to the GT Works2/GT Designer2 Reference Manual for details.)

- (f) The accessible range for an A1SJ71UC24 computer link module comprises the CPU to which the A1SJ71UC24 is mounted (the host station) and the other stations in the network to which the host station is connected.
It is not possible to access other stations in other networks by using the MELSECNET/10 network system routing function.

The access range for an A1SJ71QC24N serial communication module is the host station, other stations in the network connected to the host station, and other stations in other networks accessed through up to 7 relay stations by using the routing function.

- (g) When accessing from intelligent communication module A1SD51S to other station Q2ASCPU/QnACPU on the network, only Format 1 control table can be used. Format 2 control table cannot be used.
Access to other network is not allowed on Format 1 control table.
- (h) In Q2ASCPU, I/O assignment set with the parameter cannot be valid for MELSECNET (II) and MELSECNET/B. When setting the I/O assignment for a remote I/O station, build the remote I/O network with MELSECNET/10.

(2) Software package

The following shows the system start-up software packages to create programs for Q2ASCPU.

Peripheral Device Capable of GPP Functions	Software Package for System Start-up
Personal computer	GX Developer, SW□IVD-GPPQ

Set to the following PC CPU type using peripheral device.

PC CPU model	PC CPU model
Q2AS(H)CPU	Q2A
Q2AS(H)CPU-S1	Q2AS1

Apart from the above, the following software packages can be used.

- CAD interface package SW□IVD-CADQ
- Data conversion package SW□IVD-CNVQ
- Macro/library package SW□IVD-MSDQ
- SW□IVD-MSPQ
- Ladder sequence linking package SW□IVD-LNKQ


REMARK

The following shows the peripheral devices and software packages that cannot be used with Q2ASCPU:

- A□PUProgramming unit)
- A6WU (ROM writer unit)
- A6DU-B (Data access unit)
- A6TEL (Modem interface unit)
- A6GPP (Intelligent GPP)
- A6HGP (Hand-held graphic programmer)
- A6PHP (Plasma hand-held graphic programmer)
- System start-up software package for ACPU
SW□□□-GPPA, SW□□□-SAP2
- Utility software package for ACPU
SW□□□-GPPATEL, SW□□□-CADIF, SW□□□-DRWA,
SW□□□-FUNP, SW□□□-TSAP2

3.3.3 Q2ASCPU memory block diagram

The following block diagram shows the Q2ASCPU memory configuration.

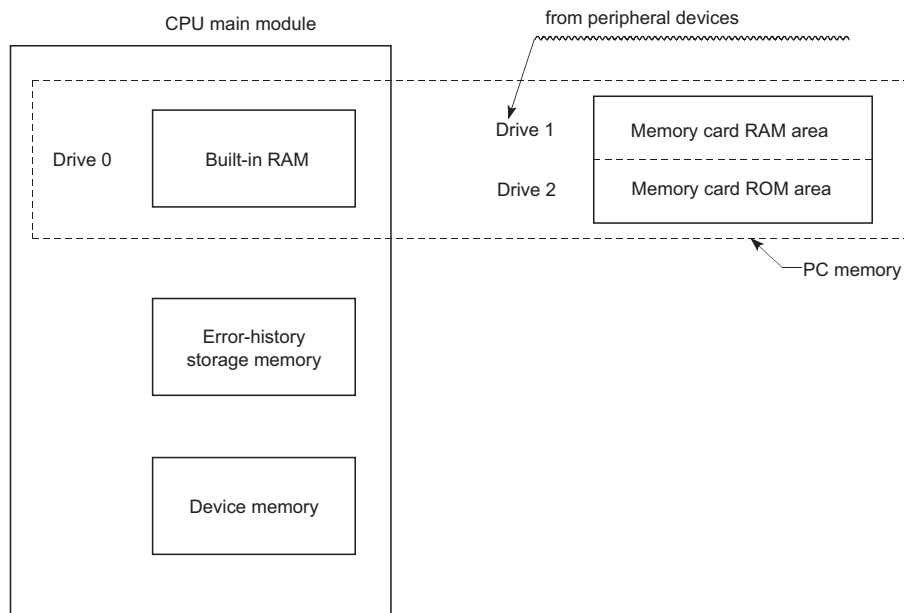

- Built-in RAM : Memory that stores parameters, sequence programs, etc.
- Error history storage memory : Memory that stores error history data
- Device memory : Memory that stores device data
- Memory card (RAM, ROM area) : Memory that stores the files, comments, etc., for parameters, sequence programs, sampling traces, etc.
- PLC memory : Indicates all the memories of drives 0 through 2.

For file types stored in each memory, refer to "File Types & Storage Destinations of Files Managed by QnACPU" in the QnACPU Programming Manual (Fundamentals).

4 PERFORMANCE SPECIFICATIONS

This section shows the performance specifications of the Q2ASCPU.

Item		Model Name				Remark
		Q2ASCPU	Q2ASCPU-S1	Q2ASHCPU	Q2ASHCPU-S1	
Control method		Sequence program control method				
I/O control mode		Refresh mode				Direct input/output is allowed by specifying direct input/output (DX□ , DY□).
Programming language		Language dedicated to sequence control				
		Relay symbol language, logic symbolic language, MELSAP-3 (SFC)				
Processing speed (Sequence instruction)	LD	0.2 μ s/step		0.075 μ s/step		
	MOV	0.6 μ s/step		0.225 μ s/step		
Constant Scan (Function that makes the scan time constant)		5ms to 2000ms (Possible to set in 5ms units)				Possible to set in the parameters
Memory capacity		Capacity of the installed memory card (Max. 2036k bytes)				
Program capacity	Number of steps	Maximum 28k step	Maximum 60k step	Maximum 28k step	Maximum 60k step	
	Number of files	28	60	28	60	
Number of I/O device points		8192 points X/Y to 1FFF				The number of points usable in the program
Number of I/O points		512 points X/Y0 to 1FF	1024 points X/Y0 to 3FF	512 points X/Y0 to 7FF	1024 points X/Y0 to FFF	The number of accessible points to actual I/O module

4. Performance specifications

MELSEC-QnA

Item		Model Name				Remark
		Q2ASCPU	Q2ASCPU-S1	Q2ASHCPU	Q2ASHCPU-S1	
Device points	Internal relay [M]	Default 8192 points M0 to 8191				Possible to set the number of points to be used by the parameter
	Latch relay [L]	Default 8192 points L0 to 8191				
	Link relay [B]	Default 8192 points B0 to 1FFF				
	Timer [T]	Default: 2048 points (T0 to T2047) (Low-speed timers and high-speed timers sharing) Set low-speed timers/high-speed timers switching with instructions. Set low-speed/high-speed measurement units by parameter. (Low-speed timers: 10ms to 1000ms, 10ms units, Default: 100ms) (High-speed timers: 1ms to 100 ms, 1ms units, default: 10 ms)				
	Retentive timer [ST]	Default 0 points ST0 to 2047 (Low-speed timers and high-speed timers sharing) Set Low-speed timers/high-speed timers switching with instructions. Set low-speed/high-speed measurement units by parameter. (Low-speed timers: 10ms to 1000ms, 10ms units, Default: 100ms) (High-speed timers: 1ms to 100 ms, 1ms units, default: 10 ms)				
	Counter [C]	• Normal counter Default 1024 points C0 to 1023 • Interrupt counters Max. 48 points (Default: 0 point, Can be set by the parameter.)				
	Data register [D]	Default 12288 points D0 to 12287				
	Link register [W]	Default 8192 points W0 to 1FFF				
	Annunciator [F]	Default 2048 points F0 to 2047				
	Edge relay [V]	Default 2048 points V0 to 2047				
	File register [R]	32768 points R0 to 32767 Up to 1042432 points can be used by block switching.				Possible to set the number of points to be used by the parameter
		1042432 points ZR0 to 1042431 Block switching is not necessary.				
	Special link relay [SB]	Default 2048 points SB0 to 7FF				The number of device points is fixed.
	Special link register [SW]	Default 2048 points SW0 to 7FF				
	Step relay [S]	8192 points S0 to 8191				
	Index register [Z]	16 points (Z0 to 15)				
	Pointer [P]	4096 points P0 to 4095 Possible to set Ranges for pointers in files and common pointers by the parameter.				
	Interrupt pointer [I]	48 points I0 to 47 The fixed-cycle interval for system interrupt pointers I28 to I31 is set by the parameter. (5ms to 1000ms, in 5ms units)				
	Special relay [SM]	2048 points SM0 to 2047				
	Special register [SD]	2048 points SD0 to 2047)				
	Function input [FX]	16 points (FX0 to F)				
	Function output [FY]	16 points (FY0 to F)				
	Function register [FD]	5 points (FD0 to 4)				
Link direct device		Devices that access link devices directly. Dedicated to MELSECNET/10Designation format: J□ □\□ □ □				

4. Performance specifications

MELSEC-QnA

Item	Model Name				Remark
	Q2ASCPU	Q2ASCPU-S1	Q2ASHCPU	Q2ASHCPU-S1	
Special function module direct device	Devices that directly access the buffer memories of special function modules. Designation format: U□ □\G□ □				
Latch (power failure compensation) range	L0 to L8191 (Default) (Latch ranges can be set for B, F, V, T, ST, C, D, W devices.)				Possible to set in the parameters
Remote RUN/PAUSE contact	Possible to setup one contact poin for each of RUN/PAUSE from X0 to X1FFF.				
Clock Function	Year, month, day, hour, minute, second, day of the week (automatic detection of the leap year) Accuracy -1.7 to +4.9s (TYP. +1.7s)/d at 0℃ Accuracy -1.0 to +5.2s (TYP. +2.2s)/d at 25℃ Accuracy -7.3 to +2.5s (TYP. -1.9s)/d at 55℃				
Allowable momentary power failure period	Depends on the power supply modules				See Section Section 16.1.
5VDC internal current consumption*	0.3A	0.3A	0.7A	0.7A	
Weight	0.5kg	0.5kg	0.5kg	0.5kg	
External dimensions	130 × 54.5 × 110 (5.12 × 2.15 × 4.33)				

REMARK


- * Indicates current consumption of the Q2ASCPU with function version "B" (9707B).The following shows the current consumption values of theQ2ASCPU without the function version:
- Q2ASCPU, Q2ASCPU-S1 : 0.3A
 - Q2ASHCPU, Q2ASHCPU-S1 : 0.7A

5 I/O NUMBER ASSIGNMENT

This section explains the method for I/O number assignment using the Q2ASCPU to enable data communications with a I/O modules and a special function module.

5.1 I/O Numbers

The I/O number is used in the sequence program to input data from a input module and to output data to an output module.
The I/O number is expressed as three-digit hexadecimal numbers.
The I/O numbers when all the I/O modules are occupied in 16 points are indicated below.

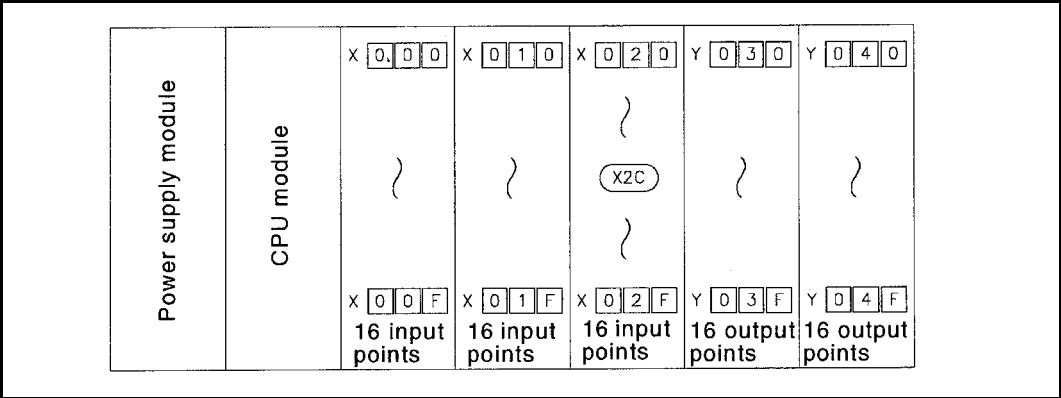

Concept of I/O numbers

REMARK

When programming with a peripheral device for GPP function, I/O numbers can be input in 2 digits.


I/O numbers	Input with a peripheral device
X010	→ X10
Y020	→ Y20

5.2 I/O Number Assignment Concept

When the programmable controller power is ON or the CPU module is reset, the I/O assignment described below is performed.


In the sequence program, designate the I/O numbers assigned in accordance with the following.

- (1) I/O numbers are sequentially assigned from left to right, taking slot 0 (The slot to the right of the CPU module) of the main base unit to be "0".
- (2) The I/O modules and special function modules mounted to the main base unit occupy the I/O numbers corresponding to the number of I/O points for each module.
- (3) 16 points are assigned to the empty slots where no I/O module or special function module is mounted.

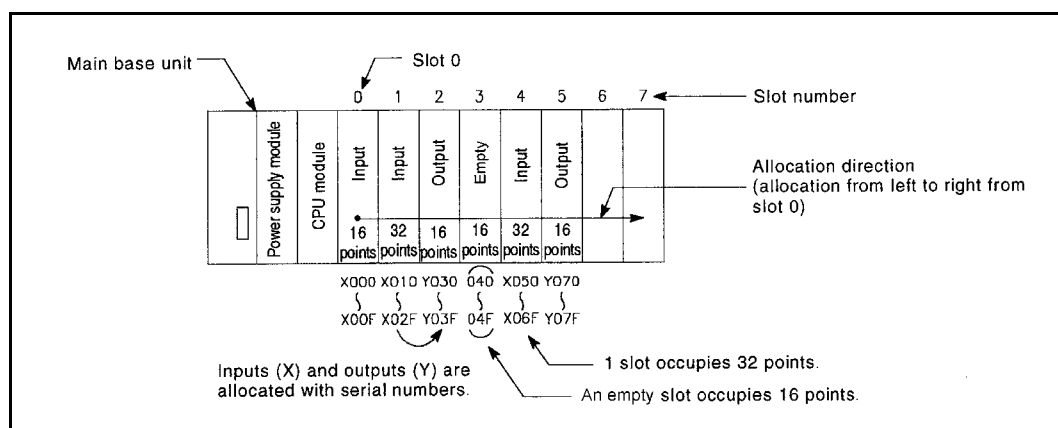

- (4) If an extension base unit is connected, its assignment starts from the number immediately after the number assigned to a main base unit.

- (5) I/O numbers are assigned assuming that every base unit has 8 slots.
 If a 5-slot type base unit is used, an I/O number obtained by adding points equivalent to 3 slots (48 points) to the final I/O number of the 5-slot base unit is assigned to the next extension base unit.

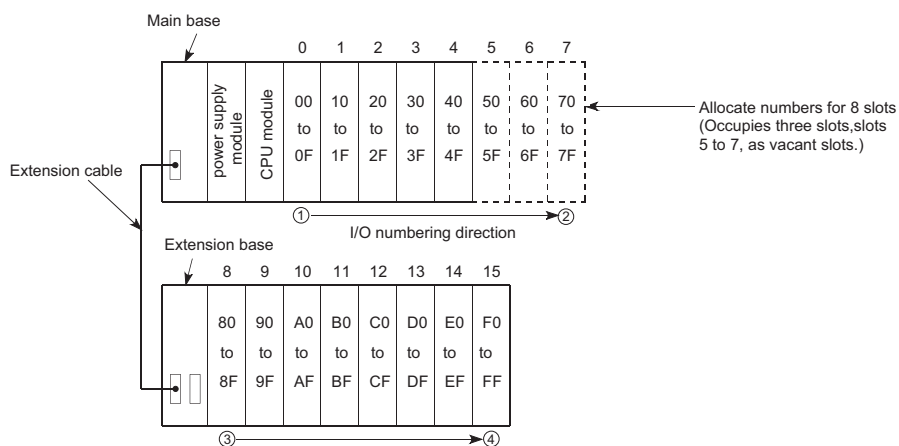

*I/O numbers are allocated in the order of ①→②→③→④
 Example above shows a case where all slots are 16 points modules

5.3 I/O Assignment with GPP Function

When using the Q2ASCPU, I/O modules and a special function module can be controlled even if I/O assignment with GPP function is not performed.

I/O assignment with GPP function are valid in the following cases.

- (1) The purpose of I/O assignment with GPP function
 - (a) When using a base unit for 5 slots, set 0 point for 3 slots for efficient use of number of I/O points.
 - (b) Reserve the points when changing a module to other than a 16-point module for future system extension.
 - (c) The I/O assignment prevents the I/O numbers from changing if an I/O module or special function module that occupies other than 16 points has to be removed due to failure.
 - (d) The I/O assignment reduces the I/O number modification in a program since it enables to match with the I/O numbers of the designed program and to change the I/O numbers assigned to each module on the base unit per slot.

- (2) The concept of I/O assignment with GPP function

The following two methods are available for I/O assignment with GPP function.

- 1) Set the number of points for the empty slots on a main base unit and extension base unit. (Points occupied by empty slot)
- 2) Set the I/O assignment per slot of main base unit or extension base unit to each module type. (I/O assignment)


Parameter settings are used for both of these methods. If both 1) and 2) are set, the setting of 2) takes priority.

- (a) Setting points occupied by empty slot


Set the number of points for all slots that are empty on the base unit.

In the systems in which this setting is not made in the parameters, 16 points are set for empty slots.

Make this setting in "8. Number of empty slots" on the "PLC system" screen in the parameter mode.

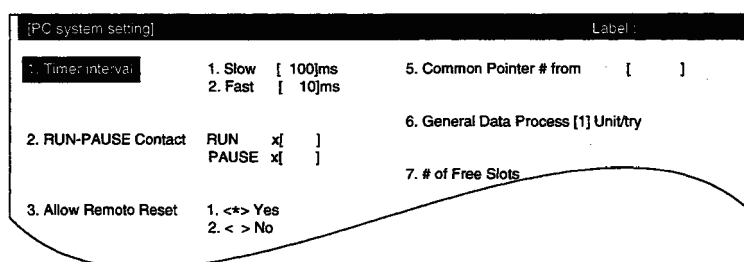

The setting is made in units of 16 point within the range of 0 to 64. The default is 16 points.
Example: When the points occupied by empty slot is set to 0 points

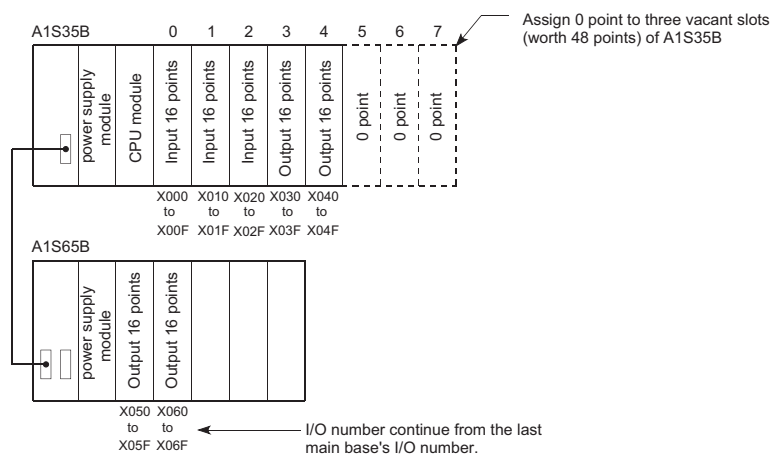

(b) I/O assignment settings

Set the I/O assignment per slot of main base unit or extension base unit to each module type.

Make this setting in the "I/O Assign" screen in the parameter mode.

[I/O allocation]					Label :
Slot	Type	Itme	1st XY	Type Name	
0(0-0)	< >	< >	[]	[]	Basic
1(0-1)	< >	< >	[]	[]	[]
2(0-2)	< >	< >	[]	[]	Power Supply
3(0-3)	< >	< >	[]	[]	[]
4(0-4)	< >	< >	[]	[]	Extension cable
5(0-5)	< >	< >	[]	[]	[]
6(0-6)	< >	< >	[]	[]	[]
7(0-7)	< >	< >	[]	[]	[]
8(1-0)	< >	< >	[]	[]	Extention 1
9(1-1)	< >	< >	[]	[]	[]
10(1-2)	< >	< >	[]	[]	Power Supply
11(1-3)	< >	< >	[]	[]	[]
12(1-4)	< >	< >	[]	[]	Extension Cable
13(1-5)	< >	< >	[]	[]	[]
14(1-6)	< >	< >	[]	[]	[]
15(1-7)	< >	< >	[]	[]	[]
PgUp : Prev PgDn : Next					Esc : Close

The setting details are as follows:

Item	Setting	Setting range	Default value
Slot setting	Set data for each slot. (Not necessary to set all data).	Empty/input/output/special	No setting
	Classification		
	Number of points	0 to 64 points (in 16 point units)	
	Start XY	0 to 1FFF (in 16 point units)	
	Model Name	Up to 16 characters	
Base specification	Set data for each base unit.	Up to 16 characters	No setting
	POWER SUPPLY MODULE		
	Extension cable	Up to 16 characters	

The items without settings are handled as follows:

- Type and Points : In accordance with the loaded module.
- Start XY : The number following the total points obtained by adding the number of points of the modules already set.
If there is any duplication, an error (SP.UNIT LAY ERROR) is detected.

POINT	The power supply module names set in the base specification is only used for the current capacity check in the PLC diagnostics mode and not used for a CPU module. Therefore, even if they are not set, any problem does not occur.

The CPU module performs the following processing when I/O assignment is set.

- 1) Any of the following assignment can be performed per slot of each base unit.

Assigned number of points			
Empty slot	Input module	Output module	Special function module
0	-	-	-
16	16	16	16
32	32	32	32
48	48	48	48
64	64	64	64

- 2) The slots for which I/O assignment has been performed with GPP function, the I/O assignment setting takes priority regardless of the loaded module.
- If a number of points fewer than the that of the loaded I/O module is set, the actual number of points of the loaded I/O module is reduced.
For example, if the loaded module is a 32-point input module but I/O assignment is set for a 16-point input module using GPP function, the latter 16 points for the input module cannot be used.
 - If a number of points is greater than the that of the loaded I/O module is set, the number of points in excess of the actual number of points is occupied with dummy points.
 - If the slot where an I/O module is loaded is set as a empty slot, the I/O module will be unusable.
- 3) The slots for which I/O assignment is not performed using GPP function are assigned with the number of points of the loaded module.
- 4) The slots for which I/O assignment is not performed using GPP function are assigned I/O numbers that are consecutive to those of modules for which I/O assignment has been performed.


(3) Precautions

- (a) If there is a disparity between the I/O assignment made in the parameter settings and the actually loaded I/O modules, the input and output is not normally performed.

Loaded module	I/O assignment	Result
Input	Output	No input
Output	Input	No output
Input/Output	Special	CPU module error
Special	Input/Output	CPU module error


- (b) The I/O assignment of a slot to which a special function module is loaded has to be the same setting with the module. Not doing so may cause an error.

- 1) A11VC..... Special: 16 points
- 2) AI61 Special: 32 points
- 3) AG62..... Input: Set number of points
- 4) Modules that occupy 2 slots..... Set "Empty, 16 points" and "Special, 32 points".

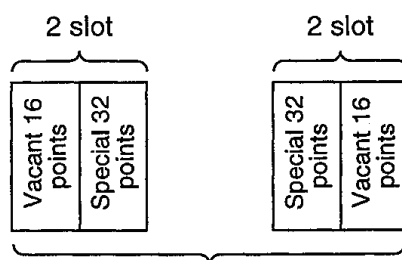

Refer to users' manual for special module being used.

- (c) When operating MELSECNET data link, perform I/O assignment as follows.
- 1) As for a master station, I/O assignment has to be performed for the master station and all remote I/O stations.
I/O assignment of MELSECNET (II)/B to the remote I/O station is invalid.

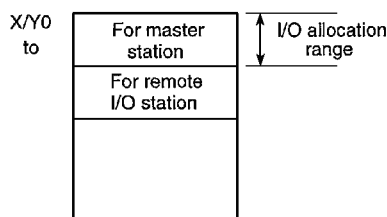

- 2) As for a local station, perform I/O assignment only for the local station.
 - 3) Assign the I/O for the I/O hybrid module (e.g. A42XY) as an output module.
- (d) When the MELSECNET/10 network is established, assign the I/O only for the host station (master station).
Since the I/O assignment of MELSECNET/10 to the remote I/O station is irrelevant, the I/O assignment is not allowed.
For I/O assignment of MELSECNET/10 to the remote I/O station, use the I/O assignment settings in the "Network param".

REMARK

As for the remote I/O station of MELSECNET (II)/B, I/O assignment settings in the "Network param" is irrelevant, therefore, the I/O assignment is not allowed.


5.4 Example of I/O Number Assignment

The following shows the example of I/O number assignment when I/O assignment is performed using GPP function.

- (1) When changing the assignment for an empty slot from 16 points to 0 or 32 points
When the A1S35B is used, there are three empty slots. When setting the assignment for these to 0 points in order to increase the number of I/O points that can be used by the CPU module

When reserving 32 I/O points for a current empty slot to which a 32-point input module is loaded later, in order to prevent the I/O number assignment change
To achieve these operations, perform I/O assignment as follows.

- (a) Loading status and I/O numbers

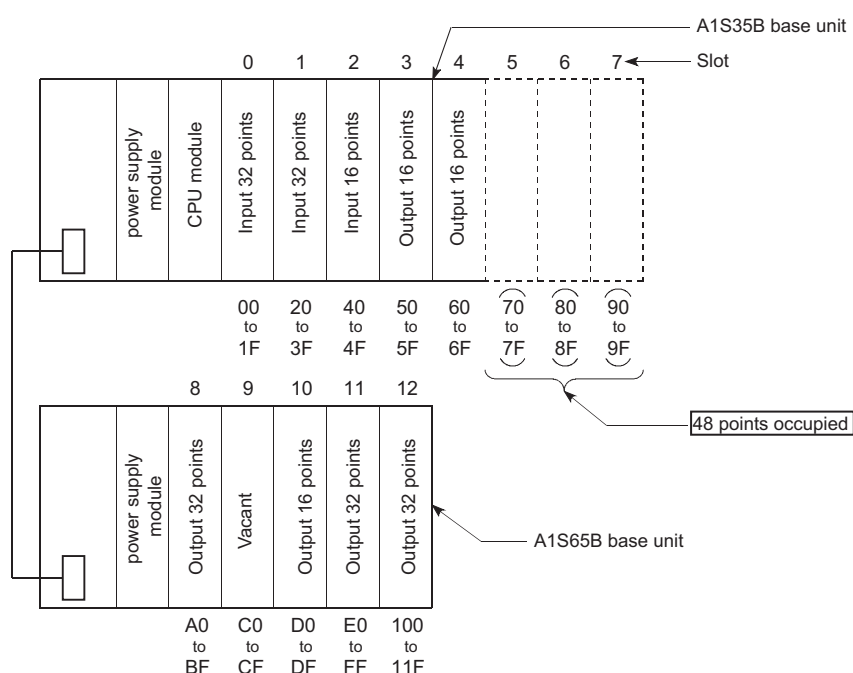


- (b) I/O numbers when I/O assignment is performed using GPP function

- 1) I/O assignment example

[I/O allocation]					Label	
Slot	Type	lme	1st XY	Type Name		
0(0-0)	<Inp>	<32Pt>	[0]	[A1SX41]	Basic	[A1S35B]
1(0-1)	<Inp>	<16Pt>	[20]	[A1SX40]		
2(0-2)	<Inp>	<32Pt>	[30]	[A1SX41]		
3(0-3)	<Out>	<16Pt>	[50]	[A1SX40]		
4(0-4)	<Free>	<16Pt>	[60]	[]		
5(0-5)	<Free>	<0Pt>	[]	[]	Extension Cable	[A1SC12B]
6(0-6)	<Free>	<0Pt>	[]	[]		
7(0-7)	<Free>	<0Pt>	[]	[]		
8(1-0)	<Out>	<32Pt>	[70]	[A1SY41]	Extension 1	[A1S65B]
9(1-1)	<Inp>	<32Pt>	[90]	[A1SX41]		
10(1-2)	<Out>	<16Pt>	[B0]	[A1SY40]		
11(1-3)	<Out>	<48Pt>	[C0]	[]		
12(1-4)	<Out>	<32Pt>	[F0]	[A1SY41]		
13(1-5)	<Free>	<0Pt>	[]	[]	Extension Cable	[]
14(1-6)	<Free>	<0Pt>	[]	[]		
15(1-7)	<Free>	<0Pt>	[]	[]		


The example of I/O assignment with GPP function

2) I/O numbers after performing I/O assignment using GPP function

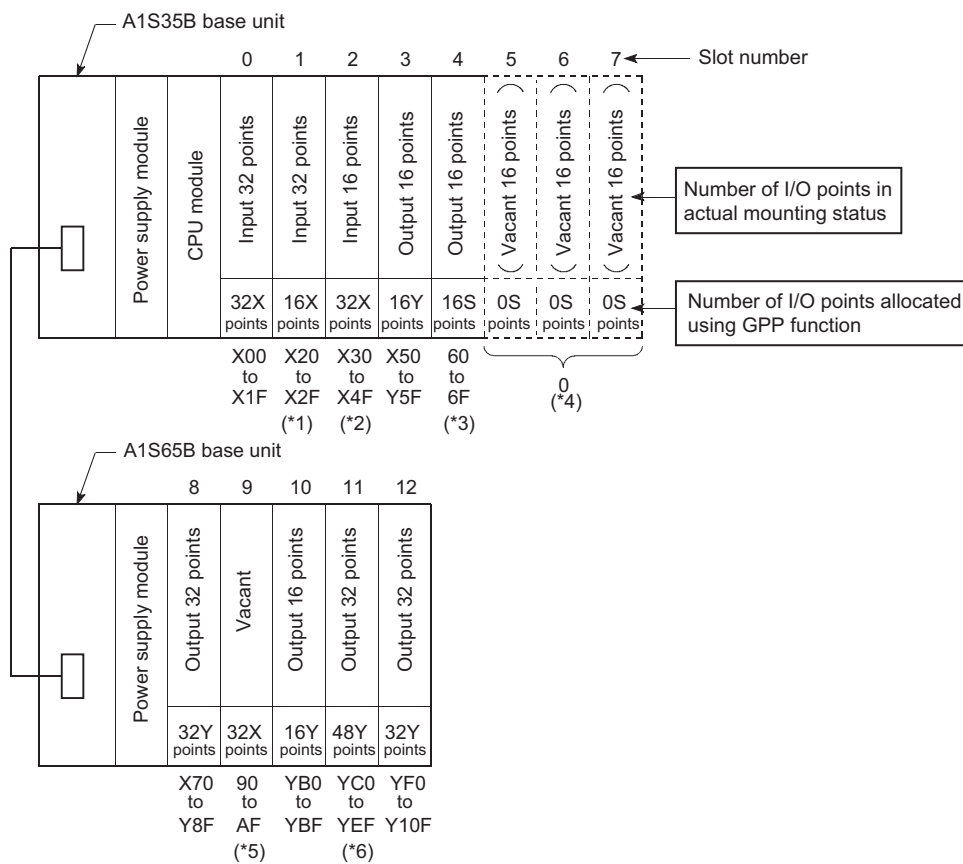

- *1 Since 16 points is set, the latter 16 points of inputs cannot be used.
- *2 Since 32 points is set, the points from 40 to 4F is occupied with dummy points.
- *3 Since "Empty (S), 16 points" is set, the points cannot be used for outputs.
- *4 Since "Empty (S), 0 points" is set, the number of I/O points for the three slots are not lost.
- *5 Since "input (S), 32 points" is set, there are 32 input points.
- *6 Since 48 points are set, E0 to EF is occupied with dummy points.

- (2) Replacing a 16-point input module with a 32-point input module
- When replacing the 16-point input module with a 32-point input module without changing the all I/O number assignment in a system to which a 16-point input module is designed To achieve this operation, perform I/O assignment as follows.
- (a) Loading status and I/O numbers before the replacement

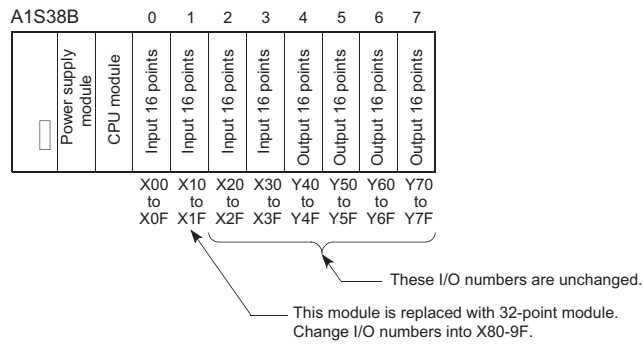

- (b) I/O numbers when I/O assignment is performed using GPP function
- 1) I/O assignment example


I/O allocation					Label
Slot	Type	Itme	1st XY	Type Name	
0(0-0)	< Inp >	< 16Pt>	[0]	[A1SX40	Basic
1(0-1)	< Inp >	< 32Pt>	[80]	[A1SX41	[A1S38B
2(0-2)	< Inp >	< 16Pt>	[20]	[A1SX40	Power Supply
3(0-3)	< >	< >	[]	[]	[A1S61P
4(0-4)	< >	< >	[]	[]	Extension Cable
5(0-5)	< >	< >	[]	[]	[]
6(0-6)	< >	< >	[]	[]	[]
7(0-7)	< >	< >	[]	[]	[]
8(1-0)	< >	< >	[]	[]	Extention 1
9(1-1)	< >	< >	[]	[]	[]
10(1-2)	< >	< >	[]	[]	Power Supply
11(1-3)	< >	< >	[]	[]	[]
12(1-4)	< >	< >	[]	[]	Extension Cable
13(1-5)	< >	< >	[]	[]	[]
14(1-6)	< >	< >	[]	[]	[]
15(1-7)	< >	< >	[]	[]	[]

Page Up : Prev Page Down : Next Esc : Close

The example of I/O assignment with GPP function

2) I/O numbers after performing I/O assignment using GPP function and replacing the module

A1S38B


	power supply module	CPU module	Input 16 points	Input 32 points	Input 16 points	Input 16 points	Output 16 points	Output 16 points	Output 16 points	Output 16 points
			X00 to X0F	X80 to X9F	X20 to X2F	X30 to X3F	Y40 to Y4F	Y50 to Y5F	Y60 to Y6F	Y70 to Y7F

POINT	<p>When the I/O number set for "Start XY" in the "I/OAssign" is changed, also set the "Start XY" for the next module to avoid changing the I/O numbers of the module for which the change was made and the subsequent modules.</p> <p>In the example above, since "20" is set for the "Start XY" for the second slot, consecutive I/O numbers starting from X30 are set for slot 3 and later.</p>
-------	---

- (3) When combining an input module and output module having non-consecutive I/O numbers on a base unit

When controlling the machine ① (I/O numbers X0 to X3F, Y40 to Y7F) and machine ② (I/O numbers X200 to X23F and Y240 to Y27F) with a single programmable controller, it is desired to combine input modules and output modules on the base unit. To achieve this operation, perform I/O assignment as follows.

(a) Loading status and I/O numbers to be set

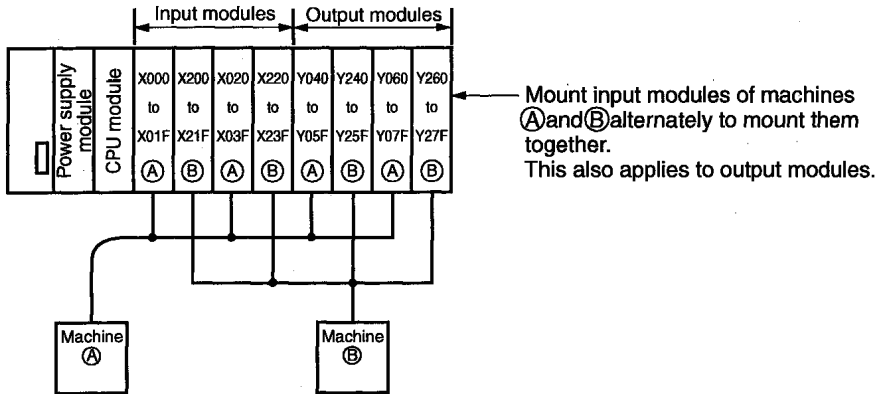

(b) The example of I/O assignment with GPP function

[I/O allocation]					Label
Slot	Type	ltime	1st XY	Type Name	
0(0-0)	<Inp>	<32Pt>	[0]	[A1SX41]	Basic
1(0-1)	<Inp>	<32Pt>	[200]	[A1SX41]	[A1S38B]
2(0-2)	<Inp>	<32Pt>	[20]	[A1SX41]	Power Supply
3(0-3)	<Inp>	<32Pt>	[220]	[A1SX41]	[A1S61P]
4(0-4)	<Out>	<32Pt>	[40]	[A1SY41]	Extension Cable
5(0-5)	<Out>	<32Pt>	[240]	[A1SY41]	[
6(0-6)	<Out>	<32Pt>	[60]	[A1SY41]	
7(0-7)	<Out>	<32Pt>	[260]	[A1SY41]	
8(1-0)	<>	<>	[]	[]	Extention 1
9(1-1)	<>	<>	[]	[]	[
10(1-2)	<>	<>	[]	[]	Power Supply
11(1-3)	<>	<>	[]	[]	[
12(1-4)	<>	<>	[]	[]	Extension Cable
13(1-5)	<>	<>	[]	[]	[
14(1-6)	<>	<>	[]	[]	
15(1-7)	<>	<>	[]	[]	

6 DATA COMMUNICATIONS WITH SPECIAL FUNCTION MODULES

This chapter explains the methods for reading data from a special function module, and writing data to a special function module with the Q2ASCPU.

The special function module is a module that allows analog quantity, high-speed pulse, etc., which cannot be processed with I/O module alone, to be handled by the Q2ASCPU. For example, analog quantity is converted to a digital value by an analog/digital converter module (which is a special function module) so that they can be used by the Q2ASCPU. The special function module has buffer memory in which data input from external sources and data to be output to external destinations are stored.


The following two methods are available for reading data from a special function module, and writing data to a special function module with the Q2ASCPU.

- 1) Using the FROM/TO instruction
- 2) Using special direct devices

These methods are explained in the following sections.

6.1 Reading/Writing Data from/to the Q2ACPU Using the FROM/TO Instruction

When the FROM/TO instruction is performed, data stored in the buffer memory of a special function module is read, or data is written to the buffer memory of a special function module.

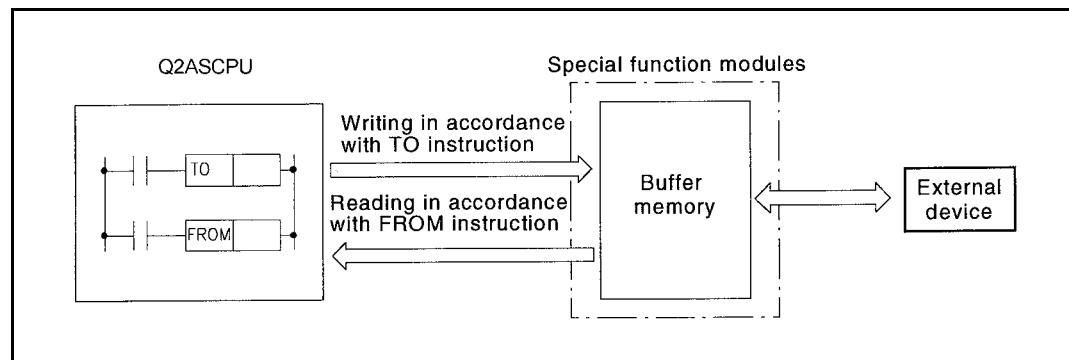

Data communications with a special function module

When the FROM instruction is performed, the data read from the buffer memory is stored in the specified device. When the TO instruction is performed, the data in the specified device is written to the buffer memory.

REMARK


- 1) For details on the FROM/TO instructions, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).
- 2) For details on the buffer memory of a special function module, refer to the manual of the special function module in use.

POINT

When executing the FROM/TO instruction for the special function module frequently in short scan time, it may cause the target special function module operation error.
When executing the FROM/TO instruction, match the processing time and conversion time of the special function module using timer or constant scanning.

6.2 Reading/Writing Data from/to the Q2ASCPU Using Special Direct Devices

As the FROM/TO instruction, the special direct device reads data stored in the buffer memory of a special function module or writes data to the buffer memory of a special function module.

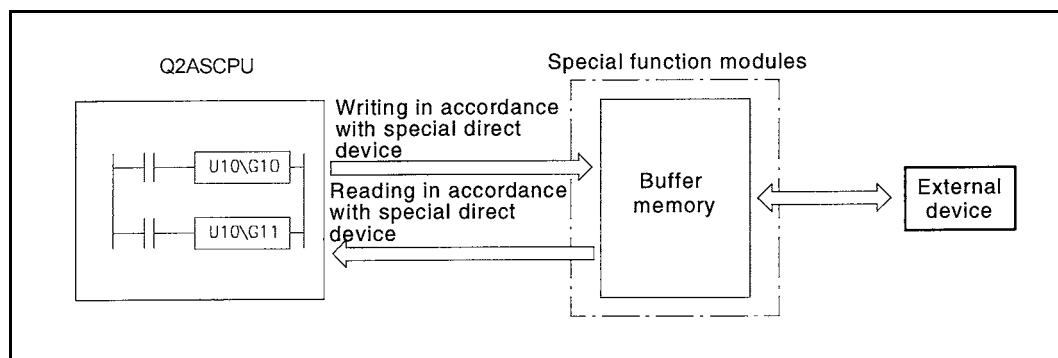

The special direct device represents the buffer memory in a special function module as the Q2ASCPU device.

Example: U10\G10: U10 → Indicates the head I/O No.100 of the special function module. (Hexadecimal)
G10 → Indicates the buffer memory address 10. (Decimal)

REMARK


For details on a special direct device, refer to the QnACPU Programming Manual (Fundamentals).

The special direct device differs from the FROM/TO instruction in that the CPU module can handle the buffer memory of a special function module as a direct device.


This can reduce the total number of steps in the program. However, the instruction processing speed is the same with the FROM/TO instruction.

Example: Writing data to address 0 of the buffer memory in the special function module loaded at X/Y0, and reading the data of address 1.

(a) Using the FROM/TO instruction

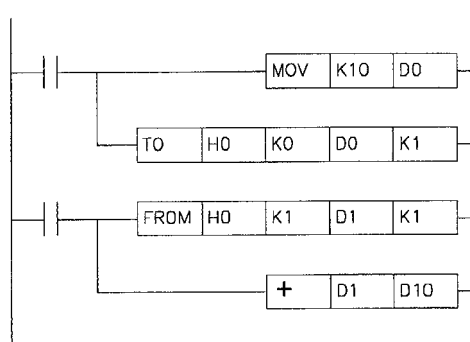

(b) Using special direct device

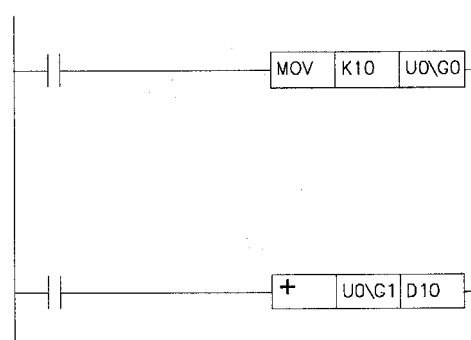

POINT	
1.	<p>When reading data from the special function module frequently during the programming, store the special direct device to a data register after reading in an area of the program by using the FROM instruction rather than by using them at each instruction.</p> <p>This is because programming scan interval is added due to an access processing to the special function module for each instruction.</p>
2.	<p>When executing the instruction using a special direct device for the special function module frequently in short scan time, it may cause the target special function module operation error.</p> <p>When performing the instruction using a special direct device, match the processing time and conversion time of the special function module using timer or constant scanning.</p>

6.3 Processing for Data Communication Requests from a Special Function Module

When a data communication request is received from a special function module such as a serial communication module, the Q2ASCPU performs the processing for the data communication request at the END processing.

The Q2ASCPU can process all the data communication requests received in one scan with one END processing, according to the parameter settings. In this case, the data lag to each module is eliminated, but the END processing is extended by the data communications request processing.

Data communications request batch processing is set in the "6. General Data Processing" on the "PC system" screen in the GPP function parameter mode.

The setting range is 1 to 6 modules, and the processing can be set per module.

[PC System Setting]		Label :
1. Timer Interval	1. Slow [100]ms 2. Fast [10]ms	5. Common Pointer # from []
2. RUN-PAUSE Contact	RUN X[] PAUSE X[]	6. General Data Process[1]Unit/try
3. Allow Remote Reset	1.<*> Yes 2.< > No	7. # of Free Slots < 16 >
4. Output at STOP->RUN	1.<*> Prior to Calc 2.< > After one Scan	8. System Interrupt
		1. 1st Interrupt Counter C[]
		2. I28 Const Interval[100]ms
		3. I29 Const Interval[40]ms
		4. I30 Const Interval[20]ms
		5. I31 Const Interval[10]ms
Execute<Y> Cancel<N>		
		Space:Select Esc:Close

7 AUTO REFRESH FUNCTION

7.1 For MELSECNET/MINI-S3


By setting link information, I/O storage device, etc. of the MELSECNET/MINI-S3 to the parameters, the module automatically communicates with the buffer memory area for the batch refresh send/received data of the type A1SJ71PT32 MELSECNET/MINI-S3 master module (abbreviated as the MINI master module hereafter).

The settings are made on the MELSECNET/MINI setting in the parameter mode of GPP function.

Sequence programs can be created using the I/O devices allocated to send/received by the MELSECNET/MINI-S3 setting. (The FROM/TO instructions are not required.)

POINT

- (1) Since up to 8 master modules can be set for auto refresh by the parameter, auto refresh is possible for up to 8 modules.
When 9 or more modules are desired, use the FROM/TO instruction in the sequence program from the 9th module.
- (2) Since auto refresh is not possible with send/received data for the separate refresh I/O modules and for the remote terminal units No.1 to No.14, use them by the FROM/TO instructions.
However, the remote terminal units shown below are subject of auto refresh in the limited area:
 - AJ35PTF-R2 RS-232C interface module
 - AJ35PT-OPB-M1-S3 mount-type tool box
 - AJ35PT-OPB-P1-S3 portable type tool box
- (3) For the master modules set up for auto refresh, since the Q2ASCPU automatically turns ON the link communication start signal Y(n+18) or Y(n+28), it is not necessary to turn it on from the sequence program.
- (4) Auto refresh of I/O data is performed by the batch after the Q2ASCPU performs the END instruction.
(Auto refresh processing is performed when the CPU module is in the RUN/PAUSE/STEP-RUN status.)
- (5) The master module may perform the processing while the link communication start signal Y(n+18) or Y(n+28) is OFF depending on the remote terminal units connected.
For instance, if the AJ35PTF-R2 RS-232C interface unit is used without protocol, it is necessary to write parameters to the parameter area (buffer memory address 860 to 929) while the link communication start signal is OFF. Since the link communication start signal becomes ON after the CPU module enters the RUN status and one scan is performed, write the parameters during the first 1 scan.

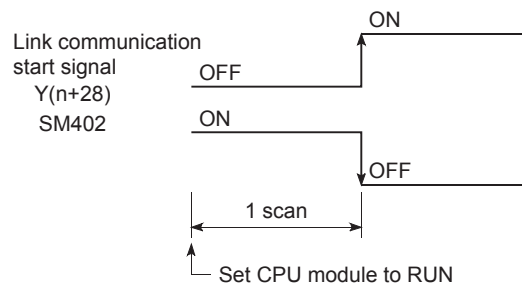

- (6) If the hardware error signal X(n+0) or X(n+20) or ROM error signal X(n+8) or X(n+28) of a master module for which auto refresh has been set comes ON, the Q2ASCPU does not perform auto refresh processing.
- (7) When making the settings, ensure that there is no duplication between receive data refresh devices and send data refresh devices.

- (1) Parameter setting items, setting ranges and contents of auto refresh, as well as the buffer memory address of the master module which is used for exchanging data with the Q2ASCPU are shown below.

Set the parameters for the number of the master modules used.

I/O signal from a master module	Buffer memory address of a master module	Item	Setting range	Description	Default value
—	—	Number of master modules	0, 1 to 8 module(s)	<ul style="list-style-type: none"> Sets the total number of the master modules used. Set "0" if auto refresh is not to be used. 	Follow the settings made in the "I/O Assign" in the parameter mode.*3
—	—	Start I/O No.	Number of I/O points of CPU module	<ul style="list-style-type: none"> Sets the head I/O number where the master module is installed. 	
—	—	Model classification of MINI/MINI-S3	<ul style="list-style-type: none"> MINI or MINI-S3 	<ul style="list-style-type: none"> MINI In I/O mode (occupies 32 points) MINI-S3 In expansion mode (occupies 48 points) 	
—	0	Total number of remote I/O stations	0 to 64 stations	<ul style="list-style-type: none"> Set only when MINI is set. In MINI-S3, since the number of master module's initial ROMs becomes valid, the setting is not necessary. (When the setting is executed, ignore it). 	
—	110 to 141	Storage device for received data *4	<ul style="list-style-type: none"> X M, L, B, T, ST, C, D, W, R, ZR, none (Bit device: multiples of 16)	<ul style="list-style-type: none"> Sets the devices to store the received/send data for batch refresh. Specify the head number of the device. The total number of remote I/O stations, set starting from the first device number, is occupied as a auto refresh area. (8 points/station × 64 stations = 512 points...: Bit device)² Use of X/Y remote I/O range is recommended for devices. 	X1000 to X11FF
—	10 to 41	Send data storage device	<ul style="list-style-type: none"> Y M, L, B, T, ST, C, D, W, R, ZR, none (Bit device: multiples of 16)		Y1000 to Y11FF
—	1	Number of retries	0 to 32 times	<ul style="list-style-type: none"> Sets the number of retries upon the communication errors occurrence. Error is not output when the communication is restored within the number of the retries set. 	5 times
Y(n+1A)*1	—	FROM/TO response specification	Link priority; CPU priority (Priority selection of access to the master module buffer memory)	1) Link priority <ul style="list-style-type: none"> Link access by MINI-S3 has the priority. During the link access, FROM/TO is caused to wait. Possible to read out the received data refreshed at the same timing. The maximum wait time (0.3ms + 0.2ms × number of separate refresh stations) for the FROM/TO instruction may be generated. 2) CPU priority <ul style="list-style-type: none"> The FROM/TO instructions from a CPU module are given access priority. Even during the link access, it interrupts and accesses. Depending on the timing, received data in the midst of I/O refresh may be read. No wait time for the FROM/TO instruction. 	CPU priority
Y(n+1B)*1	—	Data clear specification for communication faulty station	Retention, clear (received data)	<ul style="list-style-type: none"> Retention Retains the received data for batch and separate refresh. Clear Sets all points to OFF 	Clear

I/O signal from a master module	Buffer memory address of a master module	Item	Setting range	Description	Default value
—	100 to 103 195	Faulty station detection	M, L, B, T, ST, C, D, W, R, ZR, none (Bit device: multiples of 16)	<ul style="list-style-type: none"> Sets the head device to store the faulty stations detected data. MINI occupies 4 words; MINI-S3 occupies 5 words. 	No setting
—	107 196 to 203	Error No.	T, ST, C, D, W, R, ZR	<ul style="list-style-type: none"> Sets the head device to store the error code at the error occurrence. MINI occupies 1 word; MINI-S3 occupies (1 + Number of remote terminal modules) words. 	No setting
—	4	Line error check setting (Line error)	<ul style="list-style-type: none"> Test message sending (Test) OFF data sending (OFF) Immediate data transmission before line errors (Retention) 	<ul style="list-style-type: none"> Sets data sending method for verification of faulty area when the line errors occur. 	Retention
—	—	Operation at CPU STOP	Stop/Continue	<ul style="list-style-type: none"> Sets the operating status when the CPU module is in the STOP state. 	Stop

*1 "n" is determined by the installation location of the master modules.


*2 When the total number of remote I/O station is odd, add 1 to the station number to obtain the occupied storage devices.

*3 When the master module number setting column is made blank in parameter setting, auto refresh can be used without this setting.
However, model name registration is required in the "I/O Assign". (MINI mode: AJ71PT32, MINI-S3 mode: AJ71PT32-S3)

*4 When the input (X) is specified in the received data storage device, use the I/O number later than the number used for the module loaded on the main base unit and the extension base unit. When the I/O number usage range for the module loaded on the main base and the extension base is used for input/output of the received data storage device, the CPU module imports both the input ON/OFF data from the input module and the ON/OFF data from auto refresh of MELSECNET/MINI-S3. Therefore, input (X) of the CPU module is not operated as desired.

- (2) Setting of the send/received data storage devices is explained using the system example shown below.

(Example) When the device X/Y400 and later are used as the remote I/O stations:

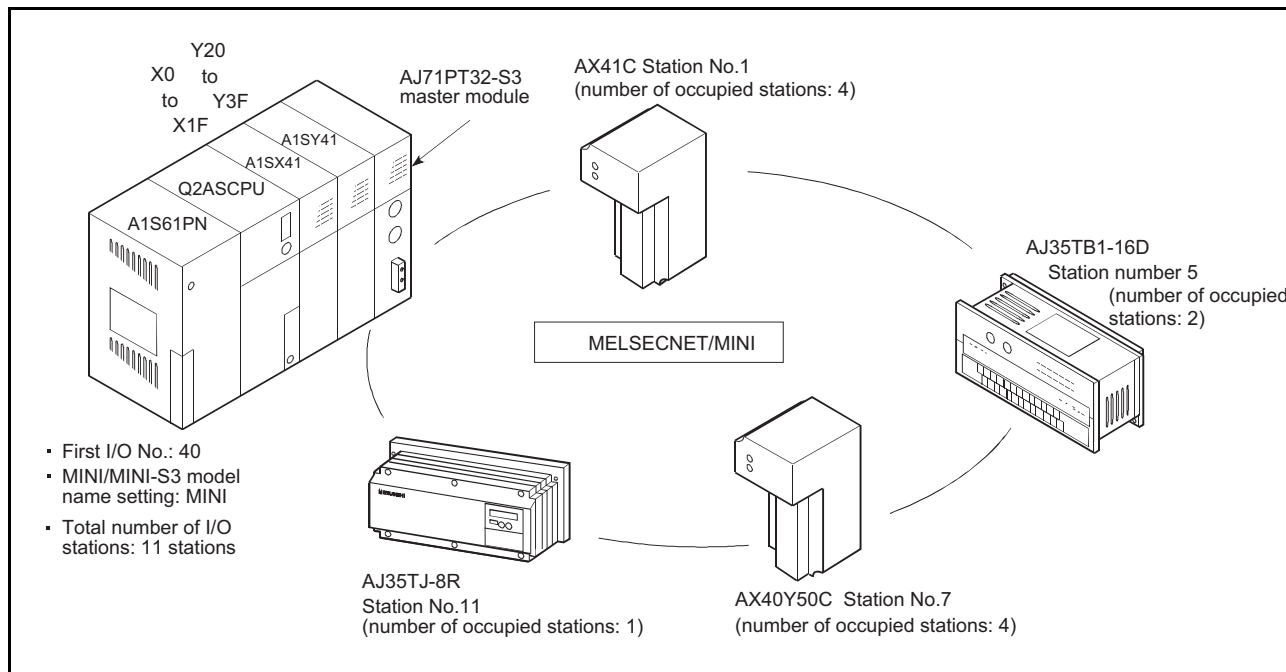

Sample parameter setting of the GPP function for the above system configuration is shown below:

[MELSECNET/MINI Setting]

1. Master Unit [1] Unit(s)

Execute(Y) Cancel(N)


Esc:Close



[MELSECNET/MINI Setting List]										Label :		
Unit	1st I/O #	Type	Status	Batch Refresh RX Data	Batch Refresh TX Data	Reply	Clr Err Data	Fault Detection Bit Data	Sta Error / Remote Error #	Loop Error Chk	Act at Stop	
1	40	S3	11	X400	Y400	5 CPU	Clr			Stor	Paus	

The storage devices for the send/received data for the present system example are as follows:

(a) Storage device for received data

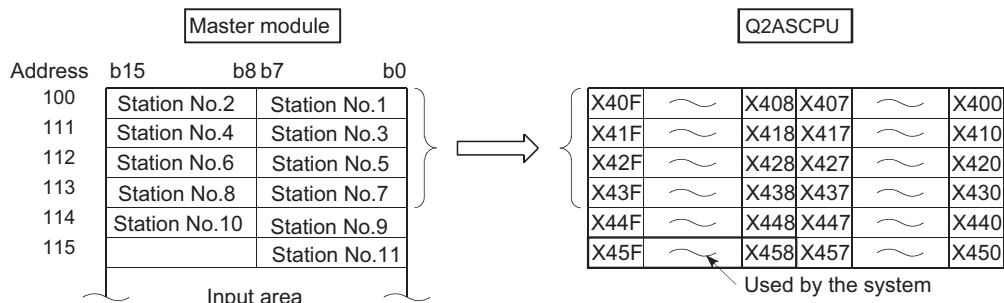


- 1) Set the device number (X400) for b0 of the station 1 as a received data storage device.
- 2) The received data storage device occupies from X400 to X45F.
For the present system example, since the total number of stations is odd, it is occupied for one extra station.
- 3) The device numbers of input modules connected are as follows:

Stations 1 to 4	AX41C	→	X400 to X41F
Stations 5 and 6	AJ35TB-16D	→	X420 to X42F
Stations 7 and 8	AX40Y50C	→	X430 to X43F

With respect to X440 to X45F, they are simultaneously refreshed, and set to OFF at any time.
Do not use X440 to X45F in the sequence program.

(b) Send data storage device

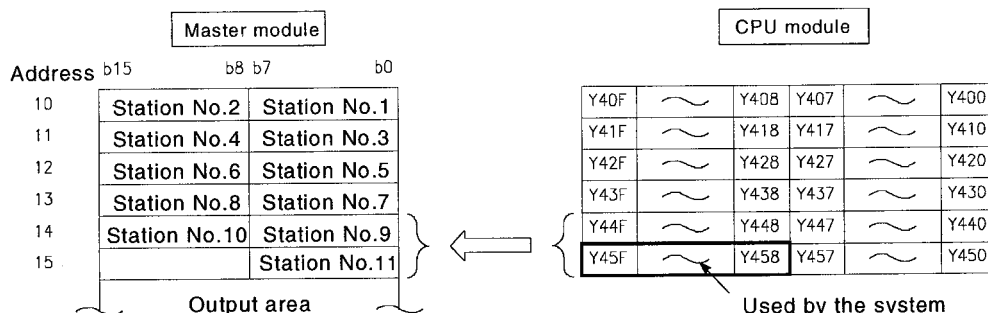

- 1) Set the device number (Y400) for b0 of the station 1 as a send data storage device.
- 2) The send data storage device occupies from Y400 to Y45F.
For the present system example, since the total number of stations is odd, it is occupied for one extra station.
- 3) The device numbers of output modules connected are as follows:
 Station 9 to 10 AX40Y50C → Y440 to Y44F
 Station 11 AJ35TJ-8R → Y450 to Y45F
 With respect to Y400 to Y43F and Y458 to Y45F, they are simultaneously refreshed, but are not output.

POINT												
(1) If the same device type is used for the send data storage devices and received data storage devices, make sure that there is no duplication of device numbers. When the received data storage device is set to B0 in the system configuration example, it occupies B0 to B5F as the device range. Set the send data storage device to B60 or later. When the send data storage device is set to B60, the device range will be B60 to BBF.												
(2) If a bit device is specified as the send/received data storage device, the device number set must be a multiple of 16. Example: <table><tr><td>(</td><td>X0, X10,</td><td>X100,</td><td>)</td></tr><tr><td>(</td><td>M0, M16,</td><td>M256,</td><td>)</td></tr><tr><td>(</td><td>B0, B10,</td><td>B100,</td><td>)</td></tr></table>	(X0, X10,	X100,)	(M0, M16,	M256,)	(B0, B10,	B100,)
(X0, X10,	X100,)									
(M0, M16,	M256,)									
(B0, B10,	B100,)									
(3) Device range used is (8 points) × (Number of stations). When the number of stations is an odd number, extra 8 points are necessary.												
(4) When specifying input (X) for the received data storage device, specify the device number out of the actual input (X) range.												


7.2 Auto Refresh Setting of CC-Link

Auto refresh of the CC-Link designates automatic communications between the Q2ASCPU and the buffer memory for cyclic communication of CC-Link master stations/local stations.

Data for communication varies depending on the remote station connected.

- Remote I/O station (Communication in ON/OFF data)
- Remote device station (Communication in ON/OFF data and Word data)
- Intelligent device station (Communication in ON/OFF data and Word data)
- Master station/local station (Communication in ON/OFF data and Word data)

The auto refresh setting of the CC-Link allows communication with other stations of CC-Link using the FROM/TO instruction without communicating with the master station of the CC-Link.

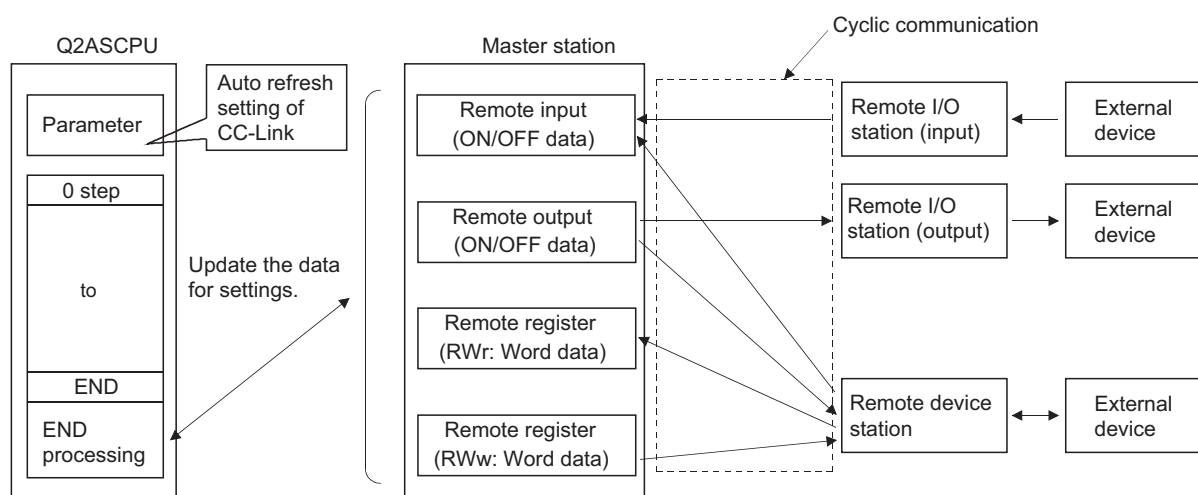

(1) Settings for auto refresh

The Table 7.1 shows the setting items for auto refresh parameters of the Q2ASCPU.

Table 7.1 List of auto refresh settings

Item	Description	Setting range	Setting station		
			M	L	T
Number of modules	The number of CC-Link modules is set.	1 to 8	○	○	○
Module head I/O number	The head I/O number of a CC-Link module is set.	0000H to 0FE0H	○	○	○
Module type	The loaded CC-Link module type (Master station, local station, stand-by station) is set.	<ul style="list-style-type: none"> • M: Master station • L: Local station • T: Stand-by station 	○	○	○
Receiving data batch refresh bit device (Input data)	<ul style="list-style-type: none"> • The device that stores the batch refresh received data from the remote station is set. • When the head device number is set, the points corresponding to the specified number of stations (Total number of stations) are obtained to refresh all areas. The output module area is also refreshed. • The settings are made in units of 16 points. 	X, M, L, B, T, ST, C, D, W, R, ZR*	○	○	○
Transmission data batch refresh bit device (Output data)	<ul style="list-style-type: none"> • The device that stores the batch refresh send data to the remote station is set. • When the head device number is set, the points corresponding to the specified number of stations (Total number of stations) are obtained to refresh all areas. The input module area is also refreshed. • The settings are made in units of 16 points. 	X, M, L, B, T, ST, C, D, W, R, ZR*	○	○	○
Receiving data batch refresh word device (Remote device: RWr)	<ul style="list-style-type: none"> • The device that stores the batch refresh received data from the remote station is set. • When the head device number is set, the points corresponding to the specified number of stations (Total number of stations) are obtained to refresh all areas. The I/O module area is also refreshed. • The settings are made per point. 	M, L, B, T, ST, C, D, W, R, ZR*	○	○	○
Transmission data batch refresh device (Remote device: RWw)	<ul style="list-style-type: none"> • The device that stores the batch refresh send data to the remote station is set. • When the head device number is set, the points corresponding to the specified number of stations (Total number of stations) are obtained to refresh all areas. The I/O module area is also refreshed. • The settings are made per point. 	M, L, B, T, ST, C, D, W, R, ZR*	○	○	○
Receiving buffer specification for transient station	• The receive buffer capacity for transient station is set.	80 to 4096	○	×	×
Transmission buffer specification for transient station	• The send buffer capacity for transient station is set.	80 to 4096	○	×	×
Batch refresh device for special relay	• The destination device for special relay is set.	M, L, B, T, ST, C, D, W, R, ZR*	○	○	○

* Only when the file register is set to "Use the designated file" with the "Parameter", R and ZR can be used as the auto refresh devices.

When "Use same file name as program" is set, R and ZR cannot be used.

REMARK

- 1) In "Setting station" in the table above, M refers to the master station, L to the local station, and T to the stand-by station.
- 2) In the table above, ○ means that the setting can be made and × means that the setting is not required.

Table 7.1 List of auto refresh settings (Continued)

Item	Description	Setting range	Setting station		
			M	L	T
Batch refresh device for special register	• The destination device for special register is set.	T, ST, C, D, W, R, ZR*	○	○	○
Auto update buffer specification	• The buffer capacity for automatic update is set.	128 to 4096	○	×	×
Total number of slave stations	• The last station number of the remote station connected to the master station is set.	1 to 64	○	×	×
Delay timer	• The delay time of link scan is set.	1 to 100 (0 is invalid.)	○	×	×
Standby station specification	• The use status of the stand-by master function is set.	• Not used • Used	○	×	×
Number of retries	• The number of retries at the occurrence of a transient transmission error is set.	1 to 7	○	×	×
Number of automatic return stations	• The number of automatic return stations is set to one link scan.	1 to 10	○	×	×
Operation specification for CPU stop	• When the CPU module has stopped, continuation/stop of the data link is set.	• Stop • Continue	○	×	×
Scan mode setting	• Synchronization/Non-synchronization is set to the CPU module scan.	• Non-synchronization • Synchronization	○	×	×
Station type	• The model for each remote station is set.	• Remote I/O station • Remote device station • Intelligent device station	○	×	×
Number of occupied stations	• The number of occupied stations for each remote station is set.	• 1 station • 2 stations • 3 stations • 4 stations	○	×	×
Specification of reserved station	• Reservation for remote station is set.	• Not reserved • Reserved	○	×	×
Specification of invalid station	• Validity/Invalidity for error detection of the remote station is set.	• Invalid • Valid	○	×	×

* Only when the file register is set to "Use the designated file" with the "Parameter", R and ZR can be used as the auto refresh devices. When "Use same file name as program" is set, R and ZR cannot be used.

REMARK

- 1) In "Setting station" in the table above, M refers to the master station, L to the local station, and T to the stand-by station.
- 2) In the table above, ○ means that the setting can be made and × means that the setting is not required.

(2) Precautions

- (a) Auto refresh of the CC-Link is available when the Q2ASCPU and the CC-Link module with function version "B" are used.
When either of the Q2ASCPU or the CC-Link module does not indicate function version "B," auto refresh of the CC-Link is not available.
- (b) Auto refresh can be set to up to 8 CC-Link modules.
When 9 or more CC-Link modules are used, handle with the FROM/TO instruction of the sequence program for the 9th module or later.
- (c) When both the CC-Link module and the master station module for MELSECNET/MINI-S3 are loaded and auto refresh is not set, the default parameter is set to the master station module for MELSECNET/MINI-S3.
- (d) The COM instruction or the G(P).ZCOM instruction allows auto refresh to the CC-Link module while performing the sequence program.
However, auto refresh to the CC-Link module cannot be performed with the J(P).ZCOM instruction. Error code "4102" (The network number designated with the dedicated network instruction does not exist) appears.
- (e) Refresh operation for the mixture of MELSECNET (/10, /II) and MELSECNET/MINI-S3.
- Refresh is performed in the order of MELSECNET (/10, /II), CC-Link and MELSECNET/MINI-S3.
Therefore, the input data specifying the same range is afterward overwritten with the executed data.
 - The output data is output to the MELSECNET (/10, /II), CC-Link, and MELSECNET/MINI-S3.
- (f) The operation of the Q2ASCPU when the CC-Link module is in the online/offline mode is shown in the table below:

Parameter settings for auto refresh	CC-Link module status	Operation of the Q2ASCPU
Set	Online	The communications with the remote station is performed with the specified parameter for auto refresh.
	Offline	The Q2ASCPU does not generate an error, but does not communicate with the remote station.
Not set	Online	The communications with the remote station is performed by the FROM/TO instruction.
	Offline	The Q2ASCPU does not generate an error, but does not communicate with the remote station.

- (g) Auto refresh setting to the CC-Link is performed using the following peripheral devices.
- Personal computer:
GX Developer, SW2IVD-GPPQ type GPP function software package

(3) Setting method

Auto refresh setting to the CC-Link is set with the following procedures.

- (a) When the "CC-Link" is selected in the "Parameter", the "CC-Link setting" screen appears.

[CC-Link setting]

1. Number of modules []

Execute(Y) Cancel(N)

Esc: Close

Set the number of the CC-Link modules (1 to 8).

- (b) Set the number of the CC-Link modules loaded on the main base unit and extension base unit for the Q2ASCPU and select "Execute", then the screen of CC-Link setting list appears.

Module number setting for refresh setting

[CC-Link setting]


Module	Starting I/O No.	Type	Batch refresh device					
			Remote input (RX)	Remote output (RY)	Remote register (RWw)	Remote register (RWw)	Special relay (SB)	Special register (SW)
1		M						

Esc: Finished

Confirmation of settings (Press **F3** key for setting.)

Pressing the **Esc** key registers the set data.

- (c) Move the cursor to the module number position for auto refresh setting and press the **F3** key (Detail). The "CC-Link setting" screen appears. Select "4. Auxiliary setting...." and "5. Station information setting...." to set detailed data.

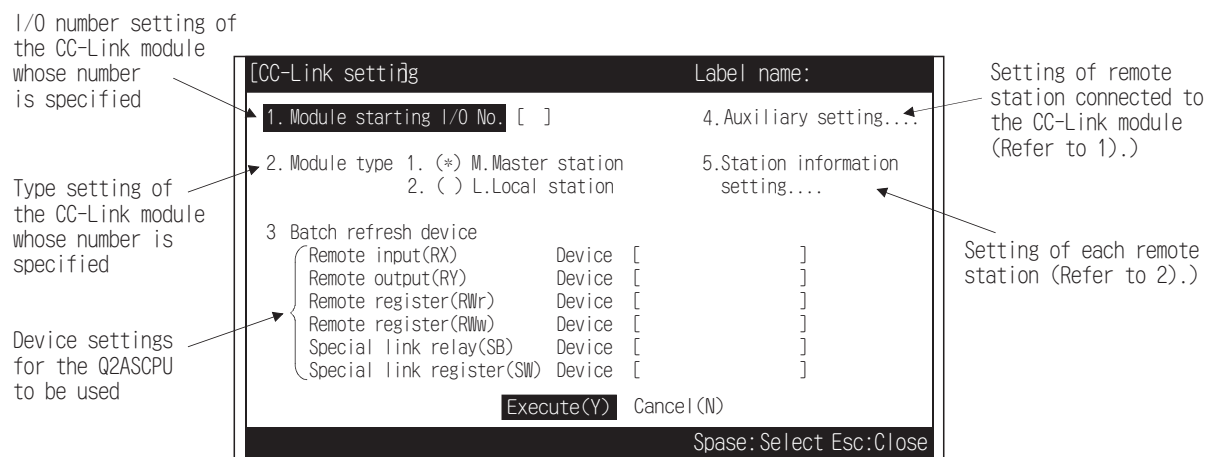

When pressing the Execute (Y) or the **Esc** key , the screen returns to the screen of CC-Link setting list.

- 1) When selecting the "4. Auxiliary setting....", the "Auxiliary setting" screen appears.

When pressing the **[Esc]** key, the screen returns to the CC-Link setting screen of (c).

Set the number of remote stations connected to the CC-Link module.

[Auxiliary setting]		Label name:
1. Total number of connected stations [64]	5. Number of automatic return stations [1]	
2. Delay timer [0] X0.05ms	6. Operation specified for CPU fault	
3. Standby station specification [0]	1. () Continue	
	2. (*) Stop	
4. Number of retries [3]	7. Scan mode specification	
	1. () Synchronous	
	2. (*) Asynchronous	
		Spase: Select Esc: Close

- 2) When selecting the "5. Station information setting...", the "Station information setting" screen appears.

When pressing the **[Esc]** key, the screen returns to the CC-Link setting screen of (c).

Set the number of stations specified in 2).

[Station information setting]				Label name:		
Station No.	Station type	Number of occupied stations	Reserved/invalid station	Intelligent buffer specification (word)		
				Send	Receive	Auto
1	< I/O >	< 1 >	< >	[---]	[---]	[---]
2	< I/O >	< 1 >	< >	[---]	[---]	[---]
3	< I/O >	< 1 >	< >	[---]	[---]	[---]
4	< I/O >	< 1 >	< >	[---]	[---]	[---]
5	< I/O >	< 1 >	< >	[---]	[---]	[---]
6	< I/O >	< 1 >	< >	[---]	[---]	[---]
7	< I/O >	< 1 >	< >	[---]	[---]	[---]
8	< I/O >	< 1 >	< >	[---]	[---]	[---]
9	< I/O >	< 1 >	< >	[---]	[---]	[---]
10	< I/O >	< 1 >	< >	[---]	[---]	[---]
11	< I/O >	< 1 >	< >	[---]	[---]	[---]
12	< I/O >	< 1 >	< >	[---]	[---]	[---]
				Spase:Select Esc:Close		

8 DEBUGGING FUNCTION

8.1 Function List

Q2ASCPU has a variety of convenient functions when debugging.

The following shows the debugging functions.

Item	Description	Reference
Monitor function	Function that reads CPU programs, device statuses from a peripheral device capable of GPP functions	Section 8.2
Write during RUN	Function that writes a program while the CPU module is running	Section 8.3
Execution time measurement	Functions that displays the processing time of a program being execute	Section 8.4
Program monitor list	Functions that displays the processing time of a program being executed	Section 8.4.1
Interrupt program monitor list	Function that displays the number of executions of an interrupt program	Section 8.4.2
Scan time measurement	Function that measures the execution time of section of a program	Section 8.4.3
Sampling trace function* ¹	Function that continually collects the data of devices in accordance with a timing set at the CPU module	Section 8.5
Status latch function* ¹	Function that collects the device data at the moment to designate	Section 8.6
Step operation	Functions that runs one step or one part of a program, runs a program with a part skipped	Section 8.7
Step execution	Function that runs a program step by step	Section 8.7.1
Partial execution	Function that executes a designated part of a program	Section 8.7.2
Skip execution	Function that executes a program with a designated part skipped	Section 8.7.3
Program trace function* ¹	Function that collects the program execution status	Section 8.8
Simulation function* ²	Function that simulats execution in isolation from the I/O modules and special function modules	Section 8.9
Debugging by several people	Function that simultaneously debuggs from several peripheral devices capable of GPP functions	Section 8.10
Monitoring trace function	Function that collects device data at a peripheral device capable of GPP functions in accordance with the designated timing	—

For details on the operation for each function, refer to the GPP function Operating Manual.

*1 When executing this function, a memory card is required.

*2 When executing part of this function, a memory card is required.

8.2 Monitor Function

This function reads CPU module programs and device statuses to a peripheral device capable of GPP functions.

Application

This function is used to set monitoring conditions for monitoring the operating statuses of the programmable controller in accordance with a precise timing. There are three "Monitoring Condition" as follows.

- Executing a monitoring at END processing.
- Setting the step number to be monitored and the step conducting status.
- Setting the device status.

This function is used to retain the monitoring screen by setting "Monitor stop condition setup" in accordance with a precise timing.

When monitoring the CPU module marked Function version B using a peripheral device capable of GPP function, local device monitor test is executed by setting "local device monitor".

8.2.1 Monitoring condition setting

Function Description

- (1) This function allows setting of the monitoring condition.
All operations are performed using Monitor/test menu in the ladder mode.
The following shows an example of setting a monitor condition.

[Monitoring Condition]			
1.< > Monitor Always.			
2.<*> Condition		Device	Current Value
1.[*] Device	1.< > Word Device [= [
	2.<*> Bit Device [Y70		= < ↑ >
2.[*] Step #	[100]= < ↑ >		
		Execute<Y>	Cancel<N>
Space:Select Esc:Close			

The following shows an explanation of the screen above:

The monitoring condition can be select either "1. () Monitor Always." or "2. () Condition".

- (a) When "1. () Monitor Always." is set

The collection timing for monitor data is every scan after END processing at the CPU module.

(b) When "2. () Condition" is set

"1. [] Device" and "2. [] Step #" can be set.

1) When only "2. [] Step #" is set

The monitor data collection timing is the moment when a QnACPU shows designated status immediately before executing the designated step.

The following shows the possible designations to execute.

- When switching from OFF to ON: :< ↑ >
- When switching from ON to OFF: :< ↓ >
- All the time only during ON :< ON >
- All the time only during OFF :<OFF >
- All the time in any statuses :<Always>

REMARK


- 1) When Step # [0] is designated, the execution condition must be set as Always.
- 2) When "1. [] Device" only is specified (when "2. [] Step #" is not specified), the monitor data collection timing is every scan after END processing of the programmable controller CPU.
When the data is changed in the same scan, it cannot be detected. (Including the low-speed program)
- 3) When only "1. [] Device" is set, either
"1. () Word Device" or "2. () Bit Device" can be designated.
 - ① When "1. () Word Device" is designated
The collection timing of the monitor data is the scan END processing when the current value of the specified word device becomes the specified value.
The following shows the method for designating the current value.
 - Decimal designation: [K




Decimal number

]
 - Hexadecimal designation: [H

Hexadecimal number

]
 - ② When "2. () Bit Device" is designated
The collection timing of the monitor data is the scan END processing when the execution status of the specified bit device becomes the specified status.
The following shows the possible designations for execution status.
 - At leading edge :< ↑ >
 - At trailing edge :< ↓ >
- 4) When "2. [] Step #" and "1. [] Device" are designated
The monitor data collection timing is such that data is collected when the status immediately before execution of the designated step or the execution status (current value) of the designated bit device (word device) attains the designated status.

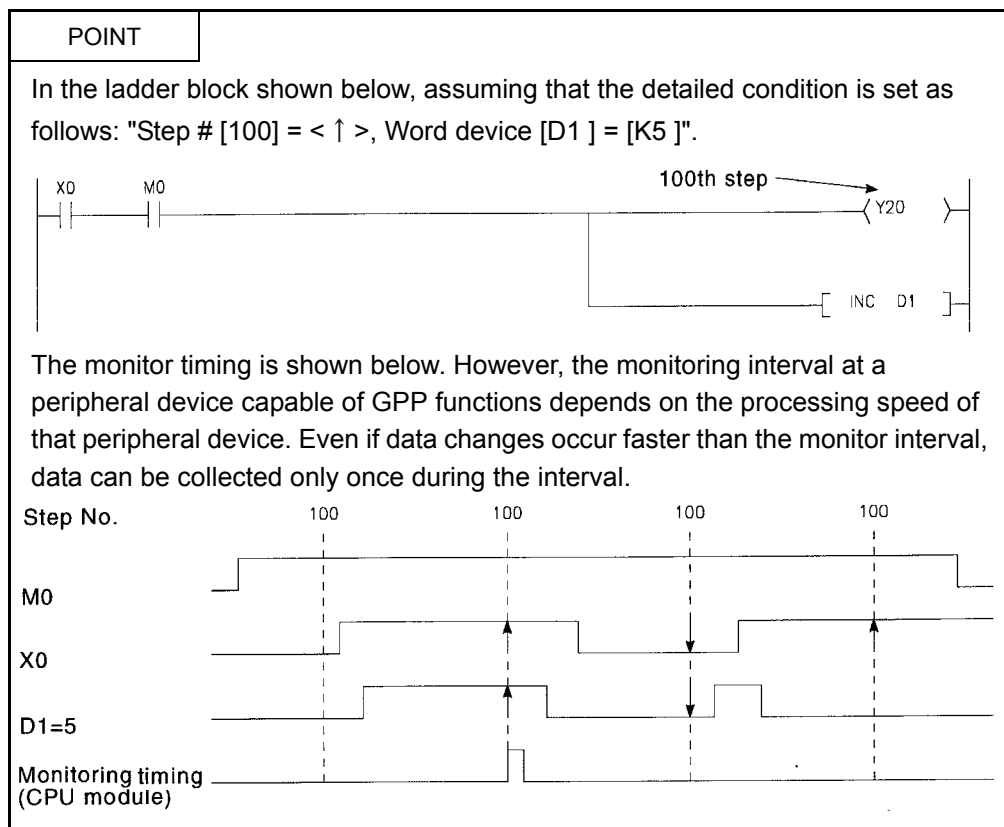

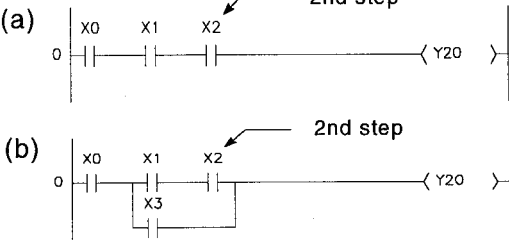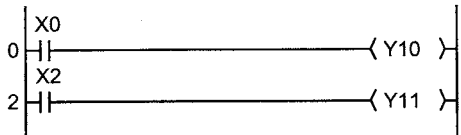POINT	
(1)	<p>Assume that "Step # [2] = <ON>" is designated as the detailed condition in the case of the ladders shown below; In this case the monitor execution differs for the two ladders. For (a) it is "X0 and X1 both ON" and for (b) it is "X1 ON (regardless of ON/OFF status of X0)".</p> <p>If a step part way through an AND/OR block is designated for a monitor condition, the monitor data collection timing is such that data is collected when the status immediately before execution of the step designated from the LD instruction in the block becomes the designated status.</p> <div><div><p>Ladder mode</p><p>(a) </p><p>(b) </p></div><div><p>List mode</p><p>0 LD X0 1 AND X1 2 AND X2 3 OUT Y20</p><p>0 LD X0 1 LD X1 2 AND X2 3 OR X3 4 ANB 5 OUT Y20</p></div></div> <p>(2) If the ladder block head other than 0 step is specified to the step number as detailed conditions, the monitor data is collected when the instruction execution status immediately before execution is the specified status.</p> <p>When "Step # [2] = <ON>" is specified in the ladder below, the monitor data is collected for OUT Y10 ON.</p> <div><div><p>Ladder mode</p><p></p></div><div><p>List mode</p><p>0 LD X0 1 OUT Y10 2 LD X1 3 OUT Y11</p></div></div>

- (2) A monitor stop condition can be set.

All operations are performed on the monitor/test screen window in the ladder mode.

The following shows an example of the setting for a monitor stop condition.

[Monitor Stop Condition]			
1. < > Without Monitor Stop			
2. < * > Condition		Device	Current Value
1. [*] Device	1. < > Word Device [] = [
	2. < * > Bit Device [Y71] = < ↑ >
2. [] Calculation State < Always >			
		Execute < Y >	Cancel < N >
Space: Select Esc: Close			

The following shows an explanation of the screen above:

Either "1. () Without Monitor Stop" or "2. () Condition" can be set for the monitor stop condition.

- (a) When "1. () Without Monitor Stop" is set

Monitoring is stopped when Esc key is pressed.

- (b) When "2. () Condition" is set

"1. [] Device" and "2. [] Calculation State" can be set.

- 1) When "2. [] Calculation State" is set

The monitor stop timing is such that monitoring stops when the execution condition of the step designated for the monitor condition attains the designated status.

The following shows the possible designations for execution status.

- When switching from OFF to ON : < ↑ >
- When switching from ON to OFF : < ↓ >
- All the time only during ON : < ON >
- All the time only during OFF : < OFF >
- All the time in any statuses : < Always >

If "2. [] Calculation State" isn't set, the timing for monitor stop is such that monitoring is stopped after CPU module END processing.

- 2) When "1. [] Device" is set Either
 "1. () Word Device" or "2. () Bit Device" can be set.

① When "1. () Word Device" is set

The monitor stop timing is such that monitoring stops when the present value of the designated word device attains the designated value.
 The following shows the method for designating the current value.


- For decimal (word) designation : [K]
- For hexadecimal (word) designation : [H]
- For decimal (double word) designation: [K L]
- For hexadecimal (double word) designation : [H L]
- For real number designation : [E]

② When "2. () Bit Device" is designated


The monitor stop timing is such that monitoring stops when the execution status of the designated bit device becomes the designated status.
 The following shows the possible designations for execution status.

- At leading edge : < ↑ >
- At trailing edge : < ↓ >


- (3) In the case of devices for which index qualifications have been made, the index qualified value is monitored.
 The following shows an example of this type of monitoring.

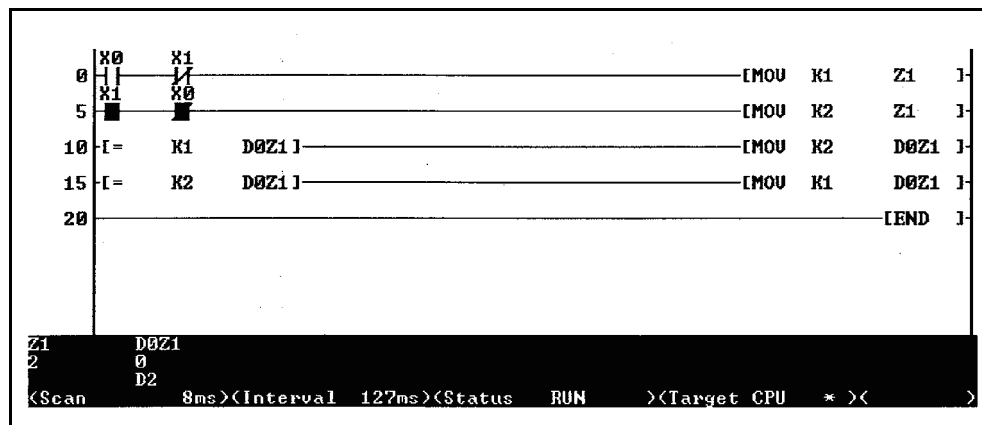

- (4) The ON status of comparison instructions can be monitored.
The following shows an example of this type of monitoring.

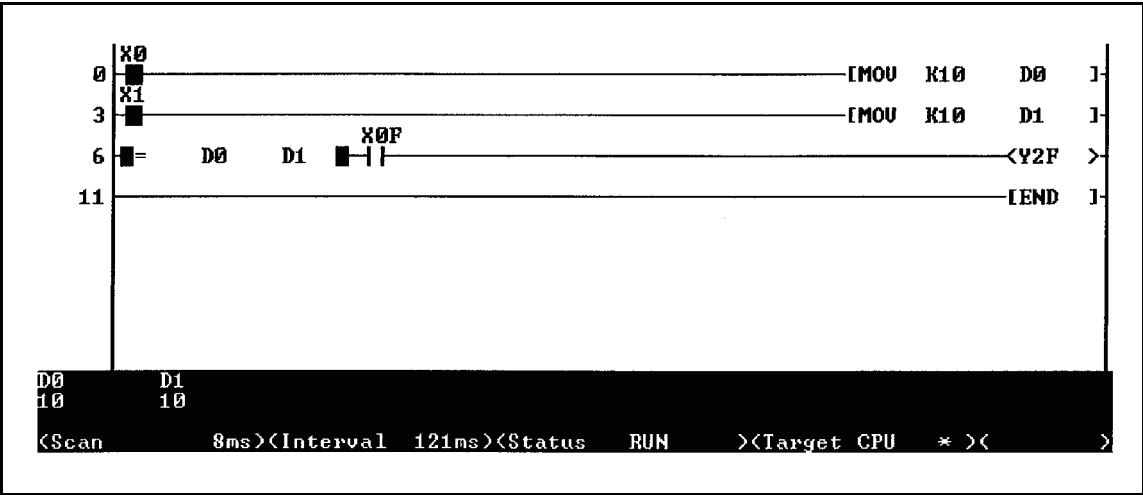


- (5) The devices of special function modules can be monitored.
The following shows an example of this type of monitoring.

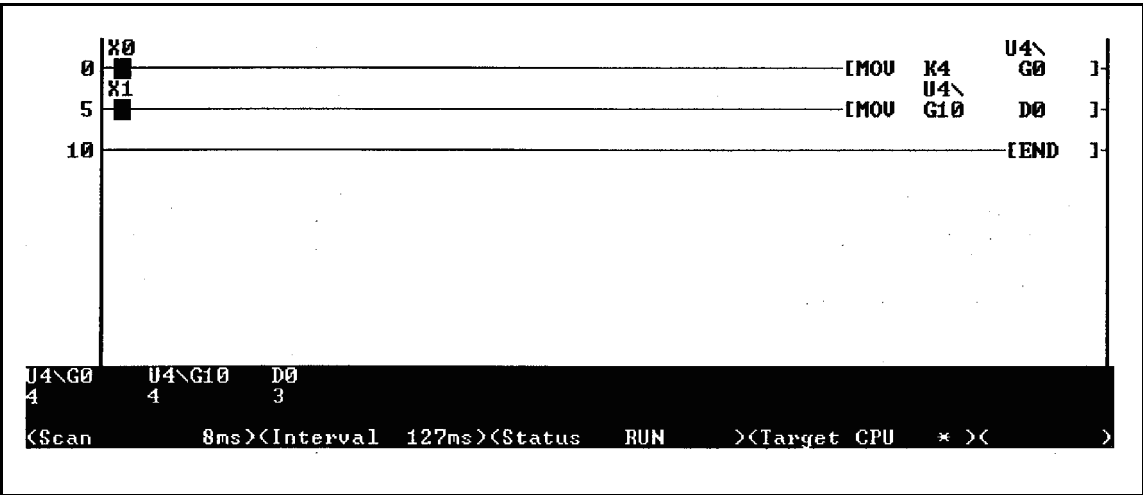

REMARK

To monitor devices of special function modules, set "2. Buffer Memory 1. Monitor" for "5/Monitor Target Setting" under the ladder mode "Option" menu.

- (6) Real numbers and character strings can be monitored.
The following shows an example of this type of monitoring.

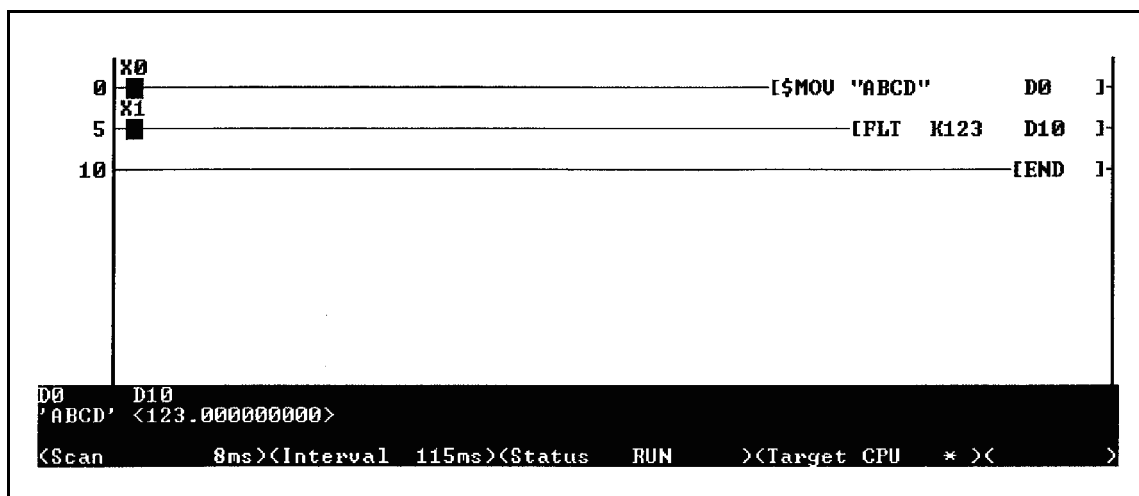

- (7) The following shows the devices that can be monitored.
- (a) Bit devices : X, FX, DX, Y, FY, DY, M, L, F, SM, V, B, SB, T(Contact), T(Coil), ST(Contact), ST(Coil), C(Contact), C(Coil), J□\X, J□\Y, J□\B, J□\SB, BL□\S
- (b) Word device : T(Current value), ST(Current value), C(Current value), D, SD, FD, W, SW, R, Z, ZR, U□\G, J□\W, J□\SW
- (8) The following shows the setting device under the detailed condition.
- (a) Bit device : X, FX, Y, FY, M, L, F, SM, V, B, SB, T(Contact), ST(Contact), C(Contact), J□\X, J□\Y, J□\B, J□\SB, BL□\S
- (b) Word device : T(Current value), ST(Current value), C(Current value), D, SD, FD, W, SW, R, Z, ZR, U□\G, J□\W, J□\SW

The following qualifications are possible with respect to the devices listed above.

- Digit designation for bit devices
- Bit number designation for word devices

NOTE


- 1) When a monitoring is performed with a monitor condition set, the file displayed at the device running GPP function is monitored.
Make sure that the file name used with GPP function is the same as the file name when monitoring is performed by executing "Newly from PLC".
- 2) When the buffer memory of a peripheral device is read by designating a direct device, FFFFH is monitored if the peripheral device is faulty or not connected.
- 3) When monitoring file registers, FFFFH is monitored if no file register designation is made.
- 4) Before monitoring, make sure that the device assignment of the CPU and GPP function agree.
- 5) For the local device monitor in each program file, the monitor operation varies depending on presence of the CPU module function version B and the GPP function model.
[Without function version B]
 - Detailed conditions (step number and device condition) are set for each program file to perform monitoring.
[With function version B]
 - When the GX Developer and the SW2IVD-GPPQ are used, the local device can be monitored in each program file by setting compatibility with local device.(Refer to Section 8.2.2.)
 - When SW0IVD-GPPQ and SW1IVD-GPPQ are used, the local device can be monitored with the same operation as the operation without function version B.
- 6) When monitoring the buffer memory of a special function module, the scan time is prolonged in the same way as it is when a FROM/TO instruction is executed.
- 7) Several people can perform monitoring at the same time.
The following considerations apply when executing this:
 - High-speed monitoring can be made possible by increasing the system area by 1k steps for each monitor for other station use when formatting the built-in RAM.
In the monitor for other stations, 15k steps maximum can be set in the system area and the corresponding file space for the user is reduced.
 - Only one person can set the detailed conditions for monitoring.
- 8) The detailed conditions for monitoring can only be set in ladder monitoring.
- 9) If the same device is designated for both a monitor condition and monitor stop condition, also designate the "ON" or "OFF" status.
- 10) When the step number is specified for the monitor condition, monitor conditions are not satisfied for no execution of the applicable step instruction as shown below:
 - Applicable step instructions are skipped by CJ, SCJ and JMP instructions.
 - The applicable instruction is the END instruction and the FEND instruction exists in the program.
- 11) Do not reset the CPU module while the monitor condition is registered.

8.2.2 Monitor test of local device (function version B or later)

With the "parameter device setting," the device set in the local device can be monitored and tested in the peripheral device.

This function allows debugging while checking details of the local device by peripheral devices.

To monitor the local device, set the peripheral device to "local device monitor". The following fig. is an example that monitoring the local device of program B with the CPU module, which is executing programs A, B and C.

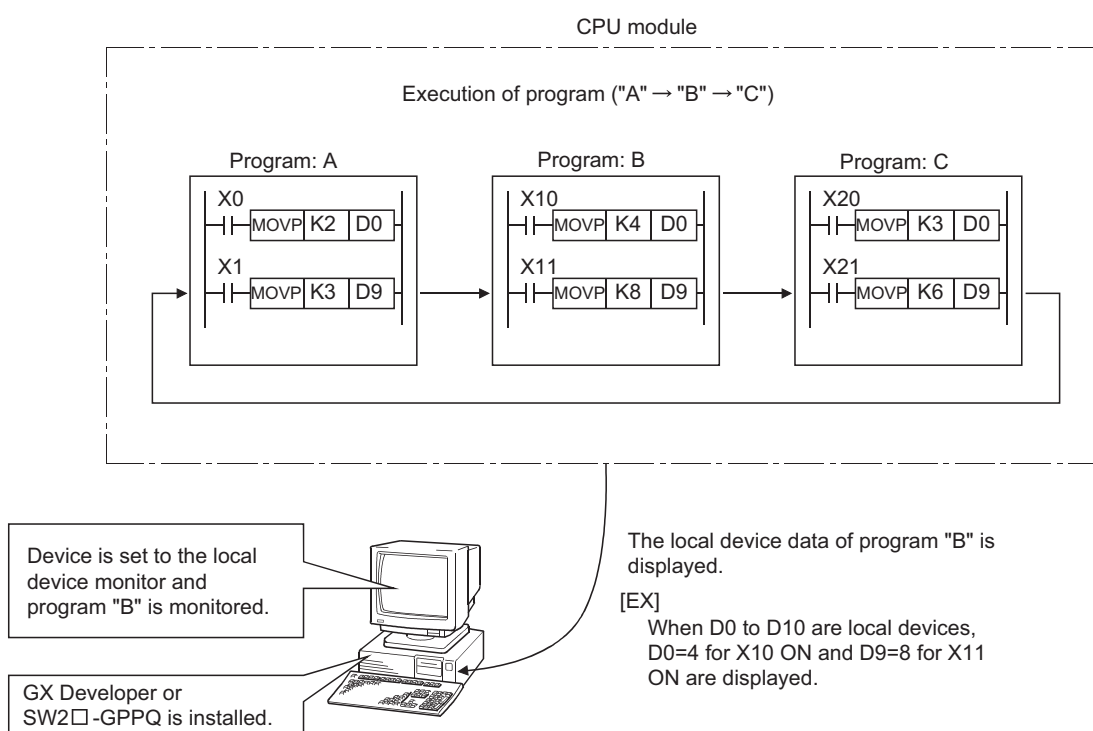


(1) Peripheral device

To perform monitor test of the local devices, the following GPP function software packages are required:

- Personal computer
GX Developer, SW2IVD-GPPQ type GPP function software package

(2) Monitoring procedures of local device

The following shows the procedures to be monitored local devices:

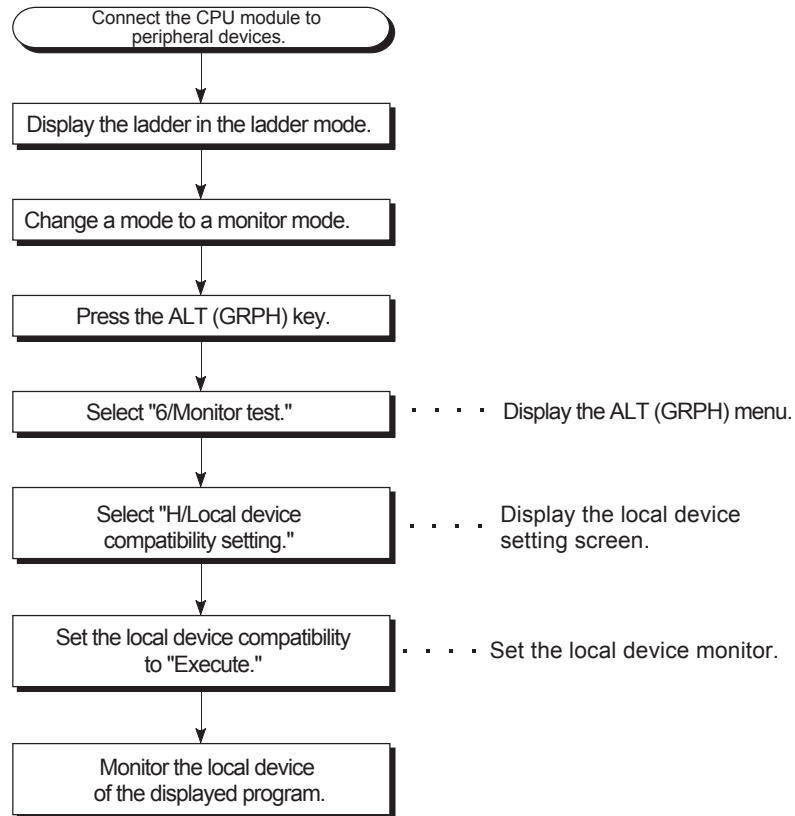

(3) Operation for CPU module and GPP function versions

Table 8.1 shows the operation when the local devices are set to D0 to D99 and when 3 programs with the program names of "A", "B" and "C" are performed in the CPU module.

(The order of the programs is A, B, C, (END processing), A, B...)

Table 8.1 Operation for CPU module and GPPQ function versions

GPPQ Model Name		Monitor Device			
		With Function Version "B"		Without Function Version "B"	
		D0	D100	D0	D100
SW0□-GPPQ SW1□-GPPQ		D0 of program "C" is monitored.	D100 after execution of program "C" is monitored.	D0 of program "C" is monitored.	D100 after execution of program "C" is monitored.
SW2□-GPPQ	When local device is not set	D0 of program "C" is monitored.	D100 after execution of program "C" is monitored.	D0 of program "C" is monitored.	D100 after execution of program "C" is monitored.
	When local device is set	D0 of the displayed program is set.	D100 after execution of the displayed program is set.	An error (error code: 4001) occurs.	

REMARK

GX Developer supports functions of function version B.

(4) Precautions

- (a) The local device that can perform the monitor test in one peripheral device is only one program.

Monitor test for multiple program local devices from one peripheral device is not allowed.

- (b) The number of programs that allows simultaneous monitor test from multiple peripheral devices is up to 16.

When the local device of the stand-by type program is monitored, the local device data is read/escape. The scan time is extended as follows:

- Q2ASCPU(S1) : $560 + 1.3 \times (\text{Number of words in the local device}) [\mu\text{s}]$
- Q2ASHCPU(S1) : $220 + 0.8 \times (\text{Number of words in the local device}) [\mu\text{s}]$

8.3 Write During RUN

This is a function that writes a program to the CPU while the CPU module is in the RUN.

**CAUTION**


- Read the manual carefully and confirm safety before changing the program during operation.
An operation error of write during run may result in damage to the machine or accident.


Application

This function is used to change a program without stopping program execution.


Function Description

- (1) Write during RUN is possible from multiple peripheral devices capable of GPP functions with respect to one file.
In order for this, designate the pointer for the programs to be written from the peripheral devices capable of GPP functions in advance. This enables write safely during RUN using peripheral devices capable of GPP functions.

The example below shows a case where peripheral device capable of GPP functions A performs write during RUN from P0, and peripheral device capable of GPP functions B performs write during RUN from P1. The program enclosed in the frame  is the program subject to write during RUN.

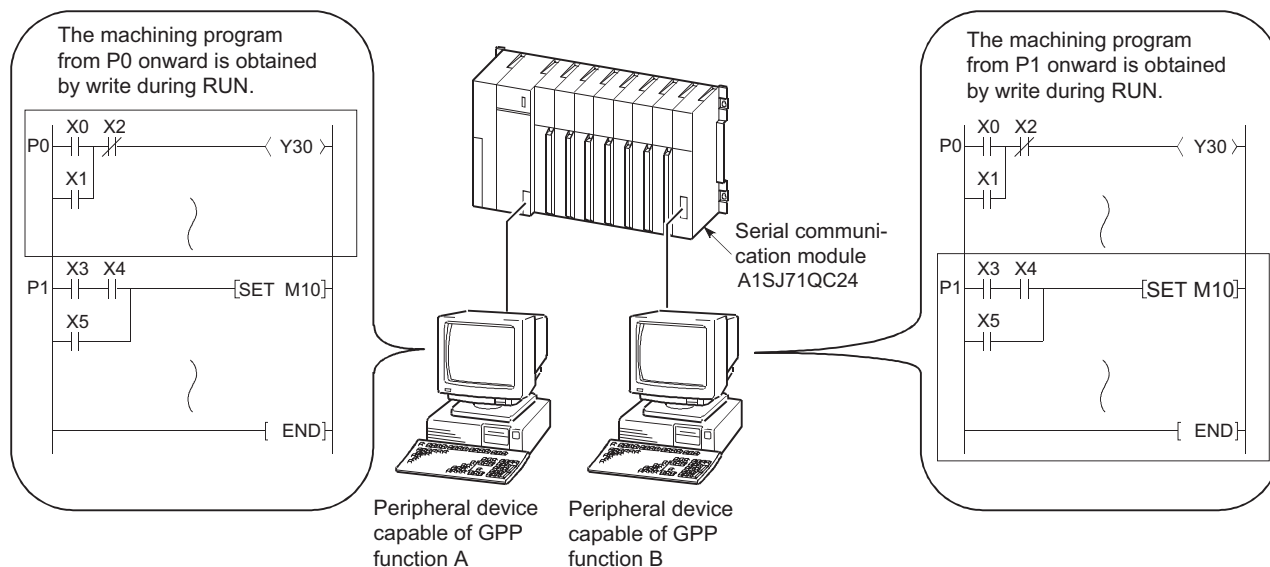

- (2) It is possible to write programs from peripheral devices capable of GPP functions that are connected to other stations in the network during the RUN.

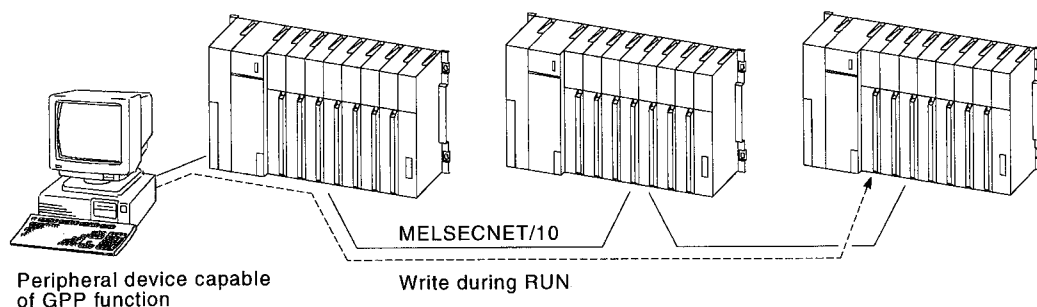

Operation Procedures

To write from the GPP function peripheral devices during RUN, the following two methods are available:

- (1) After a ladder is created in the ladder mode, write during RUN is performed by pressing + keys for conversion of the ladder.
- (2) With "4. Write/conversion setting" in "8/ Option" menu of the ladder mode, "4. Write setting during RUN" and "7. Write method during RUN" are set.

When the key is pressed for conversion of the ladder after the ladder is created, write during RUN is performed.

The following shows the setting examples:

[Write and conversion setting]	
4. Write setting during RUN	1. (*) After conversion, PC is written during RUN. 2. () After conversion, PC is written if PC is STOP. 3. () After conversion, PC is not written.
7. Write method during RUN	1. (*) Write during normal RUN 2. () Write during relative RUN with pointer


- (a) In "4. Write setting during RUN," "1. () After conversion, PLC is written during RUN" is set.
- (b) In "7. Write method during RUN," "1. () Write during normal RUN" or "2. () Write during relative RUN with pointer" is selected.

NOTE

The following shows the precautions relating to write during RUN.

- (1) The only memory that can be used for write during RUN is the built-in RAM. If write during RUN is performed during a boot operation, also write the program to the memory card at STOP.
When the boot operation is started again without write on the memory card, the program before write during RUN is transferred from the memory card to the built-in RAM for execution.
- (2) The maximum number of steps that can be handled in one write during RUN operation is 512.
The number can be changed according to how many steps of write during RUN saved using a peripheral device capable of GPP function. The saved steps of write during RUN can be set during the CPU module OFF. Note that the saved steps of write during RUN decrease every time write during RUN is performed.

- (3) During low-speed program execution, write during RUN is started when execution of all low-speed programs is completed. Also, execution of low-speed programs is suspended during write during RUN.

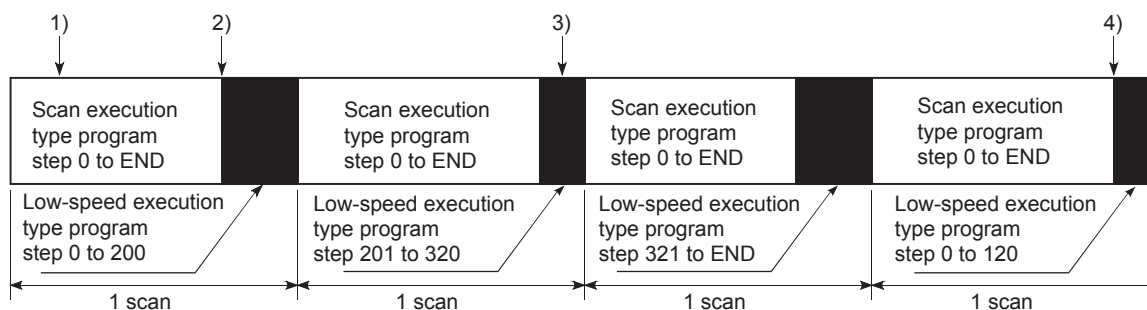

- 1): Write during RUN command of scan execution type program
 2): Write during RUN execution of scan type program
 3): Write during RUN command of low-speed execution type program
 4): Write during RUN execution of low-speed execution type program

POINT	
Write during RUN cannot be performed on the program in step operation.	

8.4 Execution Time Measurement

This is a function that displays the processing time of the program being executed.

Application

This function is used to determine the influence of the processing time of each program on the total scan time when making system adjustments.

Function Description

Execution time measurement provides the following three functions. For explanations of each function, refer to Section 8.4.1 through Section 8.4.3.

- Program monitor list
- Interrupt program monitor list
- Scan time measurement

8.4.1 Program monitor list


This is a function that displays the processing time of the program being executed.

Function Description

The scan time, execution count, and processing time for each item can be displayed for each program.

All operations are performed using Monitor/test menu in the ladder mode.

- (1) Select "Program Batch Monitor".

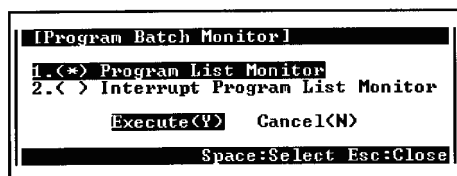

- (2) Select "Program List Monitor".

The following shows an example of execution of the program list monitor when a constant scan time of 120ms is set.

(a) → **[Program List Monitor]**

(b) → **<Total Scan Time>**

(c) → **<Program Status>**

	Mon Time	Max Scan
Scan	200ms	120.000ms
Init	ms	120.000ms
Slow	ms	0.200ms

(b) → **<Time Details / Scan>**

Program	0.300ms
END Proc Time	119.700ms
Slow Prog	110.600ms
Wait for Con	112.200ms

#	Program	Exec	Scan Time	Ex Times
1	INITIAL	Init	0.100ms	1 x
2	MACHINE	Scan	0.100ms	1400 x
3	ASSEMBLY	Scan	0.100ms	1400 x
4	TRANSFER	Scan	0.100ms	1400 x
5	TEST	Wait	0.000ms	0 x
6	MONITOR	Slow	0.300ms	57221 x
7		Wait	0.000ms	0 x
8		Wait	0.000ms	0 x
9		Wait	0.000ms	0 x
10		Wait	0.000ms	0 x
11		Wait	0.000ms	0 x

PgUp:Prev PgDn:Next Esc:Close

The following shows an explanation of the screen above:

- (a) "Total Scan Time"

The times set in "5.() PC RAS Setting" for monitor time and scan time total are displayed here for each program type.

- 1) "Mon Time"

The monitor times for scan execution type programs, initial execution type programs, and low-speed execution type programs are displayed here.

If the scan time exceeds the time displayed here, a watchdog timer error occurs at the CPU module.

- 2) "Max Scan"

The total time for the items listed under "Time Details / Scan" is displayed here.

- (b) "Time Details / Scan"

The scan time details are displayed here.

- 1) "Program"

The total execution time of scan execution type programs is displayed here.

- 2) "END Proc Time"

The END processing time is displayed here.

- 3) "Slow Prog"

When an execution time for low-speed execution type programs is set, the total execution time for low-speed execution type programs is displayed here.

- 4) "Wait for Con"

When constant scan is set, the constant scan waiting time is displayed here. However, if an execution time for low-speed execution type programs is also set, 0.000 ms is displayed.

(c) "Program Status"

The times set in "9. () Auxilliary Setting" in the parameter mode are displayed here.

1) "Program"

The program names are displayed here in the order that the parameters are set.

2) "Exec"

The types of the programs set in the parameters are displayed here.

3) "Scan Time"

The actual scan times (current values) are displayed here. In the program stop (stand-by) status, 0.000ms is displayed as the scan time.

4) "Ex Times"

The number of execution times is displayed here, taking the point at which measurement was started to be 0 in the count (When reaching the maximum times of 65536, the count returns to 0). The number of execution times is retained even when program execution is stopped.

When the subroutine program/interrupt program of the stand-by program is performed in the subroutine call/interrupt request, the number of the stand-by program is not counted.

(3) Both start () and stop () of the program can be performed on Program monitor list screen.(a) Start of program ()

Either "Scan execution" or "Low-speed execution" can be set for the stand-by program.

When the key is pressed, the window below is displayed.

[Program start]		Enter the program name for start with keys.
1. Program name []	
2. Start mode	1. (*) Scan execution	Select either scan execution or low-speed execution.
	2. () Low-speed execution	
Execution (Y) Cancel (N)		

(b) Stop of program ()

[Program stop]		Enter the program name for stop with keys.
1. Program name []	
2. Stop mode	1. (*) Output stop after stop	Select either output stop after stop or output retention after stop.
	2. () Output retention after stop	
Execution (Y) Cancel (N)		

1) When the stop mode is set to "Output stop after stop" and stop is executed, the program stops after execution of 1 scan-off. (The operation is the same as the POFF instruction execution.)

When the above stop operation is made in the stand-by program, the program stops after 1 scan-off execution.

Therefore, the "execution count" is added by one.

2) If an error occurs with the RET/IRET instruction during 1 scan OFF execution in the stand-by program, the "execution count" is added by one.

In this case, the execution type becomes "Scan execution".

8.4.2 Interrupt program monitor list

This function displays the number of executions of interrupt programs.


Application

This is used to check the execution status of interrupt programs.

Function Description

This function allows display of the execution counts of interrupt programs.
All operations are performed using the monitor/test menu in the ladder mode.

- (1) Select "Program Batch Monitor".

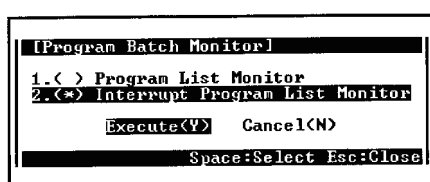

- (2) Select "Interrupt Program List Monitor".

The following shows an example of the display when the interrupt program monitor list function is run.

LInt Prog List Moni				
	Ex	Times	Comment	
I 0	1	x	IAI61 X0	I
I 1	100	x	IAI61 X1	I
I 2	100	x	IAI61 X2	I
I 3	100	x	IAI61 X3	I
I 4	20	x	IAI61 X4	I
I 5	0	x	I	I
I 6	0	x	I	I
I 7	0	x	I	I
I 8	0	x	I	I
I 9	0	x	I	I
I10	0	x	I	I
I11	0	x	I	I
I12	0	x	I	I
I13	0	x	I	I
I14	0	x	I	I
PgUp:Prev PgDn:Next				Esc:Close

The following shows an explanation of the screen above:

- (a) "Ex Times"

The number of times the program has been executed, taking the point when monitoring started as 0 in the count, is displayed here.

(When reaching the maximum times of 65536, the count returns to 0.)

The count is cleared to zero when switching to RUN.

- (b) "Comment"

The comments set in the documentation mode are displayed here.

8.4.3 Scan time measurement


This function displays the processing time for section of a program.

Function Description

This function allows measurement of the execution time of section of the program in a program file.


The function can also be used to measure times within subroutine programs and interrupt programs.

If there is an interrupt program in the monitored section, the processing is added to the total measurement time.

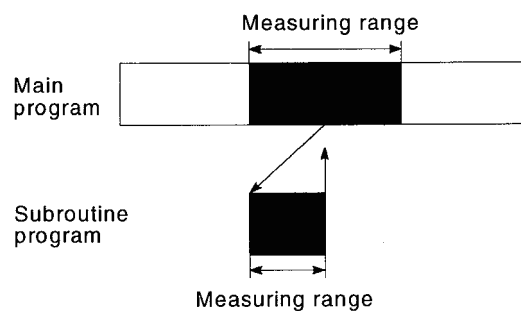


All operations are performed using "Monitor/test" menu in the ladder mode.

- (1) Select "Measure Scan".

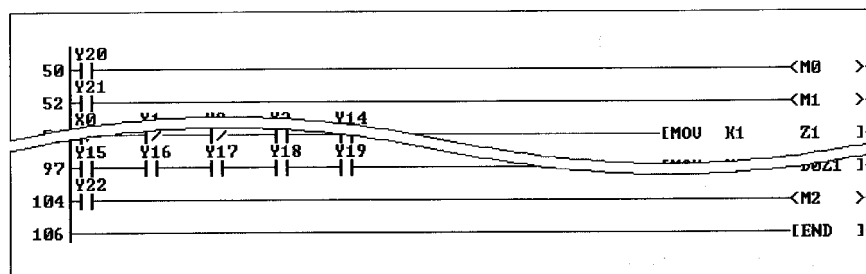

- (2) Designate the scan time measurement range (The designated part is highlighted).

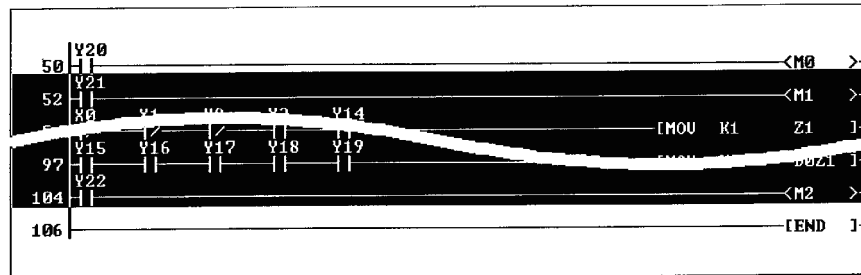

- (3) The scan time measurement results are displayed.

[Measur Scan]			
Start Stp	52	First	1.100ms
Last Step	105	Cur	1.100ms
		Max.	1.200ms
		Min.	1.000ms
Esc:Close			

NOTE

- 1) Make sure that the start step is lower than the end step in the setting.
- 2) Times that span different program files cannot be measured.
- 3) If the measured time is less than 0.100ms, 0.000ms is displayed.
- 4) END processing time is not included in the measuring time, being included in the measurement range.

8.5 Sampling Trace Function

The function that collects devices continuously on the CPU module with the specified timing.

POINT	
When executing the sampling trace function, a memory card is required.	

Application

This allows checking the changes in the contents of the devices used in a program in accordance with a designated timing during debugging.

This enables debugging time to be shortened.

Function Description

(1) Function

(a) The sampling trace function samples the contents of a designated device in a constant time interval (the sampling cycle) and stores the trace results in a sampling trace file in a memory card.

(b) The devices that can be traced are listed below.

- 1) Bit device: X, FX, DX, Y, FY, DY, M, L, F, SM, V, B, SB, T (Contact), T (Coil), ST (Contact), ST (Coil), C (Contact), C (Coil), J□\X, J□\Y, J□\B, J□\SB, BL□\S.....Max. 50 points
- 2) Word device: T (Current value), ST (Current value), C (Current value), D, SD, FD, W, SW, R, Z, ZR, U□\G, J□\W, J□\SW
.....Max. 50 points

- (c) The sampling trace file stores the trace condition data and trace execution data required to execute the sampling trace. Once a GPP function starts tracing, the number of set tracing times are executed.


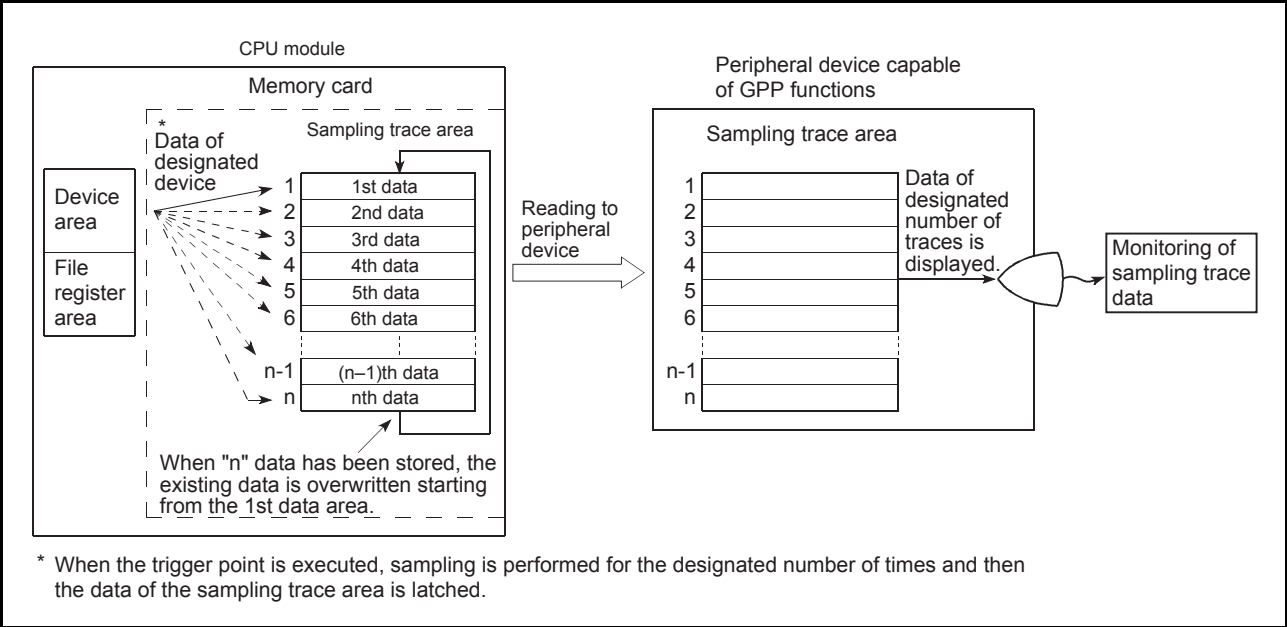


Fig. 8.1 Sampling trace operation

- (d) The trace results show the ON/OFF statuses of bit devices, and current values of word devices, for each sampling cycle.

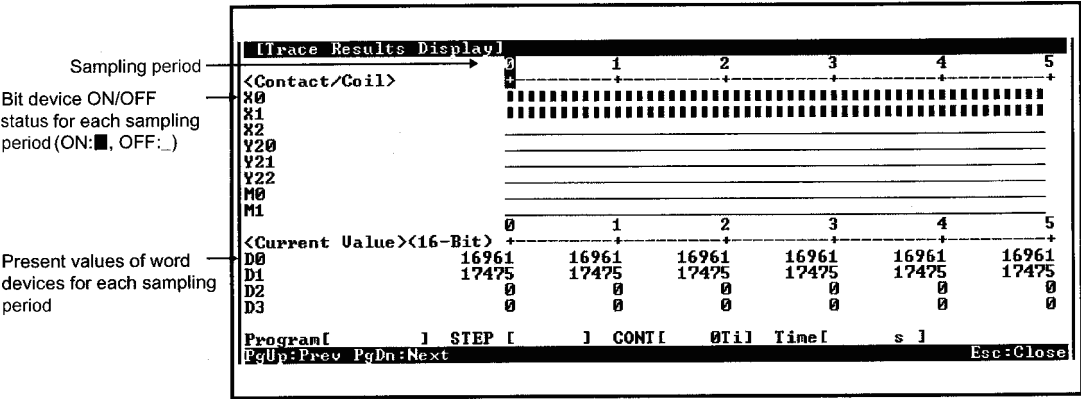

NOTE


While the CPU module is STOP, trace is stopped. The trace result cannot be read.

(2) Basic operation

The basic operation for sampling trace is shown below.


The statuses during execution of the sampling trace function can be confirmed by monitoring special relays SM800 to SM805 and SM826.

- Trace execution

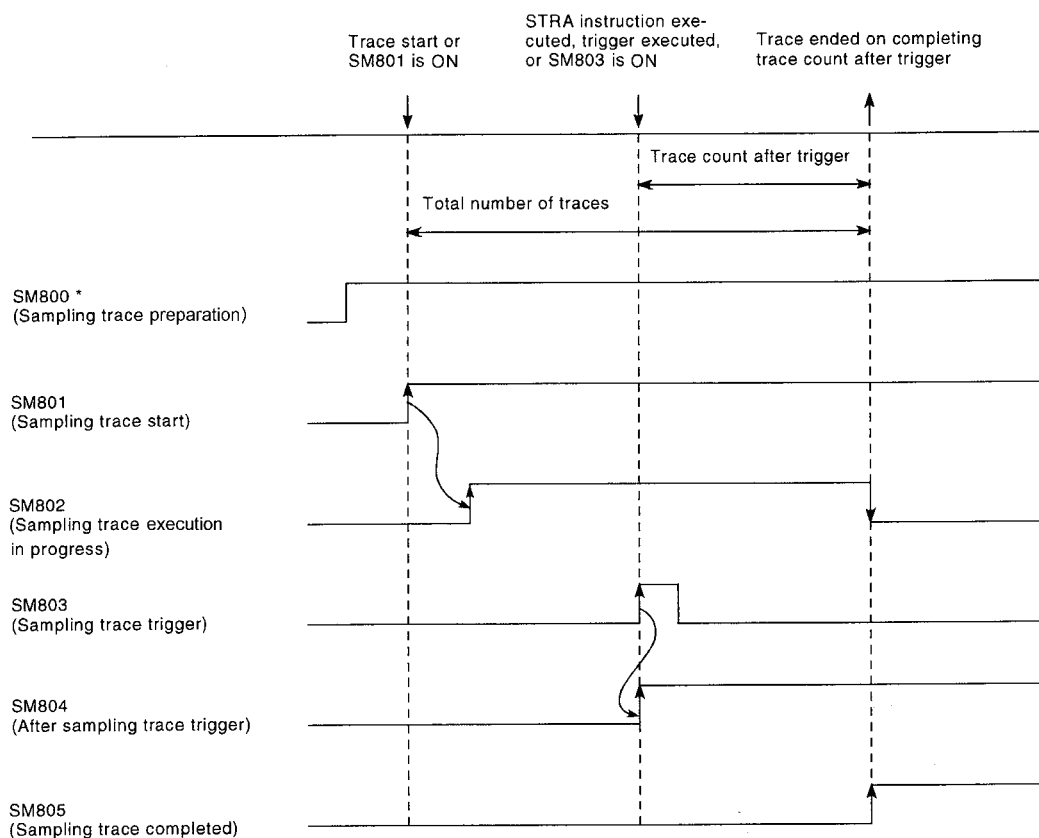

* SM800 comes ON automatically when preparation for sampling trace is completed.

- Suspending the trace

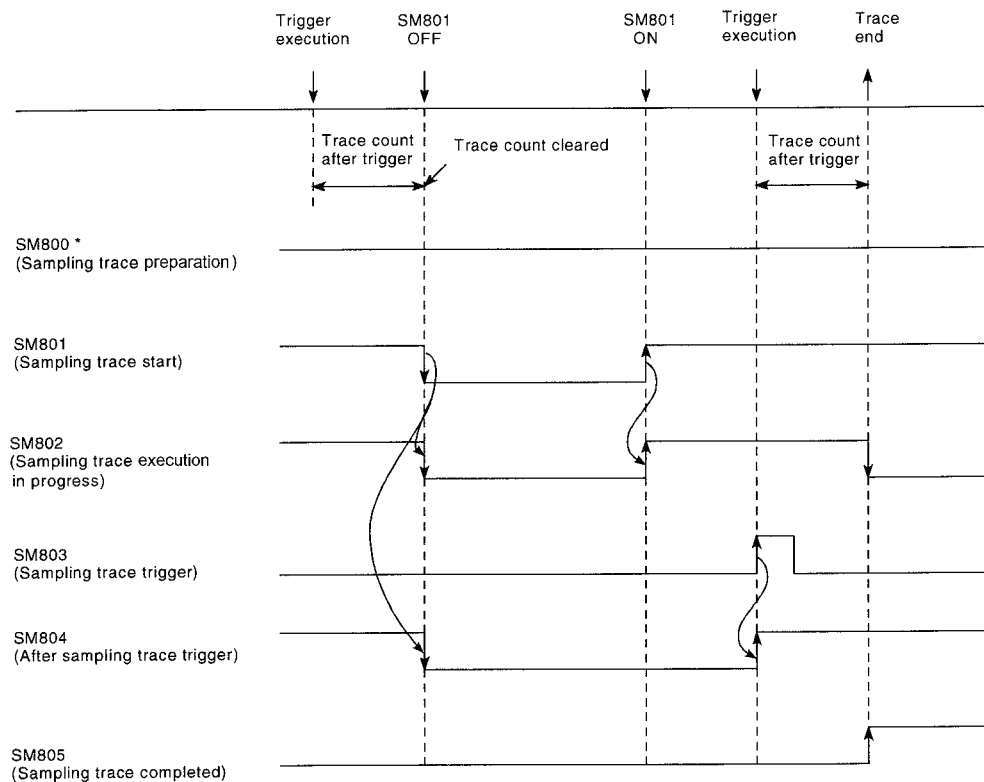

* When the trace is suspended from a peripheral device capable of GPP functions, SM800 is turned OFF.

The following shows the operation at error occurrence.

When an error occurs during sampling trace, SM826 (sampling trace error) comes ON, and at the same time, SM801 (sampling trace start) goes OFF. Start the trace again for turning OFF SM826.

Operation Procedures

The following shows the procedures of sampling trace.

These operations are performed on the "Sampling Trace" screen of the trace menu in the online mode.

(1) Set the trace devices and trace conditions with GPP function.

(a) Setting the trace devices

Set the devices at "Trace Device Setting" on the "Sampling Trace" screen.

[Trace Device Setting]					
Bit Device		Selection	Word Device		Selection
[X0]	< Do >	[D0]	< Do >
[X1]	< Do >	[D1]	< Do >
[X2]	< Do >	[D2]	< Do >
[Y20]	< Do >	[D3]	< Do >
[Y21]	< Do >	[]	
[Y22]	< Do >	[]	
[M0]	< Do >	[]	
[M1]	< Do >	[]	
[M2]	< Do Not >	[]	
[]		[]	
[]		[]	
[]		[]	


PgUp:Prev PgDn:Next Space:Select Esc:Close

(b) Setting the trace conditions

Set the trace conditions at "Trace Device Setting" on the "Sampling Trace" screen.

[Trace Condition Setting]	
1. Trace Counts	1. Total Counts [10] Times 2. Post-Trigger Counts [5] Times
2. Trace Point	1. < > Every END 2. < > Every Interval [] ms 3. < * > Specify Detail Condition
3. Trigger Point	1. < > At Instruction Execution 2. < > At Request of PDT 3. < * > Specify Detail Condition
4. Added Trace Information	1. [] Time 2. [] Step # 3. [] Program Name
Execute<Y> Cancel<N>	
Space:Select Esc:Close	

Sampling the designated number of times (count after trigger) leads completion after the trigger point execution.

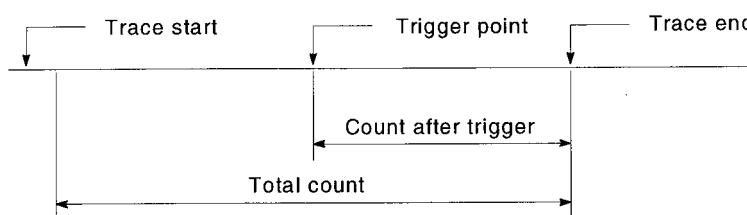

The following shows an explanation of the screen above:

One of the following four settings can be made for the trace condition: "1. Trace Counts", "2. Trace Point", "3. Trigger Point", or "4. Added Trace Information".

1) "Trace Counts"

In the case of the total count, set the number of sampling traces executed from start to end of the trace.

In the case of the count after the trigger, set the number of sampling traces executed from the trigger execution to the trace end.

The following shows the formula that sets range for these counts:

$$\text{Count after trigger} \leq \text{total count} \leq 8192$$

2) "Trace Point"

Set the timing for collection of trace data. Select one of the following:

- Ⓐ Every END : Data collected at END instruction of every scan.
- Ⓑ Every Interval : Data collected with each designated time. Setting range is 5 to 5000ms in 5ms units.
- Ⓒ Specify Detail Condition : Set a device and step number.
The following shows setting examples: The details on how to make the settings and data collection timing are the same as described in Section 8.2.1 Monitor condition setup in Monitor Function.

The following shows the setting device under the detailed condition.

- Ⓐ Bit device : X, FX, Y, FY, M, L, F, SM, V, B, SB, T (Contact), ST (Contact), C (Contact), J□\X, J□\Y, J□\B, J□\SB, BL□\S
- Ⓑ Word device : T (Current value), ST (Current value), C (Current value), D, SD, FD, W, SW, R, Z, ZR, U□\G, J□\W, J□\SW

The following qualifications are possible with respect to the devices listed above.

- Digit designation for bit devices
- Bit number designation for word devices

[Trace Pt Setting]			
	Device	Current Value	
1.[*] Device	1.< > Word Device []= []
	2.< * > Bit Device [X0]= < ↑ >	
2.[*] Step #	[1]= <Always>	
Execute(Y) Cancel(N)			
Space:Select Esc:Close			

3) "Trigger Point"

The point at which the trigger is executed is set. Select one of the following:

- Ⓐ At Instruction Execution : When executing STRA instruction
- Ⓑ At Request of PDT : When operating trigger using GPP functions
- Ⓒ Specify Detail Condition : Set a device and step number.

The following shows setting examples: The details on how to make the settings and trigger execution timing are the same as described in Section 8.2 Monitor condition setup in Monitor Function.

[Trigger Pt Setting]			
		Device	Current Value
1.[*] Device	1.< > Word Device [I=[]
	2.<*> Bit Device [X2	I= < ↑ >	
2.[*] Step #	[I= <Always>	
		Execute<Y>	Cancel<N>
Space:Select Esc:Close			

4) "Added Trace Information"

Set information to be added at each trace. Select one or multiple item(s) of the following: (Making no selection is possible.)

- Ⓐ Time : The time at which the trace was executed is stored.
- Ⓑ Step No. : The step number at which the trace was executed is stored.
- Ⓒ Program Name : The program name for which the trace was executed is stored.

(2) Write the set trace device and trace condition to the memory card.

(a) Set the trace file and storage destination.

Set the drive number and file name at "1. () Execute Trace & Display Status" on the "Sampling Trace" screen.

[Execute Trace & Display Status]	
2. Sampling Trace Data	
File to Save	
1.< > Select From List	
2.<*> File Shown Right	Drive [1] File Name [SAMPLE5]

(b) Write the trace file to the memory card.

Write the trace file to the memory card by using "9. () Write to PC (Condition)" on the "Sampling Trace" screen.

Since file names are used when writing to the memory card, multiple trace files can be written.

- (3) Execute the sampling trace.
 Execute the sampling trace by using "1. () Execute Trace & Display Status" on "Sampling Trace" screen.
 The following shows a setting example for "1. () Execute Trace & Display Status".

[Execute Trace & Display Status]

1. Operation
 1.< > Register, Start
 2.< > Suspension
 3.<*> **Display Status**
 4.< > Trigger Execution

2. Sampling Trace Data
 File to Save
 1.< > Select From List
 2.<*> File Shown Right Drive [1]
 File Name [SAMPLE7B]

3. Trace Condition
 1.< > Overwrite Conditions onto CPU's
 2.<*> Use Condition in CPU

Execute<Y> Cancel<N>

Space:Select Esc:Close

<SmpTr state>

	Setg	Curr
Total	0Ti	0Ti
AftTrig	0Ti	0Ti
Trace	Not Execute	

Displayed only when "Display Status" is selected.

The following shows an explanation of the screen above:

The following settings can be made for "Execute Trace & Display Status" : "1. Operation", "2. Sampling Trace Data", and "3. Trace Condition".

(a) "Operation"

Select one of the following:

- | | |
|----------------------|--|
| 1) Register, Start | : The trace is registered and started. The trace count is started. |
| 2) Suspension | : The trace is suspended. The trace count and the count are cleared after the trigger. (To restart the trace, select "Register, Start" again.) |
| 3) Display Status | : The trace statuses are displayed on the same screen. |
| 4) Trigger Execution | : The count is started after the trigger.
The trace is ended on reaching the designated count after the trigger. |

(b) "Sampling Trace Data"

Select one of the following:

- | | |
|---------------------|---|
| 1) Select From List | : Data from among the sampling trace files in the memory card are selected. |
| 2) File Shown Right | : The drive number and sampling trace file name are set. |

(c) "Trace Condition"

Select one of the following:

- 1) Overwrite Conditions onto CPU's : The trace condition in an existing trace file is overwritten.
 - 2) Use Condition in CPU : Sampling trace under the condition in the trace file designated in "2. Sampling Trace Data" is executed.
- (4) Retrieve the trace results from the CPU module and display them.
- 1) Read the trace results from the CPU module by using "4. () Read from PC (Results)" on the "Sampling Trace" screen.
 - 2) Display the trace results by using "4. () Trace Results Display" on the "Sampling Trace" screen.

POINT

Once the sampling trace has been executed, the second is not executed. To execute the trace again, execute the STRAR instruction to reset sampling trace.

NOTE

- 1) Set sampling trace files in the RAM area of the memory card.
- 2) It is possible to execute sampling trace from another station in the network, or from a serial communication module. However, sampling trace cannot be executed from more than one site at the same time. With the Q2ASCPU, sampling trace can be executed from only one site at a time.
- 3) Since the trace condition registered in the CPU module is latched, the condition data is retained even when the programmable controller power is turned OFF. The data can be cleared by performing a latch clear operation using the RUN/STOP key switch on the Q2ASCPU.
- 4) The Q2ASCPU must be connected to the peripheral device capable of GPP functions in order to execute sampling trace.

8.6 Status Latch Function

This function collects the data of devices at designated moment.

POINT	
When executing status latch function, a memory card is required.	

Application

This function is used to retain the statuses of devices used in a program at designated moment during debugging.


Function Description

- (1) Function
 - (a) Status latch stores the device statuses at designated moment in a status latch file of a memory card.
 - (b) The status latch file stores the status latch condition and status latch execution data for status latch execution.
Saving the device statuses can be executed in the following case.
 - When executing SLT instruction in a program
 - When specifying a status latch start at GPP functions
 - When the conditions of the set devices and step Nos. are met
 - (c) The status latch results show the bit device ON/OFF statuses and word devices values at designated moment.

(2) Basic operation

The following shows the basic operation for status latch.

The statuses during execution of the status latch function can be checked by monitoring special relays SM806 to SM809 and SM827.

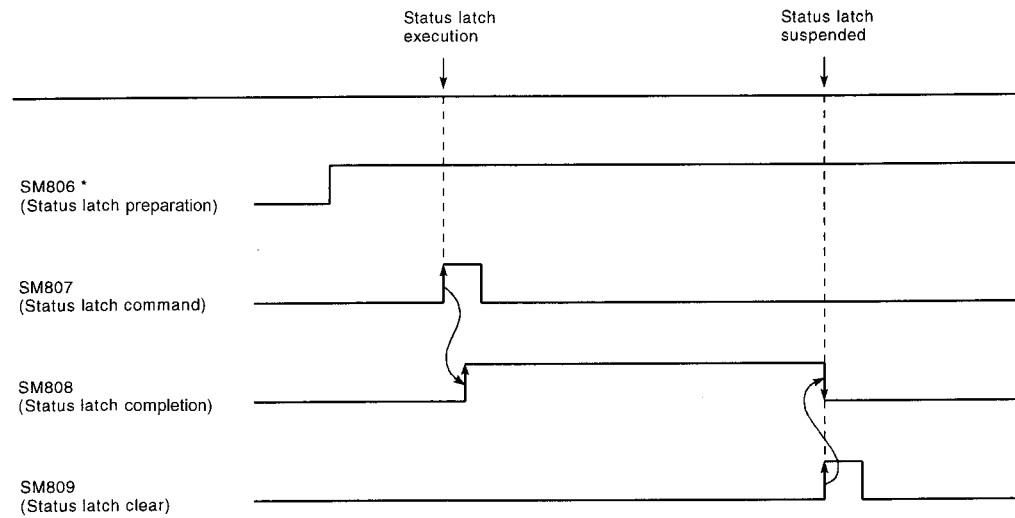

* SM806 comes ON automatically when preparation for status latch is completed.

(3) The following shows the operation at error occurrence.

When an error occurs during status latch, SM827 comes ON, and at the same time SM808 (completed) is turned ON.

To turn SM827 OFF, either turn SM809 ON or execute the SLTR instruction.

Operation Procedures

The following shows procedures for status latch.

All operations are performed on the "Status Latch" screen of the trace menu in the online mode.

(1) Setting the status latch condition

Set the status latch condition at "2. () Status Latch Condition Setting" on the "Status Latch" screen.

[Status Latch Condition Setting]	
1. Status Latch	1.< > All Internal Dev <Yes>
Device Setting	File R [] 1-[]
	2.<*> Specify Detail Range
2. Trigger Point	1.< > At Instruction Execution
	2.< > At Request of PDT
	3.<*> Specify Detail Condition
	Execute<Y> Cancel<N>
Space:Select Esc:Close	

The following shows an explanation of the screen above:

Either "1. Status Latch Device Setting" or "2. Trigger Point" can be set for the status latch condition setting.

(a) "Status Latch Device Setting"

Set the devices to execute the status latch. Select one of the following:

- 1) All Internal Dev : Whether or not QnACPU latches all built-in devices is set.
- 2) Specify Detail Range : The device types and numbers of points are set.

The following shows setting examples:

[Status Latch Device]		
# of Pt	First Device	Last Device
[4]	[D0	1-[D3]
[3]	[M0	1-[M2]
[]	[]	1-[]]
[]	[]	1-[]]
[]	[]	1-[]]

(Applicable devices)

- 1) Bit device : X, Y, M, L, F, SM, V, B, SB, T (Contact), T (Coil), C (Contact), C (Coil), ST (Contact), ST (Coil), J□\X, J□\Y, J□\B, J□\SB, BL□\S
- 2) Word device : T (Current value), ST (Current value), C (Current value), D, SD, W, SW, R, ZR, U□\G, J□\W, J□\SW

REMARK

Up to 1000 device ranges can be set including both bit devices and word devices.
The devices listed above cannot be qualified.

(b) "Trigger Point"

Set the condition to execute the status latch. Select one of the following:

- 1) At Instruction Execution : When executing SLT instruction
- 2) At Request of PDT : When operating trigger using the peripheral devices capable of GPP function.
- 3) Specify Detail Condition : Set a device and step number.

The following shows setting examples: The details on how to make the settings and trigger execution timing are the same as described in Section 8.2.1 Monitor condition setting in Monitor function.

Data collection timing

- In the case that only "Device" is specified, data are collected when the trigger condition is satisfied.
- In the case that "Step No." only is set, data is collected with the END processing when the trigger condition is satisfied.

[Trigger Pt Setting]			
1.[*] Device	1.< >	Word Device [Device
	2.<*>	Bit Device [X0	Current Value]
2.[] Step #	[]= < ↑ >	
]= <Always>	
Execute<Y> Cancel<N>			
Space:Select Esc:Close			

(2) Write the created status latch condition to the memory card.

(a) Set the status latch file and storage destination.

Set the status latch condition at "1. () Exec Status Latch & Disp Status" on the "Status Latch" screen.

[Exec Status Latch & Disp Status]	
2. Sampling Trace Data	
File to Save	
1.< >	Select From List
2.<*>	File Shown Right
Drive [1]	File Name [SAMPLE5]

(b) Write the status latch file to the memory card.

Write the status latch file to the memory card using "7. () Write to PC (Condition)" on "Status Latch" screen.

Since file names are used when writing to the memory card, multiple status latch files can be written.

- (3) Execute the status latch.

Execute the status latch by using "1. () Exec Status Latch & Disp Status" on "Status Latch" screen.

The following shows a setting example for "1. () Execute Status Latch & Display Status".

[Exec Status Latch & Disp Status]

1. Operation
 1.< > Register, Start
 2.< > Suspension
 3.<*> **Display Status**
 4.< > Trigger execution

2. Status Latch
 File to Save
 1.< > Select from List
 2.<*> File Shown Right Drive [1]
 File Name [SAMPLE7B]

3. Trace Condition
 1.< > Overwrite Conditions onto CPU's
 2.<*> Use Condition in CPU

Execute<Y> Cancel<N>

Space:Select Esc:Close

<StsLtch State>
 StsLtch Not Register

Displayed only when "Display Status" is selected.

The following is an explanation of the screen above:

The following settings can be made for "Exec Status Latch & Disp Status": "1 Operation", "2 Status Latch", and "3 Trace Condition".

(a) "Operation"

Select one of the following:

- | | |
|----------------------|---|
| 1) Register, Start | : The status latch is registered and started.
Device data collection is started. |
| 2) Suspension | : The status latch statuses are cleared. |
| 3) Display Status | : The status latch statuses are displayed on the same screen. |
| 4) Trigger execution | : The trigger is executed. (Refer to Precaution 6.) |

(b) "Status Latch"

Select one of the following:

- | | |
|---------------------|---|
| 1) Select From List | : Data from among the status latch files in the memory card are selected. |
| 2) File Shown Right | : The drive number and status latch file name are set. |

(c) "Trace Condition"

Select one of the following:

- | | |
|------------------------------------|--|
| 1) Overwrite Conditions onto CPU's | : The status latch condition in an existing status latch file is overwritten. |
| 2) Use Condition in CPU | : Status latch under the condition in the status latch file designated in "2. Status Latch" is executed. |

- (4) Retrieve the status latch results from the CPU module and display them.
 - (a) Read the status latch results from the CPU module by using "8. () Read from PC (Results)" on "Status Latch" screen.
 - (b) Display the read trace results by setting "1. () Monitor Target" on the "Monitor Target Setting" screen of "Option" menu in the ladder mode to "3. () Status Latch".

NOTE

- 1) Set status latch files in the RAM area of the memory card.
- 2) It is possible to execute status latch from another station in the network, or from a serial communication module. However, sampling trace cannot be executed from more than one site at the same time.
With Q2ASCPU, sampling trace can be executed from only one site at a time.
- 3) Since the status latch conditions registered in the CPU module are latched, the status latch data is retained even when the power is turned OFF.
The data can be cleared by performing a latch clear operation using the RUN/STOP key switch on the Q2ASCPU.
- 4) Status latch is performed by connecting the Q2ASCPU with the peripheral devices capable of GPP function.
- 5) When the monitor destination is set to the "status latch", set values of the timer/counter are not displayed.
"0" is displayed for the column of the timer/counter set values.
- 6) When "device" is specified in the detailed condition for trigger point setting, "device" is specified. When the condition is satisfied before execution of the trigger, trigger cannot be executed.

REMARK

- 1) When the monitor destination is set to "device memory", the set values of the timer/counter are not displayed.
"0" is displayed in the set value column of the timer/counter.

8.7 Step Operation

This function runs one step or one part of a program, runs a program with a part skipped.

Application

This function is used to determine the causes of faults during debugging.

Function Description

This function can only be used when the CPU module is set to STEP-RUN.

The step operation function provides the following three functions. For explanations of each function, refer to Section 8.7.1 through Section 8.7.3.

- Step execution
- Partial execution
- Skip execution

8.7.1 Step execution

Step execution is a sequence program execution that performs by one step at a time, starting from the designated step.

It allows a sequence program execution while checking an execution status of the sequence program and the contents of each device during debugging.

There are two types of step execution as described below:

- (1) Step execution for one instruction
- Instructions are executed one for each step starting from the step where program operation is stopped. Program operation is stopped again after execution of each instruction.
- This method is used to confirm the status of each devices after execution of one instruction.

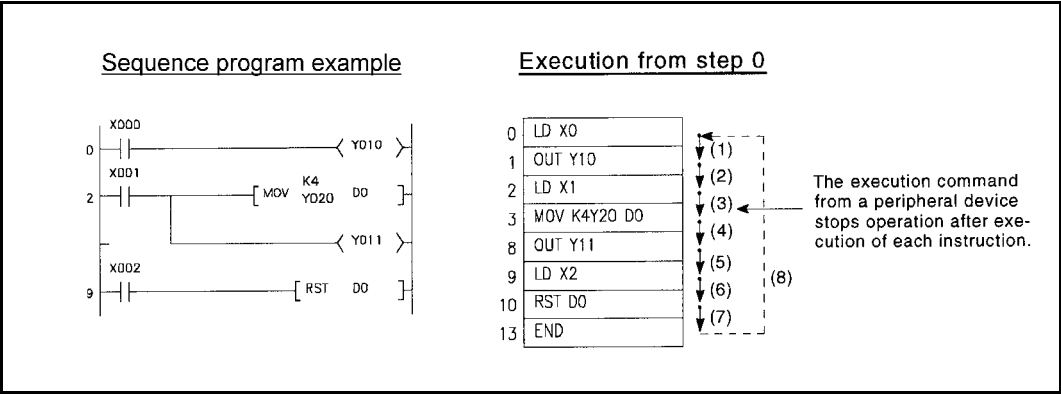


Fig. 8.2 Step execution for each instruction

- (2) Step execution with designated loop count
- Program execution is repeated for the designated loop count (range: 1 to 32767) beginning with step 0 or the step where program operation was last stopped, and is stopped at the designated step (break point).

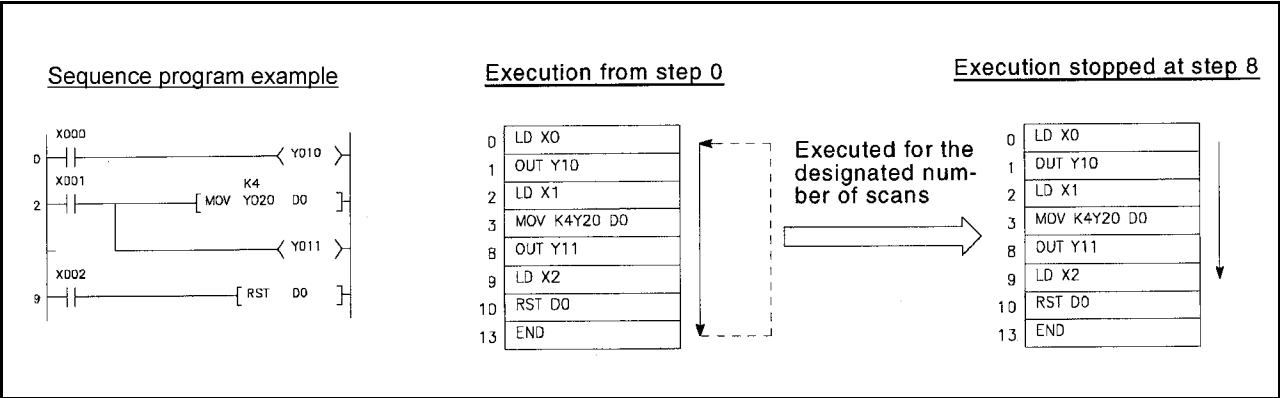


Fig. 8.3 Step execution with designated loop count

Operation Procedures

The following shows the procedures to perform step execution.

All operations are performed on Monitor/test screen in the ladder mode (debugging).

- (1) Select "B/Step Run".

[Step Run]			
1. Step Run	1.<*>	From Current Step	
	2.< >	Start Step/Pointer	[0]
2. Option	1.[]	# of Retries	[1]Times
	2.[]	Repeating Interval	[1000]
	3.[]	Break Point	1.[] Step/Pointer [0]
			2.[] Step/Pointer [0]
			3.[] Step/Pointer [0]
			4.[] Step/Pointer [0]
			5.[] Step/Pointer [0]
			6.[] Step/Pointer [0]
			7.[] Step/Pointer [0]
			8.[] Step/Pointer [0]
Execute<Y> Cancel<N>			
Space:Select Esc:Close			

8.7.2 Partial execution

The sequence program is executed from the start step or the step where operation is currently stopped to a designated step (break point).


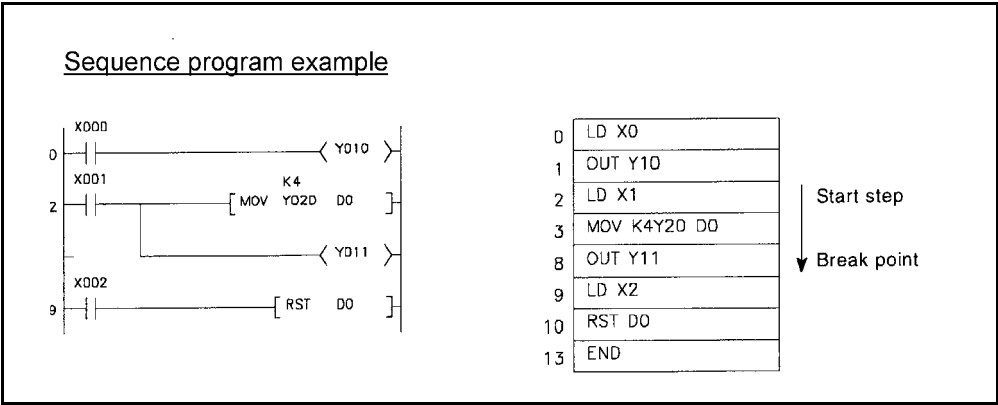


Fig. 8.4 Partial execution

Operation Procedures

The following shows the procedures to perform partial execution.
All operations are performed on Monitor/test screen in the ladder mode (debugging).

- (1) Designate the execution start step, break condition, and execution operation with GPP function.
 - (a) Setting the execution start step
Designate the step at which partial execution is started at "1. Partial Run" on the "Partial Run" screen.

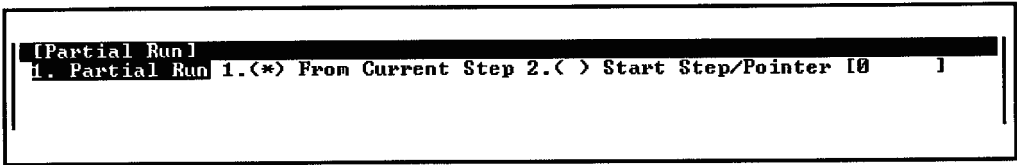

(b) Setting the break condition

Set the device status and break point at "2. Break Cond" on the "Partial Run" screen.

[Partial Run]			
1. Partial Run	1.<*> From Current Step	2.< > Start Step/Pointer	[0] 1
2. Break Cond	1.[] Device	Device	Current Value
	1.<*> Word Device	[]	[K0]
	2.< > Bit Device	[]	[< ↑ >]
	2.[] Break Point		
	1.[] Step/Pointer	[0]] = < Always> [1Times
	2.[] Step/Pointer	[0]] = < Always> [1Times
	3.[] Step/Pointer	[0]] = < Always> [1Times
	4.[] Step/Pointer	[0]] = < Always> [1Times
	5.[] Step/Pointer	[0]] = < Always> [1Times
	6.[] Step/Pointer	[0]] = < Always> [1Times
	7.[] Step/Pointer	[0]] = < Always> [1Times
	8.[] Step/Pointer	[0]] = < Always> [1Times
3. Option	1.[] Scan Time	1.<*> Real-time	
		2.< > Specified Time	[10]ms
	2.[] Interrupt Status	< Inhibit >	
	3.[] Refresh	< Successively>	
		Execute<Y>	Cancel<N>
Space:Select Esc:Close			

The following shows the devices that can be set.

- 1) Bit device : X, FX, DX, Y, FY, DY, M, L, F, SM, V, B, SB, T (Contact), T (Coil), ST (Contact), ST (Coil), C (Contact), C (Coil), J□\X, J□\Y, J□\B, J□\SB, BL□\S
- 2) Word device : T (Current value), ST (Current value), C (Current value), D, SD, FD, W, SW, R, Z, ZR, U□\G, J□\W, J□\SW

Set the scan time, interrupt status, and refresh, at "3. Option" on "Partial Run" screen.

```

[Partial Run]

3. Option      1.[ ] Scan Time 1.(*) Real-time
                2.( ) Specified Time [ 10]ms
                2.[ ] Interrupt Status < Inhibit >
                3.[ ] Refresh      <Successively>

```

The following shows all settings.

Item	Description
Scan time	Designates whether QnACPU executes the scan time by the actual time or by the designated time. (Default: designated time 10ms)
Interrupt status	Designates whether or not interrupts are prohibited during execution. (Default: "Inhibit")
Refresh	Designates whether QnACPU executes I/O refresh whenever program execution is stopped due to satisfaction of a condition, or executes only at END processing. (Default: "Successively")

8.7.3 Skip function

Skip execution or partial execution of a program whereby the program is executed with the designated step(s) skipped.


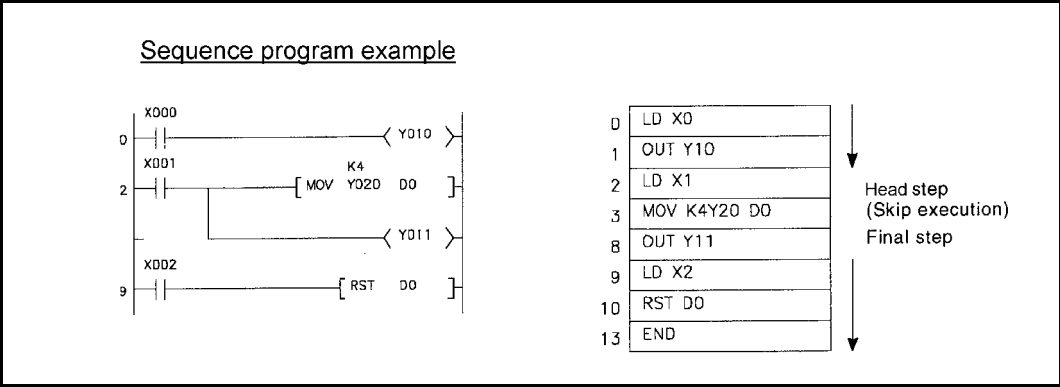


Fig. 8.5 Skip execution

Operation Procedures

The following shows the procedures to perform skip execution.
All operations are performed on Monitor/test screen in the ladder mode (debugging).

- (1) Set the program range to be skipped using GPP function.
Designate the step number(s) to be skipped on "D/Skip Run" screen.

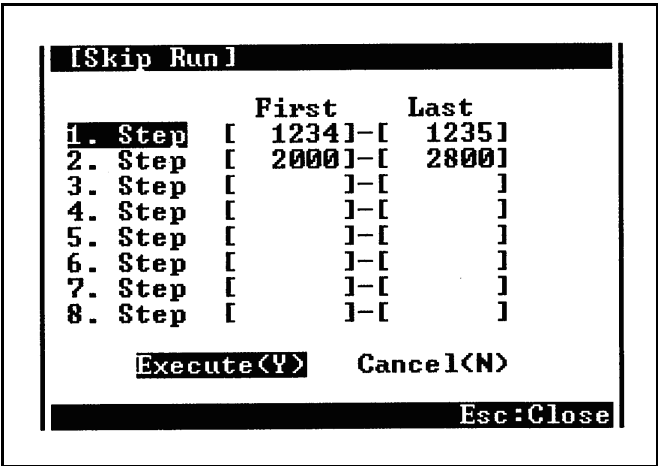

8.8 Program Trace Function

This function collects program execution statuses.

POINT	
When executing the program trace function, a memory card is required.	

Application

This function is used to check the execution status of any step of any program during debugging.

This enables debugging time to shorten.

Function Description

(1) Function

(a) The program trace function collects the execution status of the designated step of the designated program and stores it in a program trace file in the memory card.

(b) The devices that can be traced are listed below.

- 1) Bit device : X, FX, DX, Y, FY, DY, M, L, F, SM, V, B, SB, T (Contact), T (Coil), ST (Contact), ST (Coil), C (Contact), C (Coil), J□\X, J□\Y, J□\B, J□\SB, BL□\S.....Max. 50 points
- 2) Word device : T (Current value), ST (Current value), C (Current value), D, SD, FD, W, SW, R, Z, ZR, U□\G, J□\W, J□\SW
.....Max. 50 points

(c) The program trace file stores the trace condition data and trace execution data to execute a program trace. After a trace is started in a peripheral device capable of GPP functions, it is continued until the set number of traces is completed.

(d) The trace results show the program name, step No. device status, etc., for each trace No.


[Trace Results Display]							
Times	Program	Step	BranchIns	Time(ms)	D0	M0	M1
-5	MAIN	0	S 0 Step	1894.2	31339		
-4	MAIN	9	END(FEND)	1894.5	31340		
-3	MAIN	0	<Stat>	1894.9	31340		
-2	MAIN	0	S 0 Step	1900.4	31340		
-1	MAIN	9	END(FEND)	1900.6	31341		
0	MAIN	0	<Stat>	1901.1	31341		
1	MAIN	0	S 0 Step	1906.7	31341		
2	MAIN	9	END(FEND)	1906.9	31342		
3	MAIN	0	<Stat>	1907.5	31342		
4	MAIN	0	S 0 Step	1912.7	31342		
5	MAIN	9	END(FEND)	1912.9	31343		
6	MAIN	0	<Stat>	1913.4	31343		
7	MAIN	0	S 0 Step	1918.6	31343		
8	MAIN	9	END(FEND)	1918.8	31344		
9	MAIN	0	<Stat>	1919.3	31344		
PgUp:Prev PgDn:Next							Esc:Close

(2) Basic operation

The following shows the basic operation for program trace.


The statuses during execution of the program trace function can be confirmed by monitoring special relays SM810 to SM815 and SM828.

- Without suspension of the trace

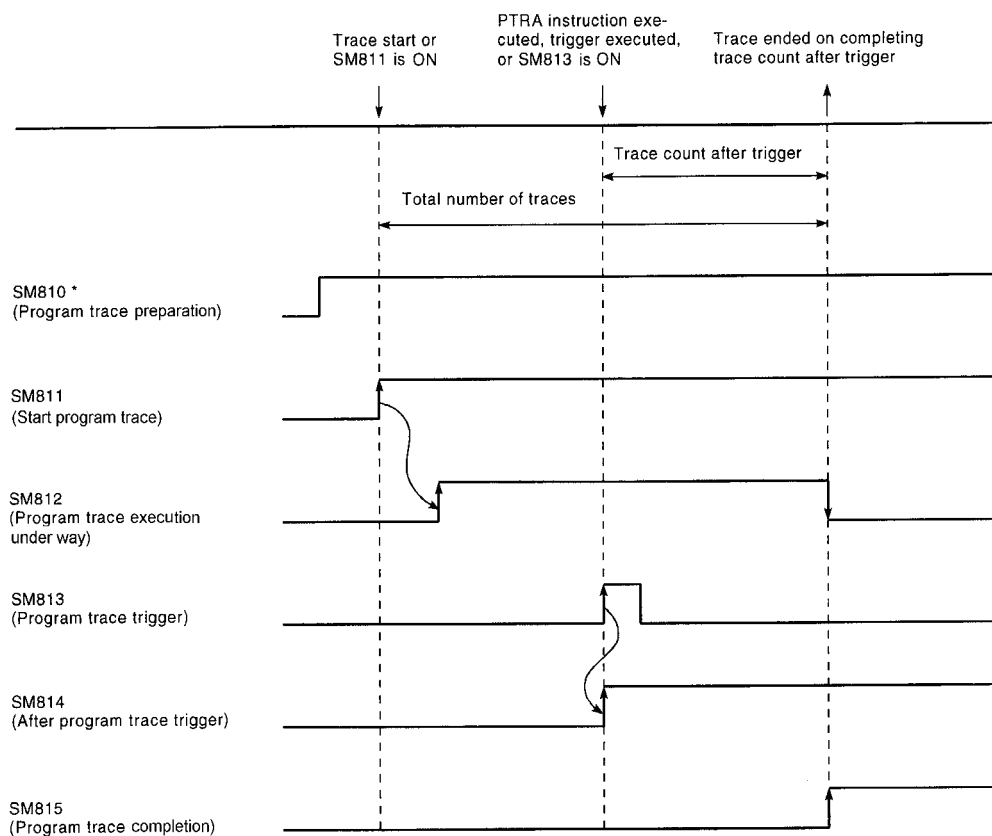

* When ready for program trace, SM810 is automatically turns ON.

- With trace suspension

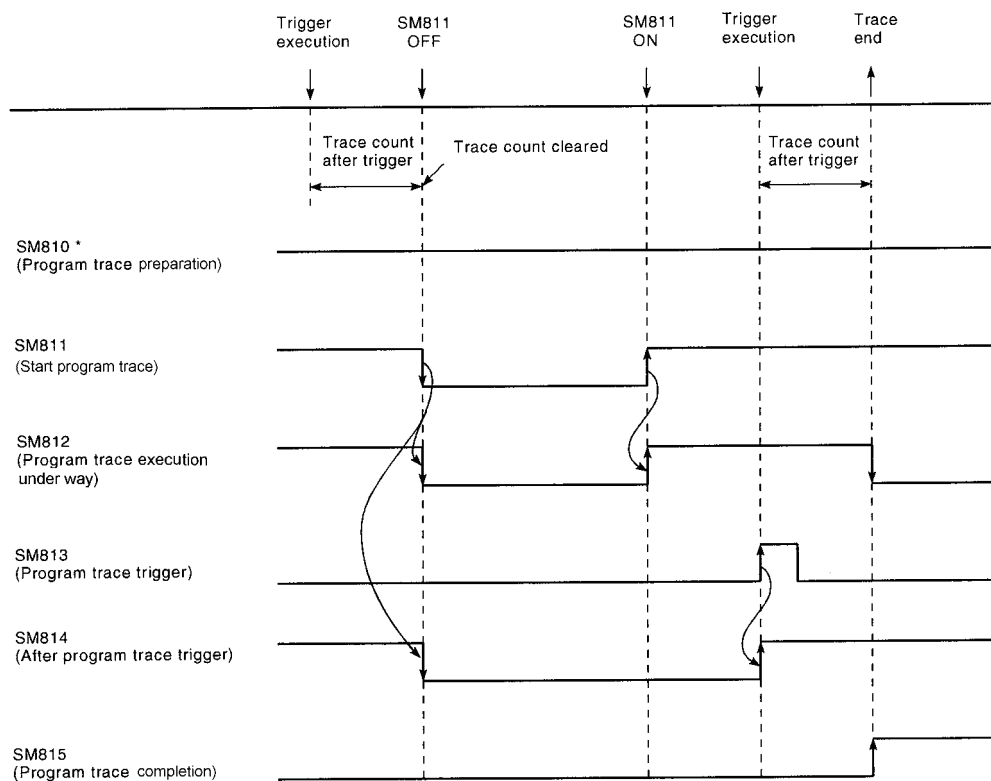

* When the trace is suspended from a peripheral device capable of GPP functions, SM810 is turned OFF.

The following shows an operation at error occurrence.

When an error occurs during program trace, SM828 (program trace error) comes ON, and at the same time, SM811 (program trace start) goes OFF.

To turn SM828 OFF, either turn SM811 ON, or execute the PTR A instruction.

Operation Procedures

The following shows the procedures to perform program trace.

These operations are performed on the "Program Trace" screen of the trace menu in the online mode.

Perform these operations with the CPU module setting to the STEP-RUN. (Refer to Section 8.7.)

(1) Set the trace devices and trace conditions with GPP function.

(a) Setting the trace devices

Set the devices at "Trace Device Setting" on the "Program Trace" screen.

[Trace Device Setting]					
Bit Device		Selection	Word Device		Selection
[X0]	< Do >	[D0]	<Do Not>
[X1072]	<Do Not>	[K4X0]	< Do >
[J2\B100]	< Do >	[U1\G10]	<Do Not>
[D0.0]	<Do Not>	[W0Z3]	< Do >
[M0]	< Do >	[]	
[Y100]	<Do Not>	[]	
[]		[]	
[]		[]	
[]		[]	
[]		[]	
[]		[]	
[]		[]	

PgUp:Prev PgDn:Next Space:Select Esc:Close

(b) Setting the trace conditions

Set the trace conditions at "Trace Condition Setting" on the "Program Trace" screen.

```

[Trace Condition Setting]

1. Trace Counts      1. Total Counts [ 1024]Times
                    2. Post-Trigger Counts [ 500]Times

2. Trace Point
                    1.[*] Branch Instruction
                    2.[*] Every Interruption
                    3.[*] At Instruction Execution

3. Trigger Point
                    1.< > At Instruction Execution
                    2.< > At Request of PDT
                    3.<*> Specify Detail Condition

Execute<Y>      Cancel<N>

Space:Select Esc:Close

```

The following is an explanation of the screen above:

One of the following three settings can be made for the trace condition: "1. Trace Counts", "2. Trace Point", or "3. Trigger Point".

1) "Trace Counts"

For the total count, set the number of program traces executed from the trace start to the trace end.

For the count after the trigger, set the number of program traces executed from execution of the trigger to the trace end.

The following shows the formula that sets range for these counts:

$$\text{Count after trigger} \leq \text{total count} \leq 8192$$

2) "Trace Point"

Set the point at which the trace is to be executed. Select one or multiple item(s) of the following:

- Ⓐ Branch Instruction :Executed at each CALL, JMP, or other instructions.
- Ⓑ Every Interruption :Executed at each interrupt program.
- Ⓒ Upon execution of :Executed at each PTRAXE instruction.
each instruction

3) "Trigger Point"

Set the point at which the trigger is executed. Select one of the following:

- ① Upon execution of : When executing PTR instruction each instruction
- ② At Request of PDI : When operating trigger using the peripheral devices capable of GPP function.
- ③ Specify Detail Condition : Set a device and step number.
The following shows setting examples: The details on how to make the settings and trigger execution timing are the same as described in Section 8.2 Monitor condition setup in Monitor function.

[[Trigger Pt Setting]]

		Device	Current Value
1.[*] Device	1.< > Word Device	[] = []
	2.< * > Bit Device	[X2] = < ↑ >
2.[] Block	1 1.< * > Step	[] Sequence Step #	[] < Always >
	2.< > TR	[] Sequence Step #	[] < Always >
Execute<Y> Cancel<N>			
Space:Select Esc:Close			

The following shows the setting device under the detailed condition.

- Bit device : X, FX, Y, FY, M, L, F, SM, V, B, SB, T (Contact), ST (Contact), C (Contact), J□\X, J□\Y, J□\B, J□\SB, BL□\S
- Word device : T (Current value), ST (Current value), C (Current value), D, SD, FD, W, SW, R, Z, ZR, U□\G, J□\W, J□\SW

The following qualifications are possible with respect to the devices listed above.

- Digit designation for bit devices
- Bit number designation for word devices

POINT	
The trace execution time, program name, step and branch factor are automatically added to the trace results.	

(2) Write the set trace device and trace condition to the memory card.

(a) Set the trace file and storage destination.

Set the drive number and file name at "1. () Execute Trace & Display Status" on "Program Trace" screen.

[Execute Trace & Display Status]

2. Program Trace Data

File to Save

1.< > Select From List

2.<*> File Shown Right

Drive [1]

File Name [SAMPLE5]

(b) Write the trace file to the memory card.

Write the trace file to the memory card by using "9. () Write to PC (Condition)" on "Program Trace" screen.

Since file names are used when writing to the memory card, multiple trace files can be written.

- (3) Execute the program trace.

Write the trace file to the memory card by using "9. () Write to PC (Condition)" on "Program Trace" screen.

The following shows a setting example for "1. () Execute Trace & Display Status".

```

[Execute Trace & Display Status]

1. Operation
  1.< > Register, Start
  2.< > Suspension
  3.<*> Status Display
  4.< > Trigger Execution

2. Program Trace Data
  File to Save
  1.< > Select from List
  2.<*> File Shown Right  Drive [1]
                           File Name [SAMPLE7B1]

3. Trace Condition
  1.< > Overwrite Conditions onto CPU's
  2.<*> Use Condition in CPU

      Execute(Y)   Cancel(N)

Space:Select  Esc:Close
  
```

<ProIr state>			
	Setg	Curr	
Total	0Ti	0Ti	← Displayed only when "Status Display" is selected.
AftTrig	0Ti	0Ti	
Trace	Not Register		

The following is an explanation of the screen above:

The following settings can be made for "Execute Trace & Display Status": "1. Operation", "2. Program Trace Data", and "3. Trace Condition".

(a) "Operation"

Select one of the following:

- 1) Register, Start : The trace is started. The trace count is started.
- 2) Suspension : The trace is suspended. The trace count and the count are cleared after the trigger. (To restart the trace, select "Register, Start" again.)
- 3) Display Status : The trace statuses are displayed on the same screen.
- 4) Trigger Execution : The count is started after the trigger. The trace is ended on reaching the designated count after the trigger.

(b) "Program Trace Data"

Select one of the following:

- 1) Select From List : Data from among the program trace files in the memory card are selected.
- 2) File Shown Right : The drive number and program trace file name are set.

(c) "Trace Condition"

Select one of the following:

- 1) Overwrite Conditions onto CPU's : The trace condition in an existing trace file is overwritten.
- 2) Use Condition in CPU : Program trace under the condition in the trace file designated in "2. Program Trace Data" is executed.

- (4) Retrieve the trace results from the CPU module and display them.
 - (a) Read the trace results from the CPU module by using "A. () Read from PC (Results)" on "Program Trace" screen.
 - (b) Display the read trace results by using "4. () Trace Results Display" on "Program Trace" screen.

POINT

Once the program trace has been executed, the second is not executed. To execute the trace again, execute the PTRAR instruction to reset program trace.

NOTE

- 1) The program trace can be performed only for STEP-RUN.
- 2) Set program trace files in the RAM area of the memory card.
- 3) It is possible to execute program trace from another station in the network, or from a serial communication module. However, sampling trace cannot be executed from more than one site at the same time. With the Q2ASCPU, sampling trace can be executed from only one site at a time.
- 4) The program trace is performed by connecting the Q2ASCPU with the peripheral device capable of GPP function.

8.9 Simulation Function

POINT	
	When the link memory and the buffer memory are simulated in the simulation data file, a memory card is required.

Application

This function simulates execution of a program in step execution or partial execution, with the input module, output module, or special function module isolated from the CPU module. This enables QnACPU to debug a program without any effects on other modules.


Function Description

- (1) When the program is executed, data changes from/to external sources are isolated by setting so that data refreshes for input/output modules are not executed.
- (2) Isolation from special function module operations is achieved by setting "Ignore" or "Depend on Simulation Data File" with respect to the buffer memory of the special function module.


Operation Procedures

The following shows the procedures to perform simulation.

□ indicates a GPP function operation and □ indicates an operation at the CPU module.

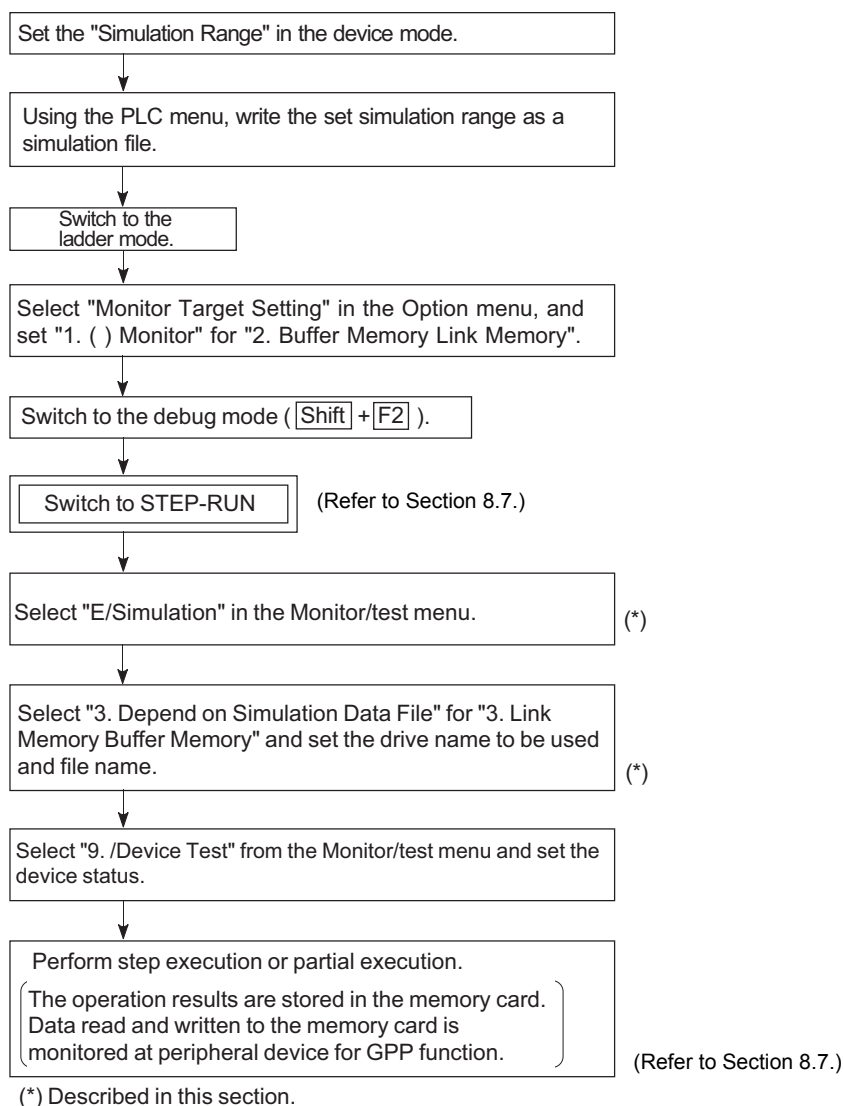

- (1) Make the settings on the simulation setting screen shown below.

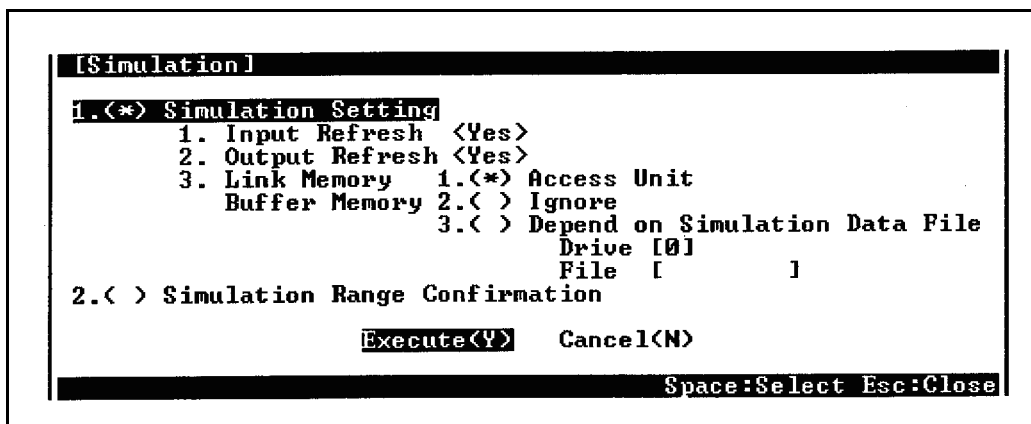

- The following shows details on the settings that can be made for each item:

Setting Item	Setting Option	Description
Input Refresh	Yes/No	Select whether inputs from external sources are input to the CPU module or not.
Output Refresh	Yes/No	Select whether the operation results in the CPU module are output to external destinations or not.
Link Memory/ Buffer Memory	Access Unit Ignore Depend on Simulation Data File	Select the method of accessing each module.

If "Depend on Simulation Data File" is selected for "Link Memory/Buffer Memory", the access range for each module can be checked by checking the simulation range settings.

[Simulation Range]				
#	# of Dev	First Device	Last Device	Comment
1	[0]	[]->[]
2	[0]	[]->[]
3	[0]	[]->[]
4	[0]	[]->[]
5	[0]	[]->[]
6	[0]	[]->[]
7	[0]	[]->[]
8	[0]	[]->[]
9	[0]	[]->[]
10	[0]	[]->[]
11	[0]	[]->[]
12	[0]	[]->[]
PgUp:Prev PgDn:Next Esc:Close				

NOTE

- 1) Simulation can be performed only for STEP-RUN.
- 2) A memory card is required to carry out link memory/buffer memory simulation using a simulation data file.
Set the simulation data file to the RAM area of the memory card.
- 3) It is possible to carry out simulation from another station in the network, or from a serial communication module. However, simulation cannot be executed from several sites at the same time. With the Q2ASCPU, sampling trace can only be executed from one site at a time.
- 4) Simulation is performed by connecting the Q2ASCPU and the peripheral devices capable of GPP function.
- 5) Note the following points when executing simulation:
 - If direct inputs (DX) and direct outputs (DY) are used to handle inputs/outputs directly, the device memory is accessed rather than the actual inputs/outputs.
 - No processing is performed for any special function module instruction.
 - When a "SP.UNIT ERROR" occurs, FFFFH is displayed in the module number area of the common information.
 - If "Ignore" is set for the buffer memory access method, FFFFH is set for access by instruction and the monitor results.

8.10 Debugging by Several People

This function allows simultaneous debugging from several peripheral devices capable of GPP functions.

Application

This function is used to simultaneously debug different files from more than one peripheral device capable of GPP functions.

Function Description

The following shows the combinations of debugging functions that can be used simultaneously by different operators.

Debug function from host	Debug function from other stations						
	Monitor	Write during RUN	Execution Time Measurement	Sampling Trace /Program Trace	Status Latch	Step Operation	Simulation
Monitor	○	×	○	○	○	○	○
Write during RUN	×	○	×	×	×	×	×
Execution time measurement	○	×	×	○	○	○	○
Sampling trace	○	×	○	×	○	○	○
Program trace	○	×	○	×	○	○	○
Status latch	○	×	○	○	×	○	○
Step operation	○	×	○	○	○	×	○
Simulation	○	×	○	○	○	○	×

○: Simultaneous execution possible. (However, the detailed condition setting at only one peripheral device capable of GPP functions is valid; detailed conditions cannot be set at the other peripheral devices capable of GPP functions.)

×: Can only be executed from one peripheral device capable of GPP functions.

8.10.1 Simultaneous monitoring by several people


The Q2ASCPU allows monitoring for several people. Setting of other station monitor file in the built-in RAM system area allows monitoring at a high-speed from other stations. (Monitor file setting for the host is not required.)

Operation Procedures

The operation for simultaneous monitoring by several people is described below.

- (1) Select "5. () Format (with Option)" for "B/PC Memory Batch Processing" in the "2/ PC" menu in the online mode, and set a monitor file for another station.

The following shows setting examples:

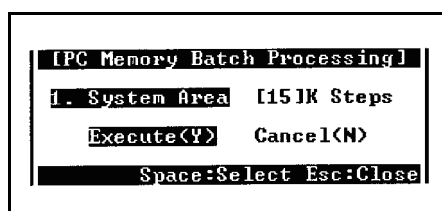

Up to 15k steps in 1k step units can be set as the system area. The area corresponding to one monitor file for another station is no more than 1k step. Accordingly, a maximum of 15 monitor files can be set.

Since the built-in RAM program file area is in the same area as the monitor file for other stations, the program file area is reduced for the area of the other station monitor file.

- (2) After setting, the built-in RAM is formatted.

NOTE

- 1) The detailed conditions for monitoring can be set from one site only.
- 2) Monitoring from other stations is possible without setting monitor files for other stations, but in this case, high-speed monitoring is not possible.
- 3) When simultaneous monitoring from multiple persons is desired, perform this operation before writing the parameter file or the program file in the built-in RAM.
If this operation is performed after writing the file in the built-in RAM, all files are erased.
- 4) The number of locations for simultaneous access to one CPU is up to 16.

8.10.2 Simultaneous execution of write during RUN by several people

The Q2ASCPU allows simultaneous write during RUN to one file or another file by several people.

Operation Procedures

The following shows the procedures for simultaneous write during RUN executed by several people.

- (1) With "4/ Write & Conversion Setting" in "8/ Option" menu of the ladder mode, "4. Write During RUN Setting" and "7. Write Method at Write During RUN" are set.


The following shows setting examples:

[Write & Conversion Setting]	
4. Write During Run Setting	1.<*) Write into PC during Run state. 2.<) Write into PC in Stop state. 3.<) Don't Write into PC.
7. Write Method at Write During Run	1.<*) Normal 2.<) Relatively using Pointer

- (a) Set "1. () Write into PC during Run state" for "4. Write During Run Setting".
- (b) Select "1. () Normal" or "2. () Relatively using Pointer" for "7. Write Method at Write During Run".

If more than one person is to perform a write during RUN operation with respect to the same file, set a write during RUN pointer in advance and select "2. () Relatively using Pointer".

The example below shows a case where peripheral device capable of GPP functions A performs write during RUN from P0, and peripheral device capable of GPP functions B performs write during RUN from P1. The program enclosed in the frame is the program subject to write during RUN.

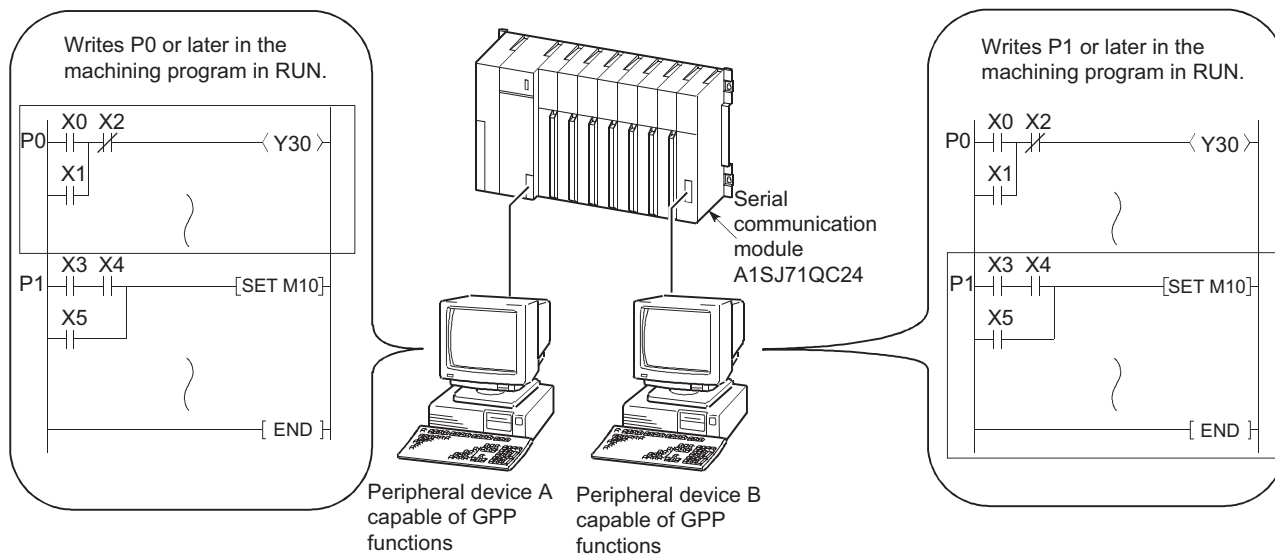**NOTE**

Refer to Section 8.3.

9 MAINTENANCE FUNCTION

9.1 Function List

The following shows the functions for maintenance.

Item	Description	Reference
Watchdog timer	Function that monitors watchdog errors due to CPU module hardware or program errors.	Section 9.2
Self-diagnostics function	Function whereby the Q2ASCPU itself diagnoses whether or not there are any errors.	Section 9.3
Error history	Function that stores the results of diagnosis in memory as a fault history.	Section 9.4
System protect	Function that sets whether reading/writing is enabled or disabled for Q2ASCPU files.	Section 9.5
Keyword Registration	Function that disables GPP function operations with respect to the CPU module.	Section 9.6
System display	Function that allows monitoring of the system configuration by connecting a peripheral device capable of GPP functions.	Section 9.7
LED indication	Function to display the CPU module operation status with the LED located on the front of the CPU module.	Section 9.8
LED indication	Indicates whether CPU module operation is normal or abnormal.	Section 9.8.1
Priority setting	Priority for LED indication is set depending on the error.	Section 9.8.2

For details of GPP function operation, refer to the GX Developer Operating Manual or the Type SW□IVD-GPPQ Software package Operating Manual (Online).

9.2 Watchdog Timer

(1) Watchdog timer (WDT)

The watchdog timer is an internal timer of programmable controller that detects programmable controller CPU hardware errors and sequence program errors. 200ms is set as the default setting for this timer.

REMARK

The time set for the watchdog timer can be changed using "WDT" in PC RAS setting in the GPP function parameter mode.

The setting range is 10ms to 2000ms (in 10ms units).

(2) Resetting the watchdog timer

The Q2ASCPU resets the watchdog timer during END processing.

When the Q2ASCPU is normally operating and executing the END instruction within the setting value of the watchdog timer, the watchdog timer does not give time-out. WDT times out when the END instruction is not executed within the value set for the watchdog timer due to a Q2ASCPU hardware error or an excessively long sequence program scan time.

REMARK

Scan time is the time taken for the execution of the sequence program, starting from step 0 and ending at step 0.

The scan time is not the same in every scan: it differs according to the execution or non-execution of the instructions used in the program. (Refer to Section 12.1.)

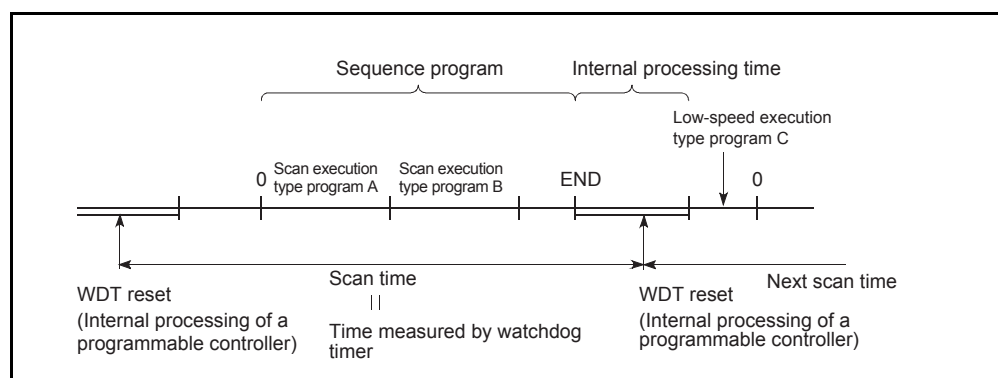


Fig. 9.1 Resetting the watchdog timer

(3) Processing when the watchdog timer times out

When the scan time exceeds the set value of the watchdog timer, a watchdog timer error occurs and the programmable controller operates as follows.

(a) All PLC outputs are turned OFF.

(b) The RUN LED on the front of the CPU module goes off and the ERROR LED flickers.

(c) SM1 turns ON and the error code is stored in SD0.

REMARK

The watchdog timer can be reset by a WDT instruction in the sequence program. However, the scan time value is not reset and scan time is measured up to the END instruction.

POINT

An error occurs within 0ms to 10ms in the measured time for watchdog timer.

9.3 Self-diagnostics Function

The self-diagnosis function is a function whereby the Q2ASCPU diagnoses its own errors.

- (1) The self-diagnosis function serves to prevent malfunctions of the programmable controller, and to facilitate preventive maintenance. Self-diagnostics processing is executed if an error occurs at QnACPU power ON or while the programmable controller is in the RUN status, and it involves the display of the error detected by the self-diagnostics function, stopping of programmable controller operation, etc.
- (2) The Q2ASCPU stores the error code of the error in the special register SD0, and turns on the ERROR LED and displays a message.
If several errors occur, the error code of the latest error is stored in SD0.
- (3) Even if the programmable controller power is turned OFF, the latest 16 errors are recorded with the battery backup. (Refer to 9.4?)
The PLC diagnostics mode of the GPP function can check error histories.
- (4) When an error is detected by self-diagnosis, CPU module operation complies with one of the following two modes:
 - Mode in which programmable controller operation is stopped
When an error is detected, operation is stopped immediately and all outputs (Y) are turned OFF.
 - Mode in which programmable controller operation is continued
When an error is detected, only the program part affected by the error is not executed; the rest of the program is executed.

In addition, settings can be made in PC RAS setting in the parameter mode to continue operation or stop operation when the following errors occur:

- 1) Calculation (including SFC programs)
- 2) Extended Ins
- 3) Fuse Blown
- 4) I/O Unit Compare
- 5) Sp Unit Access
- 6) IC Card Access
- 7) IC Card Operate

(The default for all of these in the parameters is "Pause".)

Example: If "Resume" is set for I/O module verify error, operation is continued using I/O address before error occurrence.

When an error is detected, a record of the error occurrence is stored in the special relays (SM0, SM1) and the error contents are stored in a special register (SD0). Use these special relays and this special register in the sequence program to establish programmable controller or mechanical system interlocks.

- (5) It is possible to select whether or not the following checks are performed by setting "Yes/No" for error check in PC RAS setting in the parameter mode.

- 1) Battery Check
- 2) Fuse Blown Check
- 3)

(The default for all of these in the parameter settings is "Yes".)

If "No" is set for error check, error detection is not performed for these items, which shortens the processing time for the END instruction.

Even if "Yes" for error check is set in the parameter, 1) through 3), above error check, can be canceled by turning on the special relay SM 1084.

However, if "No" is set in the parameter, turning off SM1084 is ineffective to execute the error check.

Self-diagnostics list

Diagnosis item		Diagnosis timing	Status of the CPU module	LED Status	
				RUN	ERROR
Hardware error	CPU module error	Always	Stop	OFF	Flickers
	END instruction not executed	When executing END instruction	Stop	OFF	Flickers
	RAM check	At power-ON or RESET	Stop	OFF	Flickers
	Operation circuit check	At power-ON or RESET	Stop	OFF	Flickers
	Fuse blown (Default ... stop)* ¹	When executing END instruction (Default ... check executed)* ²	Stop/Continue	OFF/ON	Flickering/ON
	I/O interrupt error	When interruption occurs	Stop	OFF	Flickers
	Special function module error	• At power-ON or RESET • When executing FROM/TO instruction	Stop	OFF	Flickers
	Control bus error	• At power-ON or RESET • When executing FROM/TO instruction	Stop	OFF	Flickers
	Occurrence of momentary power interruption	Always	Continue	ON	OFF
	Low battery	Always (Default ... check executed)* ³	Continue	ON	OFF
Handling error	I/O module verification (Default ... stop)* ¹	When executing END instruction (Default ... check executed)* ²	Stop/Continue	OFF/ON	Flickering/ON
	Special function module Special function module allocation error	• When power is ON or RESET • When switching from STOP to RUN	Stop	OFF	Flickers
	Special function module access error (Default ... stop)* ¹	When executing FROM/TO instruction	Stop/Continue	OFF/ON	Flickering/ON
	No parameters	When power is ON or RESET	Stop	OFF	Flickers
	Boot error	When power is ON or RESET	Stop	OFF	Flickers
	Memory card operation error (Default ... stop)* ¹	When memory card is inserted/removed	Stop/Continue	OFF/ON	Flickering/ON
	File setting error	When power is ON or RESET	Stop	OFF	Flickers
	File access error (Default ... stop)* ¹	When executing each instruction	Stop/Continue	OFF/ON	Flickering/ON
	Unable to execute instruction	When power is ON or RESET	Stop	OFF	Flickers
Parameter errors	Parameter setting check	• When power is ON or RESET • When switching from STOP to RUN	Stop	OFF	Flickers
	Link parameter error	• When power is ON or RESET • When switching from STOP to RUN	Stop	OFF	Flickers
	SFC parameter error	When switching from STOP to RUN	Stop	OFF	Flickers

*¹ Can be changed to operation continues by GPP function parameter setting.

*² GPP function parameters can be set so that no check is performed.
Also, checking is not performed when SM251 is on.

*³ GPP function parameters can be set so that no check is performed.

Self-diagnostics list(Continued)

Diagnosis item		Diagnosis timing	Status of the CPU module	LED Status	
				RUN	ERROR
Program error	Instruction code check	<ul style="list-style-type: none"> When power is ON or RESET When switching from STOP to RUN 	Stop	OFF	Flickers
	No END instruction	<ul style="list-style-type: none"> When power is ON or RESET When switching from STOP to RUN 	Stop	OFF	Flickers
	Pointer setting error	<ul style="list-style-type: none"> When power is ON or RESET When switching from STOP to RUN 	Stop	OFF	Flickers
	Pointer setting error	<ul style="list-style-type: none"> When power is ON or RESET When switching from STOP to RUN 	Stop	OFF	Flickers
	Operation error (Default ... stop)*1	When executing each instruction	Stop/Continue	OFF/ON	Flickering/ON
	FOR-NEXT instruction configuration error	When executing each instruction	Stop	OFF	Flickers
	CALL-RET instruction configuration error	When executing each instruction	Stop	OFF	Flickers
	Interrupt program error	When executing each instruction	Stop	OFF	Flickers
	Unable to execute instruction	When executing each instruction	Stop	OFF	Flickers
	Extended instruction error (Default ... stop)*1	When executing each instruction	Stop/Continue	OFF/ON	Flickering/ON
	SFC program configuration error	When switching from STOP to RUN	Stop	OFF	Flickers
	SFC block configuration error	When switching from STOP to RUN	Stop	OFF	Flickers
	SFC step configuration error	When switching from STOP to RUN	Stop	OFF	Flickers
	SFC syntax error	When switching from STOP to RUN	Stop	OFF	Flickers
	SFC operation check error (Default ... stop)*1	When executing each instruction	Stop/Continue	OFF/ON	Flickering/ON
	SFC program execution error	When switching from STOP to RUN	Continue	ON	ON
	SFC block execution error	When executing each instruction	Stop	OFF	Flickers
	SFC step execution error	When executing each instruction	Stop	OFF	Flickers
CPU error	Watchdog error supervision	Always	Stop	OFF	Flickers
	Program timeout	Always	Continue	ON	ON
Annunciator check		When executing each instruction	Continue	ON	OFF
CHK instruction check		When executing each instruction	Continue	ON	OFF

*1 Can be changed to operation continues by GPP function parameter setting.

9.3.1 Interruption due to error detection

Q2ASCPU can execute the interrupt program, which is interrupt pointer I32 to I39, at error occurrence.

In the case of errors for which operation can be set to continue or stop in PC RAS setting in the GPP function parameter mode, this function is only executed when "Resume" is set. If "Pause" is set for the error, a stop error interrupt program (I32) is executed.

The following shows the relevant errors.

Interrupt pointer	Corresponding error message
I32	Stop all errors
I33	Vacancy
I34	UNIT VERIFY ERR. FUSE BREAK OFF SP.UNIT ERROR
I35	OPERATION ERROR SFCP OPE.ERROR SFCP EXE.ERROR
I36	ICM.OPE.ERROR FILE.OPE.ERROR
I37	EXTEND INS.ERR.
I38	PRG.TIME OVER
I39	CHK instruction Annunciator detect
I40 to I47	Vacancy

When the error occurs and the system can continue the drive mode. Or it is an error where "continues/stops" can be selected, and "continues" is set.

POINT
Interrupt pointers I32 to I39 are prohibited for execution when the PLC power is ON or when the CPU module is reset. To use I32 to I39, make the execution allowed with IMASK instruction.

REMARK

- 1) For details on interrupt pointers, refer to the QnACPU Programming Manual (Fundamentals).
- 2) For the IMASK instruction, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).

9.3.2 LED indication due to an error

When an error occurs, the LED located on the front of the CPU module turns on. Refer to Section 9.8 for the details of the LED display.

9.3.3 Resetting error

Q2ASCPU allows error resetting only for the errors that does not block the CPU module operation.

The procedure for resetting an error is as follows.

- 1) Eliminate the cause of the error.
- 2) Store the error code to be reset in special register SD50.
- 3) Turn on special register SM50.
- 4) The error is reset.

When the CPU module is recovered from canceling the error, the special relay, special register, and LED affected by the error are set to the state before the error occurred.

If the same error occurs again after the error reset, it is recorded in the error history again.

To reset multiple detected annunciators, only the first detected F number is reset.

POINT	
	When an error is reset by storing its error code in SD50, the last two digits of the error code are ignored. Example: If errors with error codes 2100 and 2111 have occurred, and error code 2100 is reset, error code 2111 is also reset.

9.4 Error History

Q2ASCPU can record the results detected by the self-diagnostics function with the detection time in memory as an error history.

POINT
Since the internal clock of the Q2ASCPU is used for setting the detection time, be sure to set the correct time before using the CPU module. (Refer to Section 10.5 for setting method of the clock.)

(1) Storage area

- (a) The latest 16 errors are stored in the error history storage memory of the CPU module, which is latched.
- (b) In the case of storing more than 16 errors, they can be stored to files in a memory card by making the appropriate setting in the PC RAS settings in the GPP function parameter mode.
- (c) If a discrepancy arises between the parameters and memory card error history when executing 1) or 2) below, the contents of the error history files are cleared first, and the 16-point data of the fault history storage memory of the CPU is transferred to the history file.
 - 1) The number of error records in the history file as set in the parameters is changed part way through.
 - 2) A memory card whose capacity does not match the number of error records set in the parameters is installed.
- (d) The following shows the storage area for the error history file:

Storage area	File in set memory card
Number of storable error records	Max. 100 (can be changed)*1

*1 When the number of errors that can be stored is exceeded, the oldest error record is cleared and the newest one stored in the same place.

POINT
Even if the error history file set in the parameters does not exist in the memory card, no CPU module error occurs. The CPU module performs only the processing that stores errors in the error history storage file.

(2) Clearing the error history

The error history is cleared by using the error history clear function in the PLC menu in the PLC diagnosis mode of GPP function.

The error history clear function erases all details in the error history storage memory of the CPU module and in the error history file of the memory card.

9.5 System protect

Q2ASCPU features a number of functions that protect against program changes ("system protect") by restricting general data processing (access processing from GPP functions, serial communication modules, etc.) by third parties other than designers.

The following system protect functions are available.

Target Protection	Valid File for Protection	Description	Method	Valid Timing	Remark
Whole of CPU module	All files	Batch prohibition of write/control to the CPU module.	Turn ON SW1 of system setting switch 1 on the main CPU module . (See Section 15.2.)	Always	Valid for devices
Memory card units	All files	Establishes write protect for the memory card and prohibits writing.	Turn ON the memory card's write protect switch. (Refer to Section 18.5)	Always	
Drive units	Parameter Program	Registers entry codes for the following settings in relation to a specific drive (Example: Built-in RAM): 1) Prohibiting read/write display 2) Prohibiting writing	Register password. (Refer to Section 9.6)	Always	
File units	All files	Changes attributes file for each file as follows: 1) Prohibiting read/write display 2) Prohibiting writing	Change file attributes by password registration. (Refer to Section 9.6)	Always	

* "Control direction", "read/write display" and "writing" in the table above have the following meanings:

Item	Description
Control instruction	CPU module operation instruction by remote operation (Remote RUN, Remote STOP, etc.)
Read/write display	Operations of program read/write
Write	Operations that involve write processing, such as program write and test.

9.6 Password Registration

Passwords serve to prohibit reading and overwriting of data such as programs, comments, etc., in the Q2ASCPU from a peripheral device.

In password registration, the parameter files and program files of a designated memory (built-in RAM, memory card) are made the target of the entry code. There are two types of registration as follows:

- File names are not displayed, and read/write are prohibited.
- File write is prohibited. (Read is possible).

When a password is registered, file operations from a peripheral device are not possible without inputting the entry code registered in the CPU module.

(1) Register Password

Entry codes are registered using the entry code registration function in the PLC menu of the online mode of GPP function.

```

[Register Password]
Current
1. Password [ ] New
2. Operation 1.<*> Change [ ]
   1.<*> Read,Write and Display Protect
   2.<*> Write Protect
   2.<*> Cancel Password
   3.<*> None
   4.<*> Change Attribute
3. Memory 1.<*> Internal RAM
   2.[ ] IC Memory Card A(RAM)
   3.[ ] IC Memory Card A(ROM)
   4.[ ] IC Memory Card B(RAM)
   5.[ ] IC Memory Card B(ROM)
Execute<Y> Cancel<N>
Space:Select Esc:Close
  
```

The following shows an explanation of each item in the screen:

(a) Password.... When a password is registered in the CPU module, input the registered password so that file operations are executed.
When an incorrect password is input, file operations are not performed.

(b) Operation.... 1) Change : Register a new password in the CPU module.
Or, if the password matches, change the password.

① Read, Write and

Display Protect : File names in the designated memory cannot be displayed or written to.

② Write Protect

: Files in the designated memory cannot be written to. Read is possible.

2) Cancel

Password : If the password matches, the registered password is deleted from the CPU module.

3) None : The current password is recorded in the GPP function only and is not registered at the CPU module.

4) Change

Attribute : File read/write display or write can be prohibited in file units.

(Operation possible even if no entry code is registered.)

(c) Memory..... Designate the memory for which the password is to be registered.

POINT	
(1)	Password registration is valid for parameter files and program files only. Invalid for other file types. Other file types can be protected by changing attributes for each file.
(2)	The keyword registered in the CPU module cannot be read from the CPU module. If you forget the password, CPU module file operations will be impossible. Keep a record of the password, e.g. on paper, and store it in a safe place.
(3)	When a keyword is registered, memory for 1 file is occupied. (When a keyword is registered in the built-in RAM, 4k bytes are occupied.)

9.7 System Display

The following items can be checked by connecting a peripheral device capable of GPP functions to the Q2ASCPU:

- (1) The following information relating to the modules actually mounted on the base unit:
 - (a) Type
 - (b) No. of Occupied Points
 - (c) Head X/Y number

- (2) The following module information set in the parameters:
 - (a) Type
 - (b) No. of Occupied Points
 - (c) Type Name

- (3) The following information relating to the CPU module:
 - (a) Status of the RUN/STOP key switch
 - (b) Status of the system setting switches
 - (c) LED statuses

These items can be checked using the detail HELP display and CPU module panel items in the display menu of the GPP function PLC diagnostics mode.

9.8 LED indication

The Q2ASCPU module has LEDs on its front face that indicate the operating status of the CPU module.

The following shows the meanings of the LED and LED indications.

9.8.1 LED indication

(1) The following shows the meanings of the indications of each of the LEDs are given.

LED Name	Indication Detail
RUN	<p>Indicates the operating status of the CPU module.</p> <p>ON: Operating with the RUN/STOP key switch set to RUN or STEP RUN.</p> <p>OFF: Operation is stopped, with the RUN/STOP key switch in the STOP, PAUSE, or STEP RUN position.</p> <p>Flickering: An error that stops operation has been detected.</p> <p>The RUN/STOP key switch has been turned from STOP to RUN after writing a program in the STOP status.</p> <p>To light, either turn the RUN/STOP key switch RUN → STOP → RUN, or reset operation using the RUN/STOP key switch.</p>
ERROR	<p>Indicates the CPU module error detection status.</p> <p>ON: A self-diagnostics error that does not stop operation, other than a battery error, has been detected. (The operation mode at error occurrence has been set to "Resume" in PC RAS setting in the parameter mode.)</p> <p>OFF: Normal</p> <p>Flickering: An error that stops operation has been detected.</p>
USER	<p>Indicates the CHK instruction detection status, and annunciator (F) statuses.</p> <p>ON: An error has been detected by the CHK instruction, or an annunciator F has come ON.</p> <p>OFF: Normal</p> <p>Flickering: Executing latch clear.</p>
BAT.ALARM	<p>Indicates the battery statuses of the CPU module itself and the memory card.</p> <p>ON: A battery error has occurred due to low battery voltage.</p> <p>OFF: Normal</p>
BOOT	<p>Indicates status of the boot operation execution.</p> <p>ON: Execution has been completed.</p> <p>OFF: The boot operation has not been executed.</p>

- (2) The following shows how to turn OFF an LED that is currently ON.(Excluding the reset operation.)

Method for Turning OFF the LED	LED Name			
	ERROR	USER	BAT. ALARM	BOOT
Resolve the cause of the error, then execute the LEDR instruction.	○	○	○	×
Eliminate the cause of the error, then reset the error using special relay SM50 and special register SD50. (Restricted to error which do not stop operation.)* ¹	○	○	○	×
Operate the special relay SM202 and special register SD202 to turn off the LED.* ¹	×	○	×	○

○: Valid ×: Not valid

*¹ Explanation of special relays and special registers


SM50..... When turning OFF → ON, resets the error corresponding to the error code stored in SD50.

SD50..... Stores the error code of the error to be reset.

(For details on error codes, refer to Section 22.3.3.)

SM202..... When turning OFF → ON, turns OFF the LEDs corresponding to each of the bits of SD202.

SD202..... Designates the LED to be turned OFF. (The LEDs that can be turned OFF are the USER LED and the BOOT LED only.)

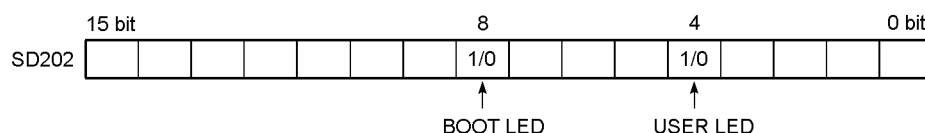

A bit setting of "1" indicates that the bit is to be turned OFF, "0" indicates that it is not to be turned OFF.

The following shows the setting possibilities (all hexadecimal notation):

- To turn both LEDs OFF: SD202 = 110H
- To turn only the BOOT LED OFF: SD202 = 100H
- To turn only the USER LED OFF: SD202 = 10H

- (3) Method for stopping ERROR LED, USER LED, and BAT.ALARM LED indications
ERROR LED, USER LED and BAT. ALARM LED have the same priority order as described for LED indications in Section 9.8.2.

If an error item number is deleted from this order of priority, the LED does not light even if the error corresponding to that error item number occurs.


(For details on the setting method, refer to the POINT in Section 9.8.2.)

9.8.2 Priority setting

If several errors occurred at a time, the indication conforms to the following conditions.

- 1) Stop error is indicated unconditionally.
- 2) Operation continue error are indicated in accordance with error item numbers in an order of priority set by default.
Priorities can be changed. (set with special registers SD207 to SD209)
- 3) If several errors with the same priority occur, a first detected error is indicated.

The following shows how to set priorities in special registers SD207 to SD209.

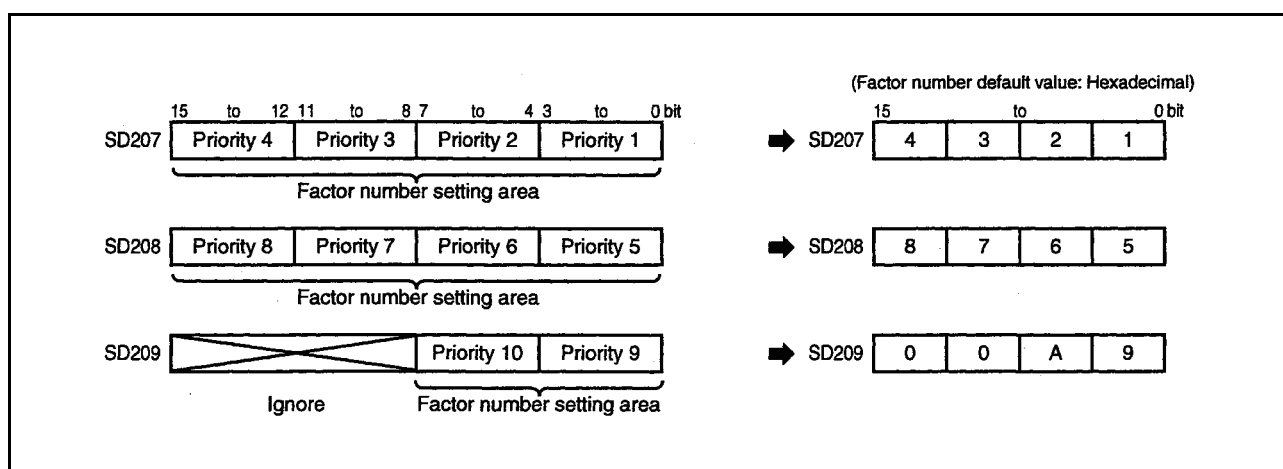


The following shows the details of the error item numbers and default for priorities which is set in special registers SD207 to SD209.

Order of priority	Error Item No. (Hex.)	Description	Remark
1	1	AC DOWN	AC power/DC power OFF
2	2	UNIT VERIFY ERR. FUSE BREAK OFF SP.UNIT ERROR	I/O module verification Fuse blown Special function module access error
3	3	OPERATION ERROR LINK PARA.ERROR SFCP OPE.ERROR SFCP EXE.ERROR	Operation error Link parameter error SFC instruction operation error SFC program execution error
4	4	ICM.OPE.ERROR FILE OPE.ERROR EXTEND INST.ERROR	Memory card operation error File access error Extended instruction error
5	5	PRG.TIME OVER	Constant scan setting time over error Low-speed execution monitoring timeout
6	6	CHK instruction	
7	7	Annunciator	
8	8	—	
9	9	BATTERY ERR.	
10	A	Clock data	

POINT

- (1) When LED indicator is left OFF for the error occurrence above, set the factor number area to 0, which stores the applicable factor numbers from SD207 to SD209.

Example: To set the ERROR LED to remain OFF when a fuse blown error occurs, set "0" in the item number setting area whose item number is "2".



Since the item number "2" is not set, the ERROR LED remains OFF even if a fuse blown error is detected. The ERROR LED remains OFF even if another error whose error item number is "2" is detected (I/O module verify error, special function module verify error).

- (2) Even if the LED is set to remain OFF, SM0 (the diagnostics error flag) is still turned ON, SM1 (the self-diagnostics error flag) is still turned ON, and the error code is stored in SD0 (CPU diagnosis error register).

10 OTHER FUNCTIONS

10.1 Function List

The following list shows the rest of the functions.

Item	Description	Reference
Constant scan	Performs a program at fixed intervals regardless of the actual program scan time.	Section 10.2
Latch function	Retains the device data when resetting the CPU module while the programmable controller power is OFF.	Section 10.3
Setting of the output status when switching from STOP to RUN	Sets the output (Y) status when the CPU module is switched from STOP to RUN (Re-outputting the outputs before STOP/Outputting the outputs after performing operation).	Section 10.4
Clock function	Runs the internal clock of the CPU module.	Section 10.5
Remote operation	Operates the Q2ASCPU from a remote place.	Section 10.6
Remote RUN/STOP	Starts or stops the CPU module operation.	Section 10.6.1
Remote STEP-RUN	Performs a step operation to the CPU module.	Section 10.6.2
Remote PAUSE	Suspends the CPU module operation.	Section 10.6.3
Remote RESET	Resets the CPU module.	Section 10.6.4
Remote latch clear	Clears the CPU module latch data.	Section 10.6.5
Relationship between remote operation and CPU module RUN/STOP key switch	Explains the relationship between the CPU module RUN/STOP key switch setting and operation when performing remote operation.	Section 10.6.6
Terminal setting	Uses the Q6PU programming unit's indicator and key input.	Section 10.7
Message display	Displays messages on the indicator of the Q6PU.	Section 10.7.1
Key input operation	Reads key input from the Q6PU.	Section 10.7.2
Reading module access time intervals	Monitors the access time intervals (The time between the acceptance of one CPU module access and the acceptance of the next CPU module access) for special function modules, network modules, and peripheral devices.	Section 10.8

For details of GPP function operation, refer to the GX Developer Operating Manual or the Type SW□IVD-GPPQ GPP Software package Operating Manual (Online).
For details of the Q6PU operation, refer to the Q6PU Operating Manual.

10.2 Constant Scan

(1) Constant scan

In the Q2ASCPU, the scan time varies since the processing time differs depend on the execution status of the instructions used in the sequence program.

Constant scan is a function whereby the sequence program is repeatedly performed while maintaining constant scan time.

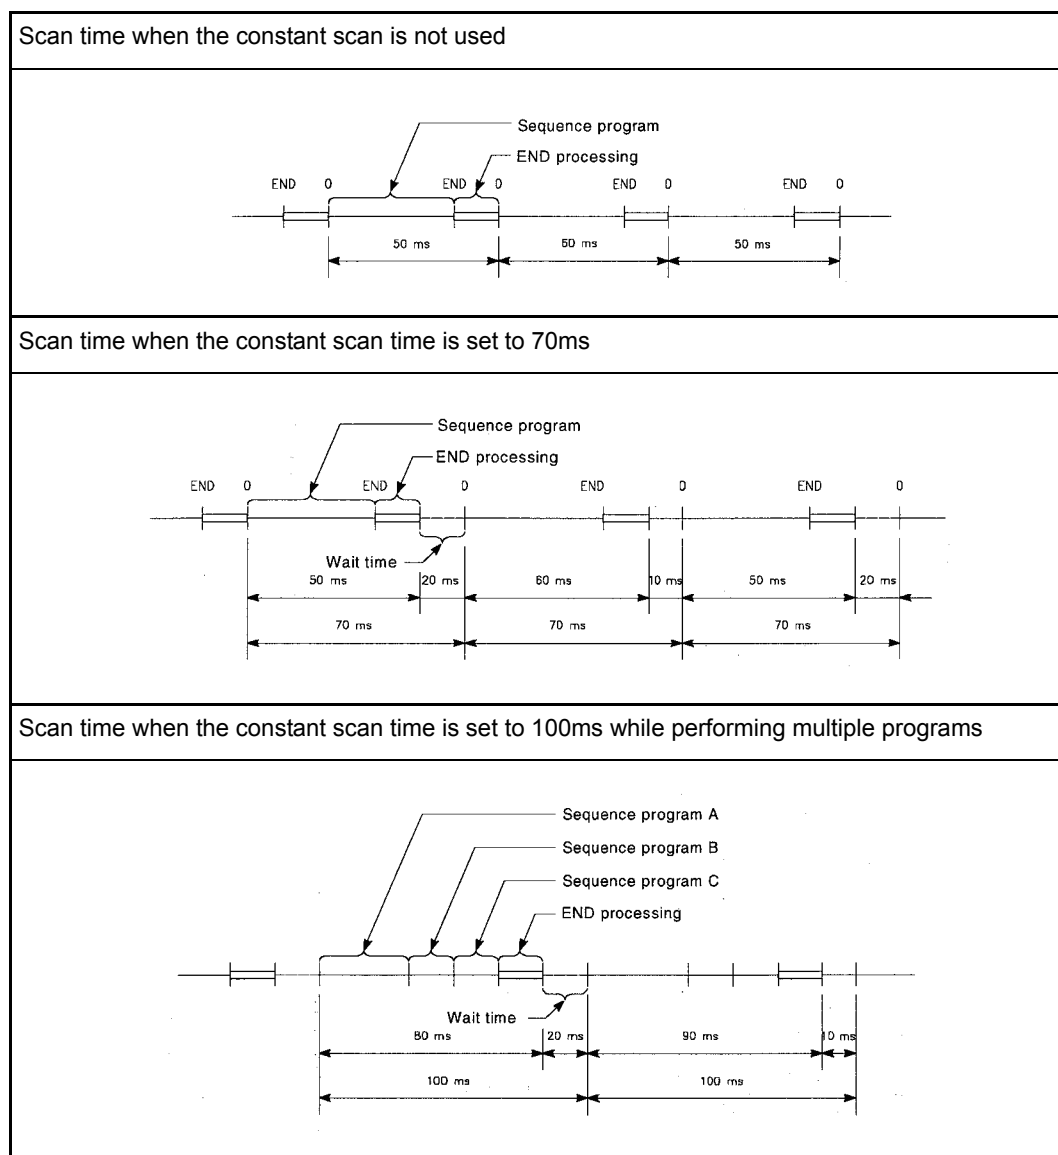



Fig. 10.1 Constant scan operation

When the low-speed execution type program is used, either this constant scan function or a low-speed program execution time has to be set.

(For details, refer to the QnACPU Programming Manual (Fundamentals).)

- (2) Setting the constant scan time
- (a) The setting is made in "PC RAS" in the parameter mode of GPP function.
- When performing the constant scan, set the constant scan time.
 - When not performing the constant scan, leave the field blank.

Example: When setting 100ms to "Constant scan"

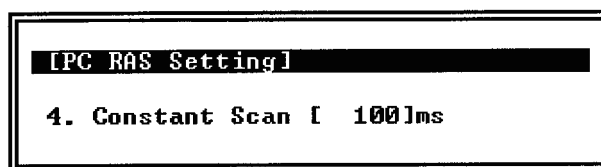

- (b) Set constant scan time that is longer than the maximum scan time of the sequence program. If the scan time of the sequence program is longer than the set value for constant scan time, the Q2ASCPU detects an error code (SD0 = 5010), and the sequence program is performed in the own scan time, ignoring the constant scan time setting.

Make sure that the constant scan time setting is shorter than the set time for WDT (Watchdog timer). If it is longer than the set time for WDT, the Q2ASCPU detects a WDT error and the program execution is stopped.

Set the constant scan time within the following range.

Setting time for WDT > Setting time for constant scan > Maximum scan time of sequence program

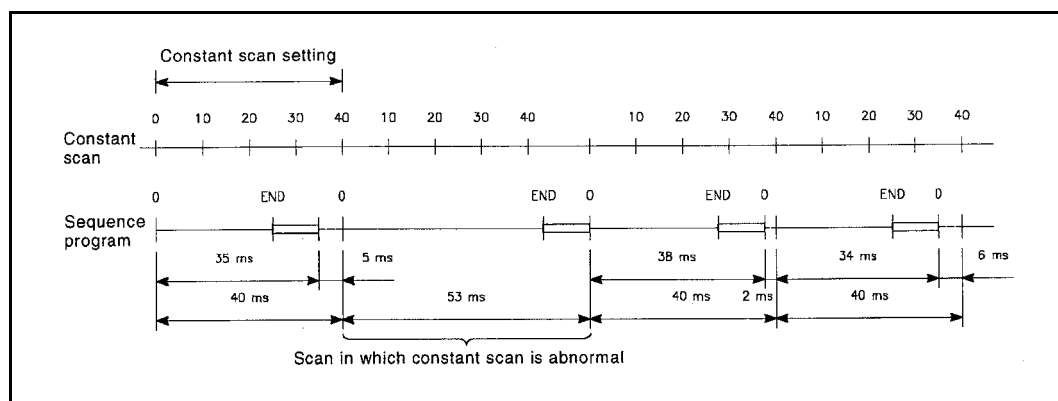


Fig. 10.2 Operation when scan time is longer than constant scan setting time

- (c) Sequence program processing is suspended in the wait time between the END processing of the sequence program and the start of the next scan. However, if an interrupt factor occurs after the execution of END processing, or if there is a low-speed execution type program, the interrupt program or the low-speed execution type program is performed.

(d) Constant scan time error

If there is a low-speed execution type program when performing the constant scan, the constant scan time may be shifted by the time shown below.

$$(\text{Error}) = \left[\begin{array}{l} \text{Maximum processing time} \\ \text{of one instruction in the} \\ \text{low-speed execution type} \\ \text{program} \end{array} \right] + \left[\frac{\text{low-speed END processing time}}{\left(\begin{array}{l} \text{Time taken to execute the END} \\ \text{processing for a low-speed} \\ \text{execution type program} \end{array} \right)} \right]$$

The low-speed execution type program is divided and performed within surplus time. Therefore, if one constant scan ends while performing the instruction takes long processing time, the constant scan is completed after finishing the processing of the instruction during execution. The time extended to complete the execution of the instruction is the constant scan error. For details of the instruction processing time, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).

10.3 Latch Function

When the programmable controller power is turned ON, the CPU module is reset using the RUN/STOP key switch, or a instantaneous power failure lasting longer than the allowable momentary power interruption time occurs, the all device values in the Q2ASCPU are cleared, and the default values are set in the devices (Bit devices: OFF, word devices: 0). The latch function retains the data in the devices when performing these operations. The operations in the program are the same whether or not the latch function is used.

(1) Application of the latch function

The latch function can be used when continuing the control to retain data such as production quantities, numbers of defects, addresses, etc., even if a instantaneous power failure longer than the allowable time occurs.

(2) Devices that can be latched

(a) The following devices can be latched.

- 1) Latch relay
- 2) Link relay
- 3) Annunciator
- 4) Edge relay
- 5) Timer
- 6) Retentive timer
- 7) Counter
- 8) Data register
- 9) Link register

POINT

Even if a latch designation is set for a device, the device will not be latched if a local device designation or device initial value designation is made.

(b) The latch range is set on the "Device" in the parameter mode of GPP function.

In latch range setting, it is possible to set a range within which the latch clear key is effective (Latch (1) Start) and a range within which the key is not effective (Latch (2) Start). For details on device latch ranges for each device, refer to the QnACPU Programming Manual (Fundamentals).

POINT

The devices data in the latch range are retained by the battery (A6BAT) installed in the CPU module.


- (1) Even if a sequence program is written to a memory card and ROM operation is performed, the battery is required for the latch function.
- (2) If the battery connector is disconnected from the CPU module connector while the programmable controller power is OFF, the devices data in the latch range is lost.

- (3) Clearing the device data in the latch range
 - (a) To clear the devices data in a latch range and set the default values instead, perform "Latch clear". When the latch clear is performed, the devices data in the non-latched range is also cleared.
However, the devices for which the latch clear key has been set to Disable in the Parameter are not cleared by performing latch clear.
 - (b) For the methods of performing latch clear, refer to Section 12.4.

10.4 Setting of the Output (Y) Status When Switching from STOP to RUN

When the RUN or other status is changed to the STOP status, the CPU module stores the output (Y) in the RUN status into the programmable controller and turns all outputs (Y) OFF.

In this function, whether to re-output the outputs (Y) when switching from STOP to RUN or to output them after an operation can be set in the "PC system" in the parameter mode of GPP function .

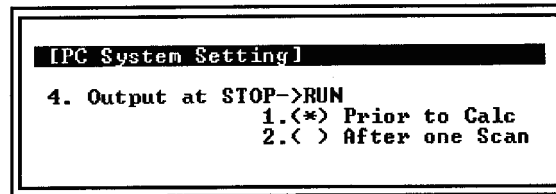

- (a) Re-output (Prior to Calc).....The output (Y) status immediately before the STOP status is output, and then the sequence program is calculated.
- (b) Output after operation execution (After one Scan).....The output is OFF status. The output (Y) will be output after the sequence program operation is executed.

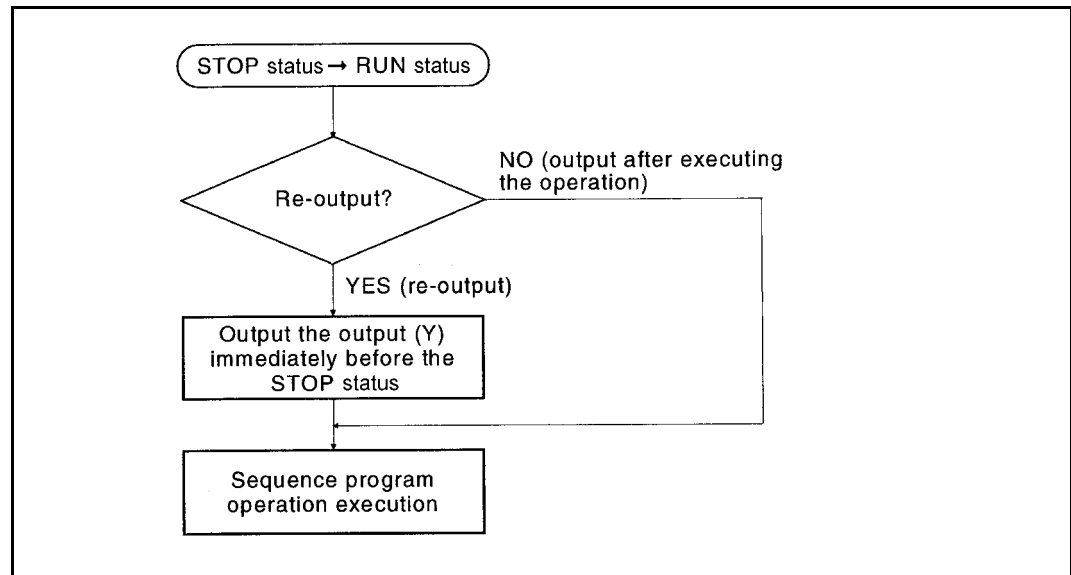


Fig. 10.3 Processing when a programmable controller is switched from STOP to RUN

10.5 Clock Function

The Q2ASCPU has a clock in the CPU module.

Since the clock data can be read in the sequence program, it can be used for time control of the user system.

In addition, the clock data can also be used for time control to the functions performed by the CPU module, such as the breakdown history.

Clock operation by the clock function is continued with the battery when the programmable controller power is turned OFF or a instantaneous power failure lasting longer than the allowable momentary power interruption time occurs.

POINT	
	The CPU module system uses the clock data for a breakdown history. When using a CPU module, be sure to set the correct time first.

(1) Clock data

The clock data is composed of the year, month, day, hour, minute, second, and day of the week used by the clock element in the programmable controller CPU, as shown below.

Data name	Description	
Year	Last two digits of the year	
Mon	1 to 12	
Sun	1 to 31(Leap year, automatic identification)	
Hour	0 to 23 (24-hour system)	
Minute	0 to 59	
Second	0 to 59	
Day of the week	0	Sunday
	1	Monday
	2	Tuesday
	3	Wednesday
	4	Thursday
	5	Friday
	6	Saturday

(2) Accuracy

The accuracy of the clock function depends on the ambient temperature, as shown below.

Ambient Temperature	Accuracy (daily variance)
0°C	-1.7 to + 4.9s (TYP. +1.7S)
+ 25°C	-1.0 to + 5.2s(TYP.+2.2S)
+ 55°C	-7.3 to + 2.5s(TYP.-1.9S)

(3) Writing clock data to the clock elements

(a) Use the following procedure to write clock data to the clock elements.

1) Writing from a peripheral device


- When using GPP function, clock data can be written to the clock elements using the "Set clock" of the PLC menu in PLC diagnostics mode.
- When using the Q6PU, clock data can be written to the clock elements by using the clock monitor option in the monitor functions of the PLC system in the other mode.

(For details on the operation for each peripheral device, refer to the Operating Manual for each.)

2) Writing from a program

Clock data is written to the clock elements using the clock instruction (DATEWR).

The following shows the example of the program.

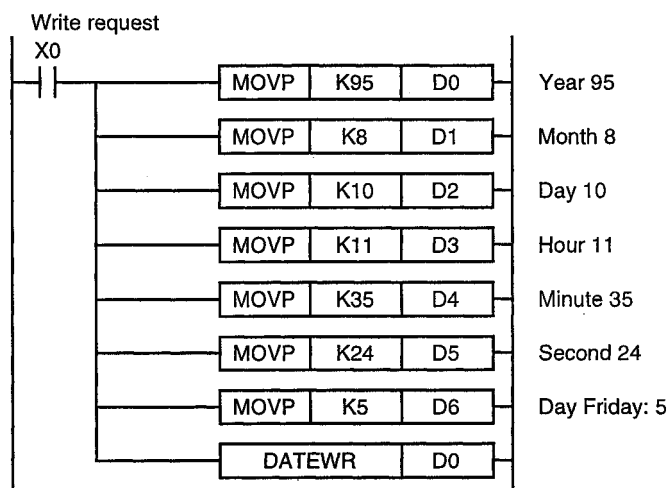

For details on the DATEWR instruction, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).

POINT

- (1) Clock data is not written to clock elements in advance. Write clock data to the clock elements before using the Q2ASCPU.
- (2) Even if partly changing the clock data, rewrite all data to the clock elements.
- (3) If the nonexistent time is written to the clock elements, normal clock operation is impossible.


Example

Setting "13" to the month.

(4) Clock data read

- (a) To read clock data to data registers, use the clock data read instruction (DATERD) in the program.

An example of a program using the instruction is shown below.



For details on the DATERD instruction, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).

- (b) To read the clock data to SD210 to SD213, turn SM213 ON from a sequence program or a peripheral device.

(5) Special relays and special registers for reading/writing clock data

The section explains the special relays and special registers used for setting data and reading clock data for clock operation.

- (a) Special relays used for the clock function

Device	Name	Description
SM210	Clock data set request	<ul style="list-style-type: none"> Writes clock data to the special registers (SD210 to SD213) and performs clock operation. Writes the clock data stored in SD210 to SD213 to the clock elements after execution of the END instruction in the scan in which SM210 turns from OFF to ON.
SM211	Clock data error	<ul style="list-style-type: none"> Used to determine whether or not there are any errors when the clock data is set. Turns ON if any data is not a BCD cord.
SM213	Clock data read request	<ul style="list-style-type: none"> Reads the clock data stored in special registers SD210 to SD213. When SM213 is ON, the clock data is read to SD210 to SD213 after execution of the END instruction.

(b) Special registers used for clock data

Device	Name	Description																
SD210	Clock data (year, month)	<ul style="list-style-type: none">The year and month are recorded as follows. The year data is the last two digits of the year. <div><div><div>b15 to b8</div><div>b7 to b0</div></div><div><div></div><div></div></div><div>Month (stores 01 to 12 in BCD)</div><div>Year (stores 00 to 99 in BCD)</div></div>																
SD211	Clock data (day, hour)	<ul style="list-style-type: none">The day and hour are recorded as follows. <div><div><div>b15 to b8</div><div>b7 to b0</div></div><div><div></div><div></div></div><div>Hour (stores 00 to 23 in BCD)</div><div>Day (stores 01 to 31 in BCD)</div></div>																
SD212	Clock data (minute, second)	<ul style="list-style-type: none">The minute and second are recorded as follows. <div><div><div>b15 to b8</div><div>b7 to b0</div></div><div><div></div><div></div></div><div>Seconds (stores 00 to 59 in BCD)</div><div>Minutes (stores 00 to 59 in BCD)</div></div>																
SD213	Clock data (day of the week)	<ul style="list-style-type: none">The day of the week is recorded as follows. <div><div><div>b15 to b4</div><div>b3 to b0</div></div><div><div></div><div></div></div><div>Day (stores 0 to 6 in BCD)</div><div>Stores 0</div></div> <ul style="list-style-type: none">The settings for the day of the week are as follows: <table><tr><td>Day of the week</td><td>Sun</td><td>Mon</td><td>Tue</td><td>Wed</td><td>Thu</td><td>Fri</td><td>Sat</td></tr><tr><td>Storage data</td><td>0</td><td>1</td><td>2</td><td>3</td><td>4</td><td>5</td><td>6</td></tr></table>	Day of the week	Sun	Mon	Tue	Wed	Thu	Fri	Sat	Storage data	0	1	2	3	4	5	6
Day of the week	Sun	Mon	Tue	Wed	Thu	Fri	Sat											
Storage data	0	1	2	3	4	5	6											

10.6 Remote Operation

With the Q2ASCPU, the operating status of the CPU module can be controlled from external sources (GPP function, intelligent special function module, remote contact, etc.).

REMARK

In this chapter, a serial communication module is used as an example of an intelligent special function module.

10.6.1 Remote RUN/STOP

Remote RUN/STOP refers to the function that sets the Q2ASCPU to RUN or STOP from an external source while the CPU module RUN/STOP key switch is set to the RUN position.

(1) Application of remote RUN/STOP

Remote RUN/STOP operation from remote location is useful in the following cases.

- (a) When the CPU module is installed in an inaccessible location
- (b) When setting the CPU module in a control panel to RUN/STOP from an external source

(2) Operation for remote RUN/STOP

The following shows the program operations to which remote RUN/STOP is performed.

- (a) Remote STOP..... The program is performed up to the END instruction, then STOP state is established.
- (b) Remote RUN..... When remote RUN is performed with the CPU in STOP set by remote STOP, the program will be in RUN state again and be performed from step 0.

(3) Method for performing remote RUN/STOP

The following two methods are available for performing remote RUN/STOP.

(a) Method using a remote RUN contact

The remote RUN contact is set in the PLC system in the parameter mode of GPP function.

The settable device range is from input X0 to 1FFF.

Remote RUN/STOP can be performed by switching the remote RUN contact ON/OFF.

- 1) When the remote RUN contact is OFF, the CPU module is in RUN state.

2) When the remote RUN contact is ON, the CPU module is in STOP state.

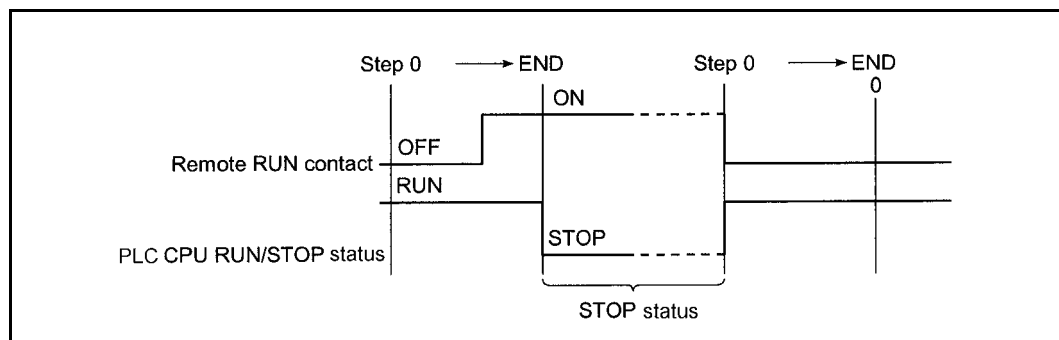


Fig. 10.4 Time chart for RUN/STOP switching with remote RUN contact

- (b) Method using GPP function, serial communication module, etc.

The CPU module can be set to RUN or STOP by remote RUN/STOP operation from GPP function, or a serial communication module, etc.

The operation using GPP function can be performed in the Remote operation of the PLC menu in any mode.

The control using a serial communication module is performed with the commands in the dedicated protocol.

For details on serial communication module control, refer to the Serial Communication Module User's Manual.

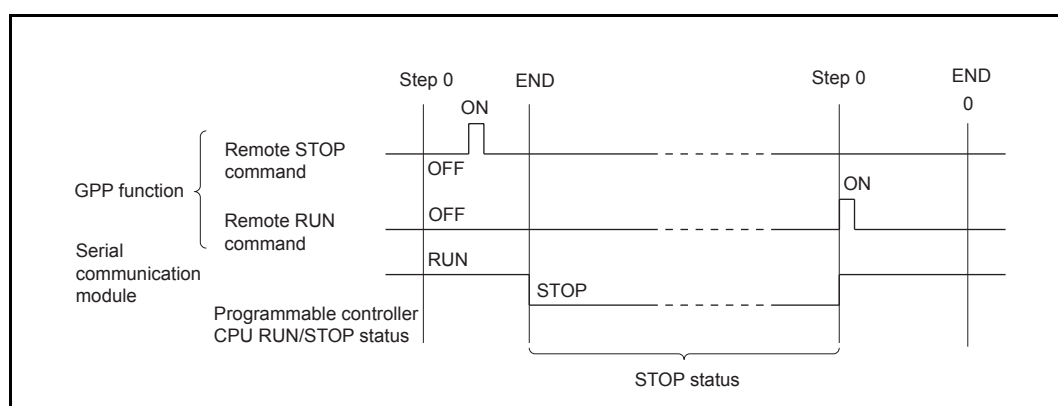


Fig. 10.5 Time chart for remote RUN/STOP switching with GPP function or a serial communication module

(4) Precautions

- (a) Since the STOP state has a priority in the Q2ASCPU, pay attention to the following points.

- 1) In the Q2ASCPU, if remote STOP is performed from any one of remote RUN contact, GPP function, serial communication module, etc., the QnACPU will be STOP.
- 2) In order to set the Q2ASCPU to RUN again after it has been set to STOP by remote STOP, all external factors which set remote STOP (Remote RUN contact, GPP function, serial communication module, etc.) have to be set to RUN.

REMARK

The RUN/STOP status is defined as follows.

- RUN status..... Status in which the sequence program is repeatedly performed from step 0 to the END instruction.
- STOP status..... Status in which the sequence program operation is stopped and all outputs (Y) are OFF.

10.6.2 Remote STEP-RUN

Remote STEP-RUN refers to the function whereby the step run of the Q2ASCPU is performed from GPP function while the RUN/STOP key switch of the module is in RUN position.

"Step run" is program execution that operates by one step at a time, starting from the designated step.

For details on step run, refer to Section 8.7.

(1) Application of remote STEP-RUN

When debugging the system, for example, the program can be performed while checking its execution and the contents of each device.

(2) Method for performing remote STEP-RUN

The procedure for remote STEP-RUN is as follows.

- 1) Set the RUN/STOP key switch of the CPU module to RUN position.
- 2) Perform STEP-RUN operation with GPP function.

10.6.3 Remote PAUSE

Remote PAUSE refers to the function that performs PAUSE function to the Q2ASCPU from an external source while the CPU module RUN/STOP key switch is set to the RUN position.

The PAUSE function stops a CPU module operation while retaining the ON/OFF status of all outputs (Y).

(1) Application of remote PAUSE

This function can be used to retain the output (Y) with ON status even if the CPU module is in STOP due to process control.

(2) Methods for remote PAUSE

The following two methods are available for performing remote PAUSE.

(a) Method using a remote PAUSE contact

The remote PAUSE contact is set in the PLC system in the parameter mode of GPP function.

The settable device range is from input X0 to 1FFF.

- 1) When the scan END processing is performed with both the remote PAUSE contact and the PAUSE enable flag (SM206) are ON, the PAUSE status contact (SM204) turns ON.

When performing up to the END instruction of the scan following the scan in which the PAUSE status contact turned ON, the PAUSE state is established and operation is stopped.

- 2) When turning the remote PAUSE contact OFF or turning SM206 OFF with GPP function, the PAUSE status is reset and the sequence program operation is again performed from step 0.

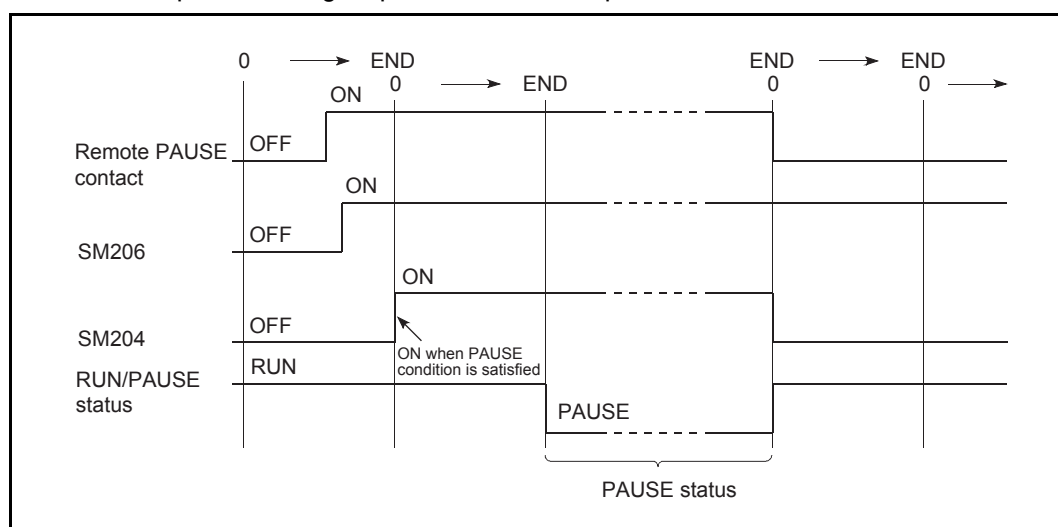


Fig. 10.6 Time chart for PAUSE with remote PAUSE contact

REMARK

When the remote RUN contact is made same as the remote PAUSE contact, the remote PAUSE contact will be invalid.

(b) Methods using GPP function or a serial communication module

The remote PAUSE operation can be performed from GPP function or from a serial communication module.

The operation using GPP function can be performed in the Remote operation of the PLC menu in any mode.

The control using a serial communication module is performed with the commands in the dedicated protocol.

For details on serial communication module control, refer to the Serial Communication Module User's Manual.

- 1) When the END processing of the scan in which the remote PAUSE command has received from GPP function is performed, the PAUSE status contact (SM204) turns ON.

When performing up to the END instruction of the scan following the scan in which the PAUSE status contact turned ON, the PAUSE status is established and the operation is stopped.

- 2) When the remote RUN command is received from GPP function, the sequence program operation is again performed from step 0.


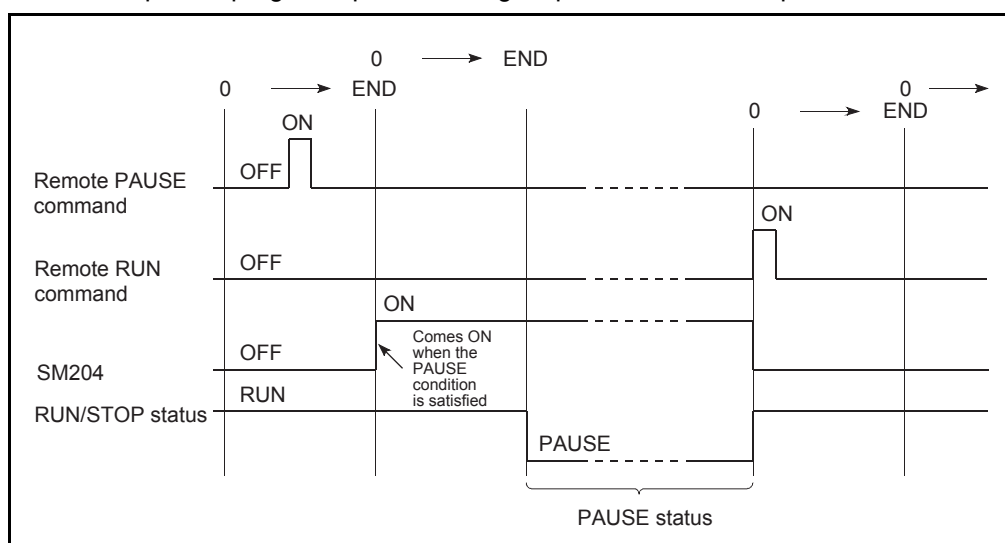


Fig. 10.7 Time chart for PAUSE with GPP function

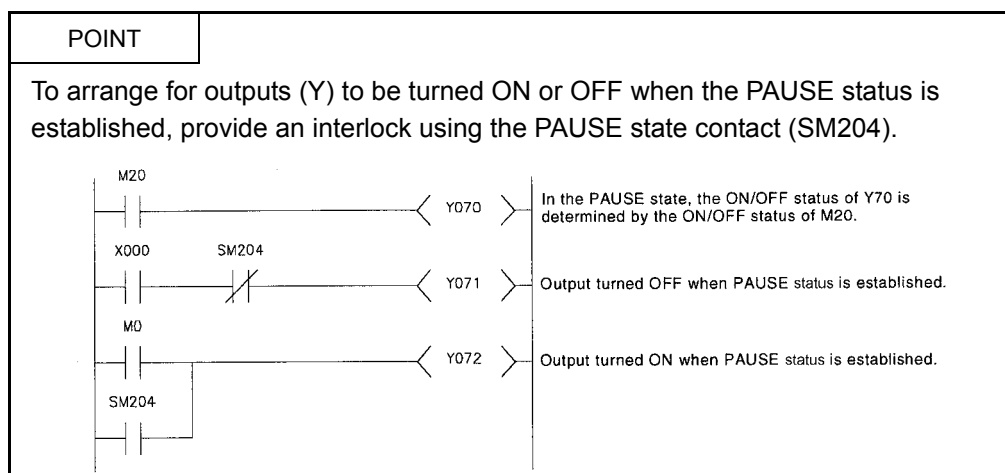

10.6.4 Remote RESET

Remote RESET is a function for resetting the Q2ASCPU by operation from an external device while the CPU module is in STOP.

Resetting is also possible even when the RUN/STOP key switch on the CPU module is set to the RUN position if the CPU module is stopped by an error detectable by the self-diagnostics function.

POINT	
	Remote RESET cannot be performed when the CPU module is in RUN.

(1) Application of remote RESET

Remote RESET can be used to reset the CPU module by remote operation when an error has occurred in the place from where the CPU module cannot be directly operated.

(2) Methods for remote RESET

Remote RESET can only be performed by operation from GPP function or a serial communication module.

- (a) Regardless of whether reset is performed from GPP function or a serial communication module, the setting to enable remote RESET has to be made in the Parameter before performing the reset operation.

The remote RESET "Enable/Disable" setting is made in the PLC system in the parameter mode of GPP function.

- (b) When the parameter is set to "Allow" in the "Remote reset" and written to the CPU module, resetting is performed with remote operation.
- When using GPP function, perform the reset in the PLC menu in any mode.
 - When using a serial communication module, perform the reset with dedicated protocol commands.

For details on serial communication module control, refer to the Serial Communication Module User's Manual.

10.6.5 Remote latch clear

Remote latch clear is a function for resetting the latched device data of the Q2ASCPU while the CPU module is in STOP by using such as a GPP function.

POINT	
Remote latch clear cannot be performed when the CPU module is in RUN.	

- (1) Application of remote latch clear
Remote latch clear is useful for latch clear operation when the CPU module is at the locations below: In this case, the function is used in combination with the remote RUN/STOP function.
 - When the CPU module is installed in an inaccessible location
 - When performing latch clear to the CPU module in a control panel from an external source
- (2) Methods for remote latch clear
Remote latch clear can only be performed by operation from GPP function or a serial communication module.
 - The operation using GPP function can be performed in the Remote operation of the PLC menu in any mode.
 - The control using a serial communication module is performed with the commands in the dedicated protocol.

For details on serial communication module control, refer to the Serial Communication Module User's Manual.

POINT	
<ol style="list-style-type: none"> 1. According to the device latch ranges set in "Device" in parameter mode, there are ranges within which latch clear is valid and ranges within which it is not valid. Remote latch clear is only valid for devices set in the range for which "Latch clear valid" is set. 2. When remote latch clear is performed, devices that are not latched are also cleared. 	

10.6.6 Relationship between remote operation and CPU module RUN/STOP key switch

Using the combination of the remote operation and the RUN/STOP key switch of the CPU module explained in Section 10.6.1 through Section 10.6.5, the operating status of the Q2ASCPU is determined as follows.

Key switch	Remote Operation					
	RUN* ¹	STEP-RUN	STOP	PAUSE* ²	RESET* ³	Latch Clear
RUN	RUN	STEP-RUN	STOP	PAUSE	Operation is not possible.* ⁴	Operation is not possible.* ⁴
STOP	STOP	STOP	STOP	STOP	RESET	Latch Clear

*1 If performed using a remote RUN contact, beforehand set "RUN-PAUSE contacts" in the PLC system in parameter mode.

*2 If performed using a remote PAUSE contact, beforehand set "RUN-PAUSE contacts" in the PLC system in parameter mode. Furthermore, the remote PAUSE enable coil (SM206) has to be turned ON in advance.

*3 "Remote reset" field in the PLC system has to be set to "Allow" in parameter mode.

*4 The operation status can be RESET if the CPU module is stopped by remote operation.

When the RUN/STOP key switch is set to RUN and multiple remote operation requests are received, the CPU module first performs the operation with the highest priority.

Remote operation	RUN	STEP-RUN	STOP	PAUSE	RESET	Latch Clear
Order of priority	4)	3)	1)	2)	-	-

The order of priority increases from (4) to (1).

10.7 Terminal Operation

This function sets the Q6PU programming unit in the terminal mode and performs the data communications shown below by using the instructions for peripheral devices of the Q2ASCPU.

- 1) Display of messages from the Q2ASCPU on the display of the Q6PU.
- 2) Storage of the Q6PU key input data in the devices of the Q2ASCPU.

In this way, the Q6PU can be used as a terminal of the Q2ASCPU.

These functions are explained from the next section.


However, for details on the instructions for peripheral devices, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).

10.7.1 Operation for message display

Specified character strings can be displayed on the Q6PU using the MSG instruction for peripheral devices.

Furthermore, character strings can be displayed with GPP function by using the CPU messages of the Display menu in the PLC diagnostics mode.


Example: Program to display "TOSOU LINE READY" as a message No.1 on the Q6PU when X0 is turned ON.

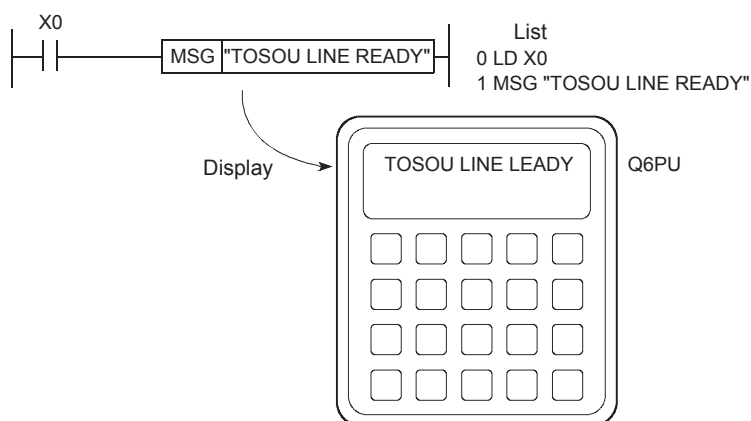

10.7.2 Key input operation

Character string data input at the Q6PU can be stored as ASCII data without change in specified devices by using the PKEY instruction for peripheral device. Data input ends when a CR code is input or when the 32nd character is input.

Example: Program to input "TOSOU LINE READY" on the Q6PU when X0 is turned ON.

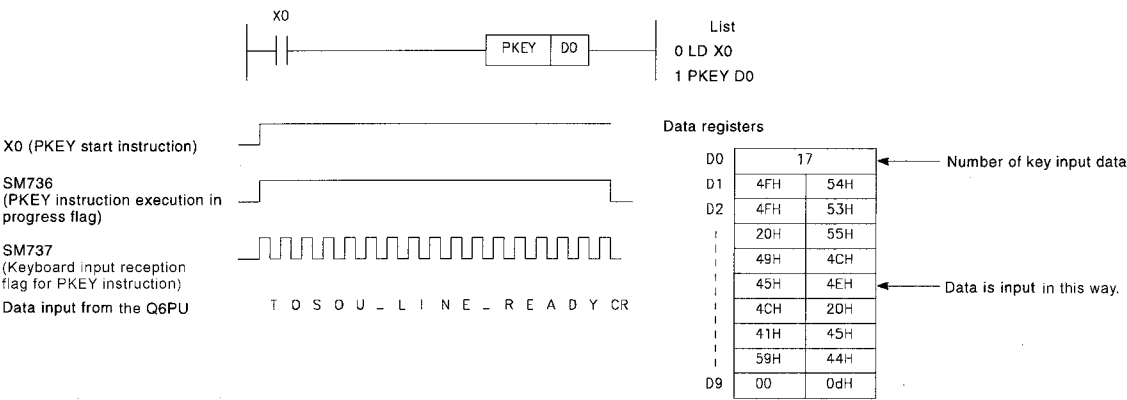

10.8 Reading Module Access Time Intervals

The Q2ASCPU can monitor the access interval time (The time between one access reception and the next access reception) for intelligent special function modules, network modules, data link modules, or GPP function. This enables to grasp the frequency of accesses to the CPU module from external sources.

The operation for reading the module access interval time involves the following special relay and special registers.

(1) Special relay


Number	Name	Description
SM551	Read module service interval	When this relay turns from OFF to ON, the module access interval time for the special function module specified in special register SD550 is read into special registers SD551 to SD552. ON : Read OFF : Ignored

(2) Special register

Number	Name	Description
SD550	Service interval measurement module	Set the I/O number of the module whose access interval time is to be measured. Set the I/O number of the peripheral device connected to the RS-422 interface of the CPU module to FFFFH. Also set the I/O number of the upper 2 digits in the 3-digit representation.
SD551 to SD552	Service interval time	When SM551 is turned ON, it stores the interval time for access from the module specified at SD550. SD551: 1ms units (Range: 0 to 65535) SD552: 1 μ s units (Range: 0 to 900, stored every 100 μ s) Example: When the module access interval time is 123.4ms: SD551=123, SD552=400

Program example:

Program for reading the module access interval time of the special function module at X/Y160.

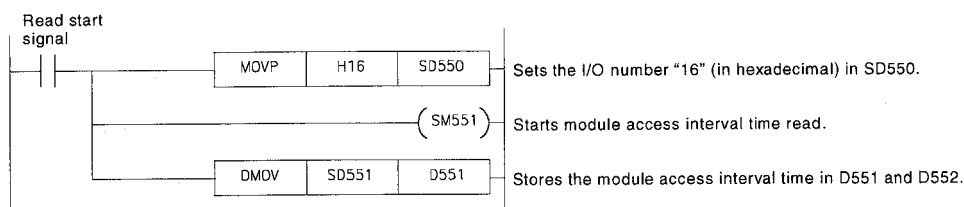

POINT

To read the access interval time for access from GPP function at another station in the network, set the I/O number of the network module.

REMARK

- The module access interval includes a transient request interval such as a monitor, a test and a program read/write.
The access interval via cyclic communication from a network module or a data link module is not stored.

11 COMMENTS THAT CAN BE STORED IN Q2ASCPU

11.1 Function List

The Q2ASCPU can store various types of comments. This has improved the CPU module operability, allowing users other than programmers to read programs easily.
The types of comments that can be stored in the Q2ASCPU are listed in the table below.

Item	Function	Refer to
PLC name	Naming the CPU module to be used.	Section 11.2
Drive title	Assigning a title to each drive.	Section 11.3
File title	Assigning a title to each file.	Section 11.4
Device comment	Assigning comments and/or labels to devices used in a program.	Section 11.5
Statements/notes	Assigning comments to each program step number or P or I pointer.	Section 11.6
Initial device value comment	Assigning a comment to the initial device value file.	Section 11.7

For details on the setting method for each function, refer to the GX Developer Operating Manual or SW□IVD-GPPQ Operating Manual (Offline).

11.2 PLC name

PLC name appends a comment to a CPU module to make it easier to confirm the CPU module when accessing the Q2ASCPU by GPP function.

Two types of PLC names can be set: labels and comments. The settings are made on the "Define PC name" screen in the parameter mode of GPP function.

```

[Define PC Name]
1. Label [SYSTEM ]
2. Comment [SYSTEM No.1]
Execute<Y> Cancel<N>
Space:Select Esc:Close


```

The setting details are indicated in the table below.


Item	Setting	Setting range	Default value
Label	Set a label for the CPU module.	Up to 10 characters	No setting
Comment	Set a comment for the CPU module.	Up to 64 characters	

11.3 Drive Title

The drive title function assigns a title to a drive to allow users to easily identify what file is stored in the built-in RAM or memory card.
Drive titles are created on the "Title Statement Def" screen under the PC menu in the online mode of GPP function.

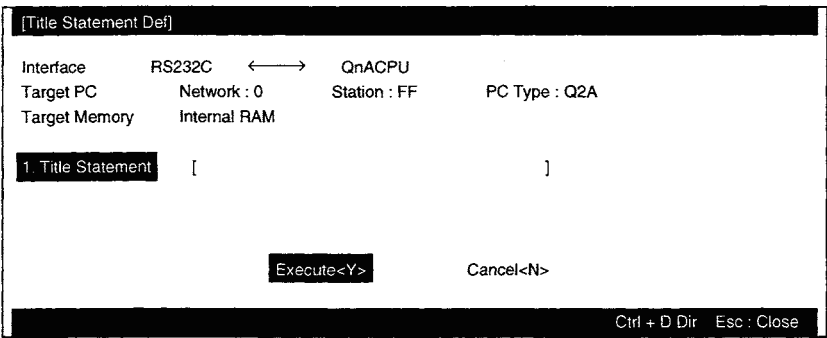

A created title is displayed on the screen as shown below.

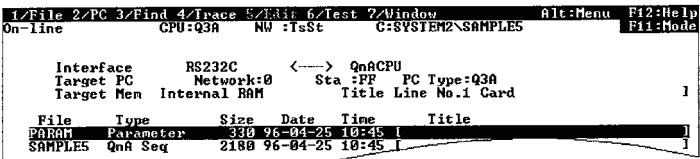

POINT	
Note that creating a drive title uses an area equivalent to one file in each memory.	

11.4 File Title

The file title function allows file titles to be assigned to files so that the contents of the files can be figured out.

File titles are set in file setting performed when starting GPP function, or in PLC writing from the PLC menu in any mode. Up to 32 characters can be used.


[Create]			
1. Drive/Path	IC:\GPPQ\USR		1
2. System	[SYSTEM1]	Title	[System No.1] 1
3. Machine	[TRANSFER]	Title	[Transfer Line] 1
4. File	[LINE1]	Title	[Line No.1 Program] 1
		Execute<Y>	Cancel<N>
Ctrl+L:List Ctrl+D:Dir Space:Select Esc:Close			

File titles are stored in the corresponding created files.

Note that they are not stored in any files for file registers.

11.5 Device Comment

The device comment function displays comments assigned to respective devices so that programs can be read easily.
In addition, by setting "Xtype" for the CPU type with GPP function, programs can be created using labels instead of devices.

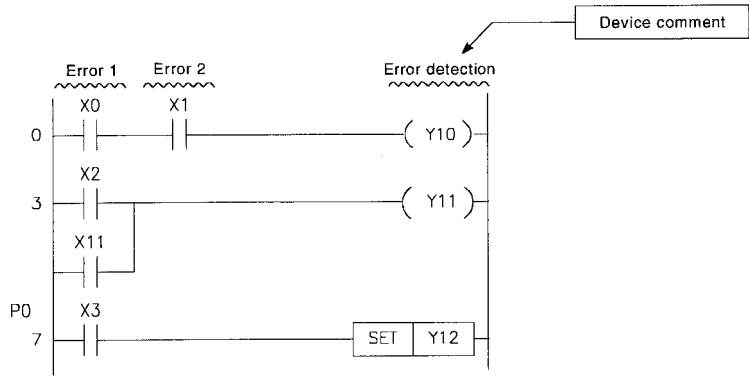

POINT
A memory card is required to create device comments and store a device comment file in a CPU module.

- (1) Device comments are set in the documentation mode of GPP function.
Up to 32 characters are used for each comment and up to 10 characters for each label (device label name).

1/File 2/PC 3/Find 5/Edit 7/Window 8/Option					Alt:Menu	F12:Help
Document	Device	CPU:Q3A	C:\SYSTEM2\SAMPLES		<Ins>	F11:Mode
	Device		Comment		Device Label	
	X	0	[12345678901234567890123456789012		1234567890	
	X	1	[]	[]	
	X	2	[]	[]	
	X	3	[]	[]	
	X	4	[]	[]	
	X	5	[]	[]	
	X	6	[]	[]	
	X	7	[]	[]	
	X	8	[]	[]	
	X	9	[]	[]	
	X	A	[]	[]	

- Comments and labels can be assigned to the following devices.
Device name:X, Y, M, L, F, SM, B, SB, V, T (present value), C (present value), ST (present value), D, SD, W, SW, R, ZR, P, I, U□\G□,
J□\X, J□\Y, J□\B, J□\SB, J□\W, J□\SW, BL□\S, BL□\TR
(When P or I comments are used as pointers for programs such as subroutine or interrupt programs, they are not displayed. To display these comments, make them displayed as pointer statements. (Refer to Section 11.6))

- (2) When using comments with application instructions (LEDC, PRC, etc.), if a device comment file has been written to the CPU module, enable one of the options in the parameter setting for the device comment file.
- This setting is made at "2. Comment file used in a command" on the "PLC file" screen in the parameter mode of GPP function.

[PC File Setting]	
1. File Register	3. Device Initial Value
1.<*> Not Used	1.< > Not Used
2.< > Program Name is Used	2.<*> Program Name is Used
Drive []	Drive [0]
3.< > Use the Following Files	3.< > Use the Following Files
Drive []	Drive []
File []	File []
Capacity [] K	
2. Comment File Used by Instruction	4. File for Local Device
1.<*> Not Used	1.<*> Not Used
2.< > Program Name is Used	2.< > Use the Following Files
Drive []	Drive []
3.< > Use the Following Files	File []
Drive []	
File []	
Execute<Y> Cancel<N>	
Space:Select Esc:Close	

The setting details are as follows:

1. "Not Used":

No setting is made for the comment file to be used. To use the comment file, use the QCDSET instruction. (For details on the QCDSET instruction, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).)

2. "Program Name is Used":

Use the comment file with the same file name as the program that exists in the specified drive and is currently being executed.

When the program is changed, the comment file is also changed.


3. Using the designated device comment file:

Use the name of the file that is stored in the drive specified by the parameter.


POINT
<p>(1) When using the QCDSET instruction, note the following points.</p> <p>(a) When the above 1) or 2) has been set, the file set with the QCDSET instruction is valid for all program files.</p> <p>(b) When 3) is set, the file set with the QCDSET instruction is valid only for the program file for which the QCDSET instruction is executed.</p> <p>(2) Even if the file set with the parameter does not exist in the specified drive, no CPU module error is generated. Since no file exists, however, the CPU module does not display any comments.</p>

11.6 Statements/Notes

Statements and notes are assigned to each program step, or to P or I pointers, in order to facilitate program reading.

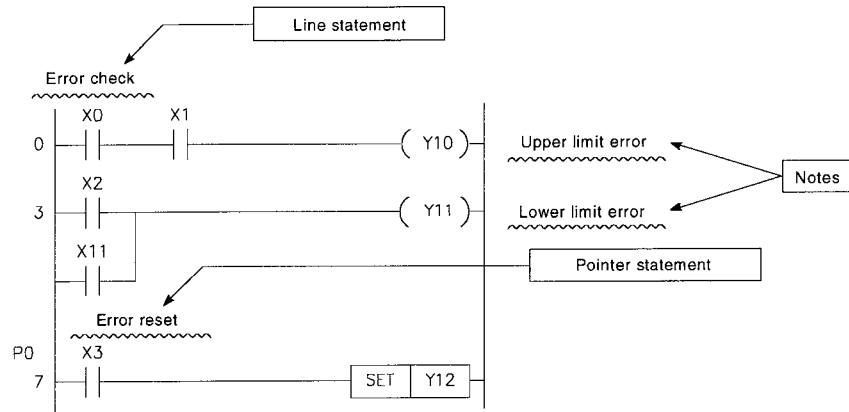

- (1) Statements or notes are set on the "Pointer statement", "Statement", or "Note" screen displayed from the edit menu in the documentation mode of GPP function.

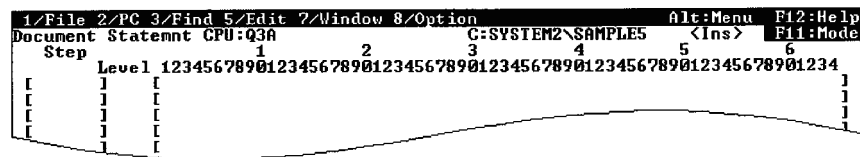

- (2) The details of each comment are as follows:
 - (a) Statement (Line statement)

A comment can be appended to a ladder block provided for individual function to explain the meaning and usage of the function.
 - (b) Pointer statement

A comment can be appended to a pointer placed in the head of a subroutine or interrupt program to explain the meaning and usage of each program.
 - (c) Note

A comment can be appended to individual ladder blocks to explain the meaning and usage of the function.

11.7 Initial Device Value Comment

Initial device value comments are assigned to initial device value files so that individual file contents can be figured out.

Initial device value comments are stored in an initial device value file.

They are set on the "Device Initial Value Range" screen displayed from the edit menu in the device mode of GPP function.

[Device Initial Value Range]				
#	# of Dev	First Device	Last Device	Comment
1	[16]	[D0] -> [D15	1 Production Indication data
2	[0]	[] -> [1
3	[0]	[] -> [
4	[0]	[] -> [


12 OVERVIEW OF PROCESSING PERFORMED BY THE Q2ASCPU

12.1 Program Execution Types

Programs to be executed by the Q2ASCPU are stored in the built-in RAM of the CPU module or in a memory card.

While all of the data can be stored as one program in the built-in RAM or a memory card, they can be also divided into several programs based on control units and stored.

When programming is undertaken by more than one designer, all the programming process can be divided into several parts based on the processing units for each designer and all of the programming data can be stored in the built-in RAM of a CPU module or a memory card.

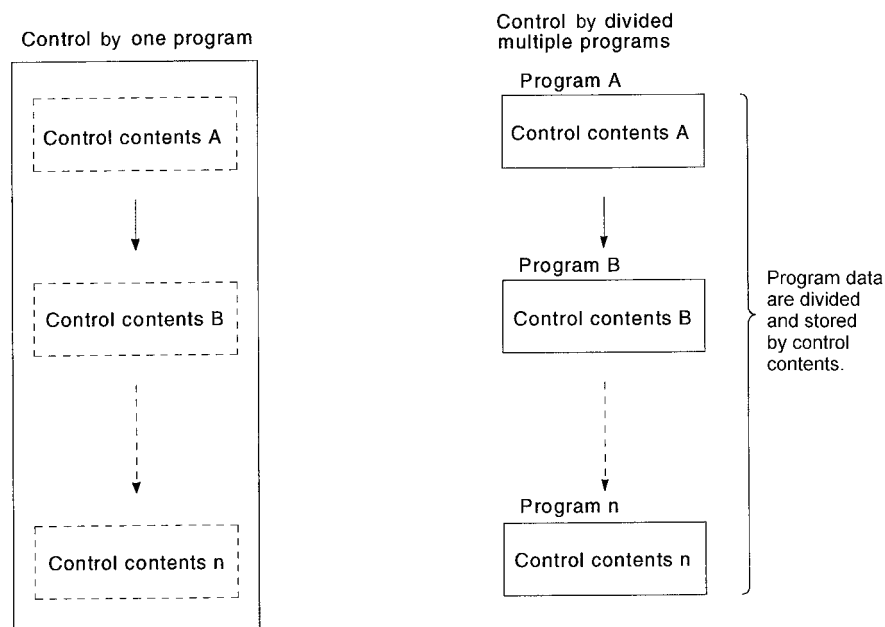

When dividing a program data into multiple programs, set "execution type" for each program in program setting in the parameter mode of GPP function.


The Q2ASCPU executes each execution type program in order of setting.

There are four executions types: "Initial execution type", "Scan execution type", "Low-speed execution type", and "Standby type".

- Initial execution type : Program executed only once when a programmable controller is powered ON, when a CPU module is reset, or when the RUN/STOP key switch of the CPU module is switched from STOP to RUN.
(Refer to Section 12.1.1)
- Scan execution type : Program that is executed once per scan, starting from the next scan after execution of the initial execution type program.
(Refer to Section 12.1.2)

- Low-speed execution type : Program that is executed only in the surplus scan time after execution of a scan execution type program in the constant scan setting, or only when the low-speed type program execution time is set.
(Refer to Section 12.1.3)
- Standby type : Program that is only executed when an execution request is made for it.
(Refer to Section 12.1.4)

The following shows the flow of operation processing when a programmable controller is powered ON, when a CPU module is reset, or when the RUN/STOP key switch of a CPU module is switched from STOP to RUN.

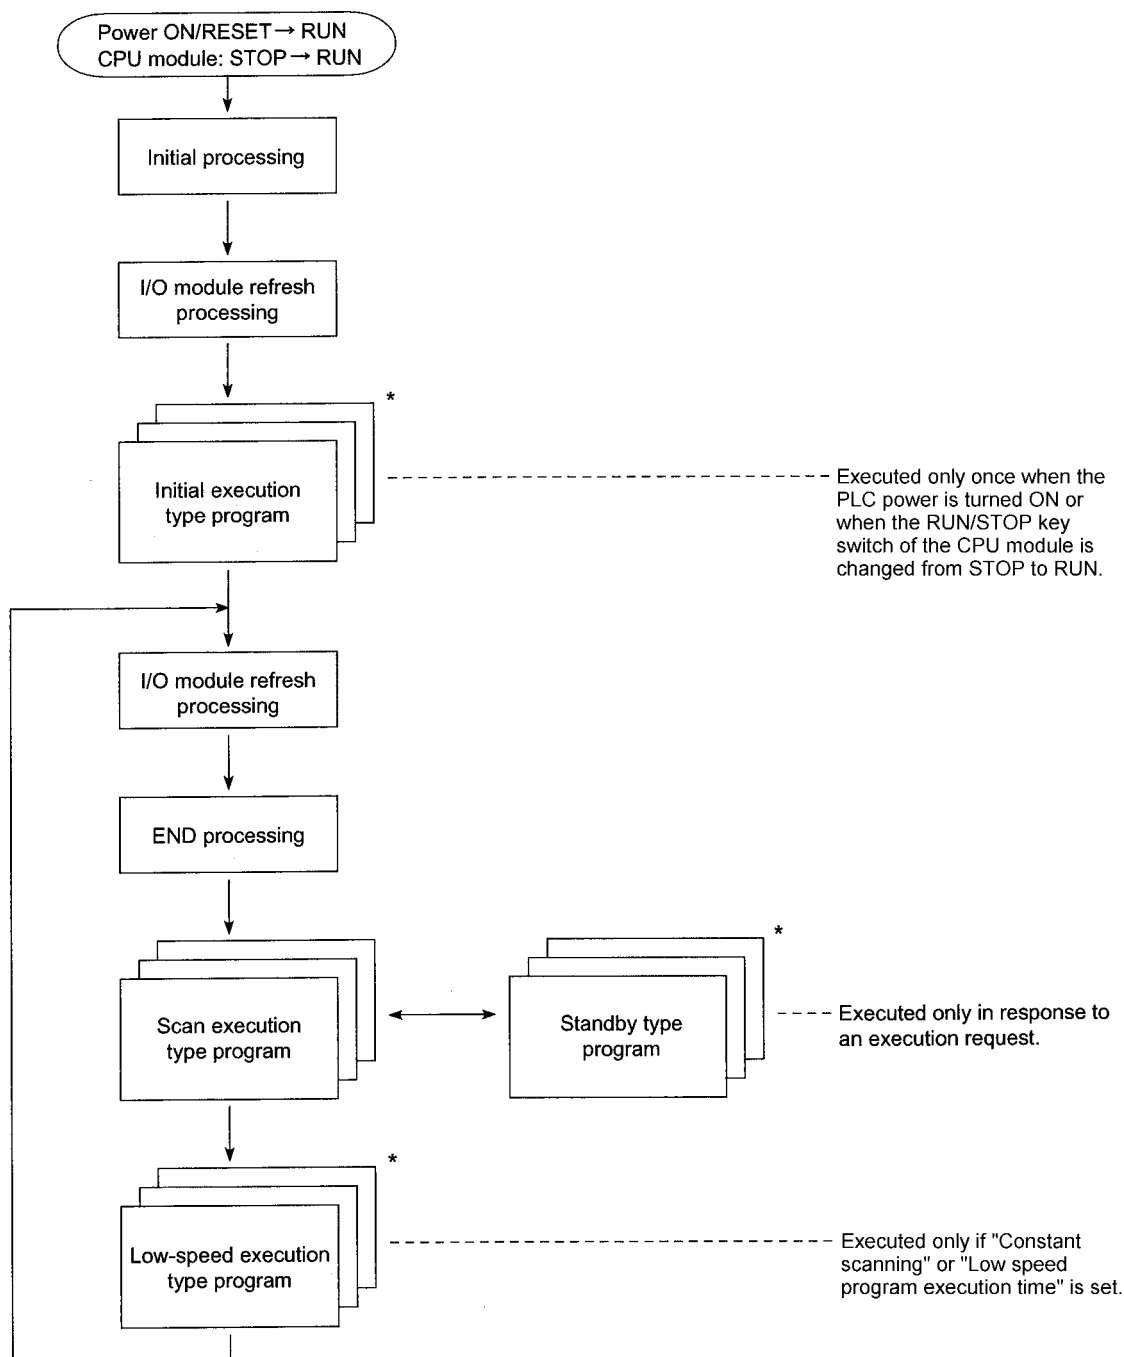


POINT

<p>For the Q2ASCPU, all execution types need not be set. Use initial execution type, low-speed execution type, and standby type programs marked with asterisks if required.</p>

12.1.1 Initial execution type programs

(1) Definition

- (a) The initial execution type program is a program executed only once when a programmable controller is powered ON, when a CPU module is reset, or when the RUN/STOP key switch of the CPU module is switched from STOP to RUN.
- (b) The execution type is set to "Init" in program setting in the parameter mode of GPP function.
- (c) Initial execution type programs can be used for applications such as the initial processing for a special function module, where once the program has been executed, it need not be executed from the next scan.*

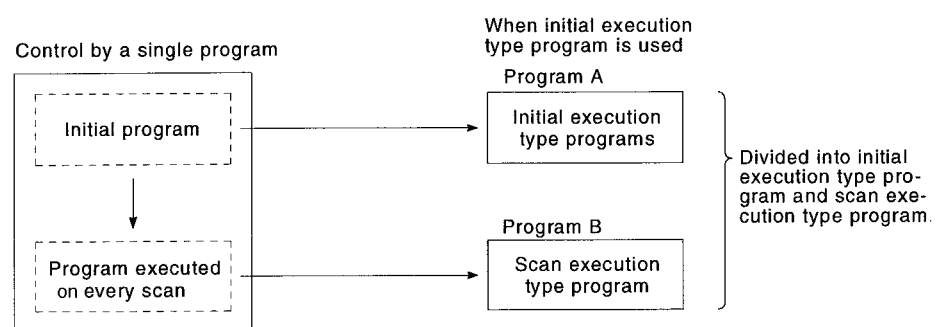


(2) Execution of multiple initial execution type programs

If there are more than one initial execution type program, they are executed in ascending order of the program numbers set in the parameter mode.

(3) END processing

When execution of all initial execution type programs is completed, END processing is performed and a scan execution type program is executed from the next scan.

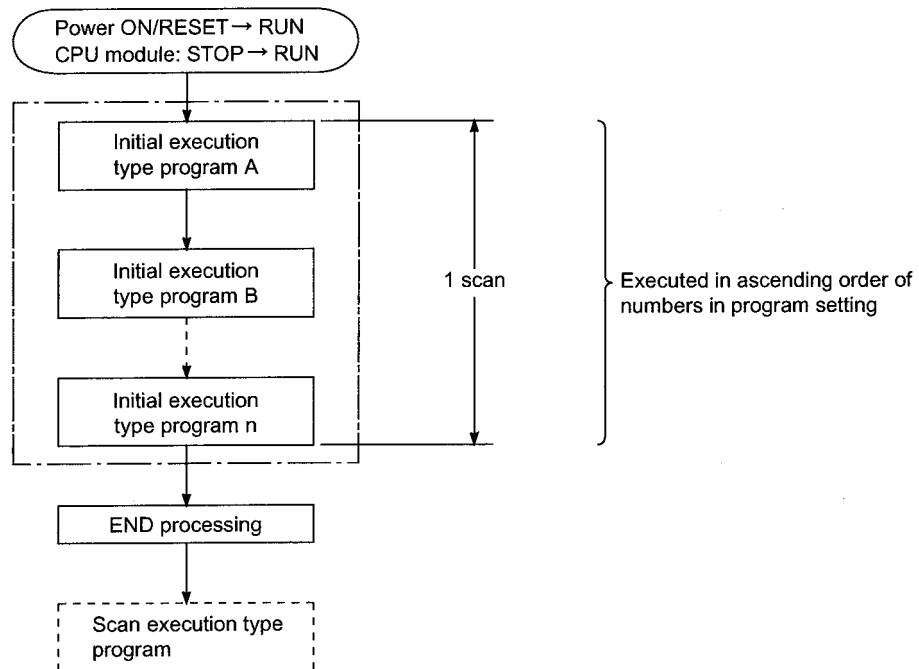

POINT

- * Instructions that contain a completion device cannot be used in initial execution type programs.


(4) Initial scan time

- (a) This is the execution time of an initial execution type program.

If multiple initial execution type programs are to be executed, it is the time required to complete execution of all these programs.

- (b) The Q2ASCPU measures the initial scan time and stores it in special registers SD522 and SD523.*1

The initial scan time can be checked by monitoring SD522 and SD523.

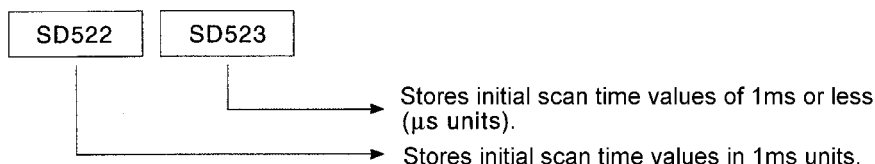

Example:

If "3" and "400" are stored in SD522 and SD523 respectively, the initial scan time is 3.4ms.

*1 The accuracy of each scan time stored in the special registers is ± 0.1 ms. Note that, even if a watchdog timer (WDT) reset instruction is executed in the sequence program, measurement of the initial scan time is continued.

(5) Initial execution monitoring time

This is a timer for monitoring the execution time of initial execution type programs; no default value is set.

To monitor the execution time of an initial execution type program, a value can be set within the range of 10ms to 2000ms in "PLC RAS" in the parameter mode. (Unit: 10 ms)

If the initial scan time exceeds the set initial execution monitoring time, a "WDT ERROR" occurs and the Q2ASCPU stops its operation.

POINT	
	<p>An error may be generated in the range of 0 to 10ms in measurement of the initial execution monitoring time.</p> <p>Because of this, if the initial execution monitoring time (t) is set as 10ms, a WDT ERROR will occur when the initial scan time exceeds the limit within the range of $10\text{ms} \leq t < 20\text{ms}$.</p>

12.1.2 Scan execution type program

(1) Definition

- (a) The scan execution type program is a program that is executed once for every scan, starting from the next scan after execution of the initial execution type program.
- (b) The execution type is set to "Scan" in program setting in the parameter mode of GPP function.


(2) Execution of multiple scan execution type programs

If there are more than one scan execution type program, they are executed in ascending order of the program numbers set in the parameter mode.

(3) END processing

When all the scan execution type programs have been executed, END processing is performed and then the first scan execution type program is executed again.

By inserting a COM instruction at the end of a scan execution type program, END processing (general data processing, link refresh) can be executed for each program.

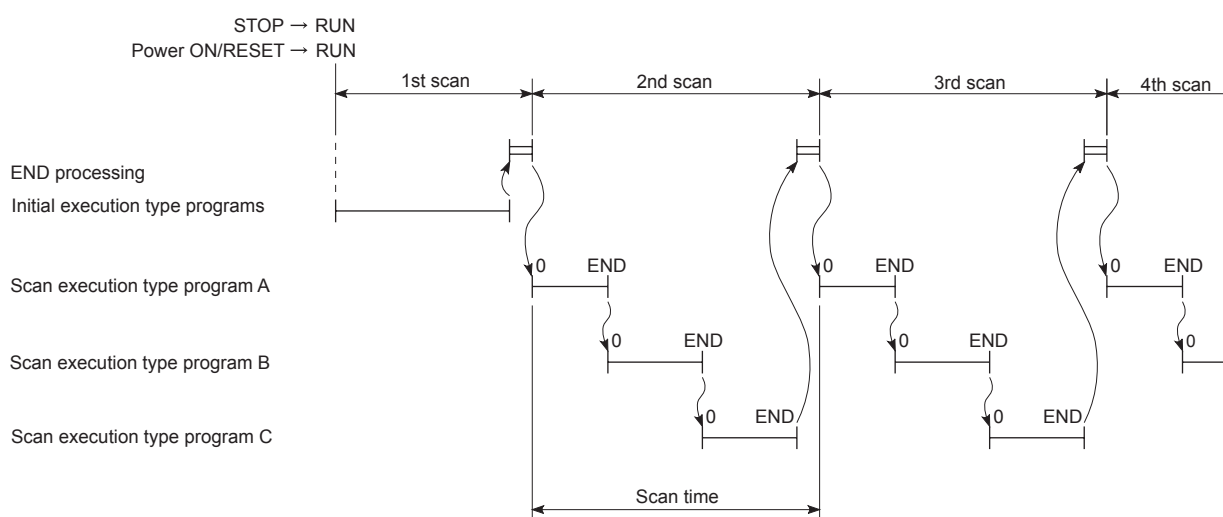(4) When constant scan time is set^{*1}

When constant scan is set, the scan execution type program is executed once for every preset constant scan time.

REMARK

- ^{*1} Constant scan is a function whereby a scan execution type program is repeatedly executed at fixed intervals.
See Section 10.2.

POINT

- (1) For the index register processing in the case where an interrupt program is executed during execution of a scan execution type program, refer to the QnACPU Programming Manual (Fundamentals).

(5) Scan time


- The scan time is a total of the scan execution type program execution time, the END processing time, and either the low-speed program execution time or the constant scan waiting time.^{*1}

When more than one scan execution type program is executed, "the execution time of the scan execution type program" is the time required for completing execution of all these programs.

^{*1} Refer to Section 12.1.3.

- The Q2ASCPU measures the present, minimum, and maximum values for the scan time and stores them in special registers SD520, SD521, and SD524 to SD527.^{*2}

The scan time can be checked by monitoring these special registers.

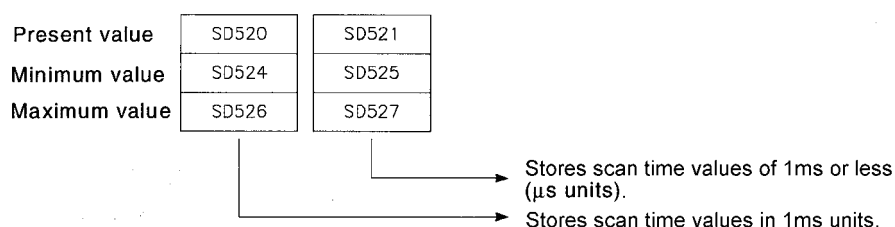

Example: If "3" and "400" are stored in SD520 and SD521 respectively, the scan time is 3.4ms.

^{*2} The accuracy of each scan time stored in the special registers is ± 0.1 ms. Note that, even if the watchdog timer (WDT) reset instruction is executed in the sequence program, measurement of each scan time is continued.

(6) WDT (watchdog timer)

This is a timer that monitors the scan time; and 200ms is set as a default value. WDT is set within the range of 10ms to 2000ms in "PLC RAS" in the parameter mode. (Unit: 10ms).

When using a low-speed execution type program(s), make sure that the specified WDT value is greater than the sum of the scan time and the low-speed execution type program execution time.

If the scan time (total of execution times for scan execution type programs and low-speed execution type programs, END processing time, and low-speed END processing time) exceeds the time set for WDT, a "WDT ERROR" occurs and the Q2ASCPU stops its operation.

POINT	
	<p>The WDT measurement error is 0 to 10ms.</p> <p>Because of this, when WDT (t) is set to 10ms, a WDT ERROR may not occur even if the scan time exceeds the limit within the range of $10\text{ms} \leq t < 20\text{ms}$.</p>

12.1.3 Low-speed execution type program

(1) Definition

- (a) The low-speed execution type program is a program that is executed only in the surplus time of constant scan operation or in the preset low-speed execution program execution time.
- When using a fixed scan time to give priority to control accuracy, set the constant scan time in "PLC RAS" in the GPP function's parameter mode.
(Setting range: 5 to 2000ms; Unit: 5ms)
 - To ensure the execution time for low-speed execution type programs in each scan and to make these programs operate properly, set the low-speed program execution time in "PLC RAS" in the parameter mode.
(Setting range: 1 to 2000ms; Unit: 1ms)
 - In order to execute low-speed execution type programs, either the constant scan time or the low-speed program execution time must be set.
- (b) Set "Slow" as the execution type in program setting in the parameter mode.
- (c) This execution type is used for programs that do not have to be executed every scan, such as a program for printer output.

(2) Execution of multiple low-speed execution type programs

If there are more than one low-speed execution type program, they are executed in ascending order of the program numbers set in the parameter mode.

- (3) Execution time for low-speed execution type program executed in one scan
- (a) When operation of all low-speed execution type programs is completed within one scan and there is surplus time, the subsequent processing varies depending on the setting status of special relay SM330 and the execution condition for the low-speed execution type programs.
- Non-synchronization method (SM330 = OFF) : Operation of a low-speed execution type program is continuously executed within surplus time.
 - Synchronization method (SM330 = ON) : Even if there is surplus time, operation of a low-speed execution type program is not executed and another operation starts from the next scan.

Operation method of low-speed execution type program	Setting status of SM330	Execution condition of low-speed execution type program	
		Constant scan setting	Low-speed program execution time setting
Non-synchronization method	OFF	Re-executes low-speed execution type program.*1	Re-executes low-speed execution type program.*2
Synchronization method	ON	Constant scan wait time occurred*3	Starts scan execution type program operation.*4

*1 When the constant scan time is set, the low-speed execution type program is repeatedly executed for the surplus time of the constant scan.
Accordingly, the execution time of the low-speed execution type program is different at each scan. If surplus time in constant scan is less than 2ms, the low-speed execution type program is not executable.

When using a low-speed execution type program, set a proper constant scan time so that surplus time will be 2ms or longer.

*2 When the low-speed program execution time is set, a low-speed execution type program is repeatedly executed for the set time duration.
Accordingly, the scan time is different at each scan.

*3 When the constant scan time is set, surplus time after completion of the low-speed END processing is used as wait time. When the set constant scan time is reached, the scan execution type program is executed.

Wait time for constant scan

$$= (\text{Set constant scan time}) - (\text{Scan time}) - (\text{Low-speed scan time})$$

Therefore, the scan time for each scan is constant.

If surplus time in constant scan is less than 2ms, the low-speed execution type program is not executable. When using a low-speed execution type program, set a proper constant scan time so that surplus time will be 2ms or longer.

*4 When the low-speed program execution time is set, operation of the scan execution type program is started ignoring the surplus time after completion of the low-speed END processing.

Surplus time in low-speed program execution time

$$= (\text{Set low-speed program execution time}) - (\text{Low-speed scan time})$$

Accordingly, the scan time is different at each scan.

- (b) If the low-speed execution type program is not processed within surplus time of the constant scan time or within the low-speed program execution time, the program execution is interrupted and is resumed in the next scan.


POINT	
(1)	For the index register processing in the case where a scan execution type program is switched to a low-speed execution type program, refer to the QnACPU Programming Manual (Fundamentals).
(2)	For the index register processing in the case where an interrupt program is executed during execution of a low-speed execution type program, refer to the QnACPU Programming Manual (Fundamentals).
(3)	Set a proper low-speed program execution time so that the value obtained by adding it to the scan time is smaller than the set WDT value.
(4)	The COM instruction cannot be used in the low-speed program.
(5)	When "Constant scan time" and "Low-speed program execution time" are set, PRG. TIME OVER (Error code: 5010) occurs in the case of (Surplus time of constant scan) < (Low-speed program execution time) Execute the low-speed execution type program either in the constant scan time or in low-speed program execution time.

1: For non-synchronous method:

(1) When "Constant scanning" is set

The operation when a low-speed execution program is executed under the following conditions is shown below.


- Constant scan time: 60 ms
- Total for scan execution type programs: 40 ms to 50 ms
- Execution time for low-speed execution type program A: 10 ms
- Execution time for low-speed execution type program B: 30 ms
- END processing: 0 ms (assuming 0 ms here to make the explanation easy)
- Low-speed END processing: 0 ms (assuming 0 ms here to make the explanation easy)

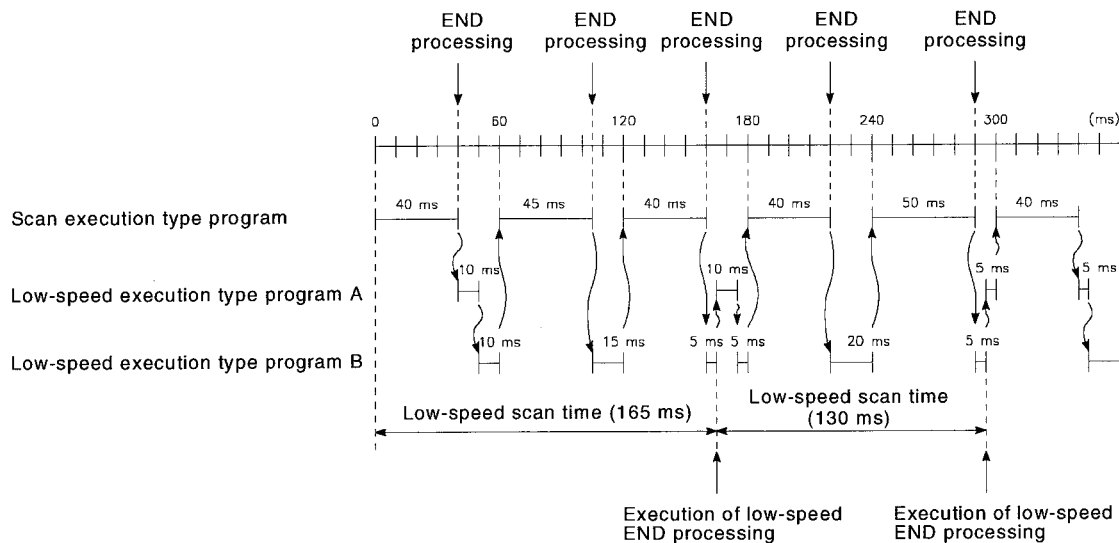

(2) When a low-speed program execution time is set

The operation when a low-speed execution program is executed under the following conditions is shown below.

- Low-speed program execution time: 30 ms
- Total for scan execution type programs: 40 ms to 50 ms
- Execution time for low-speed execution type program A: 10 ms
- Execution time for low-speed execution type program B: 30 ms
- END processing: 0 ms (assuming 0 ms here to make the explanation easy)
- Low-speed END processing: 0 ms (assuming 0 ms here to make the explanation easy)

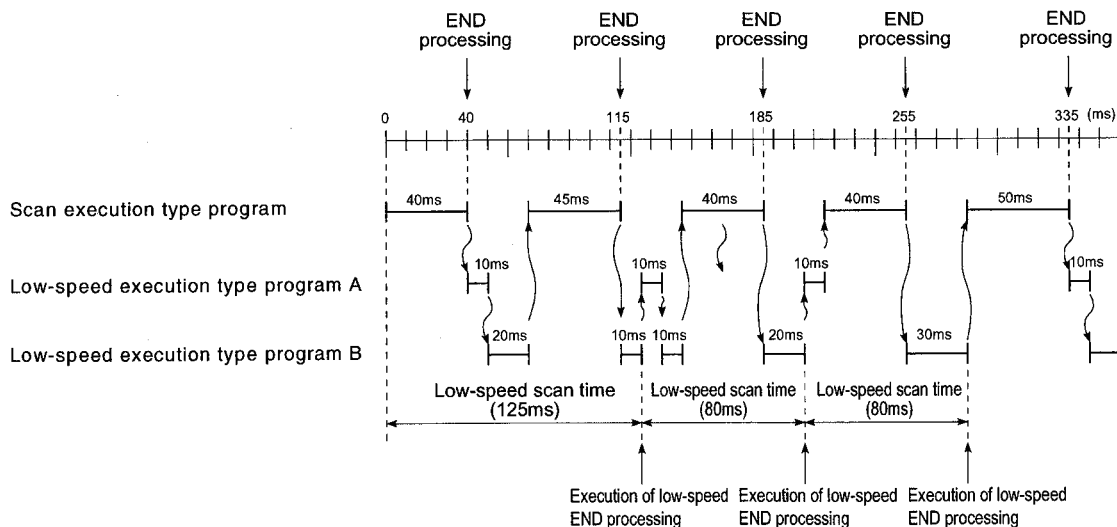


2: For synchronous method:

(1) When "Constant scanning" is set

The operation when a low-speed execution program is executed under the following conditions is shown below.


- Constant scan time: 60 ms
- Total for scan execution type programs: 40 ms to 50 ms
- Execution time for low-speed execution type program A: 10 ms
- Execution time for low-speed execution type program B: 30 ms
- END processing: 0 ms (assuming 0 ms here to make the explanation easy)
- Low-speed END processing: 0 ms (assuming 0 ms here to make the explanation easy)

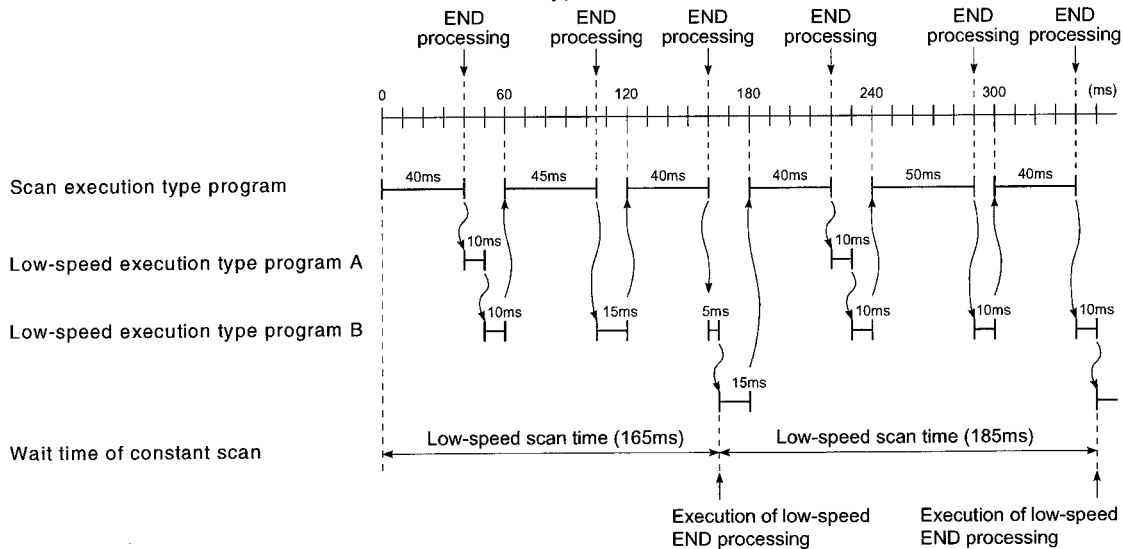

(2) When a low-speed program execution time is set

The operation when a low-speed execution program is executed under the following conditions is shown below.

- Low-speed program execution time: 30 ms
- Total for scan execution type programs: 40 ms to 50 ms
- Execution time for low-speed execution type program A: 10 ms
- Execution time for low-speed execution type program B: 30 ms
- END processing: 0 ms (assuming 0 ms here to make the explanation easy)
- Low-speed END processing: 0 ms (assuming 0 ms here to make the explanation easy)

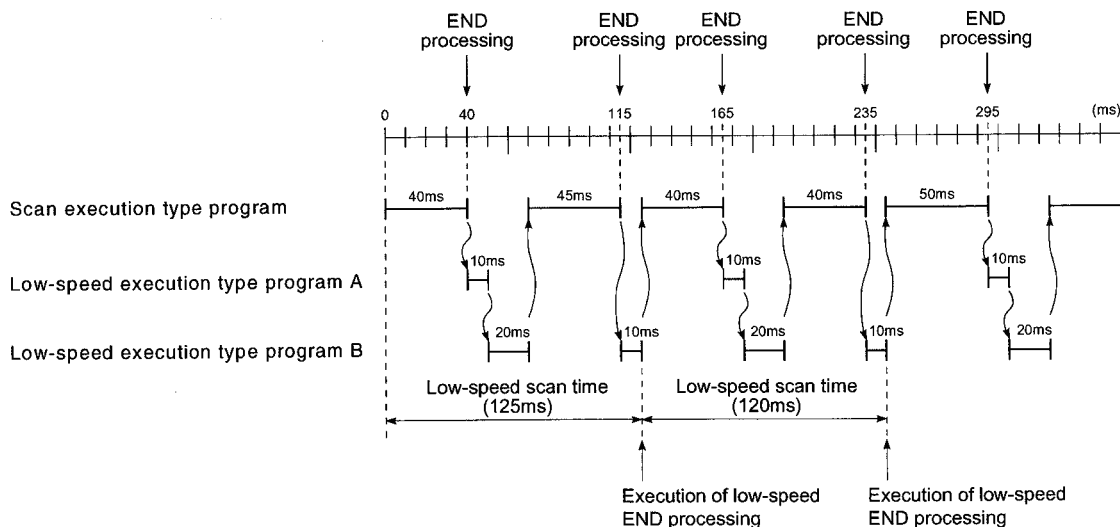

(4) END processing

When all of the low-speed execution type program has been completed, low-speed END processing is executed.

The following processing is performed in low-speed END processing:

- Setting of special relays/special registers for the low-speed execution type program
- Writing the low-speed execution type program during RUN
- Measurement of the low-speed scan time
- Resetting the watchdog timer for the low-speed execution type program

When low-speed END processing is completed, the low-speed execution type program is executed again from the beginning.

POINT	
	In execution of a low-speed execution type program, the constant scan time may be extended by a time equivalent to the maximum processing time for the instructions executed plus the low-speed END processing time.

(5) Low-speed scan time

- (a) The low-speed scan time is a total time of the time required for completion of the low-speed execution program and the low-speed END processing time.
If multiple low-speed execution type programs are to be executed, it is the total time of the time required for completion of all low-speed execution type programs and the low speed END processing time.

- (b) The Q2ASCPU measures the low-speed scan time and stores it in special registers SD528 to SD535.*1

The low-speed execution scan time can be checked by monitoring these registers.

Present value	SD528	SD529
Initial value	SD530	SD531
Minimum value	SD532	SD533
Maximum value	SD534	SD535

Example:

If "3" and "400" are stored in SD528 and SD529 respectively, the scan time is 3.4ms.

*1 The accuracy of each scan time stored in the special registers is ± 0.1 ms. Note that, even if a watchdog timer (WDT) reset instruction is executed in the sequence program, measurement of each scan time is continued.

(6) Low-speed execution monitoring time

This is a timer for monitoring the execution time of low-speed execution type programs; no default value is set.

To monitor the execution time of an low-speed execution type program, a value can be set within the range of 10ms to 2000ms in "PLC RAS" in the parameter mode. (Setting units: 10ms).

If the low-speed scan time exceeds the set low-speed execution monitoring time, a "PRG TIME OVER" error occurs. The Q2ASCPU however continues its operation.

POINT	
	The low-speed execution monitoring time is measured in low-speed END processing. Because of this, when the low-speed execution monitoring time (t) is set to 100ms, a "PRG TIME OVER" error occurs if the low-speed scan time measured in low-speed END processing exceeds 100ms.

12.1.4 Standby type program

(1) Definition


- (a) The standby type program is a program that is executed only in response to an execution request.
- (b) The standby type program has the following applications:
 - 1) Program library
Subroutine programs and interrupt programs are set as standby type programs and controlled separately from the main program.
 - 2) Set-up of programs
The main routine program is registered to the standby type program and programs required for control are changed to the scan execution type programs. Programs not used for control are changed to the standby type programs.

(2) Program library

(a) Library creation of program


- 1) Program library is used to control subroutine programs and interrupt programs separately from the main routine program.

It is possible to create multiple subroutine programs and interrupt programs as one standby type program.

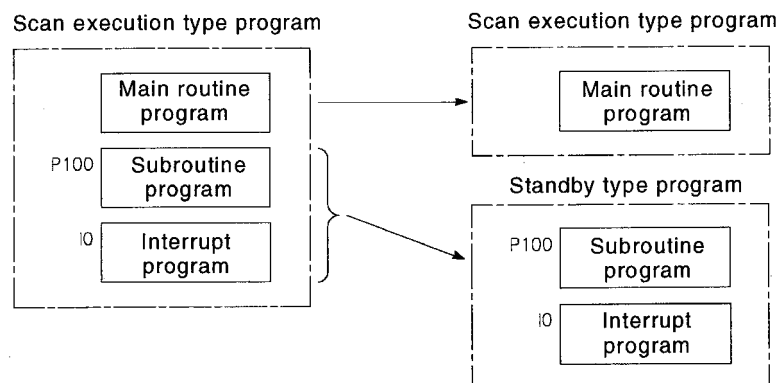


- 2) When a standby type program execution is completed, control returns to the program that was being executed before execution of the standby type program.

The following shows the operation performed when a subroutine program and an interrupt program in a standby type program are executed.

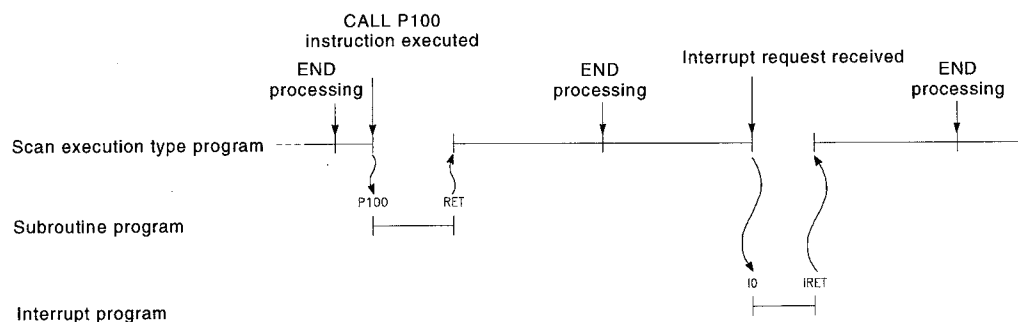


POINT	
(1)	Timers are not to be used in standby type programs because they update present values and turn ON/OFF the contacts when the OUT T□ instruction is executed.
(2)	When setting a subroutine program as a standby type program, use a common pointer. Standby type programs that use local pointers are not executable. For details on common and local pointers, refer to the QnACPU Programming Manual (Fundamentals).

- (b) When grouping several subroutine programs into one
- 1) Create subroutine programs in order starting from step 0 in the standby type program.
An END instruction is required at the end of the subroutine programs.
 - 2) Since there are no restrictions on the order of creation of subroutine programs, there is no need to arrange pointers in ascending order of pointer numbers when creating multiple subroutine programs.
 - 3) Use common pointers. *
- Subroutine programs using common pointers can be called from all the programs that are being executed by the Q2ASCPU.

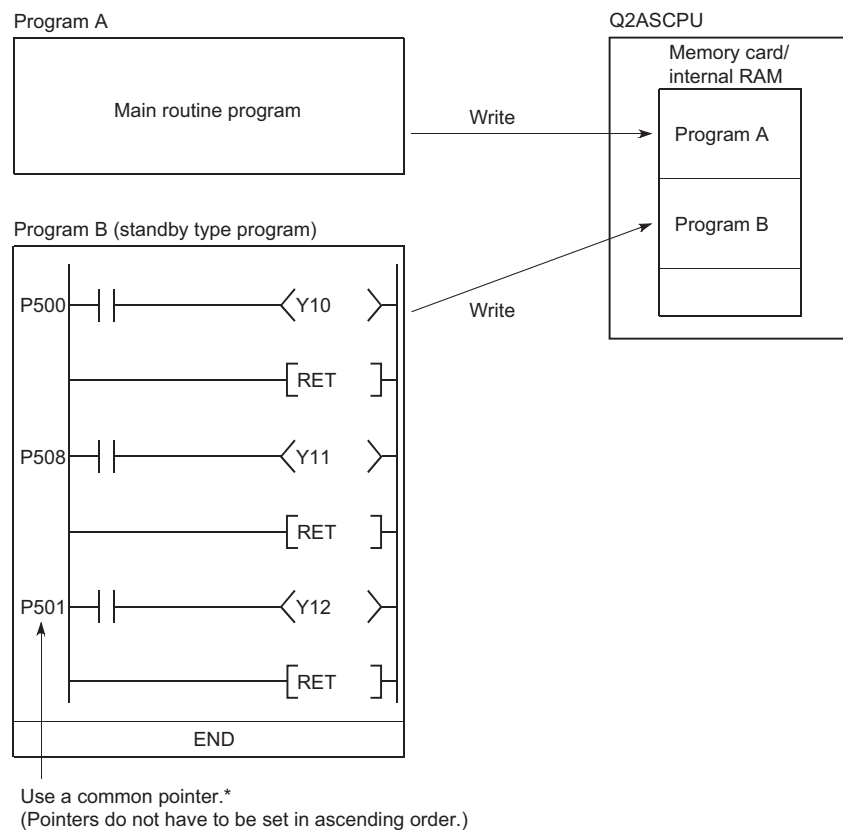**REMARK**

* For details on common pointers, refer to the QnACPU Programming Manual (Fundamentals).

- (c) When grouping several interrupt programs into one
- 1) Create interrupt programs in order starting from step 0 in the standby type program.
An END instruction is required at the end of the interrupt programs.
 - 2) Since there are no restrictions on the order of creation of interrupt programs, there is no need to arrange pointers in ascending order of pointer numbers when creating multiple interrupt programs.

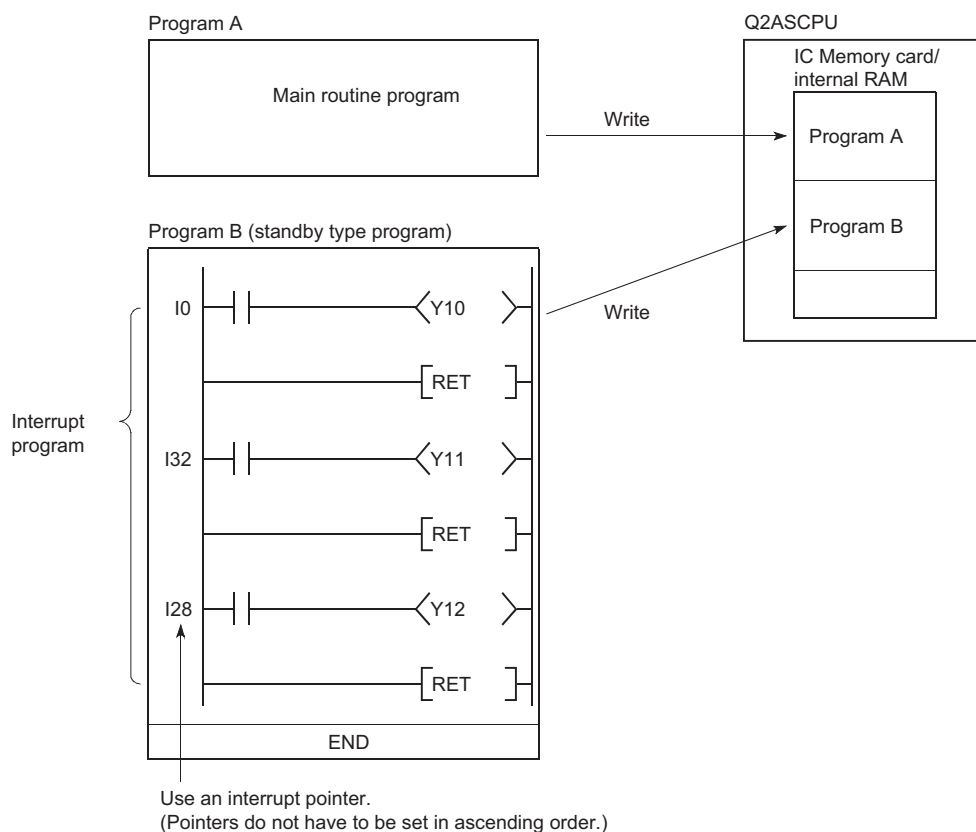**REMARK**

For details on interrupt pointers, refer to the QnACPU Programming Manual (Fundamentals).

(3) Set-up of programs

- (a) Programs corresponding to all of the systems can be created in advance, and thereby necessary programs only can be executed.

Programs set as the standby type with parameters can be changed to the scan type programs in the sequence program for execution.


Use the following instructions to change the execution type in the Q2ASCPU:

- 1) PSCAN instruction : Changes the program type from the standby type to the scan execution type.
- 2) PLOW instruction : Changes the program type from the standby type to the low-speed execution type.
- 3) PSTOP instruction : Changes the program type from the scan execution/low-speed execution type to the standby type.

- (b) The following methods are available to switch programs for execution:

- 1) When selecting programs to be executed in a control program:


- Defining the scan execution type program as the control program, the QnACPU switches between the standby type program and the scan execution type program according to the set conditions to control the program to be executed.
- The following shows how the execution types of standby programs, "ABC," "DEF," "GHI" and "JKL" are changed in the control program.

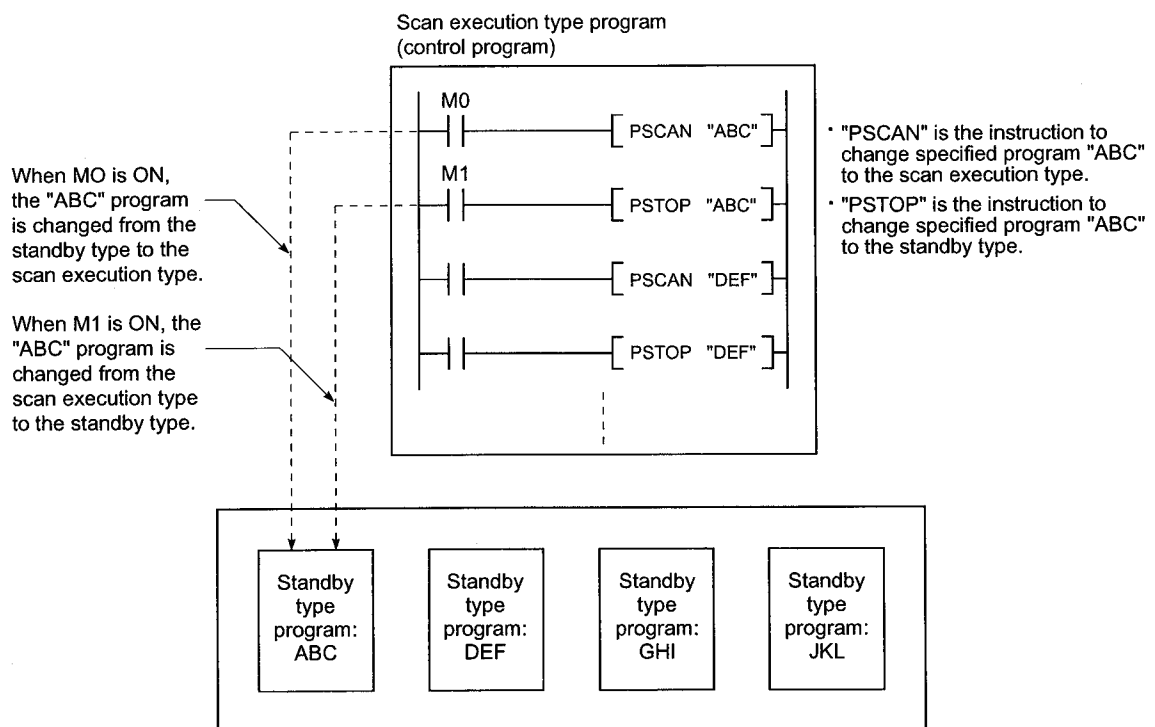

2) When changing the execution type of another program from the scan execution type program:


- In the scan execution type program in execution, the type of the program to be executed next is changed from the standby type to the scan execution type.
- The following shows the operation that the QnACPU switches the standby type program "DEF" to the scan execution type, and the scan execution program "ABC" to the standby type program when M0 in program "ABC" turns on.

[Before execution of PSCAN and PSTOP instructions]

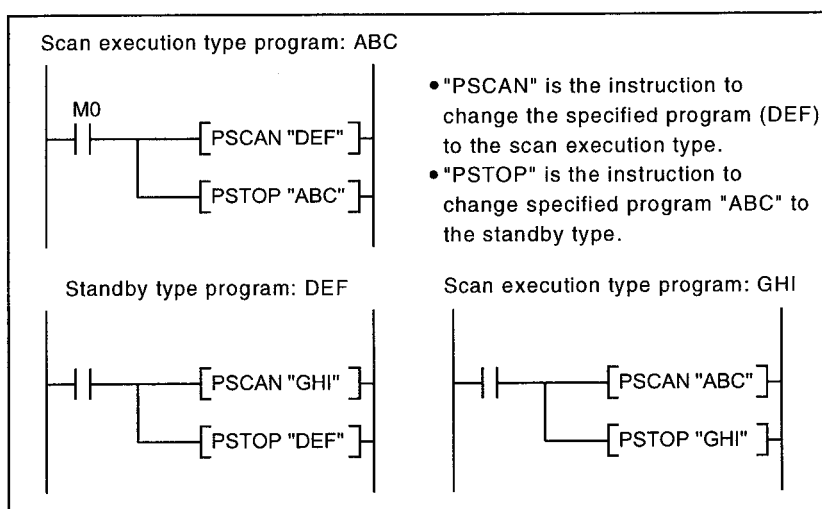


When M0 is ON

[After execution of PSCAN and PSTOP instructions]

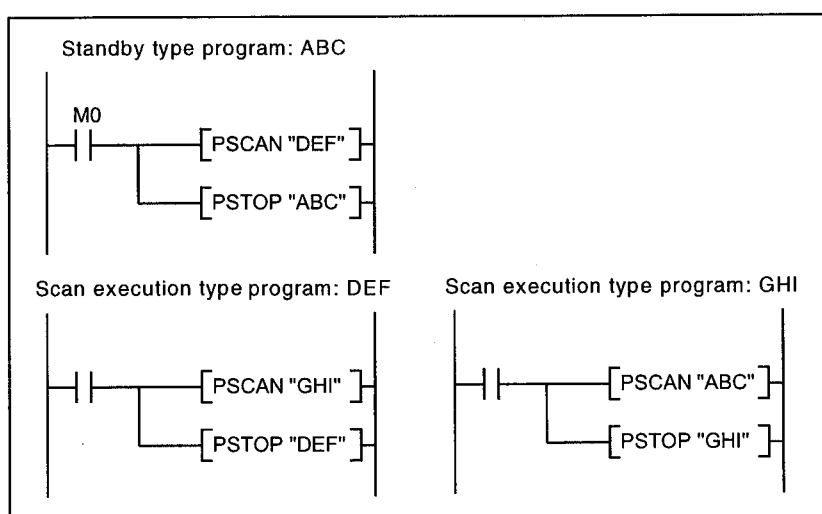

- (c) The program execution type is changed by the PSCAN or PSTOP instruction in the END processing.

Therefore, it is not changed during program execution.

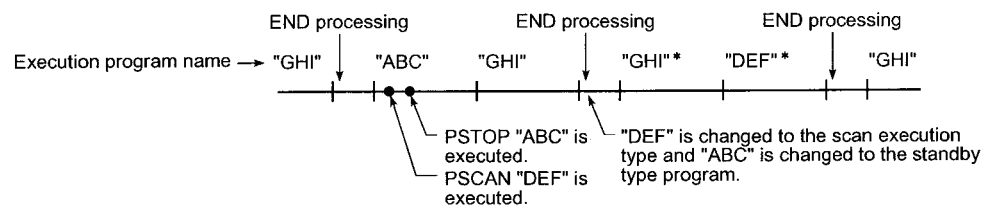

REMARK

* The "GHI" and "DEF" programs are executed in the sequence set with parameters in the program setting.

12.1.5 Initial processing

Initial processing is the pre-processing for executing sequence operations.

The QnACPU executes it only once in the case of the CPU module status described in the following table.

Once the initial processing is completed, the CPU module is placed into the operation status set by the RUN/STOP switch.

Item	Status of the CPU module		
	At Power ON	At RESET	STOP → RUN Status*1
Initialization of I/O module	○	○	×
Initialization of devices outside latched range (Bit device: OFF, Word device: 0)	○	○	×
Self-diagnostics	○	○	○
Auto allocation of module I/O No.	○	○	○
Setting MELSECNET/10 network info and MELSECNET(II)/B data link info	○	○	×
Setting CC-Link info and MELSECNET/MINI-S3 info	○	○	×
Setting initial device values	○	○	○
Booting from memory card	○	○	×

○: Executed ×: Not executed

- *1 Indicates the case that the CPU enters RUN status without being reset after changing a parameter or program in STOP status.
 (The RUN/STOP key switch is operated as follows: STOP→RUN→(RUN LED is flickering.)→STOP→RUN.)
 Note that the instructions for conversion into pulse (PLS, □P) may not function properly since the previous information may not be retained depending on the program change (write during RUN in STOP status, or write to PLC).

12.1.6 Refresh processing of I/O module

Refresh processing of I/O modules is executed.

(Refer to the QnACPU Programming Manual (Fundamentals).)

12.1.7 END processing

This is a post-process to finish one cycle of operation processing of the sequence program and to return the execution of the sequence program to step 0.

- (a) Self-diagnostic checks are performed for fuse blown, module verify, or low battery. (Refer to Section 9.3)
- (b) When data read/write is requested from a peripheral device or an intelligent special function module (computer link module, serial communication module, Ethernet module, etc.), data are exchanged between the programmable controller CPU and the peripheral device or intelligent special function module.
- (c) Refresh processing is performed when a refresh request is issued from a network module or a link module.
- (d) When the trace point for sampling trace is set to each scan (after execution of END instruction), the status of the set device is stored into the sampling trace area.
- (e) Refresh processing based on the MELSECNET/MINI-S3 automatic refresh function is performed. (Refer to Chapter 7))

POINT	
(1)	If the constant scan function (see Section 10.2) is set, the END processing time result is retained during the period between completion of END processing and start of the next scan.
(2)	If a low-speed execution type program (see Section 12.1.3) is executed, low-speed END processing is performed separately from normal END processing. In low-speed END processing, the special relays and special registers for low-speed execution programs are set.

12.2 Operation Processing of RUN, STOP, PAUSE, and STEP-RUN

The Q2ASCPU has four kinds of operation statuses: RUN, STOP, PAUSE, and step operation (STEP-RUN) statuses.

Operation processing of programmable controller CPU in each operation status is explained here.

- (1) RUN status operation processing
 - (a) The RUN status represents a status in which sequence program operation is repeated in the order from step 0 → END (FEND) instruction → step 0.
 - (b) When entering the RUN status, the CPU outputs the output status data saved in STOP status according to the output mode setting parameter for STOP → RUN.
 - (c) Processing time from switching STOP → RUN to the start of the sequence program operation is usually one to three seconds, although it may vary depending on the system configuration.
Note that it may be longer than this depending on the conditions.
- (2) STOP status operation processing
 - (a) The STOP status is a status in which sequence program operation is stopped by the RUN/STOP key switch or due to remote STOP (see Section 10.6.1).
 - (b) When entering the STOP status, the CPU saves the output status data and turns all output points to OFF. Data memories except for output (Y) are retained.
- (3) PAUSE status operation processing
 - (a) The PAUSE status represents a status in which operation of sequence program is suspended with the output and data memory statuses retained. (Refer to Section 10.6.3)
- (4) Step operation (STEP-RUN) operation processing
 - (a) STEP operation is an operation mode in which operation processing of a sequence program can be paused/continued by each instruction using GPP function. (Refer to Section 8.7)
 - (b) Since an operation processing is paused while retaining the output and data memories, the execution condition can be confirmed.

(5) Operation processing of Q2ASCPU when RUN/STOP key switch is operated

RUN/STOP state	Q2ASCPU Operation Processing				
	Operation processing of sequence program	External output	Data memory		Remark
			M, L, S, T, C, D	Y	
RUN→STOP	Executes up to the END instruction, then stops.	OS saves the output status, and sets all the output points to OFF.	Retains the condition immediately before entering the STOP status.	OS saves the output status, and sets all the output points to OFF.	
STOP→RUN	Starts from step 0.	Depends on the output mode set by the parameter for STOP→RUN.	Starts operations from the condition immediately before entering the STOP status.	Depends on the output mode set by the parameter for STOP→RUN.	

POINT
<p>The Q2ASCPU executes the following processing in any of RUN state, STOP state, or PAUSE status.</p> <ul style="list-style-type: none"> • Refresh processing of I/O modules • Data communication with peripheral devices, computer link modules, and/or serial communication modules. • Link refresh processing. <p>Thus, even in the STOP state or PAUSE state, I/O monitoring and test operations using a peripheral device, reading/writing from computer link modules or serial communication modules, and communication with other stations via MELSECNET can be performed.</p>

12.3 Operation Processing for Instantaneous Power Failure

The Q2ASCPU detects a momentary power failure when the input power voltage supplied to the power supply module becomes lower than the specified range.

When the Q2ASCPU detects an instantaneous power failure, the following operation processing is performed.

- (1) When an instantaneous power failure shorter than the allowable momentary power failure period occurred:
 - (a) When an instantaneous power failure occurs, the output statuses are held and the operation processing is suspended after the name of the currently accessing file and error history have been stored.
(The timer count continues.)
 - (b) If there is an SFC continuous operation designation, system save processing is executed.
 - (c) When power is restored, the operation processing will be continued.
 - (d) While the operation is interrupted due to an instantaneous power failure, measurement of the watchdog timer (WDT) continues. For example, if 200ms is set for the WDT parameter setting, power failure of 15ms in the scan time of 190ms will cause a watchdog timer error.

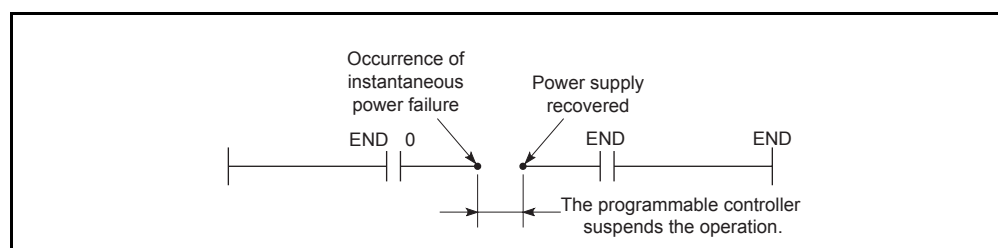


Fig. 12.1 Operation Processing for Instantaneous Power Failure

- (2) When power failure longer than the allowable momentary power failure period occurred:
The Q2ASCPU starts from the first.
The operation processing is the same as that performed at programmable controller power-up or at CPU module reset by the RUN/STOP key switch.

12.4 Data Clear Processing

The Q2ASCPU clears data other than the following by turning the RUN/STOP key switch to RESET or by resetting the programmable controller power (ON, OFF and ON):

- (a) Data in the built-in RAM (except data specified for memory clear in the boot specification)^{*1}
- (b) Data in the memory card
- (c) Data of latch-specified devices(Latch clear key enabled)
- (d) Data of latch-specified devices(Latch clear key disabled)
- (e) File register data
- (f) Local device data
- (g) Fault history data

^{*1} For the boot specification, refer to the QnACPU Programming Manual (Fundamentals).

Data given in (c) and (g) are cleared by latch clear operation using the RUN/STOP key switch (Refer to Section 15.3.) or by remote latch clear operation from GPP function (Refer to Section 10.6.5.)

The latch range is specified for each device on the "Device" screen in the parameter mode of GPP function. There are the following two latch range setting options.

- 1) Latch clear key enabled : Used to set a latch range which can be cleared by the latch clear operation using the RUN/STOP key switch.
- 2) Latch clear key disabled: Used to set a latch range which cannot be cleared by the latch clear operation using the RUN/STOP key switch.

Devices for which the latch clear key is disabled can be cleared by an instruction or by the clear operation of GPP function.

- | | | |
|---|---|---|
| { | 1) Clearing by an instruction : Reset by RST instruction , or transfer K0 with MOV instruction .
2) Clearing by GPP function : Execute device memory all clear from the PLC menu in the online mode. | } |
|---|---|---|

For details on device latch ranges, refer to the QnACPU Programming Manual (Fundamentals).

For details on the operation method of GPP function, refer to the GX Developer Operating Manual or Type SW□IVD-GPPQ Software Package Operating Manual (Online)/(Offline).

POINT	
	To clear file registers or local devices, reset them with the RST instruction or transfer KO with the MOV instruction.

[illegible]

13 PARAMETER LIST

The parameters set for the Q2ASCPU are listed in the table below.

For details on each parameter, refer to the section or reference manual indicated.

Item		Parameter No.	Description	
PLC name		—	Set labels and/or comments for peripheral devices on the CPU module. This setting does not affect CPU module operation.	
	Label	0000H	Set a label for the CPU module.	
	Comment	0001H	Set a comment for the CPU module.	
PLC system		—	Make various settings that are required for the CPU module system.	
Timer limit setting	Low-speed timer	1000H	Set the low-speed or high-speed timer limit.	
	High-speed timer			
RUN-PAUSE contacts		1000H	Set the contact to control RUN/PAUSE of the CPU module.	
Remote reset		1002H	Enable or disable the remote reset operation.	
Output at STOP→RUN		1003H	Set the output mode for switching from STOP to RUN.	
Common pointer No.		1005H	Set the first common pointer number.	
General data processing		1006H	Set the number of modules that are processed in one general data processing.	
Points occupied by empty slot		1007H	Set the number of points occupied by empty slots.	
System interrupt	Interrupt counter	1008H	Set the first interrupt counter number, and the fixed scan interval for the interrupt pointer.	
	Fixed scan interval			
PLC file		—	Set various kinds of files used by the CPU module.	
File register		1100H	Set a file register file to be used.	
Comment file used in a command		1101H	Set a comment file used in an instruction.	
Initial device value		1102H	Set a file for initial device values to be used.	
File for local device		1103H	Set a file for local devices to be used.	

13. PARAMETER LIST

MELSEC-QnA

	Setting		Reference Section/Reference Manual
	Default value	Setting range	
	–	–	Section 11.2
	No setting	Up to 10 characters	
	No setting	Up to 64 characters	
	–	–	–
	100ms	10ms to 1000ms (in 10ms units)	QnACPU Programming Manual (Fundamentals)
	10ms	1ms to 100ms (in 1ms units)	
	No setting	X0 to X1FFF	Section 10.6.1, Section 10.6.3
	Disabled	Enabled/disabled	Section 10.6.4
	Before operation	Before operation/After 1 scan	Section 10.4
	No setting	P0 to P4095	QnACPU Programming Manual (Fundamentals)
	1 module	1 to 6 modules	Section 6.3
	16 points	0 point to 64 points (in 16-point units)	Section 5.3
	No setting	C0 to C65535	QnACPU Programming Manual (Fundamentals)
	I28→100ms I29→40ms I30→20ms I31→10ms	5ms to 1000ms (in 5ms units)	
	–	–	–
	Not used	<ul style="list-style-type: none"> • Not used • Use the same file name as the program. • Use the following file. 	QnACPU Programming Manual (Fundamentals)
	Not used	<ul style="list-style-type: none"> • Not used • Use the same file name as the program. • Use the following file. 	Section 11.5
	Use the same file name as the program.	<ul style="list-style-type: none"> • Not used • Use the same file name as the program. • Use the following file. 	QnACPU Programming Manual (Fundamentals)
	Not used	<ul style="list-style-type: none"> • Not used • Use the following file. 	QnACPU Programming Manual (Fundamentals)

Item		Parameter No.	Description	
Device		—	Set the number of points, latch range, etc., for each device.	
Device points		2000H	Set the number of device points used.	
Latch (1) start (Enable C/L key)		2001H	Set the latch range for which latch clear key operation is enabled.	
Latch (2) start (Disable C/L key)		2002H	Set the latch range for which latch clear key operation is disabled.	
Local device		2003H	Set the range of devices to be set as local devices.	
PLC RAS		—	Set various kinds of settings for the RAS function.	
WDT setup	WDT setting	3000H	Set the watchdog timer for the CPU module.	
	Initial execution monitoring time			
	Low speed execution monitoring time			
Error check		3001H	Set whether to detect the specified errors or not.	
Operating mode when there is an error		3002H	Set the operation mode in which the CPU module enters when an error is detected.	
Constant scan		3003H	Set the constant scan time.	
Annunciator display mode	Display F No.	3004H	Set the display mode that is activated when an annunciator comes ON.	
	Comment display			
	Time of occurrence			
Breakdown history		3005H	Set where the CPU module breakdown history is stored.	
Low speed program execution time		3006H	Set the time required for execution of low-speed execution type programs.	

13. PARAMETER LIST

MELSEC-QnA

	Setting		Reference Section/Reference Manual
	Default value	Setting range	
	—	—	—
	X→ 8k points Y→ 8k points M→ 8k points L→ 8k points B→ 8k points F→ 2k points SB→ 2k points V→ 2k points S→ 8k points T→ 2k points ST→ 0k point C→ 1k point D→ 12k points W→ 8k points SW→ 2k points	Fixed to X (8k points), Y (8k points), S (8k points), SB (2k points), SW (2k points). Up to 32k points per device within a range of 28.8k words, including the above points However, the total for bit devices is 64k points.	QnACPU Programming Manual (Fundamentals)
	No setting	1 range only for each device	Section 10.3
	No setting	1 range only for each device	Section 10.3
	No setting	1 range only for each device	QnACPU Programming Manual (Fundamentals)
	—	—	—
	200ms	10ms to 2000ms (in 10ms units)	Section 9.2
	No setting	10ms to 2000ms (in 10ms units)	Section 12.1.1
	No setting	10ms to 2000ms (in 10ms units)	Section 12.1.3
	Checked	Error checked	Section 9.3
	Stop	Stop/Continue	Section 9.3
	No setting	5ms to 2000ms (in 5ms units)	Section 10.2
	Displayed	Displayed/Not displayed	Section 9.8.2
	Not displayed	Displayed/Not displayed	
	Not displayed	Displayed/Not displayed	
	Stored in built-in RAM	Stored in built-in RAM/specified history file	Section 9.4
	No setting	1ms to 2000ms (in 1ms units)	QnACPU Programming Manual (Fundamentals)

Item		Parameter No.	Description	
I/O Assign		—	Set the mounting status of each module.	
Slot setting	Classification	4000H	Set the module type, number of points, head I/O No., etc.	
	Number of points			
	Start XY			
	Model Name			
Base setting	Power model name	4001H	Set model names of a power supply module and/or extension cables. This setting does not affect CPU module operation.	
	Extension cable			
MELSECNET/Ethernet setting		—	Set link parameters for the MELSECNET (II) data link system, network parameters for the MELSECNET/10 network system or Ethernet parameters.	
	Unit count	5000H		
	Valid module for access to other station	5001H		
MELSECNET (II) and MELSECNET/10 network setting	Inter-device transfer parameters	5002H		
	Routing parameter	5003H		
	Network setting	5NM0H		
	Network refresh parameter	5NM1H		
	Common parameter	5NM2H		
	Station inherent parameter	5NM3H		
	I/O assignment	5NM4H		
Ethernet network setting	Group No.	9N00H		
	IP address			

13. PARAMETER LIST

MELSEC-QnA

	Setting		Reference Section/Reference Manual
	Default value	Setting range	
	—	—	—
	No setting	Empty/Input/Output/Special	Section 5.3
	No setting	0 to 64 points (in 16-point units)	
	No setting	0 to 1FFFH (in 10H units, hexadecimal)	
	No setting	Up to 16 characters	
	No setting	Up to 16 characters	Section 5.3
	—	For QnA/Q4AR MELSECNET/10 Network System Reference Manual	For QnA/Q4AR MELSECNET/10 Network System Reference Manual MELSECNET, MELSECNET/B Data Link System Reference Manual

* N and M indicate the following:
N: Number of the module counted from the first.
M: Network type

M	Network type	M	Network type	M	Network type
0H	MELSECNET/10 (Default)	7H	MELSECNET (Local station)	DH	MELSECNET/10 (Multiple remote submaster, No remote master in the host CPU module)
1H	MELSECNET/10 (Control station)	8H	MELSECNET II mixed (Local station)		
2H	MELSECNET/10 (Normal station)	9H	MELSECNET II (Local station)	EH	MELSECNET/10 (Multiple remote submaster, There is a remote master in the host CPU module.)
3H	MELSECNET/10 (Remote master station)	AH	MELSECNET/10 (Standby station)		
4H	MELSECNET (Master station)	BH	MELSECNET/10 (Multiple remote master)	FH	MELSECNET/10 (Parallel remote submaster)
5H	MELSECNET II mixed (Master station)	CH	MELSECNET/10 (Parallel remote master)		
6H	MELSECNET II (Master station)				

13. PARAMETER LIST

MELSEC-QnA

Item		Parameter No.	Description	
MELSECNET/MINI setting		—	Make the settings for automatic refresh of the MELSECNET/MINI system.	
Number of master modules		6000H	Set the number of MELSECNET/MINI master modules to be used.	
MELSECNET/ MINI detailed settings	Master module head I/O No.	600NH*	Make the detailed setting required for automatic refresh of the MELSECNET/MINI system.	
	Model name & number of stations			
	Receive data batch refresh			
	Send data batch refresh			
	Retry count for communication errors			
	FROM/TO instruction access priority			
	Receive data clear at communication error			
	Faulty station detection bit data			
	Error No.			
	MINI link operation when CPU stopped			
	Circuit error check			
Supplementary settings		7000H	Perform various settings required when multiple programs are used.	
Program setting			Set programs to be executed among multiple programs.	
Boot file setting			Set the file for boot operation and other settings.	
SFC		—	Perform various settings required for SFC programs.	
SFC program start mode		8002H		
Start condition		8003H		
Output mode when the block is stopped		8005H		
Acknowledge XY assignment		—	Allows confirmation of the settings made in I/O assignment. This setting does not affect CPU module operation.	

* N means the number of the master module counting from the first. (N: 1 to 8)

13. PARAMETER LIST

MELSEC-QnA

	Setting		Reference Section/Reference Manual
	Default value	Setting range	
	–	–	Chapter 7
	0	0 to 8	
	No setting	Number of I/O points of CPU module	
	MINIS3	MINIS3/MINI() stations	
	X1000 to 200H	X, M, L, B, T, ST, C, D, W, R, ZR, none (Bit device: multiples of 16)	
	Y1000 to 200H	Y, M, L, B, T, ST, C, D, W, R, ZR, none (Bit device: multiples of 16)	
	5 times	0 to 32 times	
	CPU	CPU/Link	
	Clear	Clear/Hold	
	No setting	M, L, B, T, ST, C, D, W, R, ZR, none	
	No setting	D, W, T, ST, C, R, ZR	
	Stop	Continue/Stop	
	Latch data	Test message/OFF data/Latch data	
	–	–	QnACPU Programming Manual (Fundamentals)
	No setting	Program name/Scan/Low-speed/Initial/Standby	
	No setting	File name/Type/Transfer source drive/ Transfer destination drive	QCPU (Q mode)/QnACPU Programming Manual (SFC)
	–	QCPU (Q mode)/QnACPU Programming Manual (SFC)	
	–	–	GX Developer Operating Manual SW□IVD-GPPQ Software Package Operating Manual (Offline)

13. PARAMETER LIST

MELSEC-QnA

Item		Parameter No	Description	
Network parametars Setting the CC-Link		-	Make the settings for automatic refresh of the CC-Link system.	
Number of CC-Link		C000H	Set the number of CC-Link master modules to be used.	
CC-Link detailed settings	Master module head I/O No	CNM2H	Make the detailed setting required for automatic refresh of the CC-LinkI system.	
	Module type	CNM1H		
	Receiving data batch refresh bit device (Input data)			
	Transmission data batch refresh bit device (Output data)			
	Receiving data batch refresh word device (Remote device: RWr)			
	Transmission data batch refresh device (Remote device: RWw)			
	Batch refresh device for special relay			
	Batch refresh device for special register			
	Number of retries			
	Number of automatic return stations			
	Standby master staiton No.			
	PLC down select			
Scan mode setting				
Delay timer				
Station information setting	Station type			
	Number of occupied stations			
	Specification of reserved station/Specification of invalid station			

	Setting		Reference Section/Reference Manual
	Default value	Setting range	
	-	-	Chapter 7
	-	1 to 8	
	-	0000H to 0FE0H	
	-	M: Master station/L: Local station/ T: Stand-by station	
	-	X,M,L,B,T,ST,C,D,W,R,ZR	
	-	Y,M,L,B,T,ST,C,D,W,R,ZR	
	-	M,L,B,T,ST,C,D,W,R,ZR	
	-	M,L,B,T,ST,C,D,W,R,ZR	
	-	M,L,B,T,ST,C,D,W,R,ZR	
	-	T,ST,C,D,W,R,ZR	
	-	1 to 7	
	-	1 to 10	
	-	Not reserved/Reserved	
	-	Continue/Stop	
	-	Synchronization/Non-synchronization	
	-	1 to 100 (0 is invalid.)	
	-	Remote I/O station/Remote device station /Intelligent device station	
	-	1 station/2 station/3 station/4 station	
	-	Specification of reserved station/Specification of invalid station	

* N and M indicate the following:
N: Number of the module counted from the first.
M: Network type M: Network type

M	Network type	M	Network type
0H	Master station)	4H	MELSECNET (Master station)
1H	Local station)	5H	MELSECNET II mixed (Master station)
2H	Standby master station	6H	MELSECNET II (Master station)
3H	MELSECNET/10 (Remote master station)		

14 SELECTING MEMORY CARD MODELS

Since the Q2ASCPU has a built-in RAM as a standard feature to store parameters and programs, programs can be executed without installing a memory card.

Each CPU model has a built-in RAM of the following program capacity.

Q2ASCPU.....	28k steps	(112k bytes)
Q2ASCPU-S1.....	60k steps	(240k bytes)
Q2ASHCPU.....	28k steps	(112k bytes)
Q2ASHCPU-S1.....	60k steps	(240k bytes)

14.1 Applications of Memory Cards

A memory card is required in the following cases:

- (1) To perform a boot operation
Parameters, programs, initial device values, comments, and boot files are stored in a memory card, and they are loaded to the built-in RAM at the time of program execution.
- (2) To use file registers.*¹
- (3) To use local devices.*²
- (4) To use a simulation data file with the simulation function.*²
- (5) To use the sampling trace function.*²
- (6) To use the status latch function.*²
- (7) To use the program trace function.*²
- (8) To store the breakdown history data in a file.*²
- (9) To execute programs of the maximum number of steps available for the Q2ASCPU.
When a program of the maximum capacity is stored in the built-in RAM, the parameter files and initial device values must be stored in a memory card.
- (10) To use the SFC trace function.*²

*¹ They will be read-only in programs if they are set in the ROM area of the memory card.

*² Can only be set in the RAM area of the memory card.

14.2 Selecting Memory Card Capacity

Select a memory card capacity according to the types and sizes of files to be stored in the memory card. The sizes of files are calculated using the formulas presented below.

Function	Approximate File Capacity (Unit: Bytes)
Drive title	64
Keyword	72
Parameters ^{*3}	MELSECNET, NET/10 None → 330 When MELSECNET (II, /B) set → Max. 4096 per module
Boot file	(Number of files × 18) + 67
Sequence program ^{*3}	(Number of steps × 4) + 122
Device comments ^{*3}	(Total comment data size of each device) + 74 • Setting with GX Developer The comment data size of 1 device is as follows: 10250 × a + 40 × b + 10 (Quotient of (No. of devices / 256) is substituted for a and the remainder for b.) • Setting with SW□ IVD-GPPQ Although the size varies depending on EMS capacity, it is equivalent to or less than the size obtained in the above DX Developer case.
Initial device value ^{*3}	(Number of device points × 2) + (device types ^{*1} × 44) + 66
File register	Number of points for file registers × 2 bytes
Local device	(72 + (6 × No. of Setting range ^{*4}) + (2 × No. of word devices) + $\frac{\text{No. of bit devices}}{8} \times \text{No. of program files used}$ Round-up
Simulation data	(Number of word device points × 2) + $\frac{\text{number of bit device points}}{16} \times 2$ + (device ranges ^{*2} × 44) + 66 Rounded up
Sampling trace data	362 + (No. of word device points + No. of bit device points) × 12 + (N1 + N2 + N3 + No. of word device points × 2 + (No. of bit device points / 16) × 2) × trace count (total count) ^{*5} • According to the items set in the added trace information on the trace device setting screen, the following values are added for N1 to N3. (Refer to Section 8.5 (2) (b)) N1: When setting time, "4" is added. N2: When setting step No., "10" is added. N3: When setting the program name, "8" is added.
Status latch data	For all devices : 58576 For detailed devices : (Number of word device points × 2) + $\frac{\text{number of bit device points}}{16} \times 2$ + (device types × 8) + 352 Rounded up
Program Trace Data	Same as sampling trace
Breakdown history data	54 × number of faults stored + 72 bytes
SFC trace data	Max. 48k (in 1 kbyte units)

*1 "Device types" represents the number of registered device names.

For example, if D, W, and T are registered, it is 3.

*2 "Device ranges" represents the number of registered range settings.

*3 These files can be transferred from the memory card to the built-in RAM in the boot operation.

*4 The total number of setting ranges is the total number of types of the devices that are set as local devices.

*5 Decimal fraction of "number of bit device points/16" is rounded up.

POINT	
	<p>Note that the capacity may be rounded up as follows depending on the memory area used for storage:</p> <p>Built-in RAM..... 4096 bytes (1k step) units</p> <p>Memory card..... 512 bytes units</p> <p>Note that, when a file is transferred from the memory card to the built-in RAM in boot operation, the reserved capacity is changed after transfer.</p>

15 HARDWARE SPECIFICATIONS OF CPU MODULES

15.1 SPECIFICATIONS

The general specification common to various modules is shown.

Specifications

Item	Specifications					
Operating ambient temperature	0 to 55℃					
Storage ambient temperature	-20 to 75℃					
Operating ambient humidity	10 to 90 % RH, No-condensing					
Storage ambient humidity	10 to 90 % RH, No-condensing					
Vibration resistance	Conforming to JIS B 3502, IEC 61131-2		Frequency	Acceleration	Amplitude	Sweep count
		Under intermittent vibration	10 to 57Hz	—	0.075mm (0.003 inch)	10 times each in X, Y, Z directions (for 80min.)
			57 to 150Hz	9.8m/s ²	—	
		Under continuous vibration	10 to 57Hz	—	0.035mm (0.001inch)	
			57 to 150Hz	4.9m/s ²	—	
Shock resistance	Conforming to JIS B 3502, IEC 61131-2 (147m/s ² , 3 times in each of 3 directions XYZ)					
Operation ambience	No corrosive gasses					
Operating elevation ^{*3}	2000m (6562 ft.) or less					
Installation location	Control panel					
Overvoltage category ^{*1}	II or lower					
Pollution degree ^{*2}	2 or lower					
Equipment category	Class I					

*1 This indicates that the equipment is assumed to be connected to which power distributor in the area from the public electrical power distribution network to machinery in the premises. Category II applies to equipment to which electrical power is supplied from fixed facilities. The surge voltage withstand level for up to the rated voltage of 300V is 2500V.


*2 This index indicates the degree of conductive material generation in the environment where the equipment is used.
In Pollution degree 2, only non-conductive pollution occurs. Occasionally, however, temporary conductivity caused by condensation can be expected.

*3 Do not use or store the programmable controller in the environment where the pressure is higher than the atmospheric pressure at sea level. Otherwise, malfunction may result. To use the programmable controller in high-pressure environment, please contact your local Mitsubishi representative.

15.2 Part Names




The names of module parts and their settings are described here.

Q2ASCPU, Q2ASCPU-S1, Q2ASHCPU, Q2ASHCPU-S1

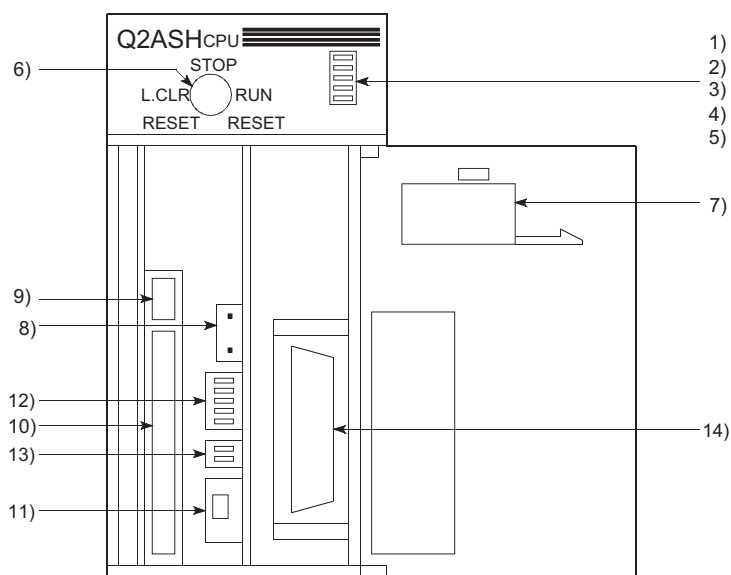

Viewed with the front cover open

No.	Name	Application
1)	RUN LED	Indicates the operating status of the CPU module. ON: Operating with the RUN/STOP key switch set to RUN or STEP RUN. OFF: Stopped with the RUN/STOP key switch set to STOP, PAUSE, or STEP RUN. Or, an error that stops operation was detected. Flickering: The RUN/STOP key switch was shifted from STOP to RUN after writing a program in the STOP state. The CPU module is not in the RUN state. To actually put the CPU module in the RUN state, either move the switch one more time from "RUN" → "STOP" → "RUN", or use the RUN/STOP key switch to perform reset operation. Alternatively, reset it with the RUN/STOP key switch.
2)	ERROR LED	ON: A self-diagnostics error that does not stop operation, other than a battery error, has been detected. (When the parameter setting is made for operation to continue when an error occurs.) OFF: Normal Flickering: An error that stops operation has been detected.
3)	USER LED	ON: An error has been detected by the CHK instruction, or an annunciator F has come ON. OFF: Normal Flickering: When latch clear is performed.
4)	BAT.ALARM LED	ON: A battery error occurred due to low battery voltage in the CPU module or memory card. OFF: Normal
5)	BOOT LED	ON: Execution of the boot operation is completed. OFF: No boot operation has been executed.
6)	RUN/STOP key switch	RUN/STOP: Starts/stops sequence program operation. L.CLR: Clears all data in the latch area (to "OFF" or "0") which is set with parameters. Clears sampling trace and status latch registrations. RESET: Resets the hardware. Resets and initializes operation when an operation error occurred.

No.	Name	Application																			
7)	Battery (A6BAT)	Backup battery for the built-in RAM and the power failure compensation function.																			
8)	Battery connector pin	Used for connection of the battery lead wire. (To prevent battery drain, the battery lead wire is disconnected from the connector before shipment. See Section 18.6.)																			
9)	Memory card EJECT button	Used to eject the memory card from the CPU module.(Refer to Section 18.7)																			
10)	Memory card installing connector	Connector for installing the memory card in the CPU module.																			
11)	Memory card in/out switch (with built-in LED) 	Used to enable/disable memory card installation or removal while the power is ON.Factory-set to OFF. ON: Cannot be removed (LED lit) OFF: Can be removed (LED unlit) Refer to Section 15.3 (3) and (4) for installation or removal of a memory card.																			
12)	System setting switch 1 	Settings required to operate the CPU module are made.All switches are set to OFF before shipping.																			
		SW5: Boot file settingSetting of the memory used for operation. ON: Boot operation OFF: Boot operation is not performed.																			
		SW2 to 4: Parameter areaSetting of the memory in which parameters are written.																			
		<table><tr><th rowspan="2">System setting switch 1</th><th rowspan="2">Built-in RAM</th><th colspan="2">Memory card</th><th rowspan="7">* SW2 to 4 are valid even if SW5 is OFF.</th></tr><tr><th>RAM</th><th>ROM</th></tr><tr><td>SW4</td><td>OFF</td><td>ON</td><td>OFF</td></tr><tr><td>SW3</td><td>OFF</td><td>OFF</td><td>ON</td></tr><tr><td>SW2</td><td>OFF</td><td>OFF</td><td>OFF</td></tr></table>	System setting switch 1	Built-in RAM	Memory card		* SW2 to 4 are valid even if SW5 is OFF.	RAM	ROM	SW4	OFF	ON	OFF	SW3	OFF	OFF	ON	SW2	OFF	OFF	OFF
		System setting switch 1			Built-in RAM	Memory card		* SW2 to 4 are valid even if SW5 is OFF.													
			RAM	ROM																	
		SW4	OFF	ON	OFF																
SW3	OFF	OFF	ON																		
SW2	OFF	OFF	OFF																		
SW1: System protectProhibition of all writing and control directions to the CPU module. ON: System protection enabled OFF: System protection disabled																					
13)	System setting switch 2 	Settings required to operate the CPU module are made.All switches are set to OFF before shipping.																			
		SW2: Not used. (Fixed to OFF.)																			
		SW1: Peripheral protocol.Select the type of the peripheral device connected to the peripheral interface of the CPU module. (When accessing an ACPU on another station from a peripheral device for ACPU, set this switch to “ON”. The setting becomes valid immediately after switching.) ON: Peripheral device for ACPU																			
14)	RS-422 connector	Connector for connecting to a peripheral device.																			

15.3 Relationship between Switch Operations and LEDs/LED Display

(1) Writing programs with the CPU module in STOP state

To write a program to the CPU module while it is in the STOP state, use the following procedure.

1) Set the RUN/STOP key switch to STOP

RUN LED :OFF

2) Set the RUN/STOP key switch to RESET

RUN LED :OFFCPU module in RESET state

3) Set the RUN/STOP key switch to STOP → RUN

RUN LED :ONCPU module in RUN state

POINT	
(1)	For the Q2ASCPU, after writing a program (except for writing to PLC during RUN), set the CPU module to RESET and then to RUN.
(2)	If the key switch is set to RUN without resetting, the CPU module will remain in STOP state displaying as follows: <p>RUN LED :Flickers *1</p> <p>After this occurs, the CPU can be placed into RUN state by setting the RUN/STOP key switch to RESET.</p> <p>In this case, internal CPU module data such device data are cleared.</p>
(3)	To prevent the internal CPU module information from being cleared, switch the RUN/STOP key switch STOP → RUN again without resetting.

*1 If Remote STOP → RUN is performed for the CPU module, the CPU will be in RUN status, not in "PROG.CHECK" status.

(2) Performing latch clear

To perform latch clear, operate the RUN/STOP key switch as follows.

- 1) Move the "RUN/STOP" key switch of the CPU module from the "STOP" to the "L.CLR" position several times to flicker the "USER LED" on the CPU module front.
Normally, the LED flickers after the switch is moved several (three or four) times. When the "USER LED" flickers, it indicates that latch clear is ready.
- 2) After the "USER LED" has flickered, moving the key switch from the "STOP" to the "L.CLR" position again executes latch clear and lights up the "USER LED". When the "USER LED" is lit for 2 seconds and then goes off, it indicates normal completion of latch clear.
- 3) To cancel latch clear midway, move the key switch to the "RUN" position to put the CPU module in a RUN status or to the "RESET" position to reset.

POINT	
(1)	The latch clear operation can be set enabled or disabled for each device in the device setting in the parameter mode.
(2)	Remote latch clear executed by the GPP function is an alternative method other than using the RUN/STOP key switch.(Refer to Section 10.6.5)

(3) Removing a memory card while the programmable controller power is ON:

When removing a memory card with the programmable controller power ON, operate the memory card in/out switch as follows:

- 1) In/out switch: ON.
LED in the switch :ON Memory card removal prohibited
- 2) In/out switch: OFF
LED in the switch :OFF Memory card removal permitted
Removal of memory card

POINT	
(1)	The LED in the in/out switch may not come OFF if the memory card is being used for a CPU module system function (sampling trace, status latch, etc.) or by a program. In such a case, stop the function or program using the memory card. After aborting it, confirm that the LED in the in/out switch has gone OFF, then remove the memory card.
(2)	When a file register, local device or breakdown history set with parameters is present, the memory card cannot be removed. Even if the memory card in/out switch is turned OFF, its built-in LED does not turn OFF. When the file register is set to "Not used" with the QDRSET (P) instruction, the memory card can be removed.
(3)	After removing the memory card, do not turn on the memory card insertion/disconnection switch for preventing an error.

- (4) Installing a memory card while the programmable controller power is ON:
When installing a memory card with the programmable controller power ON, operate the memory card in/out switch as follows:
- 1) Install the memory card.
 - 2) In/out switch: ON
LED in the switch :ON Memory card removal prohibited

POINT	
(1)	After installing the memory card, set the memory card in/out switch to ON. If it is not set to ON, the memory card cannot be used.
(2)	During one scan after the memory card installation, mounting processing is performed again. Note that the scan time may be increased by 10ms at maximum.

16 POWER SUPPLY MODULE

This section describes the specifications and selection of power supply modules.

16.1 Specifications

16.1.1 Power supply module specifications

(1) Standard power supply module

Power supply module specifications

Item		Performance specifications		
		A1S61PN	A1S62PN	A1S63P
Slot position		Power supply module slot		
Input power supply		100 to 240VAC ^{+10%} _{-15%} (85 to 264VAC)		24VDC ^{+30%} _{-35%} (15.6 to 31.2VAC)
Input frequency		50/60Hz± 5		—
Input voltage distortion		Within 5% (See Section 19.8)		—
Max. input apparent power		105VA		41W
Inrush current		20A, 8ms or less ^{*4}		81A, 1ms or less
Rated output current	5VDC	5A	3A	5A
	24VDC	—	0.6A	—
Overcurrent protection ^{*1}	5VDC	5.5A or higher	3.3A or higher	5.5A or higher
	24VDC	—	0.66A or higher	—
Overvoltage protection ^{*2}	5VDC	5.5 to 6.5V		
	24VDC	—		
Efficiency		65% or higher		
Allowable momentary power failure period ^{*3}		20ms or less		10ms or lower (24VDC or higher)
Dielectric withstand voltage	Between primary and 5VDC	AC across input/LG and output/FG, 2830VAC rms/3 cycles (altitude 2000m (6562ft.))		500VAC
	—			
Insulation resistance		AC across input/LG and output/FG 10MΩ or higher, measures with a 500VDC insulation resistance tester (10MΩ or above by insulation resistance tester)		
Noise durability		• Checked by noise simulator of noise voltage 1500Vp-p, noise width 1 μ , and noise frequency 25 to 60Hz • Checked by noise simulator of noise voltage IEC801-4, 2kV, 1500Vp-p, noise width 1 μ s, and noise frequency 25 to 60Hz		• Checked by noise simulator of noise voltage 1500Vp-p, noise width 1 μ , and noise frequency 25 to 60Hz
Power indicator		Power LED indication (light at the time of output of 5VDC)		
Fuse		Built-in (User cannot change.)		

Item	Performance specifications		
	A1S61PN	A1S62PN	A1S63P
Terminal screw size	M3.5×7		
Applicable wire size	0.75 to 2mm ²		
Applicable solderless terminal	RAV1.25 to 3.5, RAV2 to 3.5		
Applicable tightening torque	59 to 88N · cm		
External dimensions	130mm×55mm×93.6mm		
Weight	0.60kg	0.60kg	0.50kg

REMARK

1) The number of occupied slots for the A66P is 1.

POINT

*1 Overcurrent protection

(a) The overcurrent protector shuts off the 5VDC and/or 24VDC circuit(s) and stops the system if the current exceeding the specified value flows in the circuit(s).

As this results in voltage drop, the power supply module LED turns OFF or is dimly lit.

(b) When this device is activated, eliminate probable causes such as insufficient current capacity or short circuit, and then start the system. When the current has reached the normal value, the system will start from the first.

*2 Overvoltage protection

The overvoltage protector shuts off the 5VDC circuit and stops the system if overvoltage of 5.5 to 6.5V is applied to the circuit.

The power supply module LED turns OFF. When restarting the system, switch the input power OFF, then back ON. The system is started up with an initial start. If the system is not booted and the LED remains off, this means that the power supply module has to be replaced.

*3 Allowable momentary power failure period

The allowable momentary power failure period of programmable controller CPUs varies depending on the power supply module used.

In the system using the A1S63P, it is the time from when the primary side of the stabilized power supply supplying 24VDC to the A1S63P turns OFF until the voltage (secondary side) has dropped from 24VDC to the specified value (15.6VDC) or less.

*4 Inrush current

If power is reapplied immediately after power OFF (within 5 seconds), an inrush current exceeding the specified value may flow (for 2ms or less).


Therefore, before reapplying power, make sure that 5 seconds have elapsed after power off.

When selecting a fuse or breaker for an external circuit, consider the above as well as meltdown and detection characteristics.

16.1.2 Power supply module selection

A power supply module is selected based on to the total current consumption of I/O modules, special function modules and peripheral devices to which power is supplied by the power supply module. Remember that when an extension base module such as A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B or A58B are used, power is supplied by the main base.

For 5VDC current consumption of I/O modules, special function modules and peripheral devices, refer to Section 3.3.

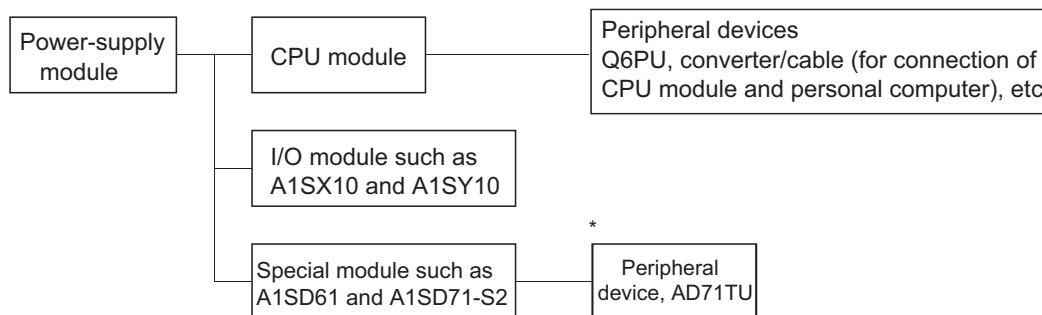

* Select the module in consideration of the current consumption of the peripheral device that will be connected to the special-function module. For example, when AD71TU is connected to A1SD71-S2, the current consumption of AD71TU must also be considered.

- (2) Selection of power-supply module when extension base modules such as A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B and A58B are used
 When extension base modules such as A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B and A58B are used, the 5 VDC power supply is supplied through the extension cable from the power-supply module of the main base module. Thus, when one of these units is used, pay attantion to the following:
 - (a) When mounting a power supply module on the main base unit, select a model that can cover 5VDC current consumed by modules mounted on the A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B, and/or A58B.
 [Example] When the 5 VDC current consumption on the main base module is 3A and the 5 VDC current consumption on A1S55B is 1A, the power-supply module that is loaded into the main base module must be A1S61PN(DC5V 5A).
 - (b) Since power to the A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B or A58B is supplied via an extension cable, a voltage drop occurs through the cable. It is necessary to select a power supply module and cables with proper length so that 4.75VDC or more is available on the receiving end. Refer to the usage standard of the Extension Base Module in Section 17.3 for details on voltage drops, etc.

16.2 Precautions for Handling

**CAUTION**

- Use the programmable controller under the environment specified in the user's manual.
Otherwise, it may cause electric shocks, fires, malfunctions, product deterioration or damage.
- Install the module after inserting the pegs on the bottom of the module securely into the base unit peg holes.
Not doing so could cause a malfunction, failure or fall.
If too tight, it may cause damage to the screws and/or module, resulting in an accidental drop of the module, short circuit or malfunctions.
- Connect the extension cable to the connector of the base unit or module.
Check for incomplete connection after installing it.
Poor electrical contact may cause incorrect inputs and/or outputs.
- Insert the memory cassette and fully press it to the memory cassette connector.
Check for incomplete connection after installing it.
Poor electrical contact may cause malfunctions.
- Be sure to shut off all phases of the external power supply used by the system before mounting or removing the module.
Failure to do so may damage the module.
- Do not directly touch the conductive part or electronic components of the module.
Doing so may cause malfunctions or a failure of the module.

The following explains the handling precautions for unpacking to mounting of the power supply module.


- (1) Do not drop the power supply module or give it hard shock since its case, terminal block connectors and pin connectors are made of resin.
- (2) Tighten the module mounting screws (unnecessary in normal operating status), terminal screws, etc. in the following ranges.


Screw	Tightening torque range
Power supply module terminal block terminal screw (M3 screw)	39 to 59N · cm
Power supply module terminal block terminal screw (M4 screw)	98 to 137N · cm
Module mounting screws (Optional) (M4 screw)	78 to 118N · cm

- (3) When installing the module to the base unit, press the module completely so that its hook is locked into the base. When dismounting the module, press the hooks until they come off the base completely, and then pull the module toward you. (See Section 19.5.)

16.3 Part Names

The following gives the names and description of the parts of the power supply modules :

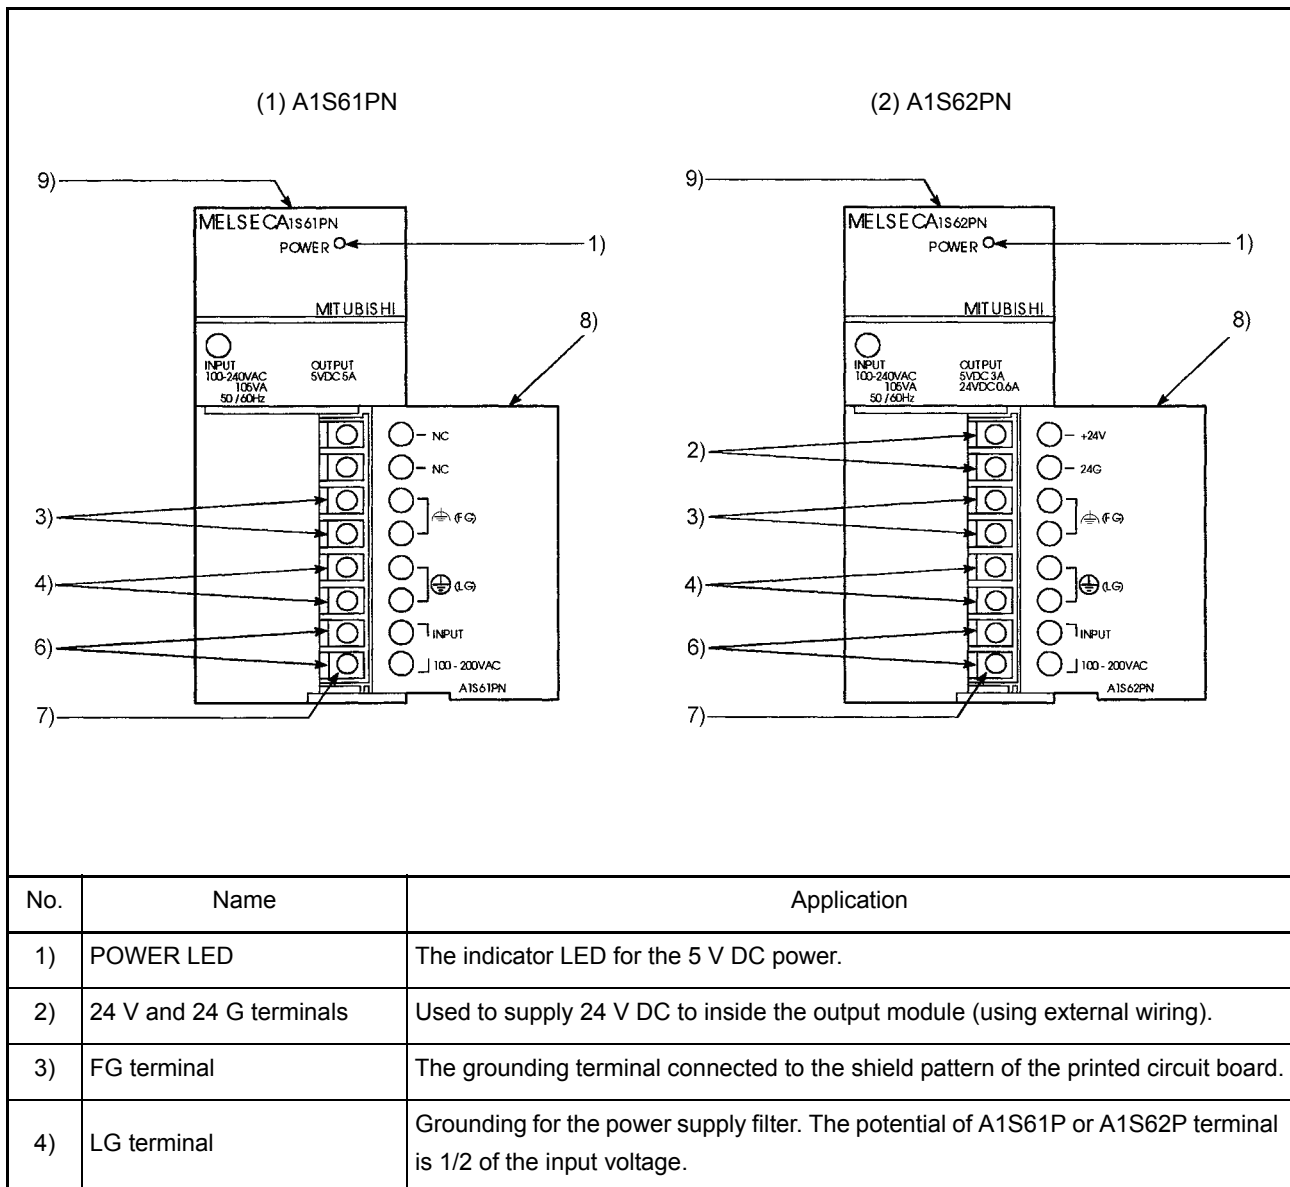

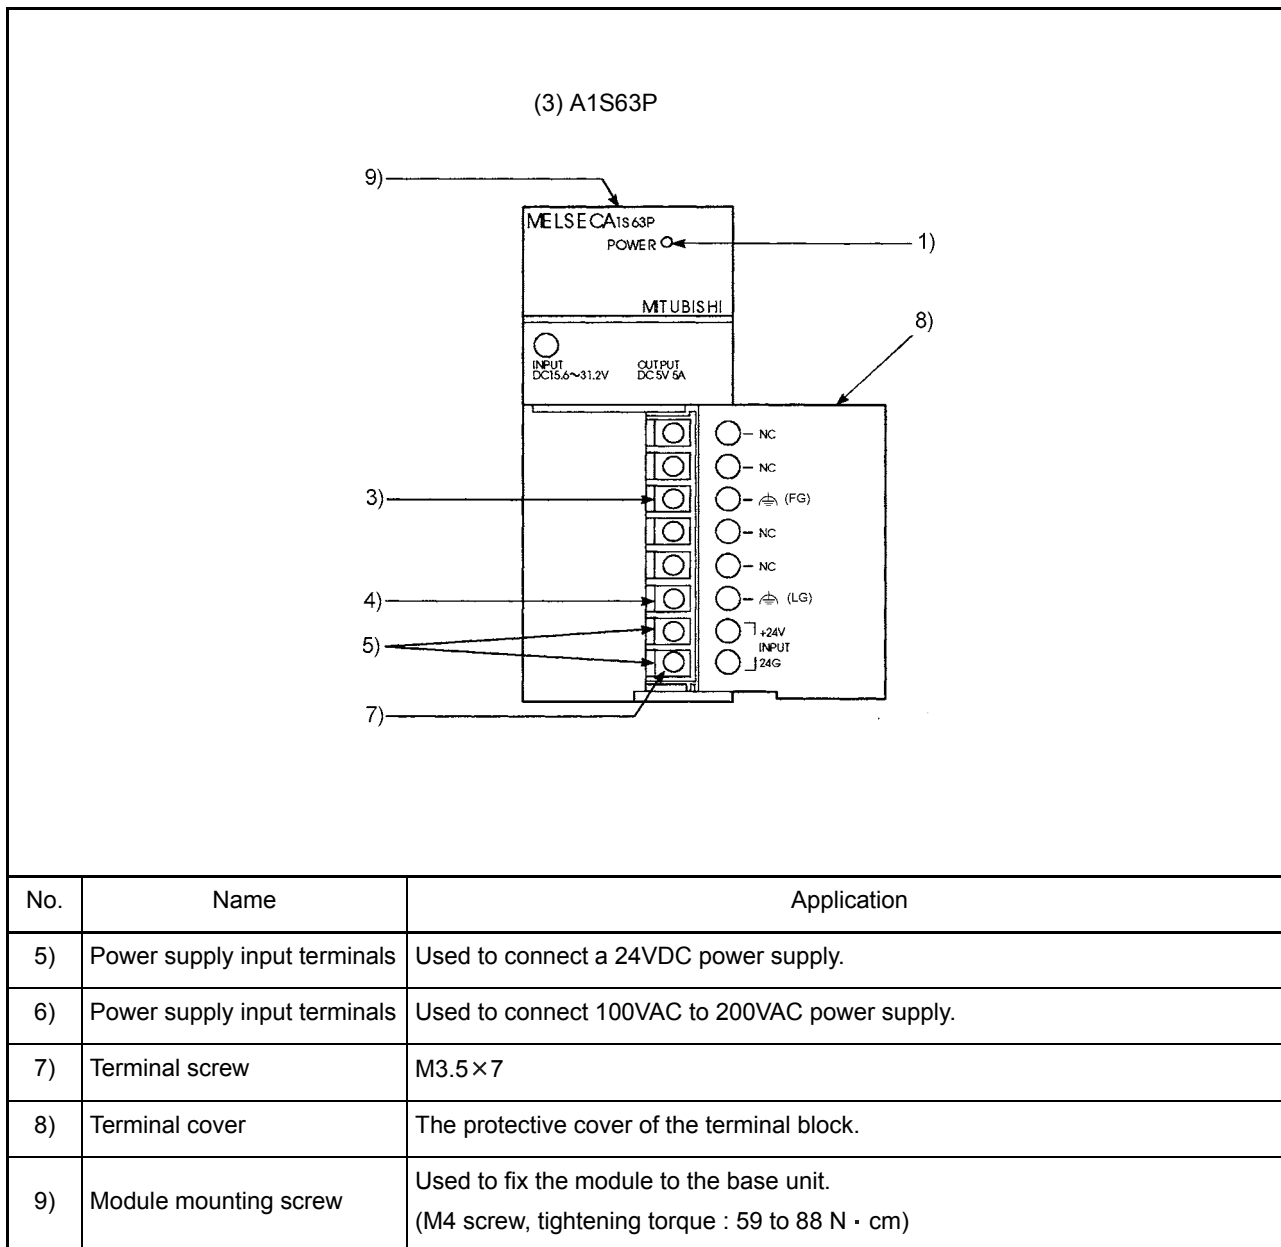

POINT
(1) Do not cable to the unused terminals such as FG and LG on the terminal block (terminals whose name is not printed on the terminal cover).
(2) Be sure to ground the terminal LG to the protective ground conductor.

17 BASE UNIT AND EXTENSION CABLE

This section explains the specifications of the base units (the main and extension base units) and extension cables available for the systems, and the application standards for use of extension base units.

17.1 Base Unit Specifications

(1) Main base unit specifications

Table 17.1 Main base unit specifications

Item	A1S32B	A1S33B	A1S35B	A1S38B	A1S38HB
I/O module installation range	2 modules can be installed.	3 modules can be installed.	5 modules can be installed.	8 modules can be installed.	8 modules can be installed.
Extension possibility	Extendable				
Installation hole size	ϕ 6 bell-shaped holes (for M5 screws)				
External dimensions	220mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)	255mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)	325mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)	430mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)	
Weight	0.52kg	0.65kg	0.75kg	0.97kg	1.0kg
Accessory	Attaching screws: M5×25 4 screws				

(2) Extension base unit specifications

Table 17.2 Extension base unit specifications

Item	A1S65B	A1S65B-S1	A1S68B	A1S68B-S1	A1S52B	A1S52B-S1	A1S55B	A1S55B-S1	A1S58B	A1S58B-S1
I/O module installation range	5 modules can be installed.		8 modules can be installed.		2 modules can be installed.		5 modules can be installed.		8 modules can be installed.	
Power supply module loading necessity	Power supply module required				Unnecessary (Refer to POINT below)					
Installation hole size	φ 6 bell-shaped holes (for M5 screws)									
Terminal screw size	—		—		M4×6(FG terminal)					
Applicable wire size	—		—		0.75 to 2mm ²					
Applicable solderless terminal	—		—		(V) 1.25-4 (V) 1.25-YS4(V)2-YS4A (Applicable tightening torque: 78 to 118N・cm)					
External dimensions	315mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)		420mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)		135mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)		260mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)		365mm (3.3inch) × 130mm (2.1inch) × 28mm (0.1inch)	
Weight	0.71kg		0.95kg		0.38kg		0.61kg		0.87kg	
Accessory	Attaching screws: M5×25 4 screws				*1 Dustproof cover (for I/O module): 1 pc. Attaching screws: M5×25 4 screws					

*1 1 For the attachment of the dustproof cover, refer to Section 19.6.

POINT
<p>(1) 5VDC power for the A1S52B(S1), A1S55B(S1) or A1S58B(S1) is supplied from the power supply module mounted to the main base unit.</p> <p>(2) Refer to Section 16.1.2, "Selecting the Power Supply Module" or Section 17.3, "Application Standards of Extension Base Unit" when using A1S52B(S1), A1S55B(S1) and A1S58B(S1).</p>

17.1.1 Main base unit for high-speed access (A1S38HB/A1S38HBEU)

The main base units, (A1S38HB/A1S38HBEU) for high-speed access have been improved in the speed of access to the buffer memory of the special function module mounted on A1S38HB/A1S38HBEU.

POINT
(1) The A1S38HB/A1S38HBEU can perform high-speed access to the buffer memories of special function modules only. I/O devices of I/O modules are not accessed at high speed but at the same access speed as that of a conventional main base unit.
(2) When an extension base unit is connected to the A1S38HB/A1S38HBEU, the buffer memories of the special function modules on the extension base unit are not accessed at high speed. The access speed is the same as the one in the case of connecting to a conventional main base unit.

REMARK

- (1) The A1S38HB/A1S38HBEU base unit is dedicated to the Q2ASCPU and cannot be used with the AnSCPU.
- (2) When using the simulation module A6SIM-X64Y64, set its base unit specification to "1" or later.
If "0" is set, the A6SIM-X64Y64 does not operate normally.
When "0" is to be set for the base unit specification of the A6SIM-X64Y64, replace the base unit with the A38B.

17.2 Extension Cable Specification List

The specifications of the extension cables used for the Q2ASCPU system are shown below:

Item	A1SC01B	A1SC03B	A1SC07B	A1SC12B	A1SC30B	A1SC60B	A1SC05NB	A1SC07NB	A1SC30NB	A1SC50NB
Cable length	0.055m	0.33m	0.7 (2.30)	1.2 (3.94)	3.0 (9.84)	6.0 (19.69)	0.45 (1.48)	0.7 (2.30)	3.0 (9.84)	5 (16.43)
Resistance value of 5VDC supply line (at 55°C)	0.02 Ω	0.02 Ω	0.04 Ω	0.06 Ω	0.12 Ω	0.18 Ω	0.04 Ω	0.05 Ω	0.12 Ω	0.18 Ω
Application	Connection between a main base and A1S5□B(S1)/A1S6□B(S1)						Connection between a main base and A5□B/A6□B			
Weight	0.025	0.10	0.14	0.20	0.40	0.65	0.20	0.22	0.40	0.56

**CAUTION**

- Connect the extension cable to the connector of the base unit or module. After that, check for incomplete insertion. Poor electrical contact may cause incorrect inputs and/or outputs.
- When using extension cables, keep them away from the main circuit cables (high voltage, large current).

17.3 Application Standards of Extension Base Unit (A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B, A58B)

To the A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B and A58B extension base units, 5VDC is supplied from the power supply module on the main base unit. (Power is not supplied from any power supply module on the A62B, A65B and A68B.)

Therefore, if a voltage drop occurs on an extension cable, the specified voltage may not be supplied to the receiving end, resulting in erroneous inputs and outputs.

It is recommended to connect the A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B and/or A58B after a main base unit to minimize a voltage drop.

Determine applicability of the A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B and A58B by the following calculation method.

(1) Selection condition

The voltage received by the module installed in the last slot of an extension base unit A1S52B(S1), A1S55B(S1), A1S58B(S1), A52B, A55B or A58B must be 4.75 V or above.

Since the output voltage of the power supply module is set at 5.1 V or above, the voltage drop must be 0.35 V or less.

(2) Classification of voltage drop

Voltage drop is classified into (a), (b), and (c) as follows according to the connecting method and type of extension base units.

(a) Voltage drop of a main base unit

(b) Voltage drop of an extension base unit

(c) Voltage drop over an extension cable

Extension base unit used	Extension cable connected to the left side of main base unit (serial)	Extension cable connected to the right side of main base unit (Parallel)
A1S52B(S1), A1S55B(S1) or A1S58B(S1) extension base unit is used	<p>Voltage drop of the main base unit can be ignored.</p>	

Extension base unit used	Extension cable connected to the left side of main base unit (serial)	Extension cable connected to the right side of main base unit (Parallel)
A52B, A55B or A58B extension base unit is used	<div><p>(c)</p><p>A1S3□B</p><p>A5□B</p></div> <p>Voltage drop of the main and the extension base units can be ignored.</p>	<div><p>A1S3□B</p><p>(a)</p><p>(c)</p><p>A5□B</p></div> <p>Voltage drop of the extension base units can be ignored.</p>

17.4 Handling Precautions

The handling precautions to be taken from unpacking to mounting a base unit are described below.

The terminal connectors and pin connectors of the base unit are made of resin. Do not drop them or apply heavy impact to them.


**CAUTION**

- Do not remove the printed-circuit board from the base unit.
Doing so may cause failure, malfunctions, personal injuries and/or a fire.
- Use caution to prevent foreign matter, such as dust or wire chips, from entering the base unit during wiring.
Failure to do so may cause a failure, malfunction or fire.

17.5 Part Names

Part names of the base unit are shown here.

(1) Main base module (A1S32B, A1S33B, A1S35B, A1S38B, A1S38HB, A1S38HBEU)

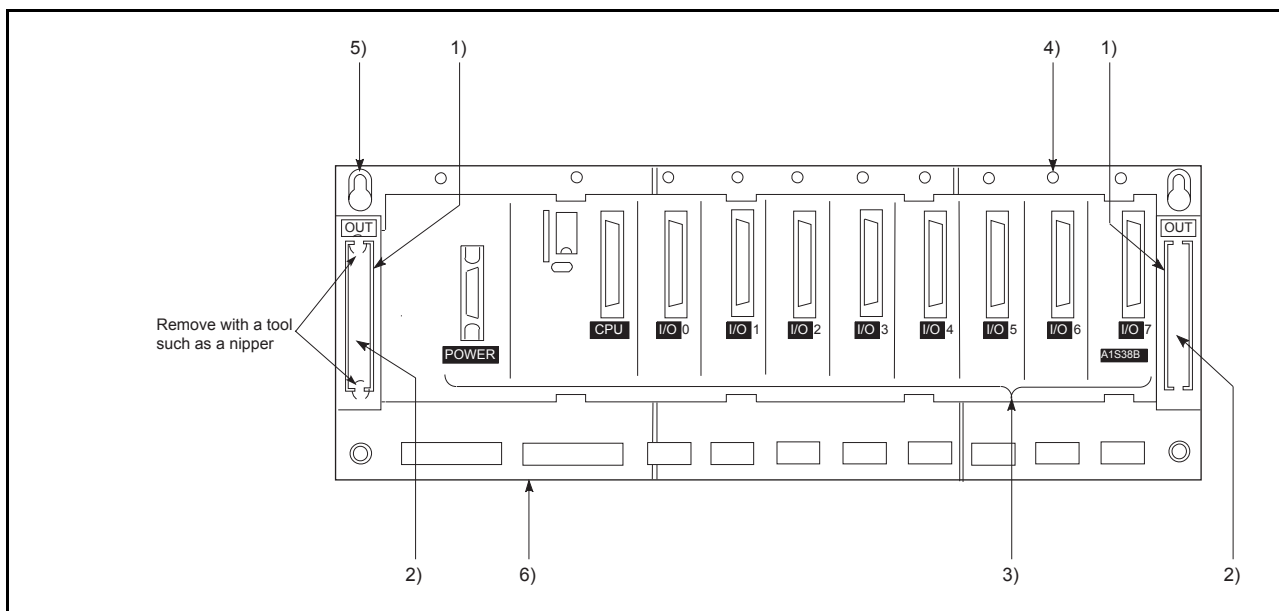


No.	Name	Application
1)	Extension cable connector	Connects an extension cable using a signal-communication connector for the extension base module.
2)	Base cover	Protective cover for the extension cable connector. To expand it, the area surrounded by grooves located below the word "OUT" on the base cover should be removed with a nipper, etc.
3)	Module connector	Connector to load the power supply module, CPU module, I/O module and specialfunction module. To prevent dust accumulation, load the attached connector cover, blank cover (A1SG60) or a dummy module (A1SG62) to reserved space connector not loaded a module.
4)	Module mounting screw	Screws to attach the module to the bases. Screw size: for M4 screw
5)	Base mounting hole	Mounting hole to attach the base module to the panel of the control panels, etc. (For M5 screw)
6)	DIN rail hook	Attachment hook for DIN rail One piece each for A1S32B and A1S33B. Two pieces each for A1S35B, A1S38B, A1S38HB and A1S38HBEU.

IMPORTANT

Only one extension base module can be connected to a main base module.
Connecting two extension connectors of the main base module to extension base modules may result in input and/or output errors.

- (2) Extension base module (A1S52B, A1S55B, A1S58B, A1S52B-S1, A1S55B-S1, A1S58B-S1, A1S65B, A1S68B, A1S65B-S1, A1S68B-S1)

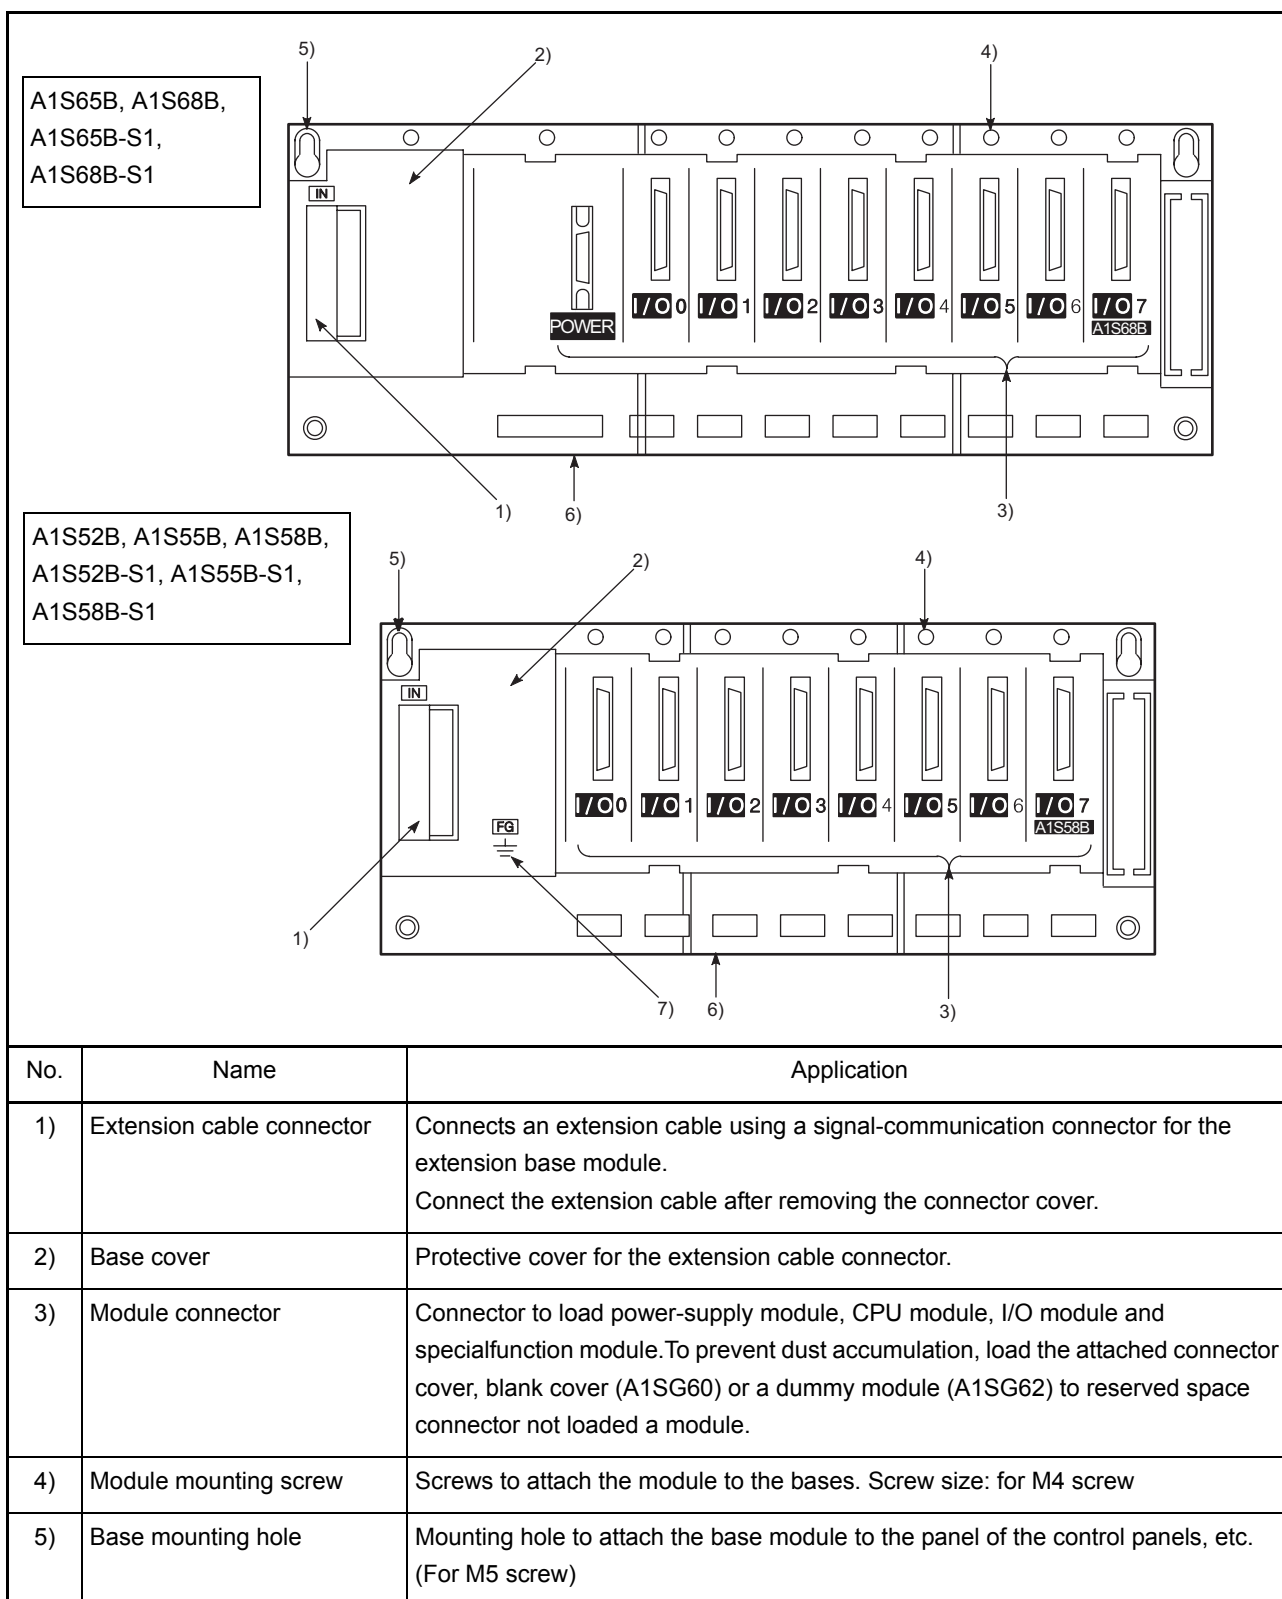

No.	Name	Application
6)	DIN rail hook	Attachment hook for DIN rail One piece each for A1S52B, A1S55B, A1S52B-S1 and A1S55B-S1. Two pieces each for A1S65B, A1S68B, A1S58B, A1S65B-S1, A1S68B-S1 and A1S58B-S1.
7)	FG terminal	The grounding terminal connected to the shield pattern of the printed circuit board.

18 MEMORY CARDS AND BATTERIES

This section describes the specifications and handling of the memory cards and batteries that can be used with the Q2ASCPU.

18.1 Memory Card Specifications

The specifications of the memory cards that can be used with Q2ASCPU conform to JEIDA Ver. 4.0.

(1) SRAM type memory cards

Item	Model Name					
	Q1MEM-64S	Q1MEM-128S	Q1MEM-256S	Q1MEM-512S	Q1MEM-1MS	Q1MEM-2MS
SRAM memory capacity before formatting	64k bytes	128k bytes	256k bytes	512k bytes	1M bytes	2M bytes
SRAM memory capacity after formatting	59k bytes	123k bytes	250.5k bytes	506k bytes	1016.5k bytes	2036k bytes
Number of storable files	118	128				256
Insertion/removal limit	5000 times					
External dimensions	85.6mm (3.3inch) × 54mm (2.1inch) × 3.3mm (0.1inch)					
Weight	0.04kg					

(2) SRAM + E²PROM type memory cards

Item		Model Name				
		Q1MEM-64SE	Q1MEM-128SE	Q1MEM-256SE	Q1MEM-512SE	Q1MEM-1MSE
Memory capacity before formatting		32k bytes	64k bytes	128k bytes	256k bytes	512k bytes
	SRAM					
	E ² PROM	32k bytes	64k bytes	128k bytes	256k bytes	512k bytes
Memory capacity after formatting		28.5k bytes	58.5k bytes	122.5k bytes	250k bytes	505.5k bytes
	SRAM					
	E ² PROM	29k bytes	59k bytes	123k bytes	250.5k bytes	506k bytes
Number of storable files		57	117	128		
	SRAM					
	E ² PROM	58	118	128		
Maximum number of writes to E ² PROM		10,000 times				

(2) SRAM + E²PROM type memory cards

Item	Model Name				
	Q1MEM-64SE	Q1MEM-128SE	Q1MEM-256SE	Q1MEM-512SE	Q1MEM-1MSE
Insertion/removal limit	5000 times				
External dimensions	85.6mm (3.3inch) × 54mm (2.1inch) × 3.3mm (0.1inch)				
Weight	0.04kg				

18.2 Handling Memory Cards

(1) Formatting memory cards

All memory cards used with Q2ASCPU must be formatted.

The purchased memory card is not formatted. Use the memory card after formatting with the GPP function.

(a) SRAM+E²PROM type memory card

Format both RAM and ROM.

If installed with only one of them formatted, the Q2ASCPU detects an error (ICM.OPE.ERROR).

For information on how to format SRAM and E²PROM, see the following manual.

- GX Developer Operating Manual
- Type SW□IVD-GPPQ Software package Operating Manual (Online)

(2) Installing the battery in the memory card

The memory card is packaged with a RAM memory backup battery. To use the RAM memory of the memory card, this battery must be installed first.

POINT	
	The battery installed in the CPU module does not back up RAM memories of memory cards. Also, a battery installed in a memory card does not back up the internal RAM of a CPU module.

(3) Switch setting when using a memory card

When using a memory card, turn ON the memory card in/out switch which is close to the connector. If it is set to OFF, the memory card cannot be used.

18.3 Battery Specifications (CPU Module and Memory Card Batteries)

(1) CPU module batteries

Item	Model Name
	A6BAT
Type	Thionyl chloride lithium battery
Initial voltage	3.6VDC
Battery guarantee period	5 years
Total power failure time	Refer to Section 21.3.1
Lithium content	0.48g
Application	Built-in RAM memory backup and power failure compensation
External dimensions	$\phi 16 \times 30\text{mm}$ [0.6 \times 1.2 inch]

REMARK

- For the battery directive in EU member states, refer to Appendix 11.

(2) Memory card batteries

Item	Model Name
	BR2325 or equivalent
Type	BR-type coin cell lithium battery
Initial voltage	3.0VDC
Battery guarantee period	5 years
Total power failure time	Refer to Section 21.3.1
Lithium content	0.05g
Application	Card memory backup and power failure compensation

18.4 Handling Precautions

Handling precautions on memory cards and batteries from unpacking to mounting are listed below.

(1) Memory card

- (a) Do not drop, bend or apply any strong impact to the memory card.
- (b) Do not expose the memory card to water.
- (c) Do not expose the memory card to direct sunlight or leave it near a heat source.
- (d) Be careful to prevent dust from entering the connector.
- (e) Do not store the memory card in high temperature or high humidity areas.
- (f) To protect the memory card from static electricity, always enclose it in a plastic case before transporting or storing.
- (g) Do not touch the terminals of the memory card.



CAUTION


- Insert the memory card and fully press it to the memory card connector. Check for incomplete connection after installing it.
Poor electrical contact may cause malfunctions.

(2) Battery

- (a) Do not short the battery.
- (b) Do not disassemble the battery.
- (c) Do not put it into a fire.
- (d) Do not heat it.
- (e) Do not apply solder to the battery poles.

18.5 Part Names of Memory Card


Part names of the memory card are shown below.

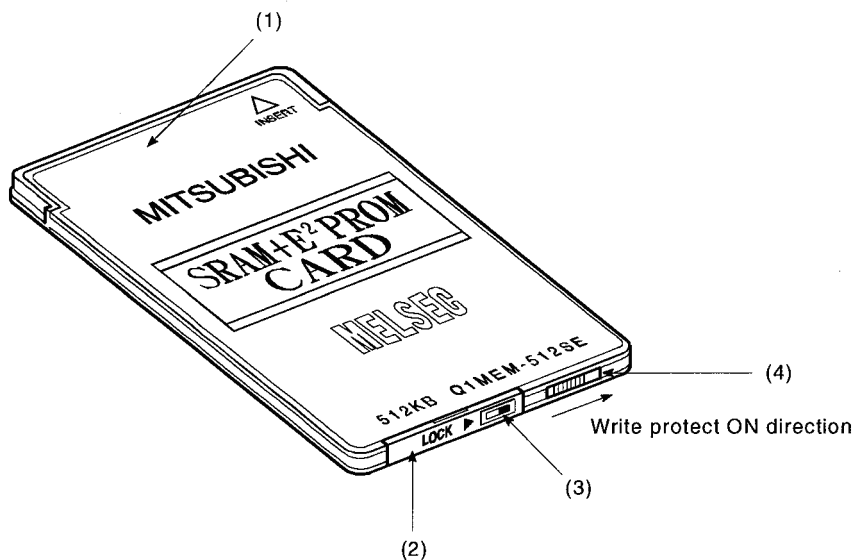


* Must be set before writing a program and starting operation.

18.6 Installing Batteries (CPU Module and Memory Card Batteries)

- (1) Since the CPU module battery is shipped with its battery connector disconnected, connect the connector according to the procedure indicated below.

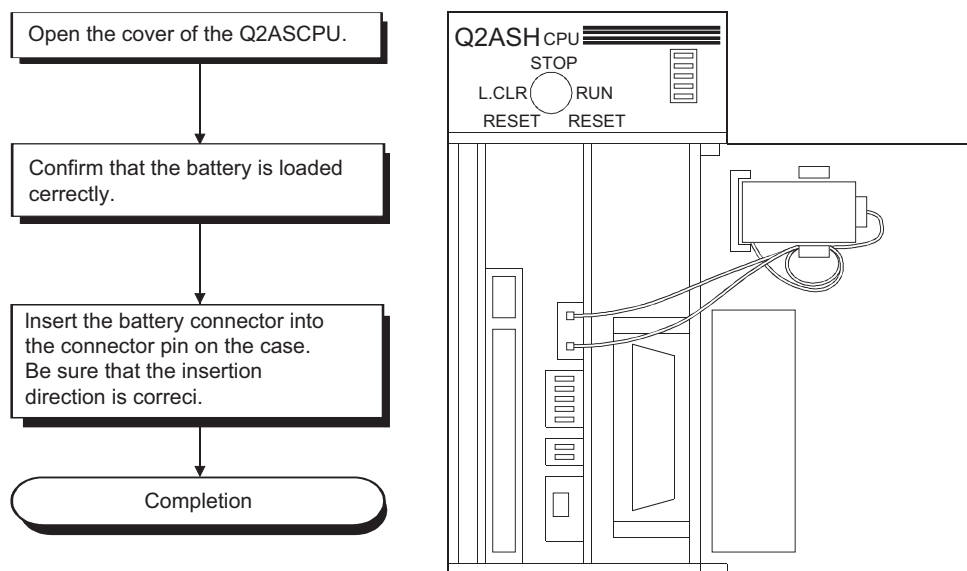

- (2) Since the memory card battery is removed from the battery holder before shipping, set it in the battery holder before use of the RAM.

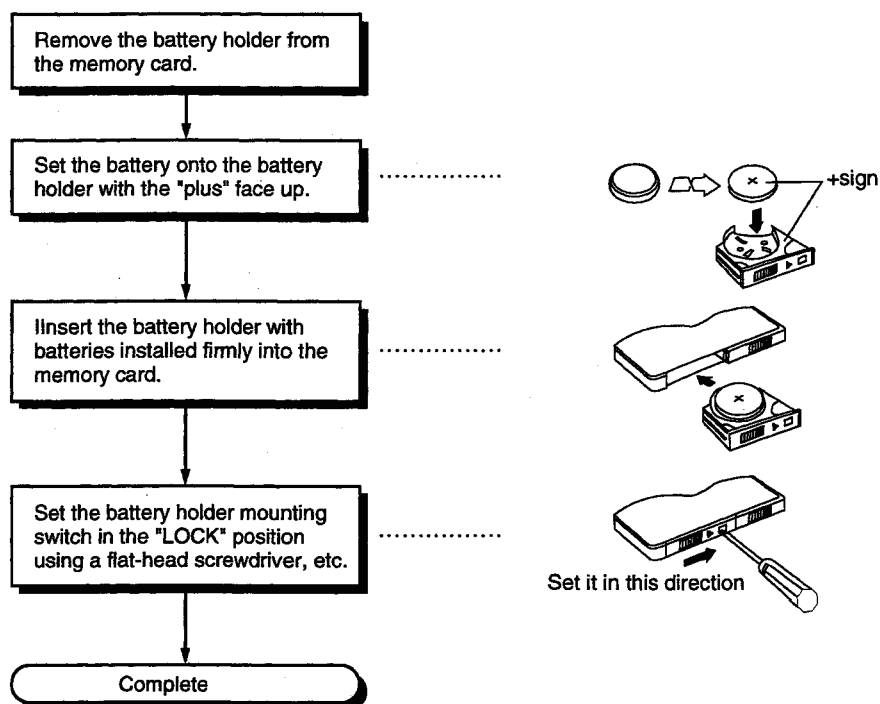


18.7 Installing/Removing A Memory Card

(1) Installing a memory card

When installing a memory card into the CPU module with its power ON, make sure that the orientation of the memory card is correct, then insert it fully until its edge is flush with the face of the EJECT button.

After installing it, set the memory card in/out switch to "ON".

The memory card is operable after the LED on the memory card in/out switch turns ON.

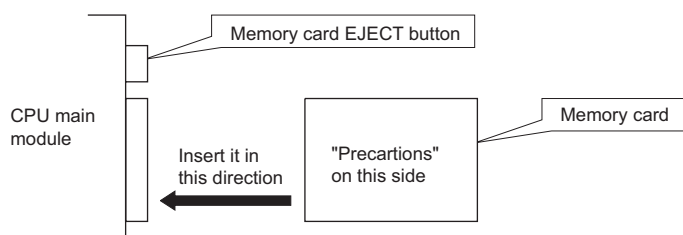
**CAUTION**

- Insert the memory card and fully press it to the memory card connector. After that, check for incomplete insertion. Poor electrical contact may cause malfunctions.

(2) Removing the memory card

Before removing the memory card from the CPU module with its power ON, set the memory card in/out switch to "OFF".

Verify that the LED on the switch has gone OFF. Then, press the memory card EJECT button and remove the memory card.

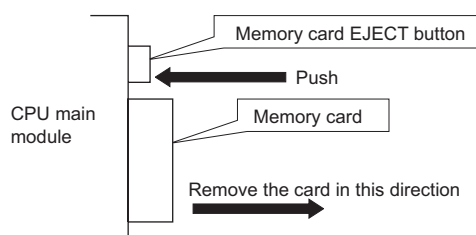**POINT**

- (1) When a memory card is installed, the scan time will increase by 10ms at maximum. The scan time increases only in 1 scan during which the Q2ASCPU performs mount processing.
- (2) If the memory card in/out switch is turned OFF while the system or a program is using the memory card, it may take a while for the LED on the switch to go OFF.
- (3) Installing or removing a memory card with the memory card in/out switch set ON while the power is ON will destroy the contents of the memory card.

(3) Memory card remove/insert prohibit flag (special relays SM605)

Instead of operating the memory card in/out switch, turning ON/OFF special relays SM605 (memory card) can be also used as the card remove/insert prohibit flag. Once removal/insertion is prohibited with the remove/install prohibit flag, it is still disabled even if the memory card in/out switch is set to ON.

The relationship between the memory card in/out switch and the memory card remove/insert prohibit flag is shown in the table below.

Memory card remove/insert prohibit flag	Memory card in/out switch	
	ON (Removal/Insertion Prohibited)	OFF (Removal/Insertion Permitted)
ON (removal/insertion prohibited)	Removal/insertion prohibited	Removal/insertion prohibited
OFF (removal/insertion permitted)	Removal/insertion prohibited	Removal/insertion permitted

19 LOADING AND INSTALLATION

This chapter describes the loading and installation procedures and precautions to obtain the maximum system reliability and performance.

19.1 Fail-Safe Circuit Concept

When the programmable controller is powered ON or OFF, improper outputs may be generated temporarily depending on the delay time and start-up time differences between the programmable controller power supply and the external power supply for the control target (especially, DC).

For example, if the external power supply for a DC output module is powered ON and then the programmable controller is powered ON, the DC output module may generate incorrect outputs temporarily upon the programmable controller power-ON. To prevent this, it is required to build a circuit by which the programmable controller is powered on first.

Also, an external power failure or programmable controller failure may lead to erroneous operation.

In order to eliminate the possibility of a system error and to ensure fail-safe operation, create a circuit (emergency stop circuit, protection circuit, interlock circuit, etc.) outside the programmable controller for the parts whose faulty operation could cause mechanical damage and/or accidents.

A system design circuit example based on the above is provided later.



DANGER

- Create a safety circuit outside the programmable controller to ensure the whole system will operate safely even if an external power failure or a programmable controller failure occurs.

Otherwise, incorrect output or malfunction may cause an accident.

- (1) When creating an emergency stop circuit, a protection circuit or an interlock circuit for incompatible actions such as forward/reverse rotation or for damage prevention such as the upper/lower limit setting in positioning, create it outside the programmable controller.

Install the emergency stop switch outside the control panel so that workers can operate it easily.

- (2) When the programmable controller detects the following error conditions, it stops the operation and turns off all the outputs.

- The overcurrent or overvoltage protector of the power supply module is activated.
- The programmable controller CPU detects an error such as a watchdog timer error by the self-diagnostics function.

In the case of an error undetectable by the programmable controller CPU, such as an I/O control part error, all the outputs may turn on. In order to make all machines operate safely in such a case, set up a fail-safe circuit or a specific mechanism outside the programmable controller.

- (3) Depending on the failure of the output module's relay or transistor, the output status may remain ON or OFF incorrectly. For output signals that may lead to a serious accident, create an external monitoring circuit.


**DANGER**

- If load current more than the rating or overcurrent due to a short circuit in the load has flowed in the output module for a long time, it may cause a fire and smoke. Provide an external safety device such as a fuse.
- Design a circuit so that the external power will be supplied after power-up of the programmable controller.
Activating the external power supply prior to the programmable controller may result in an accident due to incorrect output or malfunction.
- For the operation status of each station at a communication error in data link, refer to the respective data link manual.
Otherwise, incorrect output or malfunction may cause an accident.
- When controlling a running programmable controller (data modification) by connecting a peripheral device to the CPU module or a PC to a special function module, create an interlock circuit on sequence programs so that the whole system functions safely all the time.
Also, before performing any other controls (e.g. program modification, operating status change (status control)), read the manual carefully and ensure the safety. In these controls, especially the one from an external device to a programmable controller in a remote location, some programmable controller side problem may not be resolved immediately due to failure of data communications.
To prevent this, create an interlock circuit on sequence programs and establish corrective procedures for communication failure between the external device and the programmable controller CPU.
- When setting up the system, do not allow any empty slot on the base unit.
If any slot is left empty, be sure to use a blank cover (A1SG60) or a dummy module (A1SG62) for it.
When using the extension base unit, A1S52B(S1), A1S55B(S1) or A1S58B(S1), attach the included dustproof cover to the module in slot 0.
This must be done because some internal parts of the module may be fried during a short circuit test or when an overcurrent or overvoltage is accidentally applied to the external I/O section.

**CAUTION**

- Do not install the control lines or communication cables together with the main circuit or power lines, or bring them close to each other.
Keep a distance of 100mm (3.94inch) or more between them.
Failure to do so may cause malfunctions due to noise.
- If register R outside the allowable range has been read out with the MOV instruction, the file register data will be FFFFH. Using this as it is may cause malfunctions. Pay attention not to use any out-of-range file register when designing sequence programs. For instruction details, refer to the programming manual.
- When an output module is used to control the lamp load, heater, solenoid valve, etc., a large current (ten times larger than the normal one) may flow at the time that the output status changes from OFF to ON. Take some preventive measures such as replacing the module with the one of a suitable current rating.

(1) System design circuit example

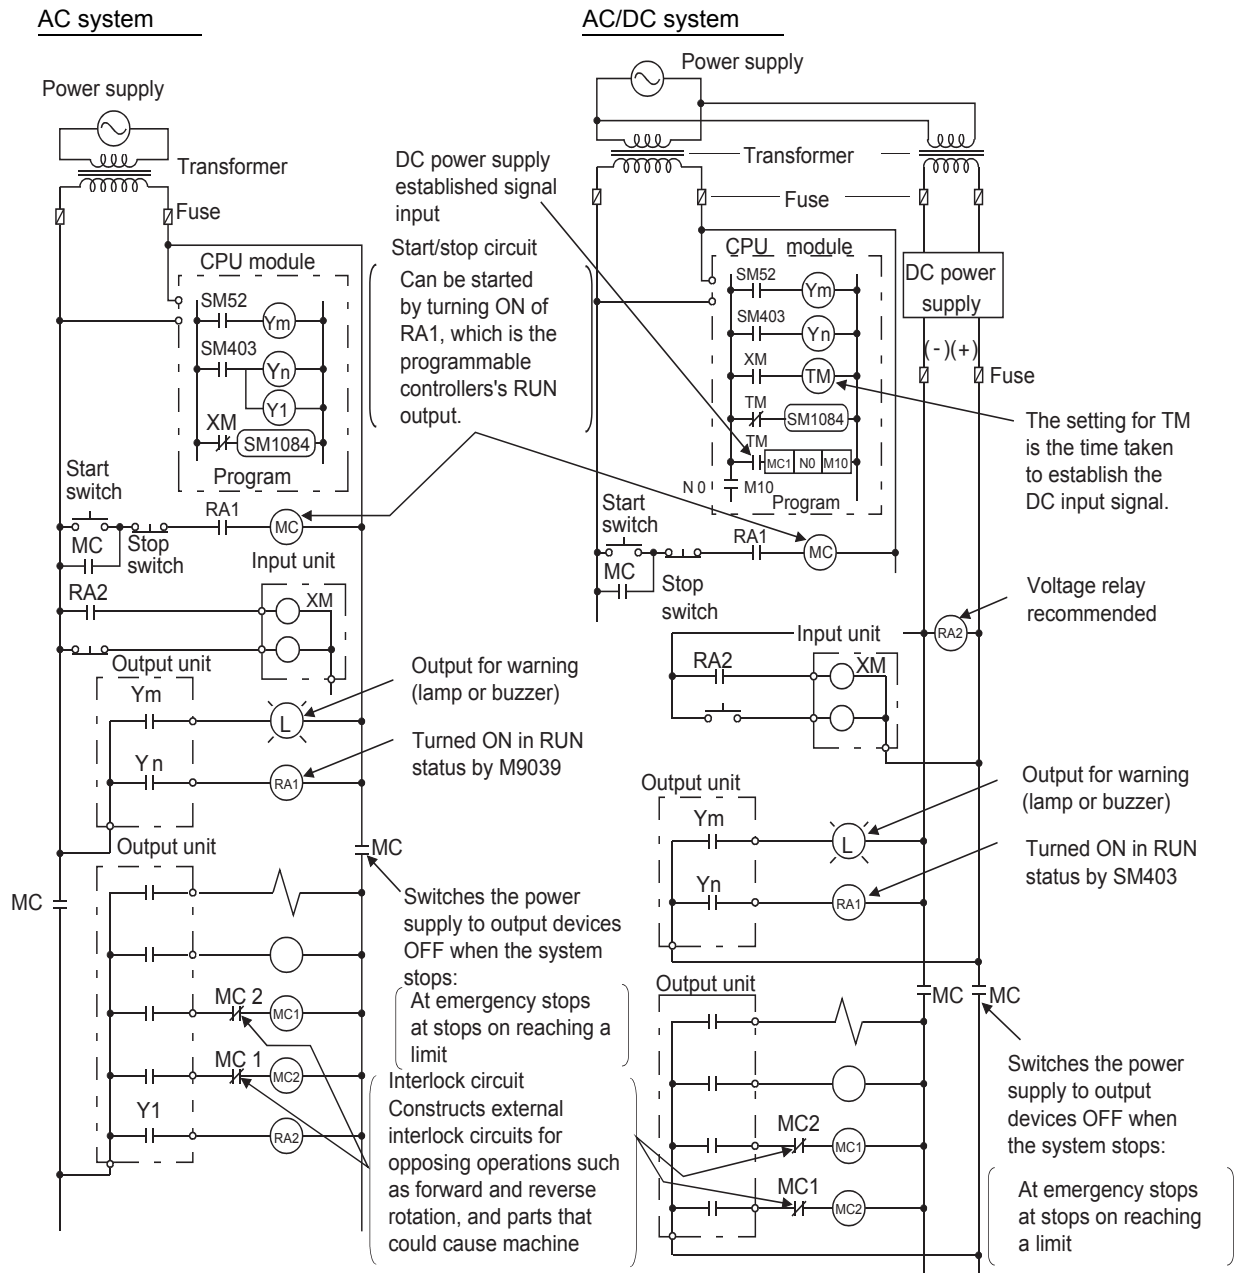

The procedures used to switch on the power supply are indicated below.

AC system

- 1) Switch the power supply ON.
- 2) Set the CPU module to RUN.
- 3) Switch the start switch ON.
- 4) The output devices are driven in accordance with the program when the magnetic contactor (MC) comes ON.

AC/DC system

- 1) Switch the power supply ON.
- 2) Set the CPU module to RUN.
- 3) Switch RA2 ON when the DC power supply starts.
- 4) Set the timer (TM) to "ON" upon 100% establishment of DC power supply.
(The set value for TM shall be the period from turning "ON" RA2 to 100% establishment of DC power supply. Set 0.5 seconds for it.)
- 5) Switch the start switch ON.
- 6) The output devices are driven in accordance with the program when the magnetic contactor (MC) comes ON.
(When a voltage relay is used for RA2, the timer in the program (TM) is not necessary.)

(2) Fail-safe measures for programmable controller failure


While failure of a CPU module and its memory can be detected by the self-diagnostics function, an error occurred in I/O control area may not be detected by the CPU module.

In such a case, depending on the condition of the failure, all device points could turn ON or OFF resulting in a situation where normal operations of the control target and safety cannot be ensured.

Though Mitsubishi programmable controllers are manufactured under strict quality control, create a fail-safe circuit outside the programmable controller to prevent mechanical damage and accidents in the case of a programmable controller failure occurred due to any cause.


Examples of a system and its fail-safe circuitry are described below:

< System example >

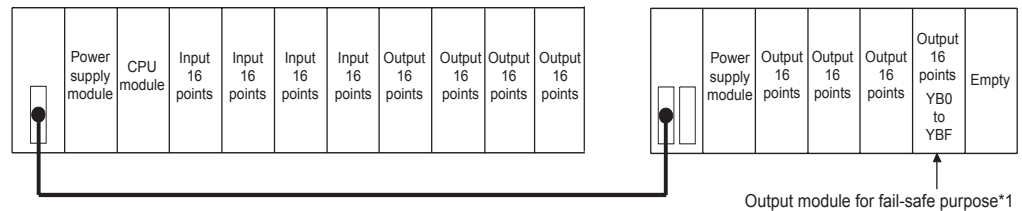

*1 The output module for fail safe purpose should be mounted on the last slot of the system.(YB0 to YBF in the above system.)


< Fail safe circuit example >

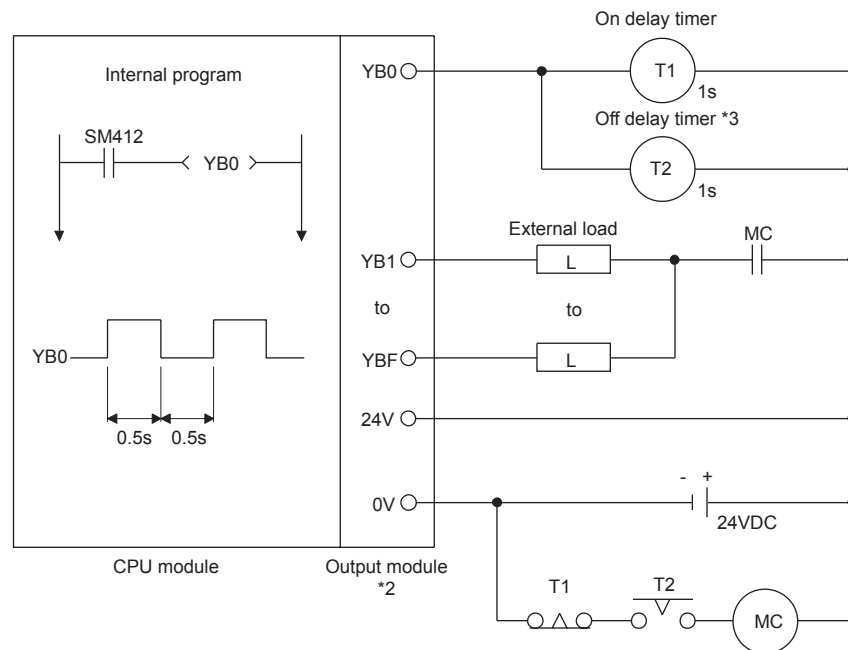

*2 Since YB0 turns ON and OFF alternatively at 0.5 second intervals, use a contactless output module (a transistor is used in the above example).

*3 If an off delay timer (especially miniature timer) is not available, construct a fail safe circuit using an on delay timer shown on the next page.

When constructing a fail safe circuit using on delay timers only

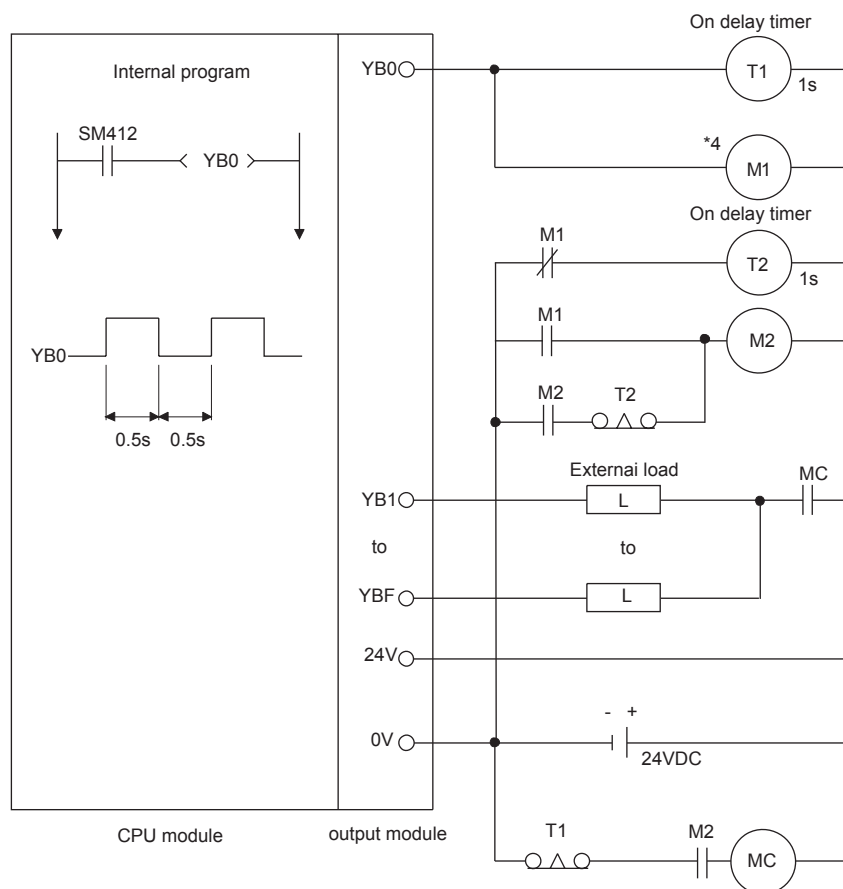

*4 Use a solid state relay for the M1 relay.

19.2 Installation Environment

Avoid the following environment when installing a programmable controller system:

- (1) The ambient temperature may fall outside the range of 0 to 55°C .
- (2) The ambient humidity may fall outside the range of 10 to 90%RH.
- (3) Condensation may occur due to drastic changes in temperature.
- (4) Corrosive gas or flammable gas exists.
- (5) A lot of conductive powdery substance such as dust or iron powder, oil mist, salt, or organic solvent exists.
- (6) A location exposed to direct sunlight.
- (7) Strong electric or magnetic fields may be generated.
- (8) Vibrations and shocks are transmitted directly to the system.


19.3 Calculation of Heat Generated by the programmable controller

The operating ambient temperature in the panel where the programmable controller is stored must be kept 55°C or less. For heat dissipation design of the panel, it is necessary to know the average power consumption (heat generation) of the devices and machinery stored inside. In this section, a method to obtain the average power consumption of the programmable controller system is explained.

Calculate the temperature rise inside the panel from the power consumption.

Average Power Consumption

The power consuming parts of the programmable controller may be roughly classified into the following blocks:

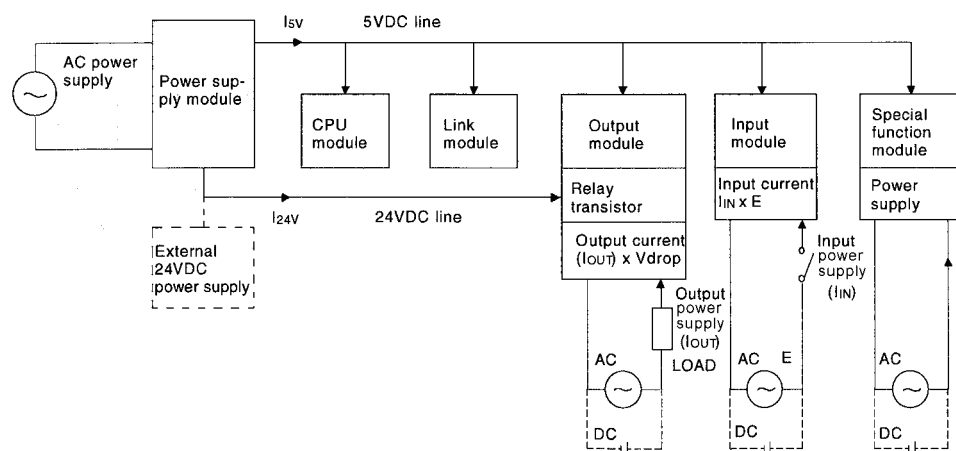

(1) Power consumption by power supply module

The power conversion efficiency of the power supply module is about 70%, and 30% is consumed as heat generated, thus, 3/7 of the output power is the power consumption. Therefore, the calculation formula is:

$$W_{pw} = \frac{3}{7} \{ (I_{5V} \times 5) + (I_{15V} \times 15) + (I_{24V} \times 24) \} \text{ (W)}$$

I_{5V} : Current consumption of 5VDC logic ladder circuit of each module

I_{15V} : Current consumption of 15VDC external power supply part of special function module

I_{24V} : Average current consumption of 24VDC power supply for output module's internal consumption

(Current consumption equivalent to the points simultaneously ON)

..... Not applicable to a system where 24VDC is supplied externally and a power supply module with no 24VDC output is used.

(2) Total power consumption of 5VDC logic circuits of modules

The 5VDC output circuit power of the power supply module is regarded as the power consumption of each module.

$$W_{5V} = I_{5V} \times 5 \text{ (W)}$$

- (3) Total 24VDC average power consumption of the output module (power consumption equivalent to the points simultaneously ON)

The average 24VDC output circuit power of the power supply module is regarded as the total power consumption of each module.

$$W_{24V} = I_{24V} \times 24 \text{ (W)}$$

- (4) Average power consumption due to output voltage drop of the output modules (power consumption equivalent to the points simultaneously ON)

$$W_{OUT} = I_{OUT} \times V_{drop} \times \text{Output points} \times \text{that are simultaneously ON (W)}$$

I_{OUT} : Output current (actual operating current) (A)

V_{drop} : Voltage dropped across each output load (V)

- (5) Average input power consumption of the input modules (power consumption equivalent to the points simultaneously ON)

$$W_{IN} = I_{IN} \times E \times \text{Input points} \times \text{that are simultaneously ON (W)}$$

I_{IN} : Input current (effective value for AC) (A)

E : Input voltage (actual operating voltage) (V)

- (6) Power consumption of the external power supply part of the special function module

$$W_S = I_{+15V} \times 15 + I_{-15V} \times 15 + I_{24V} \times 24 \text{ (W)}$$

The total of the power consumption values obtained for each block is power consumption of the entire programmable controller system.

$$W = W_{pw} + W_{5V} + W_{24V} + W_{OUT} + W_{IN} + W_S \text{ (W)}$$

Using this value (W), calculate the amount of heat generation and temperature rise inside the panel.

The calculation formula to obtain the temperature rise inside a panel is shown as:

$$T = \frac{W}{UA} [^{\circ}\text{C}]$$

W : Power consumption of the entire programmable controller system (the value obtained above)

A : Surface area inside the panel (m^2)

U : When temperature inside panel is kept constant by a fan, etc. 6

When air inside panel is not circulated 4

POINT	
	<p>If the temperature inside the panel can exceed the specified range, it is recommended to install a heat exchanger to the panel to lower the inside temperature.</p> <p>If a ordinary ventilation fan is used, it sucks dust together with the outside air and it may affect the performance of the programmable controller.</p>

19.4 Installing the Base Units

Precautions on installation of the main base unit and extension base unit are described here.

19.4.1 Installation precautions

Precautions for installing a programmable controller to a panel, etc. are explained below.

- (1) To improve the ventilation and to facilitate the exchange of the module, provide at least 30mm (1.18in.) of distance between the top part of the module and any structure or part.
However, when A52B, A55B, A58B, A62B, A65B or A68B extension base unit is used, provide at least 80mm (3.15in.) of distance between the top of the unit and any structural part.
- (2) Do not install the programmable controller vertically or horizontally, because it may affect the ventilation.
- (3) If the base unit is installed to the surface which is not flat or is distorted, an excessive force is applied to the printed-circuit board and it may cause a fault. Be sure to install it to a flat surface.
- (4) Avoid sharing the same panel with any source of vibration such as a large-sized magnetic contactor or no-fuse breaker, and install to a separate panel or away from such devices.
- (5) Provide wiring ducts as necessary.
However, when the clearance from the top or bottom of the programmable controller is less than that in Fig. 19.1 and Fig. 19.2, pay attention to the following:
 - (a) When installing to the top of programmable controller, to improve the ventilation, keep the height of the duct to 50mm (1.97in.) or below.
In addition, the distance from the top of the programmable controller should be sufficient for tightening and loosening works for the mounting screws on the top of the module.
The module cannot be replaced if the screws on the top of the module cannot be loosened or tightened.
 - (b) When placing a duct under the programmable controller, take into account the use of optical fiber cables or coaxial cables as well as the minimum bending radius of the cables.
- (6) If any device is installed in front of the programmable controller (i.e. installed in the back of the door), position it to secure at least 100mm (3.94inch) of distance to avoid the effects of radiated noise and heat.
Also, place the base unit at least 50mm (1.97inch) away from any other equipment on the right or left.
- (7) When installing the base unit to DIN rail in an environment with large vibration, use a vibration-proofing bracket (A1S-PLT-D). Mounting the vibration-proofing bracket (A1S-PLT-D) enhances the resistance to vibration.
Depending on the environment to set up the base unit, it is also recommended to fix the base unit to the control panel directly.

19.4.2 Installation

Installation location of the main base unit and the extension base unit is shown below.

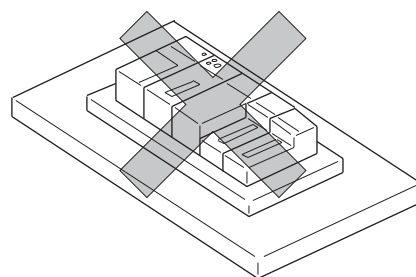
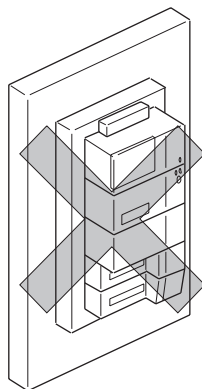
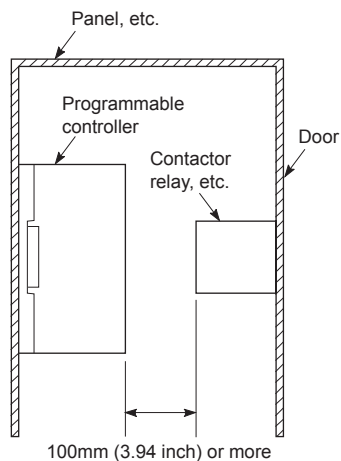
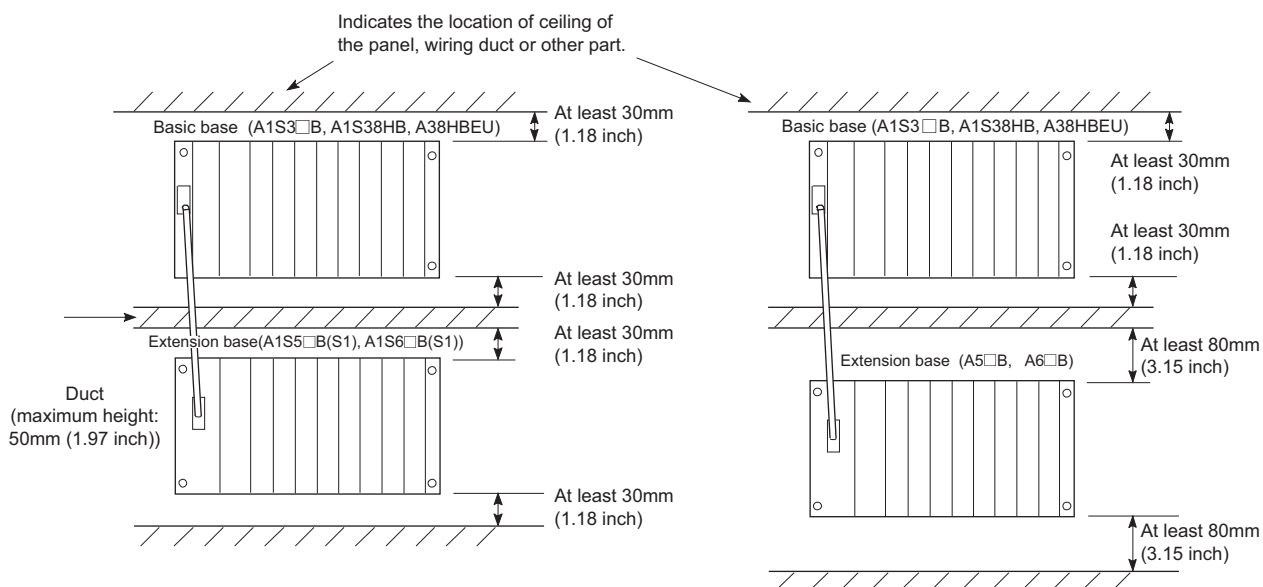
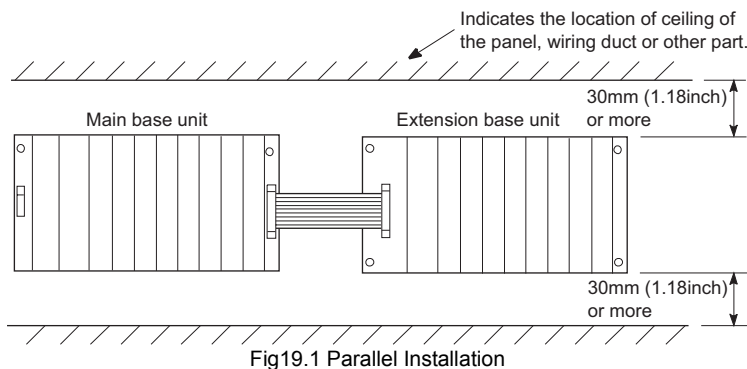


Fig. 19.3 Distance from Front Device

Fig. 19.4 Vertical Mounting (not allowed)


Fig. 19.5 Horizontal Mounting (not allowed)

19.5 Installation and Removal of Modules

This section explains how to install or remove the power supply module, CPU module, I/O module and special function module, etc. to or from the base unit.



**CAUTION**

- Install the module after inserting the pegs on the bottom of the module securely into the base unit peg holes.
Not doing so could cause a malfunction, failure or fall.
If too tight, it may cause damage to the screws and/or module, resulting in an accidental drop of the module, short circuit or malfunctions.
- Be sure to shut off all phases of the external power supply used by the system before mounting or removing the module.
Failure to do so may damage the module.
- Do not directly touch the conductive part or electronic components of the module.
Doing so may cause malfunctions or a failure of the module.

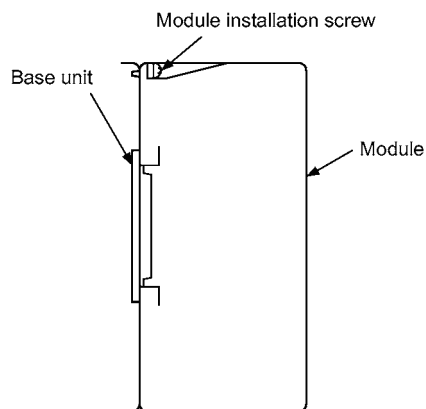


(1) Module installation

The procedure for mounting a module is described below.

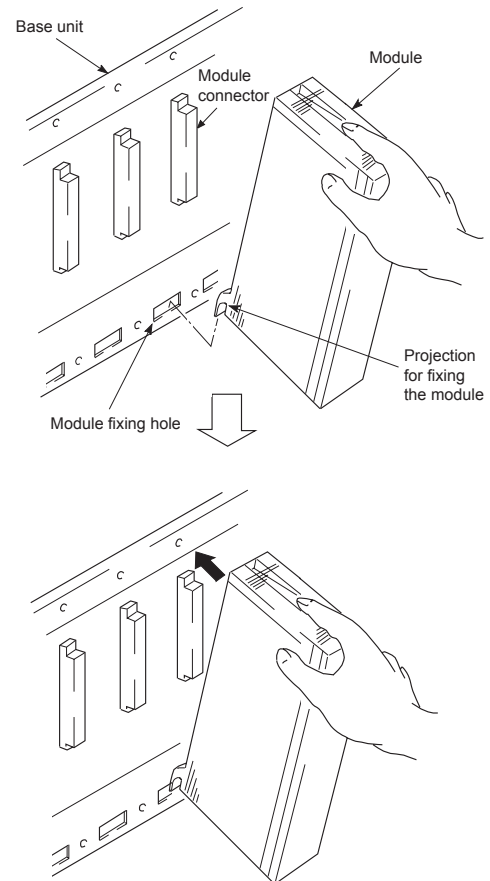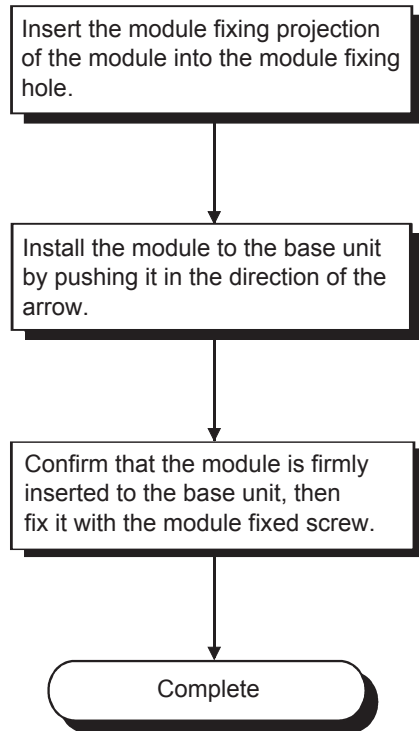

(2) Removing a module

The procedure for removing a module is explained here.

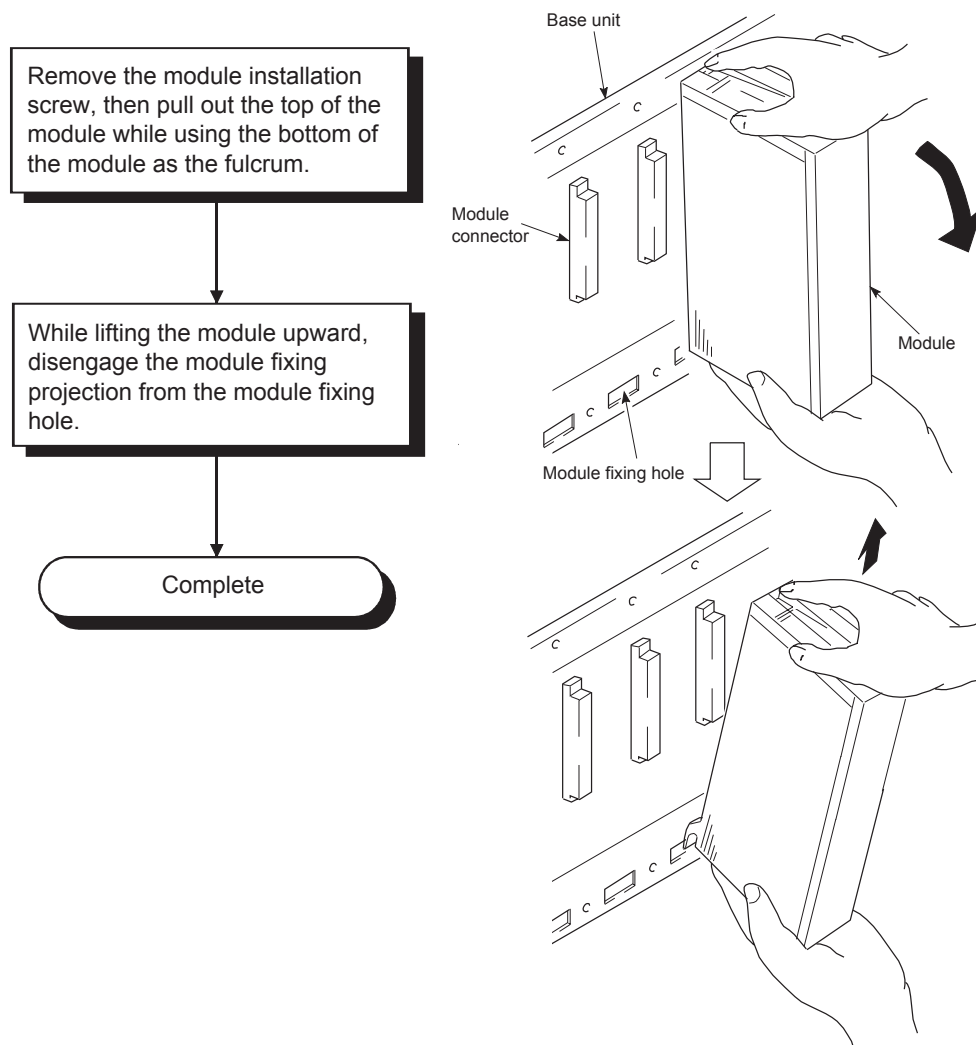

POINT


To dismount the module, be sure to disengage the hook from the module fixing hole and then remove the module fixing projection from the module fixing hole. If the module is forcibly removed, the hook or module fixing projection will be damaged.

19.6 Installation and Removal of the Dustproof Cover

When using the A1S52B(S1), A1S55B(S1) or A1S58B(S1), attach the dustproof cover supplied with the extension base unit to the I/O module on the left end. If no dustproof cover is attached, foreign matter will enter the I/O module, causing a failure.


Procedures for installing and removing the dustproof cover are described below.

(1) Installation

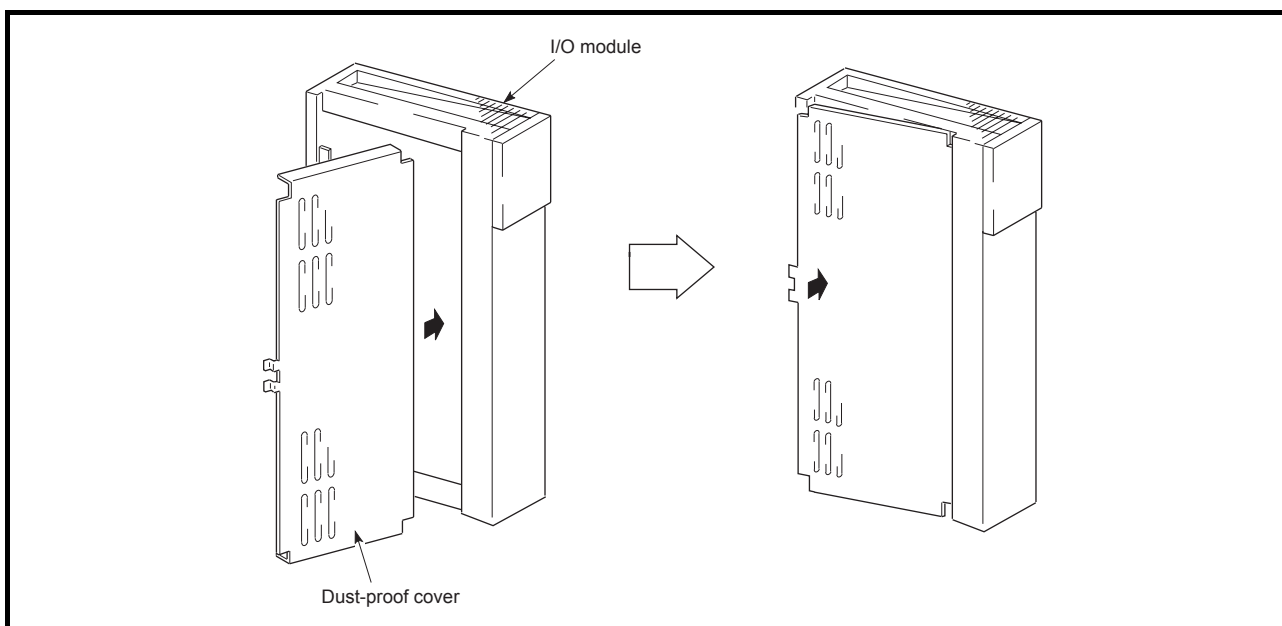

Insert the dustproof cover into the connector- or terminal-side groove of the I/O module first as shown in the figure, and then push the dustproof cover.

(2) Removal

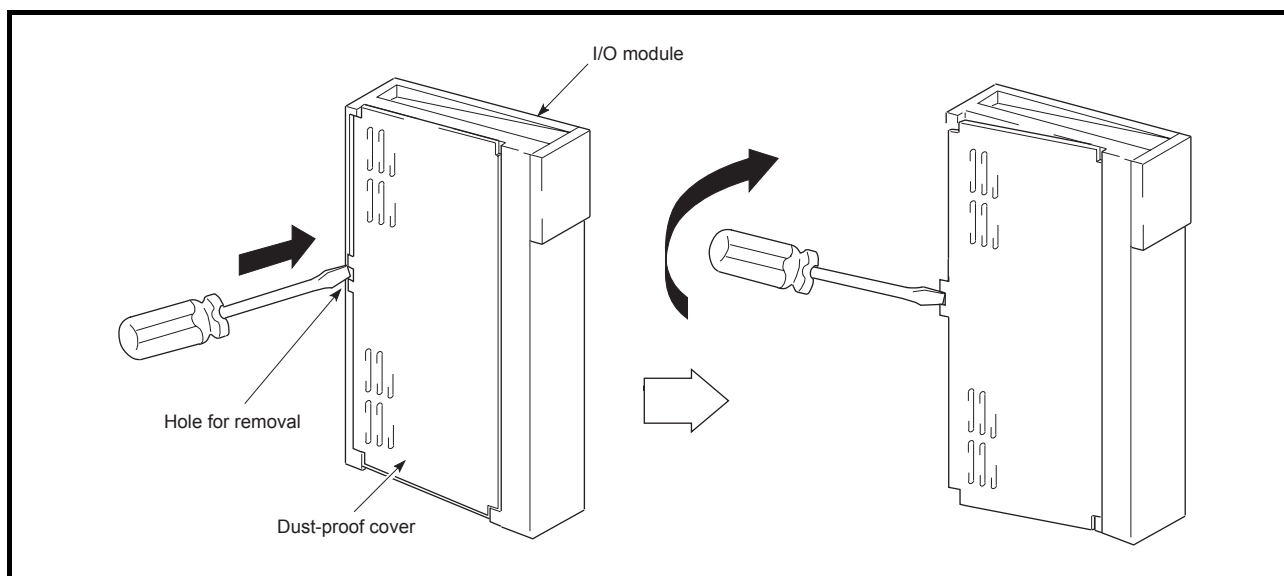

To remove the dustproof cover from the I/O module, insert the tip of a flat-head screwdriver into the hole as shown in the figure, then pry the tab of the cover out from the hole using the screwdriver.

19.7 Wiring

19.7.1 Wiring instructions

Instructions for wiring of power cables or I/O cables are given in this section.


**DANGER**

- Be sure to shut off all the phases of the external power supply used by the system before wiring.
Failure to do so may result in an electric shock or damage of the product.
- Before energizing and operating the system after wiring, be sure to attach the terminal cover supplied with the product.
Failure to do so may cause an electric shock.

**CAUTION**

- Ground the FG and LG terminals correctly.
Failure to do so may cause an electric shock or malfunctions.
- Wire the module correctly after confirming the rated voltage and terminal layout.
Connecting a power supply of a different voltage rating or incorrect wiring may cause a fire or failure.
- Do not connect multiple power supply modules to one module in parallel.
The power supply modules may be heated, resulting in a fire or failure.
- Press, crimp or properly solder the connector for external connection with the specified tool.
Incomplete connection may cause a short circuit, fire or malfunctions.
- Tighten terminal screws within the specified torque range.
If the screw is too loose, it may cause a short circuit, fire or malfunctions
If too tight, it may damage the screw and/or the module, resulting in a drop of the module , a short circuit or malfunctions.
- Carefully prevent foreign matter such as dust or wire chips from entering the module.
Failure to do so may cause a fire, failure or malfunctions.
- Install our programmable controller in a control panel for use.
Wire the main power supply to the power supply module installed in a control panel through a distribution terminal block.
Furthermore, the wiring and replacement of a power supply module have to be performed by a maintenance worker who acquainted with shock protection.
(For the wiring methods, refer to Section 19.7.)

- (1) Wiring the power supply
 - (a) When voltage fluctuates outside the specified value range, connect a constant-voltage transformer.



- (b) Use a power supply which generates minimal noise between wires and between the programmable controller and ground.
If excessive noise is generated, connect an isolating transformer.




- (c) When using a power transformer or an isolating transformer to reduce the voltage from 200VAC to 100VAC, its capacity must be equal to or greater than the corresponding value shown in the following table.

Power Supply Module	Transformer Capacity
A1S61PN	110VA × n
A1S62PN	110VA × n

n: Stands for the number of power supply modules.

- (d) Separate the programmable controller's power supply line from the lines for I/O devices and power devices as shown below.
When there is much noise, connect an isolating transformer.
- (e) Taking rated current or inrush current into consideration when wiring the power supply, be sure to connect a breaker or an external fuse that have proper blown and detection.
When using a single programmable controller, a 10A breaker or an external fuse are recommended for wiring protection.

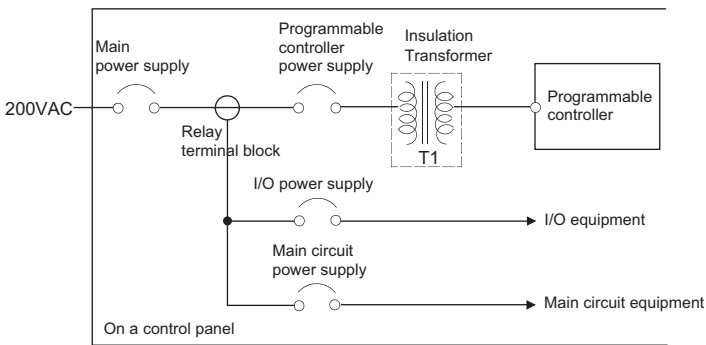


- (f) Note on using 24VDC output of the A1S62PN power supply module.


**CAUTION**

- Do not connect multiple power supply modules to one module in parallel. The power supply modules may be heated, resulting in a fire or failure.

If the 24VDC output power from a single power supply module is insufficient, supply it from the external 24VDC power supply.

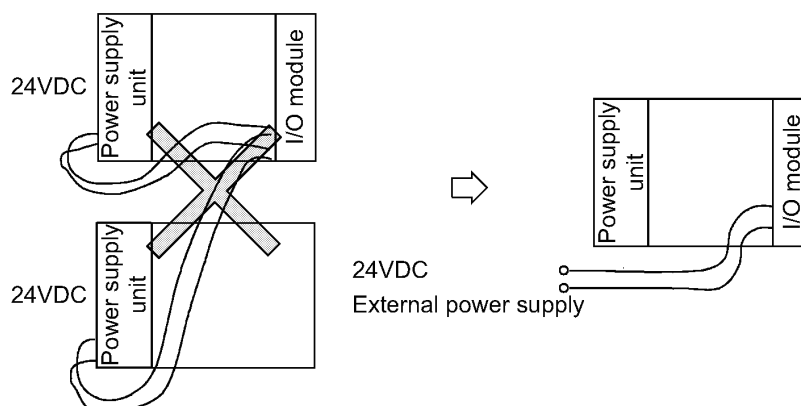

- (g) Twist the 100VAC, 200VAC or 24VDC wires as tightly as possible, and use the minimum length to make connection between modules. Also, use a thick wire (max. 2 mm²) to minimize voltage drop.
- (h) Do not install 100VAC and 24VDC wires together with main circuit wires (high voltage and large current) or I/O signal lines (including common line). Provide a distance of 100mm (3.94inch) or more between them if possible.
- (i) As a measure against lightning surges, connect a lightning surge absorber as shown below.

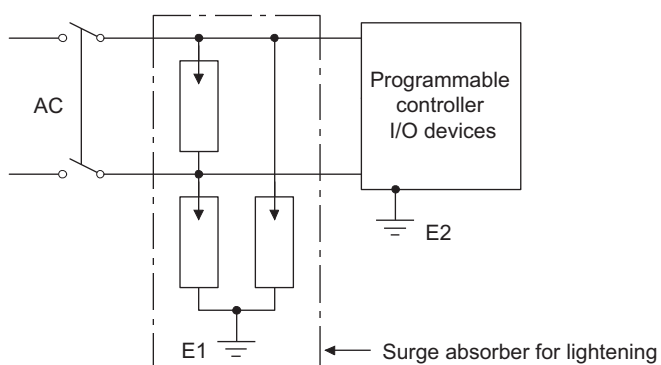


POINT
(1) Ground the lightning surge absorber (E1) and the programmable controller (E2) separately from each other.
(2) Select a lightning surge absorber whose voltage does not exceed the maximum allowable circuit voltage even when line voltage reaches the maximum.

(2) Wiring I/O equipment

**CAUTION**

- Do not install the control lines or communication cables together with the main circuit or power lines, or bring them close to each other. Keep a distance of 100mm (3.94inch) or more between them. Failure to do so may cause malfunctions due to noise.

- (a) The applicable wire size for a terminal block connector is 0.75 to 2mm². It is recommended to use wire of 0.75mm² for easy use.
- (b) Run the input line and output line away from each other.
- (c) Separate the I/O signal lines (including common line) at least 100mm (3.94inch) away from the main circuit line carrying high voltage and large current.
- (d) If it is not possible, use a batch shielding cable and ground it on the programmable controller side. However, ground it on the opposite side in some cases.

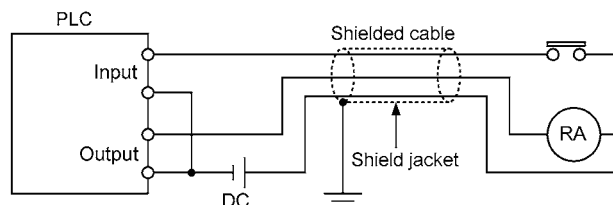

- (e) When ducts are used for wiring, securely ground them.
- (f) Separate the 24VDC I/O cables from the 100VAC and 200VAC cables.
- (g) In a long distance wiring of 200m (656.2ft.) or longer, leak current due to capacitance may cause failure.
- (h) As protective measures against lightning surges, separate the AC wiring from the DC wiring and connect a lightning surge absorber as shown in (1) (i). Failure to do so increases the risk of I/O equipment failure due to lightning.


(3) Grounding

**CAUTION**



- Ground the FG and LG terminals correctly.
Failure to do so may cause an electric shock or malfunctions.

(a) Carry out the independent grounding if possible.


(b)



(1) Independent grounding Best

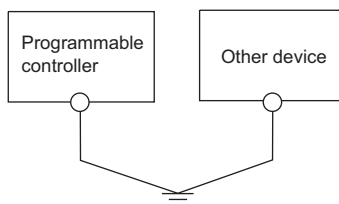

(2) Shared grounding Good

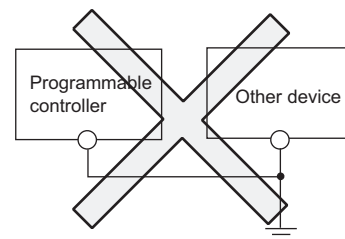

(3) Common grounding Not allowed


(c) Use the cable of 2mm^2 (0.0031in.^2) or more for grounding.

Set the grounding point closer to the programmable controller to make the grounding cable short as possible.

(d) If any malfunction occurs due to grounding, disconnect either or both of the LG and FG terminals of the base unit from the ground.


19.7.2 Wiring to module terminals

This section provides an example for wiring power cables and ground wires to the main and extension bases.

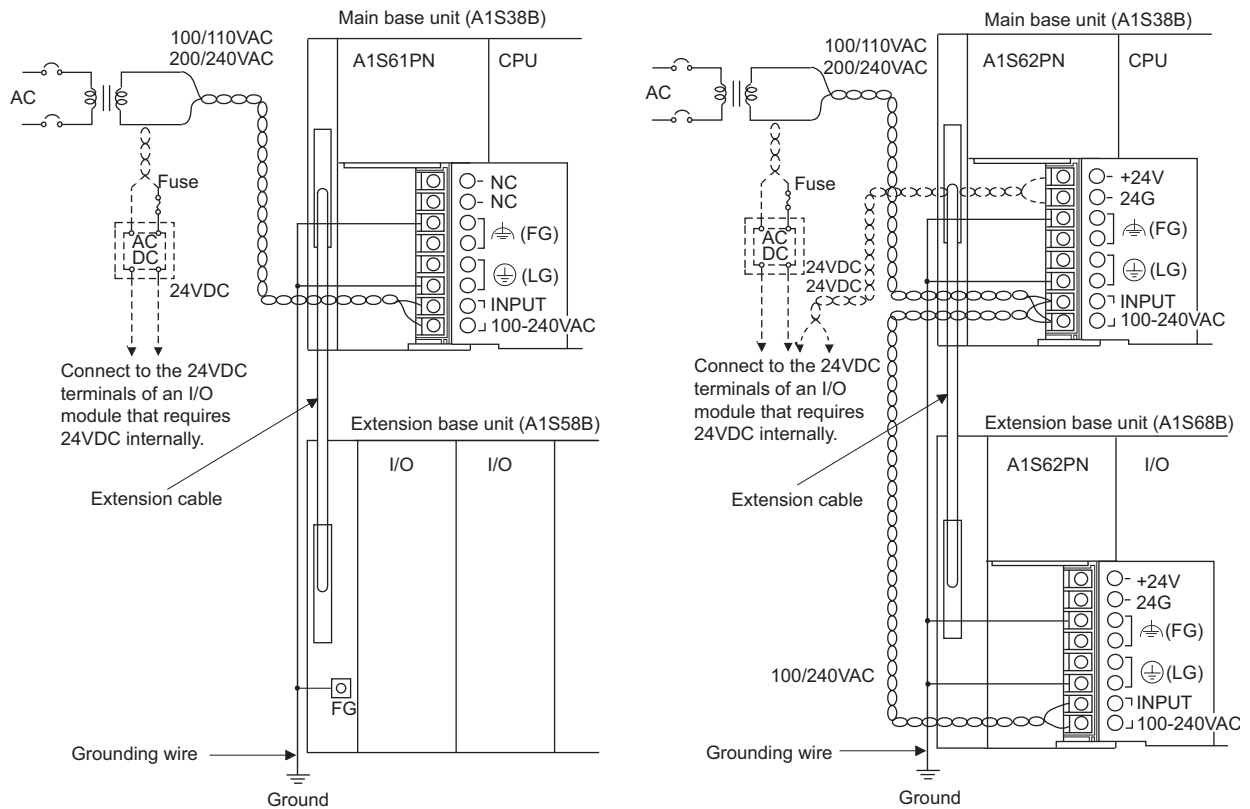

POINT

- (1) Use the thickest possible (max. 2 mm² (14 AWG)) wires for the 100/200 VAC and 24 VDC power cables. Be sure to twist these wires starting at the connection terminals. For wiring a terminal block, be sure to use a solderless terminal. To prevent short-circuit due to loosening screws, use the solderless terminals with insulation sleeves of 0.8 mm (0.03 inch) or less thick. The number of the solderless terminals to be connected for one terminal block are limited to 2

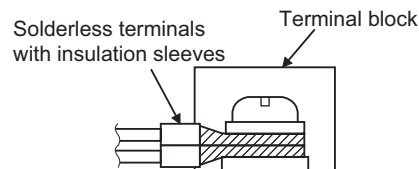

- (2) When connection is made between the LG and FG terminals, be sure to ground the wire. Failure to observe this instruction after connecting the LG and FG terminals will make the line susceptible to noise. Note that each LG terminal has half the potential of the input voltage; you might get an electric shock if you touch it.
- (3) A1S61PN and A1S62PN do not need to be switched as they are 100 to 240VAC wide-range.

19.8 Precautions When Connecting Uninterruptible Power Supply Module (UPS)

When connecting a programmable controller system to an uninterruptible power supply (UPS), pay attention to the following.

Use an on-line or line interactive UPS (with voltage distortion of 5% or less.)

When using an off-line system UPS, use the F series UPS manufactured by Mitsubishi Electric (serial No. P or later). Example: FW-F10-03.K/0.5K

Do not use any off-line system UPS other than the F series.

20 EMC AND LOW VOLTAGE DIRECTIVES

The products sold in the European countries have been required by law to comply with the EMC and Low Voltage Directives of the EU Directives since 1996 and 1997, respectively. The manufacturers must confirm by self-declaration that their products meet the requirements of these directives, and put the CE mark on the products.

20.1 Requirements for Compliance with EMC Directives

The EMC Directives specifies emission and immunity criteria and requires the products to meet both of them, i.e., not to emit excessive electromagnetic interference (emission): to be immune to electromagnetic interference outside (immunity). Guidelines for complying the machinery including MELSEC-QnA series programmable controller with the EMC Directives are provided in Section 20.1.1 to Section 20.1.7 below.

The guidelines are created based on the requirements of the regulations and relevant standards, however, they do not guarantee that the machinery constructed according to them will comply with the Directives. Therefore, manufacturers must finally determine how to make it comply and how it is compliant with the EMC Directives.

20.1.1 EMC standards

Standards related to the EMC directives are described below.

Specifications	Test Item	Test Description	Standard Values
EN61000-6-4 (2001)	EN55011 ^{*2} Radiated noise	Measure the emission released by the product.	30M-230MHz QP: 30dB μ /m (30m measurement) ^{*1} 230M-1000MHz QP: 30dB μ /m (30m measurement) ^{*1}
	EN55011 ^{*2} Conduction noise	Measure the emission released by the product to the power line.	150k-500kHz QP: 79 dB, Mean: 66 dB ^{*1} 500k-30MHz QP: 73 dB, Mean : 60 dB ^{*1}
EN61131-2/A12 (2000)	EN61000-4-2 ^{*2} Static electricity immunity	Immunity test by applying static electricity to the module enclosure.	4kV contact discharge 8kV air discharge
	EN61000-4-4 ^{*2} First transient burst noise	Immunity test by applying burst noise to the power line and signal line.	2kV power line 1kV signal line
	EN61000-4-12 ^{*2} Damped oscillatory wave	Immunity test in which damped oscillatory waves are applied to power line.	1kV
	EN61000-4-3 ^{*2} Radiated electromagnetic field	Immunity test in which electric fields are applied to the product.	10V/m, 26-1000MHz
EN61000-6-2 (2001)	EN61000-4-6 ^{*2} Conduction noise	Immunity test in which electromagnetic fields are induced to power cables and signal line.	10V, 0.15-80MHz

^{*1} QP: Quasi-peak value, Mean: Average value

^{*2} The programmable controller is an open type device (device installed to another device) and must be installed in a conductive control panel. The tests for the corresponding items were performed while the programmable controller was installed inside the control panel.

20.1.2 Installation inside the control panel

The programmable controller is open equipment and must be installed within a control panel for use.* This is effective not only for ensuring safety but also for shielding electromagnetic noise generated from the programmable controller.

* Each network remote station also needs to be installed inside the control panel. However, waterproof type remote stations can be installed outside the control panel.

(1) Control panel

- (a) Use a conductive control panel.
- (b) When fixing the top or base plate with bolts, mask the fixing area when painting so that an electrical contact can be made.
- (c) To ensure an electrical contact with the control panel, mask the bolt areas of the inner plates when painting to allow conductivity over the widest possible area.
- (d) Ground the control panel with a thick wire so that a low impedance can be ensured even at high frequencies.
- (e) Holes made in the control panel must be 10 cm (3.94 inch) diameter or less. If the diameter is more than 10cm (3.94 inch), radio waves can be leaked.
- (f) Lock the control panel so that only those who are trained and have acquired enough knowledge of electric facilities can open the control panel.

(2) Connection of power cable and ground wires

Handle the power cables and ground wires as described below.

- (a) Provide a grounding point near the power supply module. Ground the power supply module's LG and FG terminals (LG : Line Ground, FG : Frame Ground) with the thickest and shortest wire possible. (The wire length must be 30 cm (11.18 inch) or shorter.) As the LG and FG terminals release the noise generated in the programmable controller to the ground, the lowest possible impedance must be ensured.
The ground wires also need to be short as they are used to release noise. Because the wire itself carries large noise, short wiring prevents it from acting as an antenna.
- (b) Twist the ground wire led from the grounding point with the power cable. By doing this, noise from the power cable can be released to the ground. If a filter is attached to the power cable, however, this twisting may not be needed.

20.1.3 Cables


The cables running from the control panel contain a high frequency noise component, and outside the control panel, they release noise acting as antennas. The cables connected to input/output modules or special modules which leave the control panel must always be shielded cables.

Attaching ferrite cores is not required except some CPU types, however, using ferrite cores can restrain noise emanated via cables.


Using shielded cables also increase noise resistance. The signal lines (including common line) of the programmable controller, which are connected to I/O modules and/or special modules, have noise resistance compliant with EN61131-2/A12(2000) in the condition that shielded cables are to be used. If shielded cables are not used, or if grounding of shielded cables is not correct, the noise resistance will be less than the specified value.

(1) Grounding of shielded cables

- (a) Shielding must be done close to the control panel. Otherwise, electromagnetic induction from the cable after the grounding point will generate high frequency noise.
- (b) Partly remove the outer sheath of the shielded cable so that it can be contact with the widest possible area of the control panel. A clamp may also be used as shown in the figure below. In this case, cover the control panel's inner surface which will come in contact with the clamp when painting.

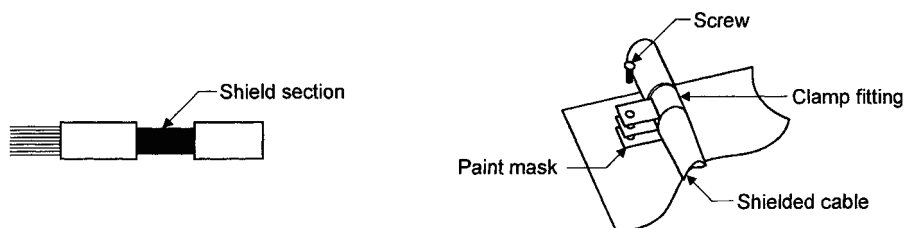


Note) Grounding a shield cable by soldering a wire to the shield section as illustrated below is not recommended. The high frequency impedance will increase and the shield will be ineffective.

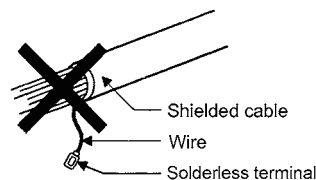

(2) MELSECNET (II) and MELSECNET/10 modules

- (a) Use double-shielded coaxial cables (MITSUBISHI CABLE INDUSTRIES, LTD.: 5C-2V-CCY) for the MELSECNET modules (such as A1SJ71AR21, A1SJ71QLR21, A1SJ71QBR11) which uses coaxial cables. Noise in the range of 30 MHz or higher in radiated noise can be suppressed by the use of double-shielded coaxial cables. Ground the double-shielded coaxial cable by connecting its outer shield to the ground.




Refer to (1) for the grounding of the shield.

- (b) Always attach a ferrite core to the double-shielded coaxial cable connected to the MELSECNET module. In addition, position the ferrite core on each cable near the outlet of the control panel. The ZCAT3035 ferrite core (TDK) is recommended.

(3) Ethernet module


Precautions to be followed when AUI cables*1, twisted pair cables and coaxial cables are used are described below.

- (a) Be sure to ground the AUI cables*1 connected to the 10BASE5 connectors. Because the AUI cable is of the shielded type, as shown in the figure below, partly remove the outer sheath, and ground the exposed shield section to the widest possible surface.

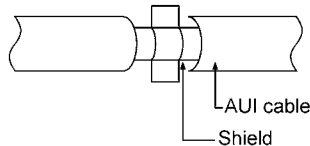

Refer to (1) for the grounding of the shield.

- (b) Use shielded twisted pair cables as the twisted pair cables*1 connected to the 10BASE-T connectors. Partly strip the outer sheath of the shielded twisted pair cable, and ground the exposed shield section to the widest possible area as shown below.

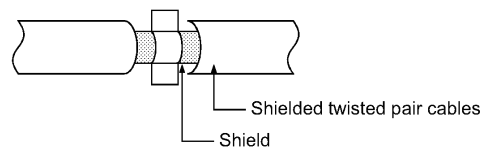


Refer to (1) for the grounding of the shield.

*1 Make sure to attach a ferrite core to the cable.

As a ferrite core, the ZCAT2035 manufactured by TDK is recommended.

- (c) Always use double-shielded coaxial cables as the coaxial cables^{*2} connected to the 10BASE2 connectors. Ground the double-shielded coaxial cable by connecting its outer shield to the ground.



Refer to (1) for the grounding of the shield.

- ^{*2} Make sure to attach a ferrite core to the cable.
As a ferrite core, ZCAT2035 manufactured by TDK is recommended.

Ethernet is the registered trademark of XEROX, Co.,LTD

- (4) I/O signal cables and other communication cables


Always ground the I/O signal lines (including common line) and other communication cables (RS-232-C, RS-422, etc.) in the same manner as described in (1) if they are brought out of the control panel.

- (5) Positioning modules


Precautions for configuring machinery compliant with the EMC Directives using the AD75P□-S3 are described below.

- (a) When using a cable of 2m (6.56ft.) or less

- Ground the shield section of the external wiring cable with a cable clamp.
(Ground the shield at the closest location to the A1SD75□-S3 external wiring connector.)
- Connect the external wiring cable to a drive unit or an external device in the shortest distance.
- Install the drive unit in the same panel.

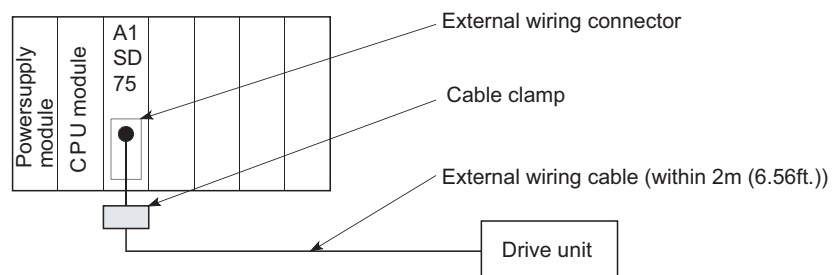


- (b) When connecting a cable longer than 2m (6.56ft.), but not exceeding 10m (32.81ft.)
- Ground the shield section of the external wiring cable with a cable clamp.
(Ground the shield at the closest location to the A1SD75□-S3 external wiring connector.)
 - Install a ferrite core.
 - Connect the external wiring cable to a drive unit or an external device in the shortest distance.

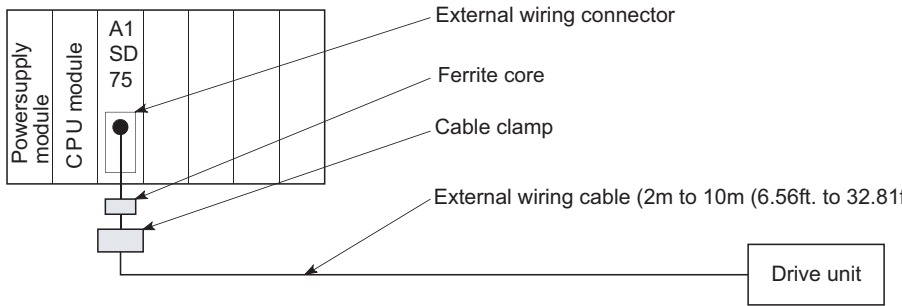

- (c) Models and required quantities of the ferrite core and cable clamp
- Cable clamp
Model: AD75CK (Manufactured by Mitsubishi Electric)
 - Ferrite core
Model: ZCAT3035-1330 (TDK ferrite core)
Contact: TDK Corporation
 - Required quantity

Cable length	Optional part	Required quantity		
		1 axis	2 axes	3 axes
Within 2m (6.56ft.)	AD75CK	1	1	1
2m (6.56ft.) to 10m (32.81ft.)	AD75CK	1	1	1
	ZCAT3035-1330	1	2	3


- (d) Cable clamp position

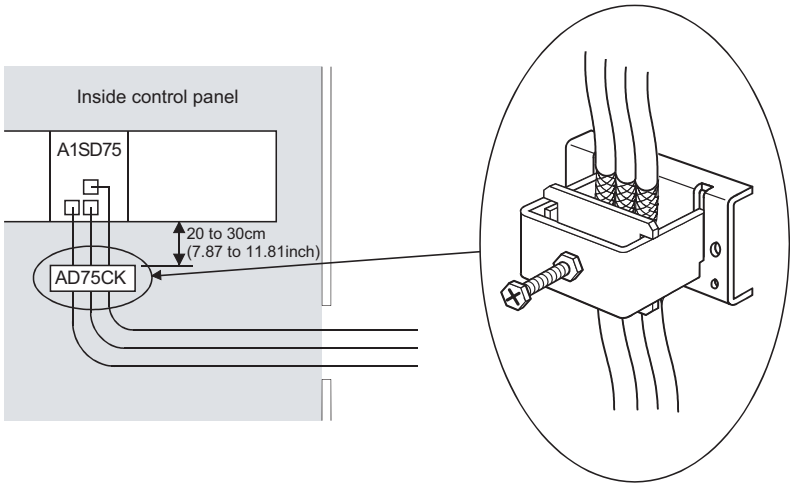

(6) CC-Link module


- (a) Be sure to ground the shield of the cable that is connected to a CC-Link module close to the exit of the control panel or to any of CC-Link stations within 30cm (11.81inch) from the module or stations.

The CC-Link dedicated cables are shielded cables. As shown in the illustration below, remove a part of the outer sheath and ground it to the widest possible area.



- (b) Always use the specified CC-Link dedicated cable.
 (c) Connect the CC-Link module and each CC-Link station to the FG line inside the control panel with the FG terminals as shown below.

[Simplified diagram]

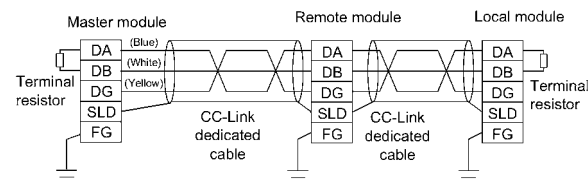

- (d) Power line connecting to the external power supply terminal (compliant with I/O power port of CE standard) should be 30m (98.43 ft.) or less.
 Power line connecting to module power supply terminal (compliant with main power port of CE standard) should be 10m (32.81 ft.) or less.
- (e) A power line connecting to the analog input of the following modules should be 30cm or less.
- AJ65BT-64RD3
 - AJ65BT-64RD4
 - AJ65BT-68TD

(7) Measures against static electricity

When using an insulation displacement connector without connector cover, a connected cable for the connector is thin in applicable wire size and coating. Therefore, note that the module may cause an electric discharge failure.

As measures against the failure, using pressure-displacement type connector whose applicable wire size is thick or soldering type connector is recommended.

20.1.4 Power supply module

The precautions required for each power supply module are described below. Always observe the items noted as precautions.

Model Name	Precautions
A1S61PN, A1S62PN	Make sure to short and ground the LG and FG terminals.*2
A1S63P*1	Use a CE-compliant 24VDC power supply in the control panel.

*1 If sufficient filter circuitry is built into the 24VDC external power supply module, the noise generated by A1S63P will be absorbed by that filter circuit, so a line filter may not be required. Use a CE-compliant 24VDC power supply in the control panel.

*2 To ensure the compliance with CE (EN6111-21/A11), make sure to short-circuit the LG and FG terminals using a wire of 6 to 7cm (2.36 to 2.76inch).

20.1.5 Base unit

The following table lists the base units that can be used for compliance with the EMC directives.

Type	Model Name	Applicability
Main Base Unit	A1S38HBEU	Applicable
	A1S3□B, A1S38HB	N/A
Extension Base Unit	A1S5□B, A1S6□B	Applicable

20.1.6 Ferrite core

Use of ferrite cores is effective in reducing conduction noise in the band of about 10MHz and radiated noise of 30 to 100MHz.

It is recommended to attach ferrite cores when the shield of the shielded cable coming out of control panel does not work effectively, or when emission of the conduction noise from the power supply line has to be suppressed.*1 The ferrite cores used in our tests are TDK's ZCAT3035.

It should be noted that the ferrite cores should be fitted to the cables in the position immediately before they are pulled out of the enclosure. If the fitting position is improper, the ferrite will not produce any effect.

*1 To comply with CE(EN61131-2/A12), make sure to attach 2 or more ferrite cores to the power supply line.

The position should be as close to the power supply module as possible.

- Ferrite core

Model: ZCAT2235-1030A (TDK ferrite core)

Contact: TDK Corporation


20.1.7 Noise filter (power supply line filter)

A noise filter is effective for suppressing conduction noise. It is not required to attach a noise filter to the power supply line except for some models, however, attaching it can suppress more noise. (The noise filter has the effect on reducing conduction noise of 10MHz or less.). Use any of the following noise filters (double μ type filters) or equivalent.

Model name	FN343-3/01	FN660-6/06	ZHC2203-11
Manufacturer	SCHAFFNER	SCHAFFNER	TDK
Rated current	3A	6A	3A
Rated voltage	250V		

The precautions required when installing a noise filter are described below.

- (1) Do not bundle the wires on the input side and output side of the noise filter. When bundled, the output side noise will be induced into the input side wires from which noise has been filtered out.

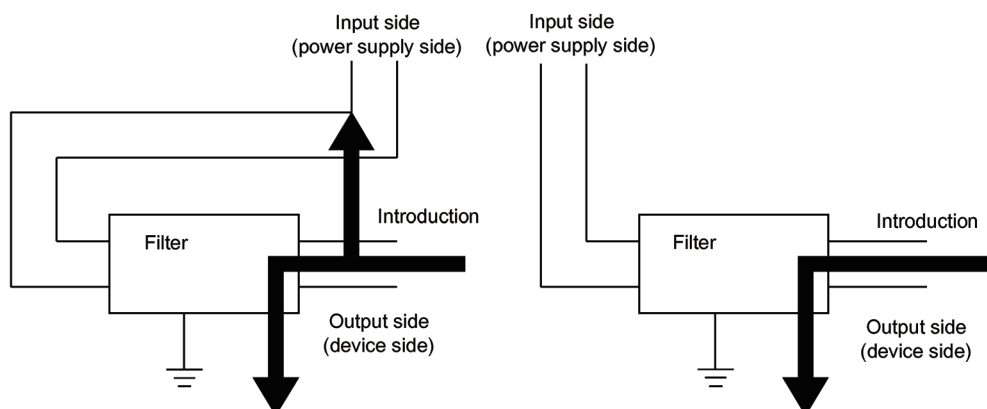

- (2) Ground the noise filter ground terminal to the control panel with the shortest wire possible (approx. 10cm (3.94in.)).

20.1.8 Power line for external power supply terminal

The power line connecting to the external power supply terminal of the module should be 30m (98.43 ft.) or less.

The power line connecting to the external power supply terminal of the following module should be 10m (32.81 ft.) or less.

- A1SJ71QLP21S

20.2 Requirements for Compliance with Low Voltage Directives

The Low Voltage Directives apply to the electrical equipment operating from 50 to 1000VAC or 75 to 1500VDC; the manufacturer must ensure the safety of the equipment. Sections 20.2.1 to Section 20.2.7 provide precautions on installation and wiring of the MELSEC-QnA series programmable controller to conform to The Low Voltage Directives. The descriptions are made based on the requirements and standards of the latest regulation. However, they do not guarantee that any machinery produced according to the contents of this manual is compliant with the above directives. Therefore, manufacturers must finally determine how to make it comply it and how it is compliant with the low voltage directives.

20.2.1 Standard applied for MELSEC-QnA series programmable controller

The standard applied for MELSEC-QnA series programmable controller is EN61010-1 Safety of devices used in measurement, control, or laboratories.

For the modules which operate with the rated voltage of 50 VAC/75 VDC or above, we have developed new models that conform to the above standard.

For the modules which operate with the rated voltage less than 50 VAC or 75 VDC, conventional models can be used, because the low voltage directives do not apply to them.

20.2.2 Precautions when using the QnA series programmable controller

Module selection

(1) POWER SUPPLY MODULE

Since a power supply module with the rated input voltage of 100/200VAC has a potentially hazardous voltage area (42.4V or more at the peak), select a model in which reinforced insulation is provided between the primary and secondary sides. For those of 24VDC rated input, conventional models can be used.

(2) I/O module

Since an I/O module with the rated input voltage of 100/200VAC has a potentially hazardous voltage area, select a model in which reinforced insulation is provided between the primary and secondary sides. For those of 24VDC rated input, conventional models can be used.

(3) CPU module, memory card, base unit

Conventional models can be used for these modules, because they only have a 5VDC circuit inside.

(4) Special function module

Conventional models can be used for the special function modules including analog modules, network modules, and positioning modules, because their rated voltage is 24VDC or lower.

(5) Display

Use the CE-marked product.

20.2.3 Power supply

The insulation specification of the power supply module was designed assuming installation category II. Be sure to use the installation category II power supply to the programmable controller.

The installation category indicates the durability level against surge voltage generated by a thunderbolt. Category I has the lowest durability; and category IV has the highest durability.

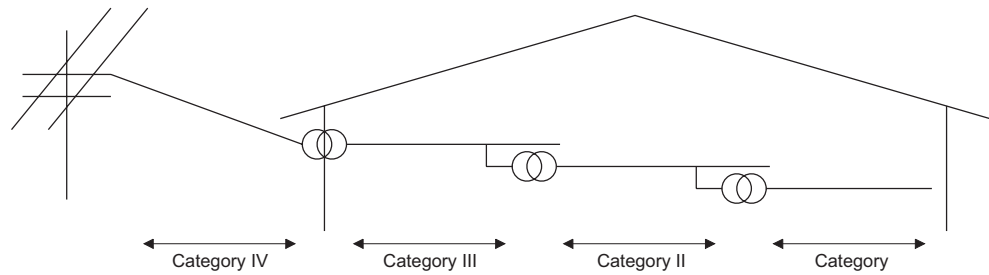


Figure 20.1 Installation Category

Category II indicates a power supply whose voltage has been reduced by two or more levels of isolating transformers from the public power distribution.

20.2.4 Control panel

Because the programmable controller is an open type device (a device designed to be stored within another device), be sure to use it inside the control panel.*

* Also, each network remote station needs to be installed inside the control panel. However, the waterproof type remote station can be installed outside the control panel.

(1) Shock protection

To prevent personnel such as operators who are not familiar with electricity from electric shocks, the control panel must be handled as follows:

- (a) Lock the control panel so that only the qualified personnel can open it.
- (b) Provide a mechanism so that opening the control panel will automatically stop the power supply.
- (c) For electric shock protection, use IP20 or greater control panel.

(2) Dustproof and waterproof features

The control panel also has the dustproof and waterproof functions. Insufficient dustproof and waterproof features lower the insulation withstand voltage, resulting in insulation destruction. As our programmable controllers are designed assuming the pollution level 2, use them in an environment of pollution level 2 or lower.

Pollution level 1: An environment where the air is dry and conductive dust does not exist.

Pollution level 2: An environment where conductive dust does not usually exist, however, temporary conductivity may occasionally occur due to accumulated dust. Generally, this is the level for the inside of the IP54-equivalent control panel in a control room or on a shop floor.

Pollution level 3: An environment where conductive dust exists and conductivity may be generated due to accumulated dust.
An environment for a typical factory floor.

Pollution level 4: Continuous conductivity may occur due to rain, snow, etc. An outdoor environment.

As shown above, the programmable controller can meet pollution level 2 when stored in a control panel equivalent to IP54.

20.2.5 Module installation

(1) Installing modules contiguously


The left side face of each QnA series I/O module is open. When installing I/O modules to the base, do not allow any empty slots between modules. If a slot to the left of a 100/200VAC module is left empty, the circuit board containing the hazardous voltage circuit is exposed. When a slot needs to be left open, be sure to install the blank module (A1SG60).


When using the A1S5□B(S1) expansion base with no power supply, attach the included cover to the side of the leftmost module.

20.2.6 Grounding

There are two kinds of ground terminals as shown below. Either ground terminal must be used grounded.

Be sure to perform protective grounding to ensure the safety.

Protective grounding  : Ensures the safety of the programmable controller and improves the noise resistance.

Functional grounding  : Improves the noise resistance.

20.2.7 External wiring

(1) Module power supply and external power supply

For the remote module which requires 24VDC as module power supply, the 5/12/24/48VDC I/O module, and the special function module which requires the external power supply, use the 5/12/24/48VDC circuit which is doubly insulated from the hazardous voltage circuit or use the power supply whose insulation is reinforced.

(2) External devices

When a device with a hazardous voltage circuit is externally connected to the programmable controller, use a model whose circuit section of the interface to the programmable controller is intensively insulated from the hazardous voltage circuit.

(3) Reinforced insulation

Reinforced insulation refers to the insulation with the dielectric withstand voltage shown in Table 1.

Reinforced Insulation Withstand Voltage (Installation Category II, source : IEC664)

Rated voltage of hazardous voltage area	Surge withstand voltage (1.2/50 μ s)
150VAC or less	2500V
300VAC or less	4000V

21 MAINTENANCE AND INSPECTION

In order to use the programmable controller always in good condition, conducting daily and periodical maintenance/inspection on the following items are strongly recommended.

21.1 Daily Inspection

Dairy inspection items recommended are shown in Table 21.1.

Table 21.1 Dairy Inspection

Item	Check item		Content of inspection	Judgement	Action
1	Installation condition of the base unit		Confirm if installation screws are not loose or cover is not detached.	It is installed securely.	Retighten the screw.
2	Installation condition of the I/O modules		Check if the module is not disengaged and if the hook is securely engaged.	The hook should be securely engaged and the module should be positively mounted.	Securely engage the hook.
3	Connection conditions		Loosening of terminal screw	No loosening.	Retighten the terminal screw.
			Proximity of solderless terminals.	There is an appropriate distance.	Correct the distance.
			Connector areas of extension cable	No loosening at connectors.	Retighten the connector fixing screw.
4	LEDs on the main module	POWER SUPPLY MODULE POWER LED	Confirm it is ON.	The LED is ON. (Faulty if it is OFF.)	Refer to Section 22.2.2
		CPU module "RUN" LED	Confirm it is ON in the "RUN" state.	The LED is ON. (Faulty if it is OFF.)	Refer to Section 22.2.3 Section 22.2.4
		CPU module "ERROR" LED	Check that the LED is OFF.	OFF (Faulty if it is ON or flickering.)	Refer to Section 22.2.5
		CPU module "BAT. ARM" LED	Check that the LED is OFF.	OFF (Faulty if it is ON.)	Refer to Section 22.2.7
		Input module LED	Confirm if it correctly turns on and off.	The LED is ON when input is ON, and OFF when input is OFF. (Faulty other than the above.)	Refer to Section 22.2.8
		Output module LED	Confirm if it correctly turns on and off.	The LED is ON when output is ON, and OFF when output is OFF. (Faulty other than the above.)	Refer to Section 22.2.8

21.2 Periodic Inspection

Inspection on items shown below should be conducted once or twice every six months to a year. Conduct the inspection when the equipment is moved or modified, or wiring is changed.

Table 21.2 Periodic inspection

Item	Check item		Content of inspection	Judgement	Corrective action
1	Ambient environment	Ambient temperature	Measure with temperature and humidity gauge.	0 to 55°C	When used in a panel, temperature inside the panel is the ambient temperature.
		Ambient humidity		10 to 90%RH	
		Atmosphere	Measure presence of corrosive gases.	There is no corrosive gas present.	
2	Line voltage check		100/200VAC Measure voltage across 100/200VAC terminals.	85 to 264VAC	Change the power supply.
3	Installation condition	Loosening, backlash	Test by moving the module.	Must be installed solidly.	Retighten the screw. For CPU, I/O, or power supply, if loosened, secure it with screws.
		Adhesion of dirt or foreign matters	Visual inspection	No adhesion.	Remove and clean.
4	Connection conditions	Loosening of terminal screw	Retighten with a screwdriver.	No loosening.	Retighten.
		Proximity of solderless terminals	Visual inspection	There is an appropriate distance.	Correct the distance.
		Loosening of connector	Visual inspection	No loosening.	Retighten the connector fixing screw.
5	Battery		Confirm SM51 or SM52 is OFF with a peripheral device in the monitoring mode.	(Preventive maintenance)	Even when there is no low-battery display, replace if specified life is exceeded.

**DANGER**

- Be sure to shut off all phases of the external power supply used by the system before cleaning or retightening the terminal screws or module mounting screws. Failure to do so may result in an electric shock.
If they are too loose, it may cause a short circuit or malfunctions.
If too tight, it may cause damage to the screws and/or module, resulting in an accidental drop of the module, short circuit or malfunctions.

21.3 Battery Replacement

Special relay SM51 or SM52 is turned ON when voltage of the battery for backing up programs and power failure compensation function drops. Even though programs and contents of power failure compensation function are not erased immediately when these special relays become ON, the contents could be erased if the ON-status of the special relay fails to be recognized.

Replace the battery before the total latch time after special relay SM51 turns ON reaches the stipulated time.

POINT	
	SM51 is a battery voltage drop alarm, and it remains ON once turning it ON even if the battery voltage returns to normal.
	SM52 is a battery voltage drop alarm, and after turning ON, it goes OFF when the battery voltage returns to normal.
	After SM51 and SM52 have turned ON, immediately replace the battery.

SM51 is a battery voltage drop alarm, and it remains ON once turning it ON even if the battery voltage returns to normal.

In order to determine which of these memory's battery has sustained the voltage drop, check the contents of special relay SD51 and SD52.

When the voltage of any memory's battery drops, the bit in SD51 and SD52 that corresponds to each memory turns ON.

SD51, SD52 bit No.	Corresponding memory
Bit 0	Built-in RAM
Bit 1, 2	Memory card

POINT				
<p>The relationship of back up between the status of the batteries installed in the CPU module and memory cards is explained below.</p> <p>The following two points are applied.</p> <p>1) The battery installed in the CPU module does not back up the RAM memories of the memory cards.</p> <p>2) The batteries installed in the memory cards do not back up the built-in RAM of the CPU module.</p>				
CPU module AC power supply for CPU module	CPU module CPU module battery	Memory card memory Battery	CPU module CPU module memory	Memory card memory Memory
ON	ON	ON	○	○
		OFF	○	○
	OFF	ON	○	○
		OFF	○	○
OFF	ON	ON	○	○
		OFF	○	×
	OFF	ON	×	○
		OFF	×	×

○ : Back up is possible.
× : Back up is not possible.

The battery life guideline and the replacement procedures are explained on the following pages.

21.3.1 Battery life

(1) Battery life of CPU module

The CPU module battery life differs depending on the CPU model. The life for each CPU model is shown in Table 21.3.

Table 21.3 CPU module battery life

CPU module model name	Battery life (Total power failure time) [hr]		
	Guaranteed value (MIN)	Actual value (TYP)	After SM51 is turned ON
Q2ASCPU	1800	14500	48
Q2ASCPU-S1	1150	10700	27
Q2ASHCPU	1050	4400	24
Q2ASHCPU-S1	860	2250	19

* Actual value indicates a rough average value and guaranteed value indicates the minimum value.

POINT
<p>(1) Switch batteries regularly in case that battery hours (total power failure time) exceed guaranteed values.</p> <p>(2) When the battery hours (total power failure time) may exceed the guaranteed value, take the following measures.</p> <p>Perform ROM operation to protect a program in case that the battery dies at programmable controller power supply OFF.</p> <ul style="list-style-type: none"> After SM51 (Battery low) turns ON, back up a program and data within the specified time shown in the Table 21.3.

(2) Battery life of memory card

The battery life of memory card differs depending on the memory capacity. The life for each memory is shown in Table 21.4.

Table 21.4 Battery lives of memory cards

Memory card model name	Battery life (Total power failure time) [hr]		
	Guaranteed value (MIN)	Actual value (TYP)	After SM51 is turned ON
Q1MEM-64S	5256	23652	8
Q1MEM-128S	2628	12264	6
Q1MEM-256S	5256	23652	8
Q1MEM-512S	2628	12264	6
Q1MEM-1MS	7008	23652	6
Q1MEM-2MS	2628	12264	6
Q1MEM-64SE	5256	23652	8
Q1MEM-128SE	5256	23652	8
Q1MEM-256SE	5256	23652	8
Q1MEM-512SE	5256	23652	8
Q1MEM-1MSE	2628	12264	6

* Actual value indicates a rough average value and guaranteed value indicates the minimum value.

The guide for preventive maintenance is as follows.

- 1) Replace in 4 to 5 years even when the total power failure time is less than the guaranteed value shown in the table above.
- 2) Replace when the total power failure time exceeds the guaranteed value shown in the table above and the SM51 is ON.

21.3.2 Battery replacement procedure

**DANGER**


- Properly connect batteries.

Do not charge, disassemble, heat or throw them into the fire and do not make them short-circuited and soldered.

Incorrect battery handling may cause personal injuries or a fire due to exothermic heat, burst and/or ignition.

(1) CPU module battery replacement procedure


Replace the battery of a CPU module according to the following procedure when life of the battery is over. Even when the battery is removed, memory is backed up by the capacitor for a while. However, if replacement takes longer than the guaranteed value shown in the following table, the content of the memory may be erased, so replace the battery quickly. Even if the programmable controller power is ON, the battery of the CPU module can be replaced. In this case, the memory contents are backed up by the power supply voltage from the power supply module.

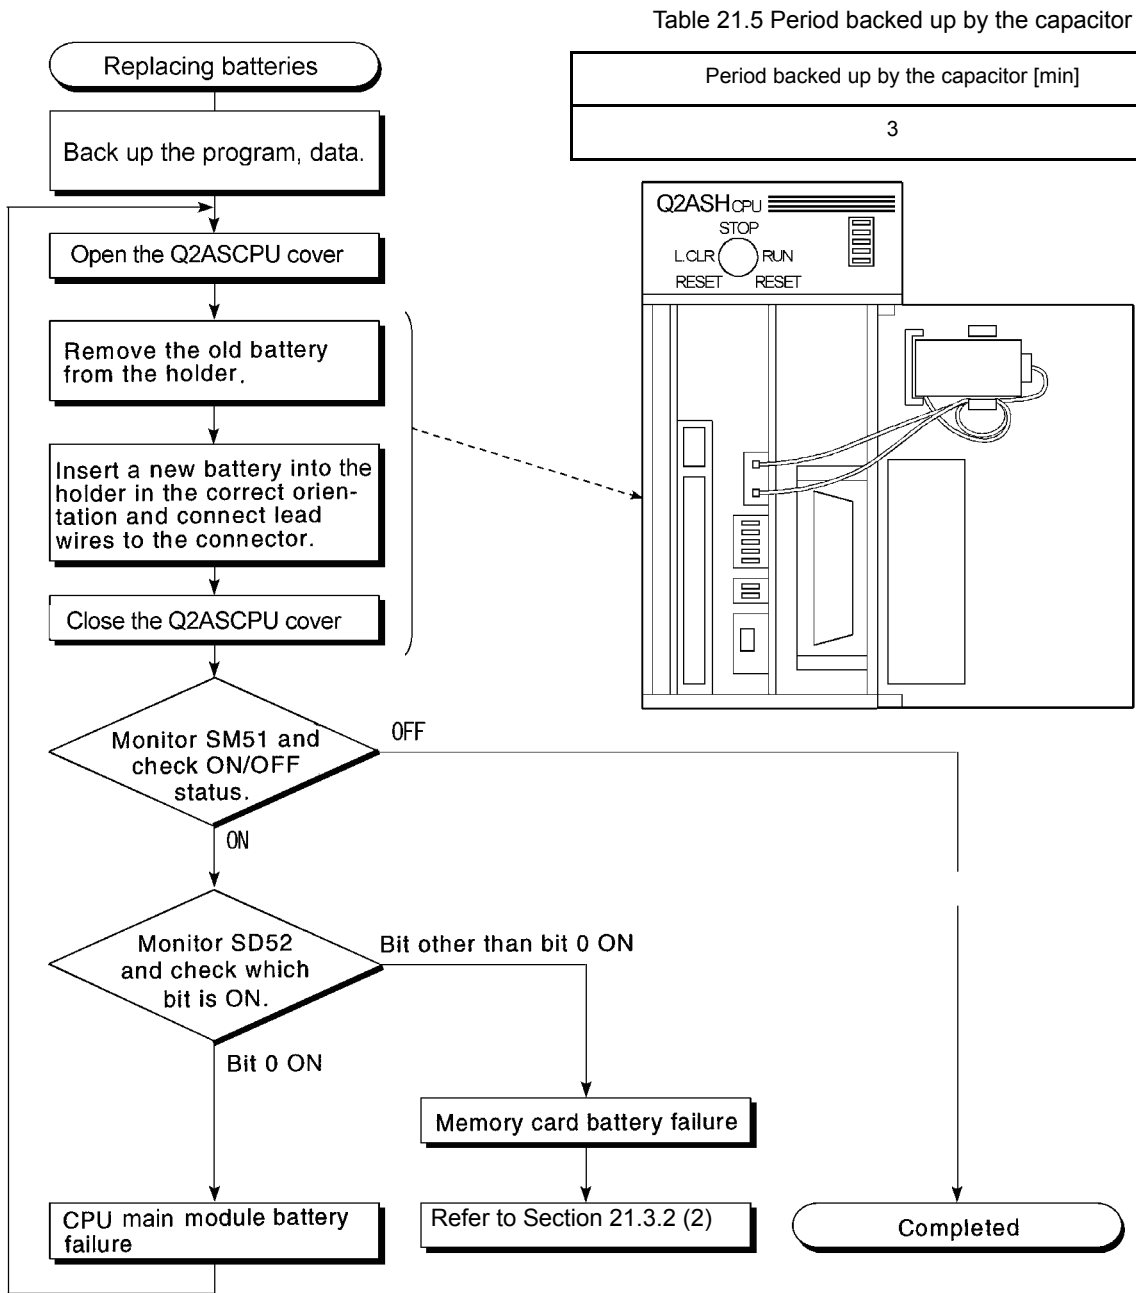

(2) Memory card battery replacement procedure

Replace the memory card battery according to the following procedure when the life is over. Even if the battery is removed, the memory card memory is backed up by a capacitor so that the battery can be replaced while the memory card is out of the CPU module.

However, if the time taken to replace the battery exceeds the guaranteed value indicated in Table 21.6 below, the contents of the memory may be lost. Therefore, change the battery as quickly as possible. While the programmable controller power is ON, the battery can be replaced without removing the memory card in the CPU module. In this case, the memory contents are backed up by the power supply voltage from the power supply module.

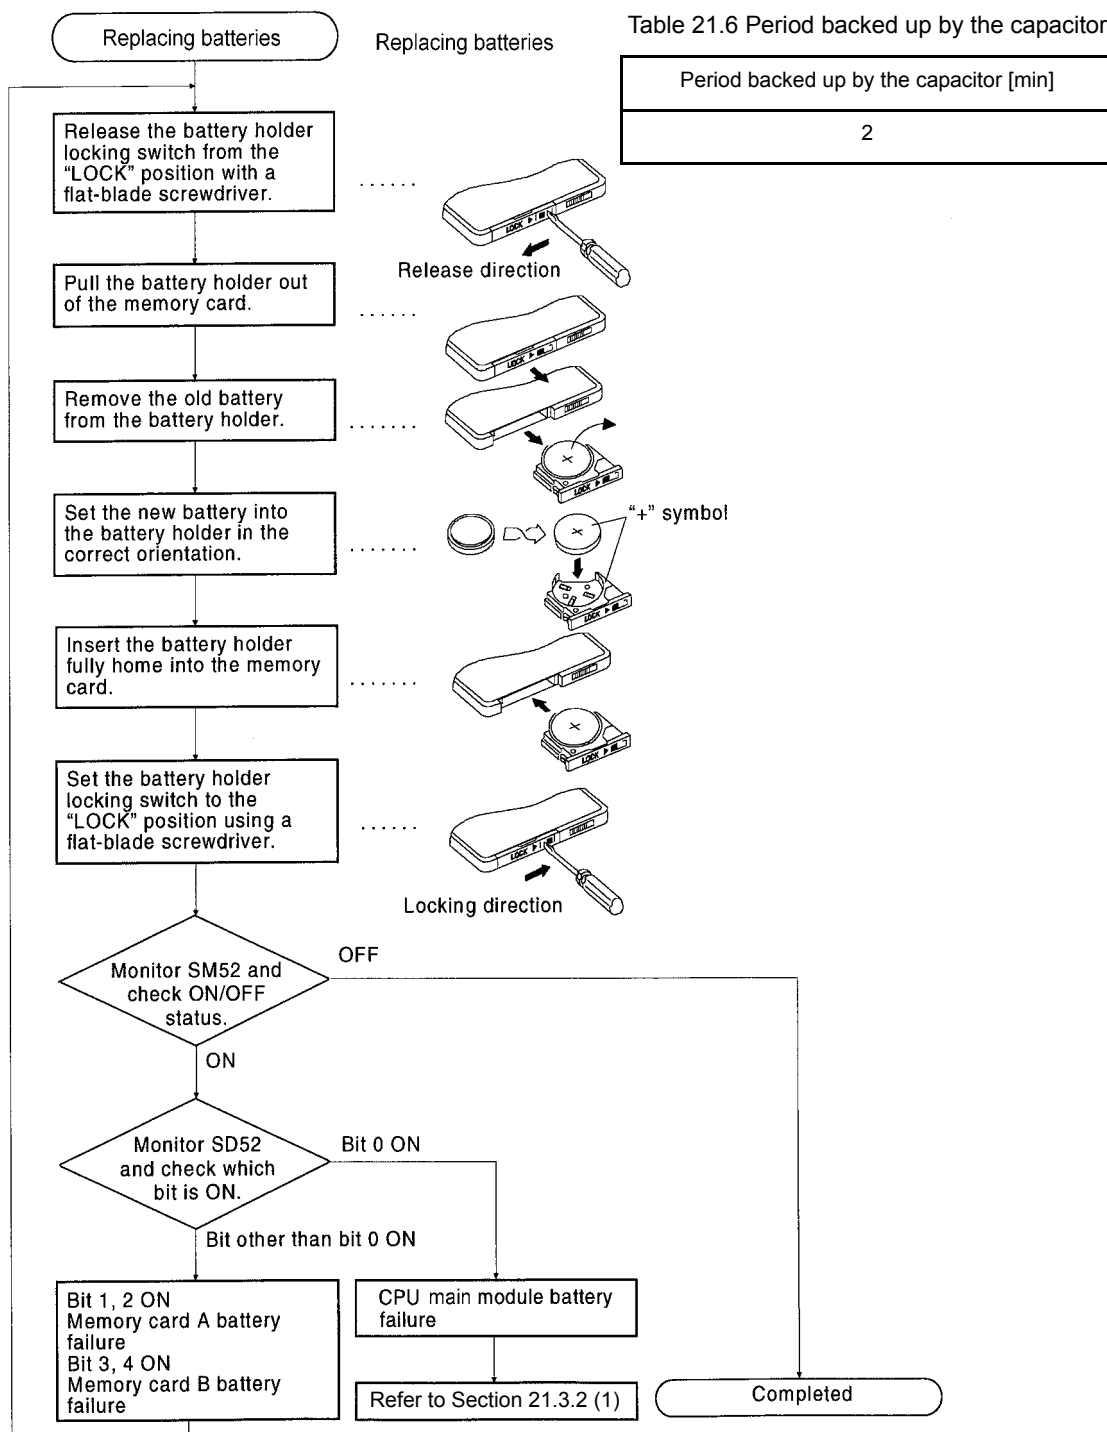

21.4 When Reoperating a programmable controller After Storing it with a Battery Unconnected

When reoperating after a battery is uncounted and the programmable controller is stored, the memory contents of a CPU module and memory card may be undefined.

Therefore, when resuming the operation, clear the CPU module memory and format the memory in the CPU module by peripheral device.

After doing so, write the memory contents backed up before saving to each memory.

The relationship between the backed-up memory and the batteries is explained below.

Memory			Battery	
			A6BAT installed in a CPU module	Battery incorporates a memory card
CPU module	Built-in RAM		○	×
	Device*		○	×
Memory card	SRAM type		×	○
	SRAM + E ² PROM type	SRAM	×	○
		E ² PROM	– (Battery back up is not required.)	

○: Battery is backed up. ×: Battery is not backed up.

*As for device memory, also clear the latch range.

Before resuming the operation, clear/format the memory for which a battery is backed up in the table above with a peripheral device.

For memory clear/format operations, refer to the following manuals.

- Type SW□ IVD-GPPQ GPP Software package Operating Manual (Online)
- GX Developer Operating Manual

POINT
<p>(1) Make sure to back up each memory contents before storing the programmable controller.</p> <p>When a programmable controller power supply is ON or CPU module reset is cancelled, a CPU module reviews the status of data below, and initializes all the data if detecting an error.</p> <ul style="list-style-type: none"> ▪ RAM data in built-in RAM ▪ Breakdown history ▪ Latch data (Latch relay (L), latch setting range device set in a parameter), special relay SM900 to SM999, special register SD900 to SD999) ▪ Sampling trace data

21.5 When a programmable controller is Reoperated After Stored with the Battery Over the Battery Life

If a battery exceeded its guaranteed life is stored and reoperated, the memory contents of CPU module and memory card may be undefined.

Therefore, when resuming the operation, clear the CPU module memory and format the memory in the CPU module by peripheral device.

After doing so, write the memory contents backed up before saving to each memory.

The relationship between the backed-up memory and the batteries is explained below.

Memory			Battery	
			A6BAT installed in a CPU module	Battery incorporates a memory card
CPU module	Built-in RAM		○	×
	Device*		○	×
Memory card	SRAM type		×	○
	SRAM + E2PROM type	SRAM	×	○
		E2PROM	– (Battery back up is not required.)	

○: Battery is backed up. ×: Battery is not backed up.

*As for device memory, also clear the latch range.

Before resuming the operation, clear/format the memory for which a battery is backed up in the table above with a peripheral device.

For memory clear/format operations, refer to the following manuals.

- Type SW□ IVD-GPPQ GPP Software package Operating Manual (Online)
- GX Developer Operating Manual

POINT
<p>(1) Make sure to back up each memory contents before storing a programmable controller.</p> <p>(2) When a programmable controller power supply is ON or CPU module reset is cancelled, a CPU module reviews the status of data below, and initializes all the data if detecting an error.</p> <ul style="list-style-type: none"> ▪ RAM data in built-in RAM ▪ Breakdown history ▪ Latch data (Latch relay (L), latch setting range device set in a parameter), special relay SM900 to SM999, special register SD900 to SD999) ▪ Sampling trace data

22 TROUBLESHOOTING

The description, cause determination, and corrective actions of each error which may occur during system usage are described.

22.1 Fundamentals of Troubleshooting

Besides using obviously highly-reliable devices to increase system reliability, it is an important point to quickly start up the system again when an error occurs. In order to quickly start up the system, find the cause of the problem and resolve it. There are the following three basic points to be aware of when performing troubleshooting.

(1) Visual confirmation

Confirm the following points:

- 1) Machine operation (stop status and operation status)
- 2) Power supply ON/OFF
- 3) I/O equipment status
- 4) Wiring status (I/O wires and cable)
- 5) Display status of each display indicator (POWER LED, RUN LED, ERROR LED, I/O LED, etc.)
- 6) Status of each setting switch (extension base, power failure compensation, etc.)

After confirming 1) to 6), connect a peripheral device and observe the operation status of the programmable controller and program contents.

(2) Error confirmation

Observe how the error changes by performing the following operations:

- 1) Set the RUN/STOP key switch to "STOP".
- 2) Reset using the RUN/STOP key switch.
- 3) Turn ON/OFF the power supply.

(3) Narrow down the range

By performing the (1) and (2) above, assume the faulty area in the following:


- 1) Programmable controller or external?
- 2) I/O module or others?
- 3) Sequence program?

22.2 Troubleshooting

The error definition determination method, error definition corresponding to the error code, and corrective actions are described.


22.2.1 Troubleshooting flowchart

The error definitions are described by events.

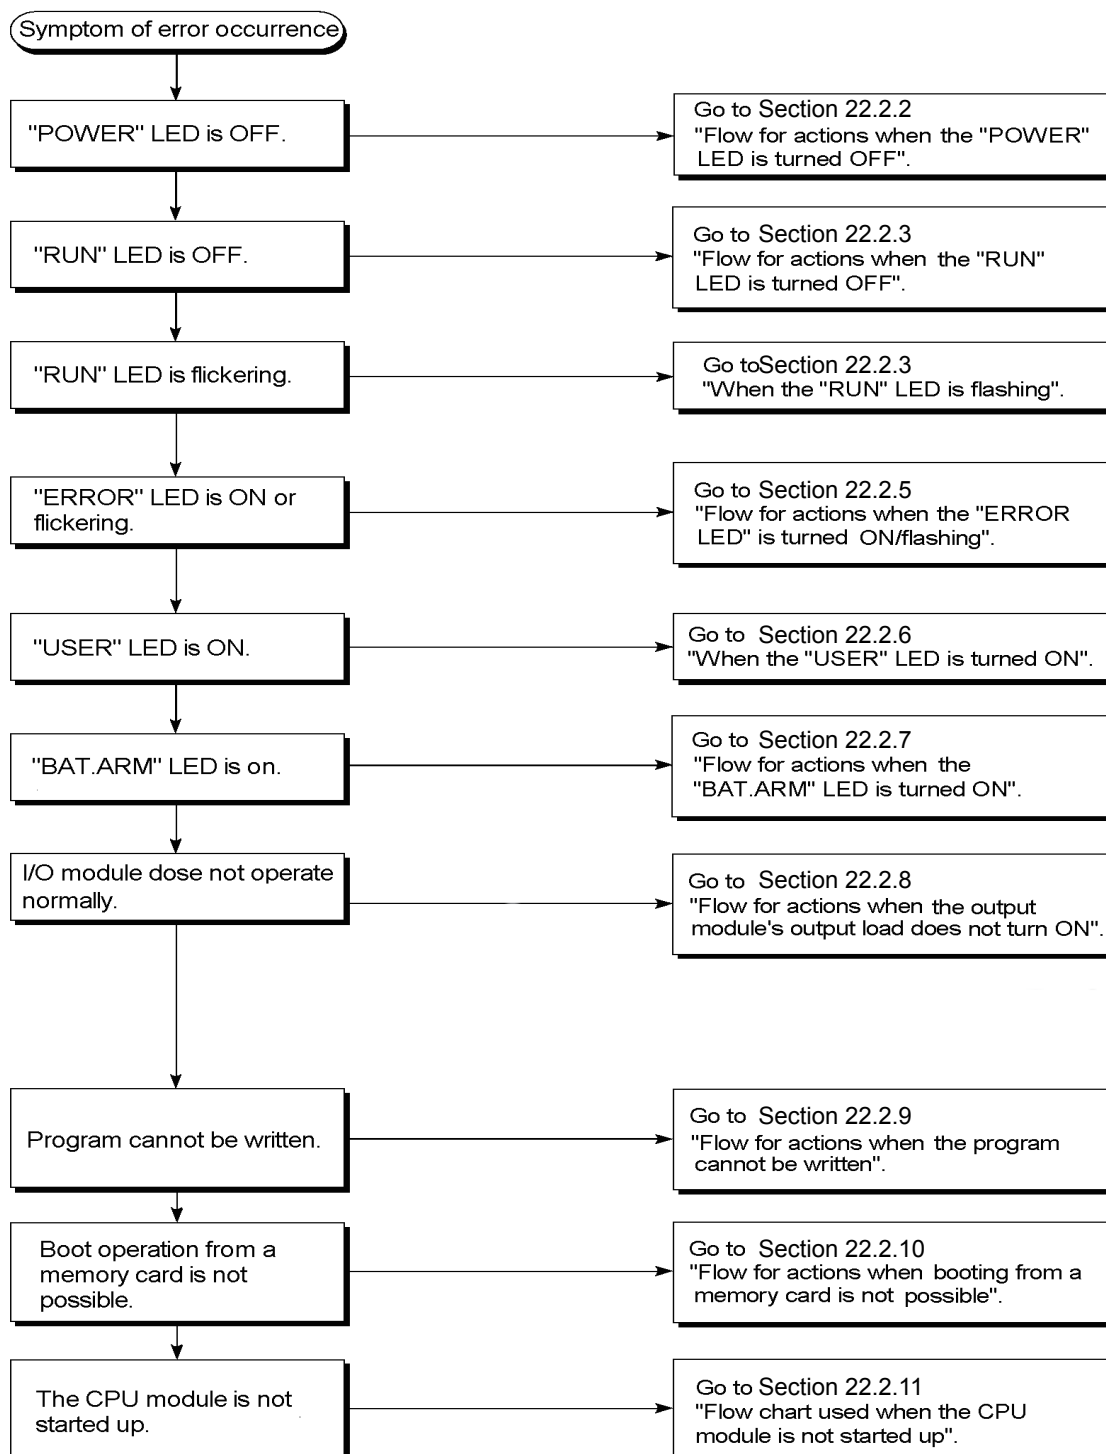


22.2.2 Flow for actions when the "POWER" LED is turned OFF

The flow when the programmable controller power is ON or when the "POWER" LED of the power supply module is ON during operation is described.

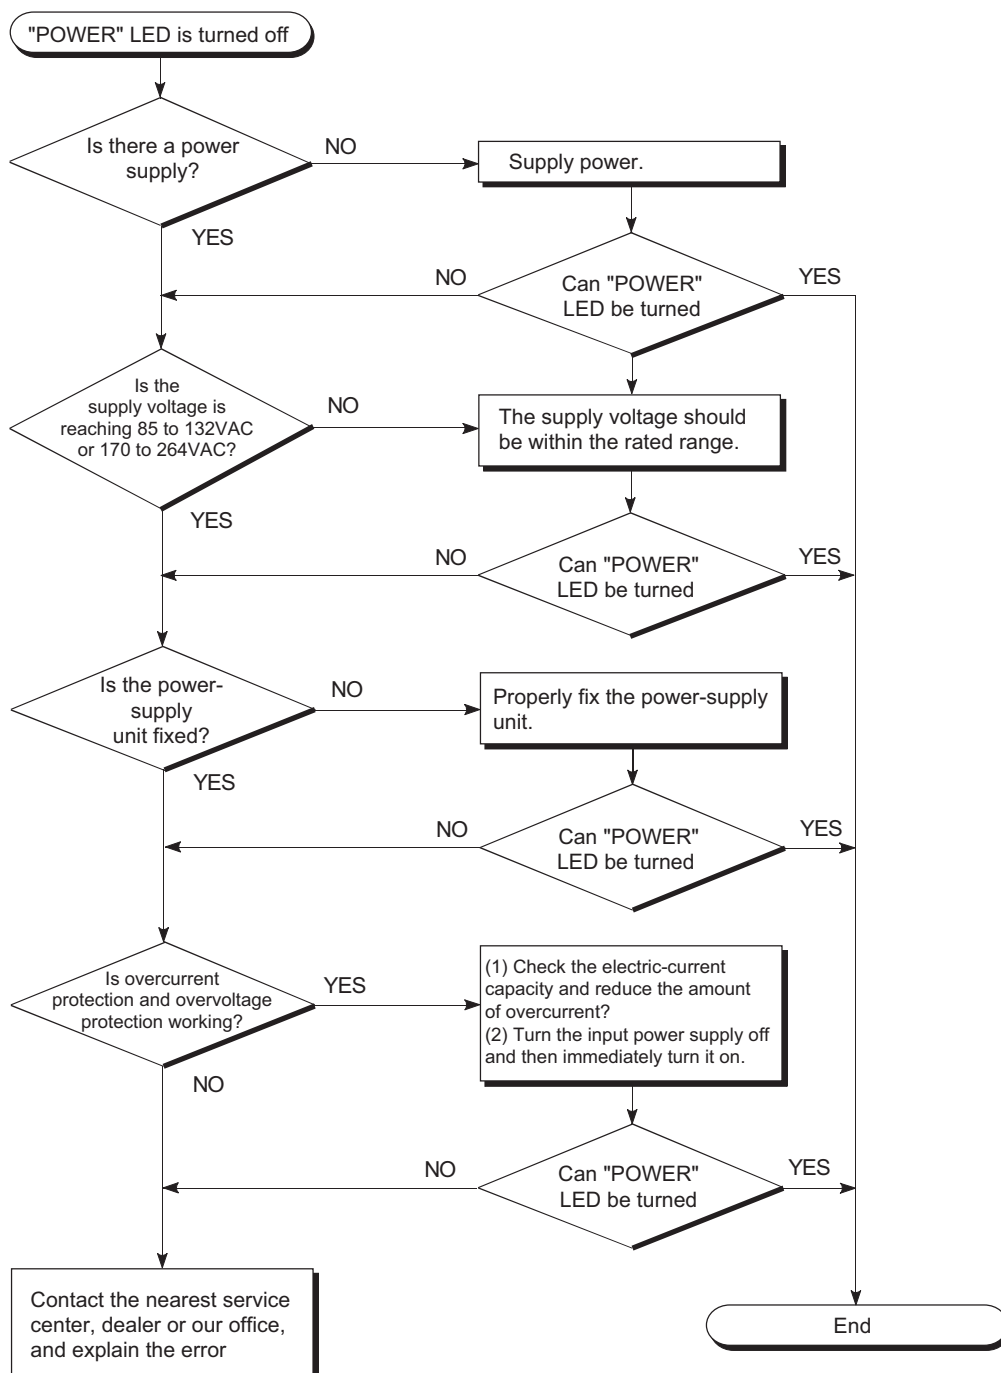

22.2.3 Flow for actions when the "RUN" LED is turned OFF

The flow when the "POWER" LED of the CPU module turns OFF during operation is described.

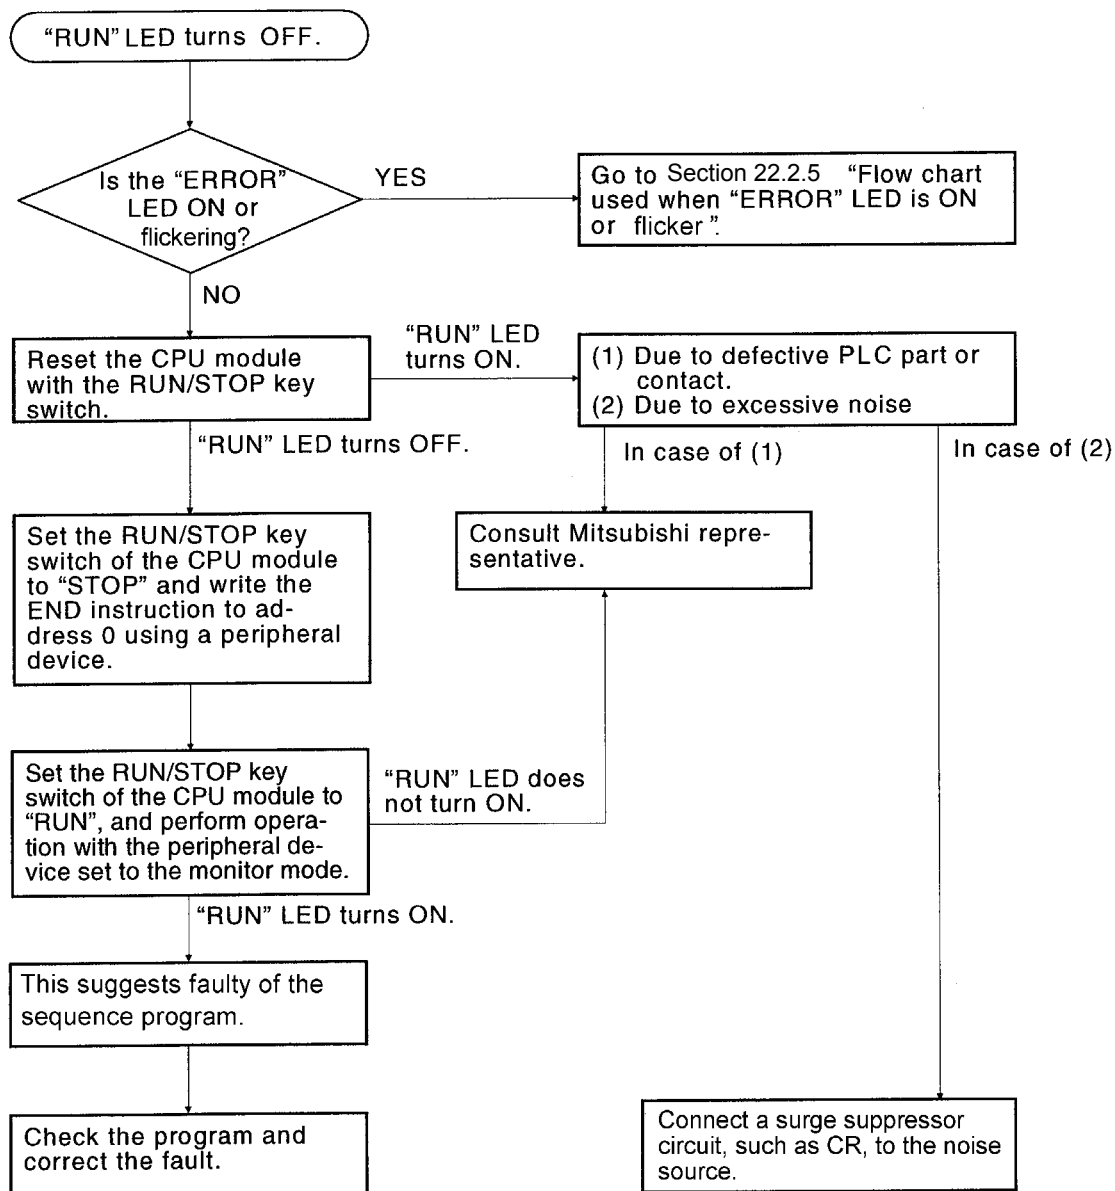

22.2.4 When the "RUN" LED is flashing


Flashing of the "RUN" LED of a CPU module is described below.

With the Q2ASCPU, when the RUN/STOP key switch is turned from STOP to RUN after writing a program in the STOP state, the "RUN" LED flashes. Then, no CPU module error occurs, but the operation stops.

To set the CPU module to RUN, either turn the RUN/STOP key switch to STOP then RUN again, or reset the CPU module using the key switch. The "RUN" LED turns ON.

22.2.5 Flow for actions when the "ERROR LED" is turned ON/flashing

The flow when the programmable controller power is ON, when the operation is started or when the "ERROR" LED of the CPU module is ON/blinking during operation is described.

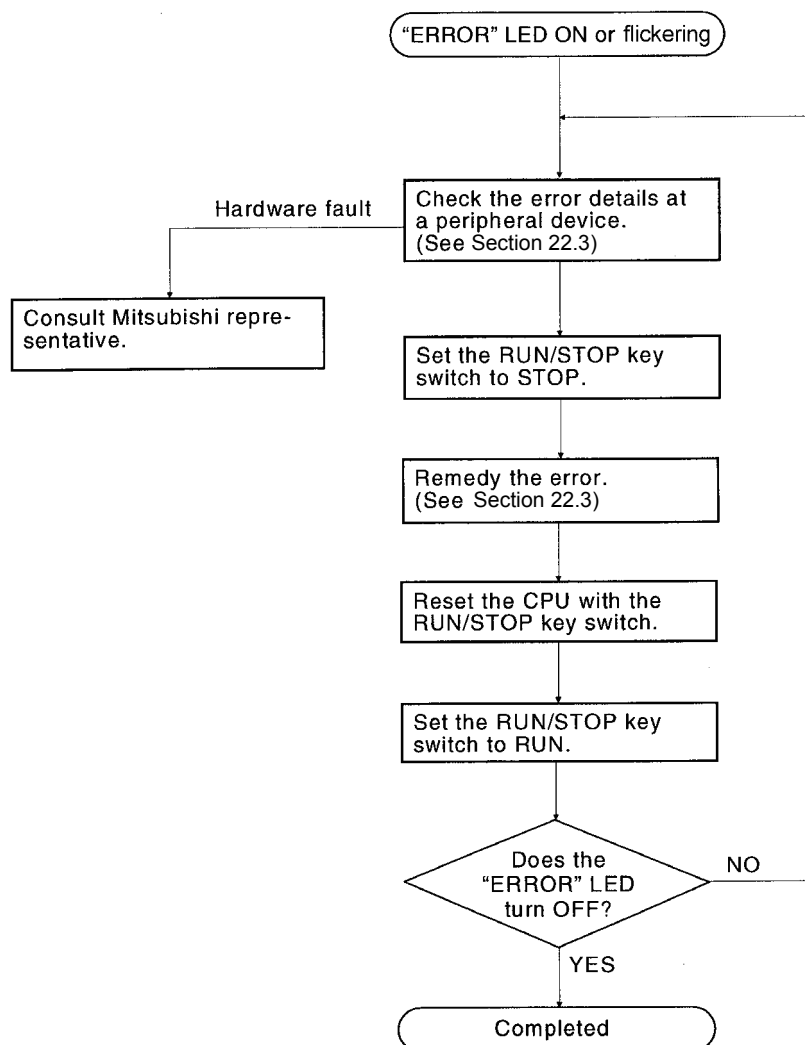

22.2.6 When the "USER" LED is turned ON

This section describes the case when the "USER" LED of CPU module is turned on.

With the Q2ASCPU, the "USER" LED comes ON when an error is detected by the CHK instruction, or when an annunciator (F), turns ON.

When the "USER" LED is turned ON, monitor SM62 and SM80 of the special relay in the peripheral device monitor mode.

After monitoring and removing the cause, the "USER" LED can be turned OFF by resetting the RUN/STOP key switch or performing the LEDR instruction.

- When SM62 is ON
With the annunciator (F) ON, the "USER" LED is ON.
Check the error cause with SD62 to SD79.
- When SM80 is ON,
With execution of the CHK instruction, the "USER" LED is ON.
Check the error cause with SD80.

After checking the error cause, remove the cause.

The "USER" LED can be turned OFF by either of the following operations.

- Resetting the system with the RUN/STOP key switch
- Execution of the LEDR instruction with the sequence program

REMARK

When the RUN/STOP key switch is turned to "L.CLR" several times in a latch clear operation, the "USER" LED flashes to indicate that latch clear processing is in progress.

When the RUN/STOP key switch is turned once more to "L.CLR" while the "USER" LED is flashing, the "USER" LED goes OFF and latch clear processing is ended.


22.2.7 Flow for actions when the "BAT.ARM" LED is turned ON

This section describes the case when the "BAT.ARM" LED of CPU module is turned on. With the Q2ASCPU, the "BAT.ARM" LED turns ON when the voltage of the battery for a CPU module or a memory card drops.

When the "BAT.ARM" LED turns ON, monitor the special relays (SM51 and SM52) and special registers (SD51 and SD52) in the peripheral device monitor mode, and check if there has been a voltage drop at either of the battery for a CPU module or a memory card. After monitoring and replacing the battery by a new one, the "BAT.ALM" LED can be turned OFF by resetting the RUN/STOP key switch or performing the LEDR instruction.

22.2.8 Flow for actions when the output module's output load does not turn ON

The flow when the output load of the output module is not turned ON during operation is described.

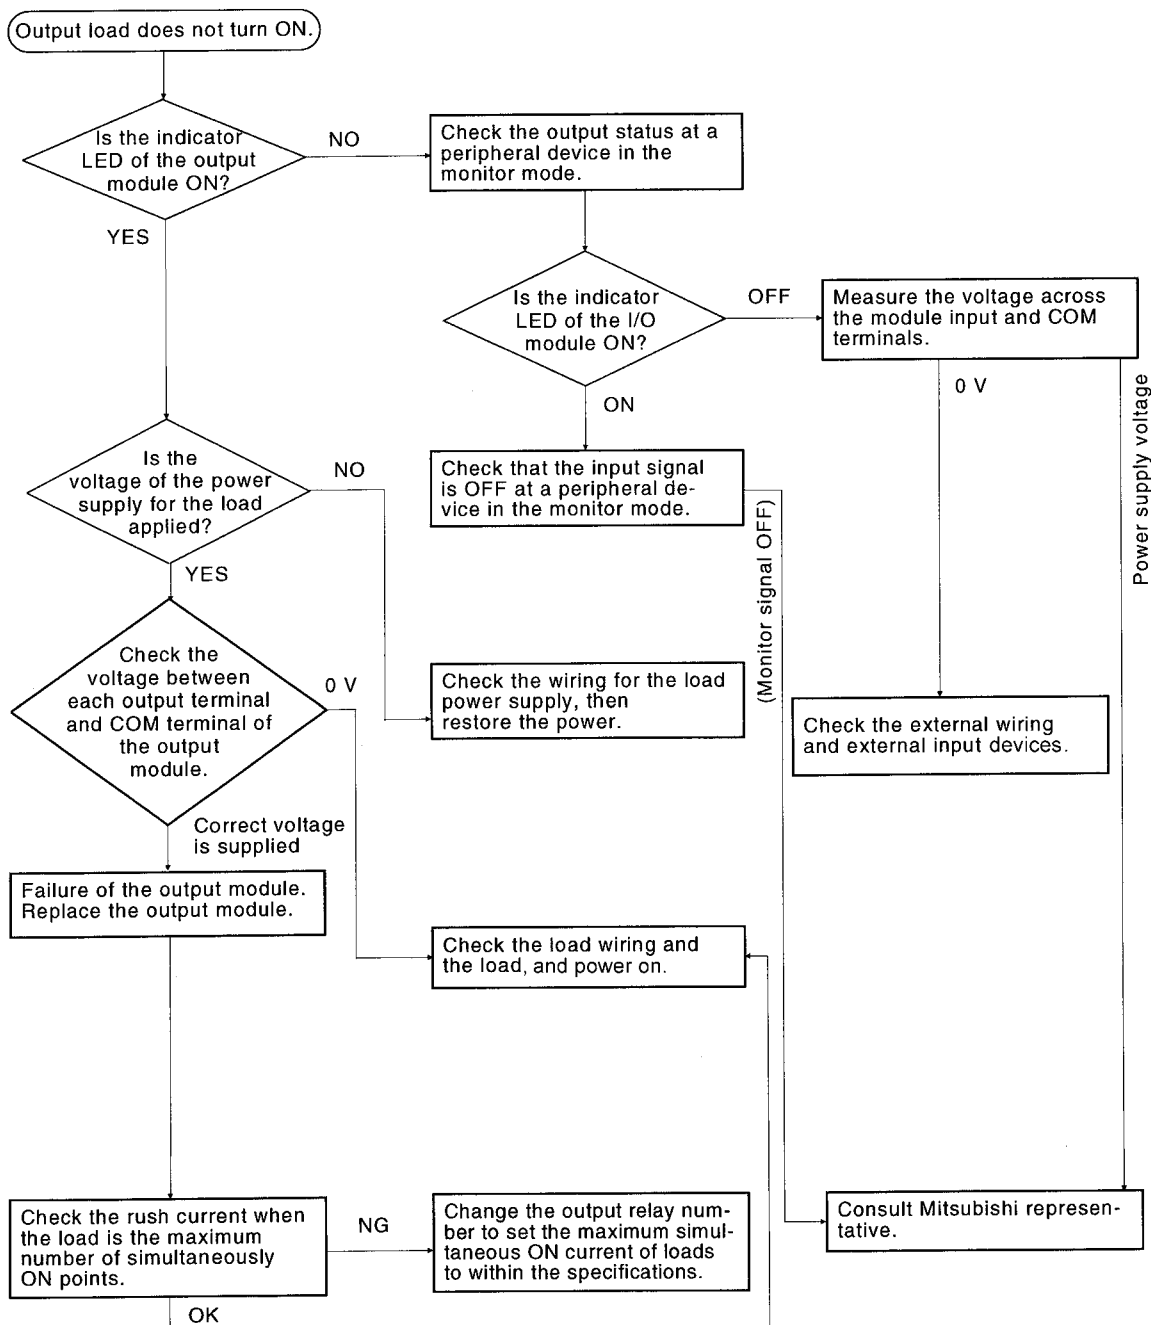




POINT

For problems when the input signal does not turn off or output load does not turn off, perform troubleshooting by referring to the fault examples for the I/O modules in Section 22.5.

22.2.9 Flow for actions when the program cannot be written


The flow when a program cannot be written to the CPU module is described.

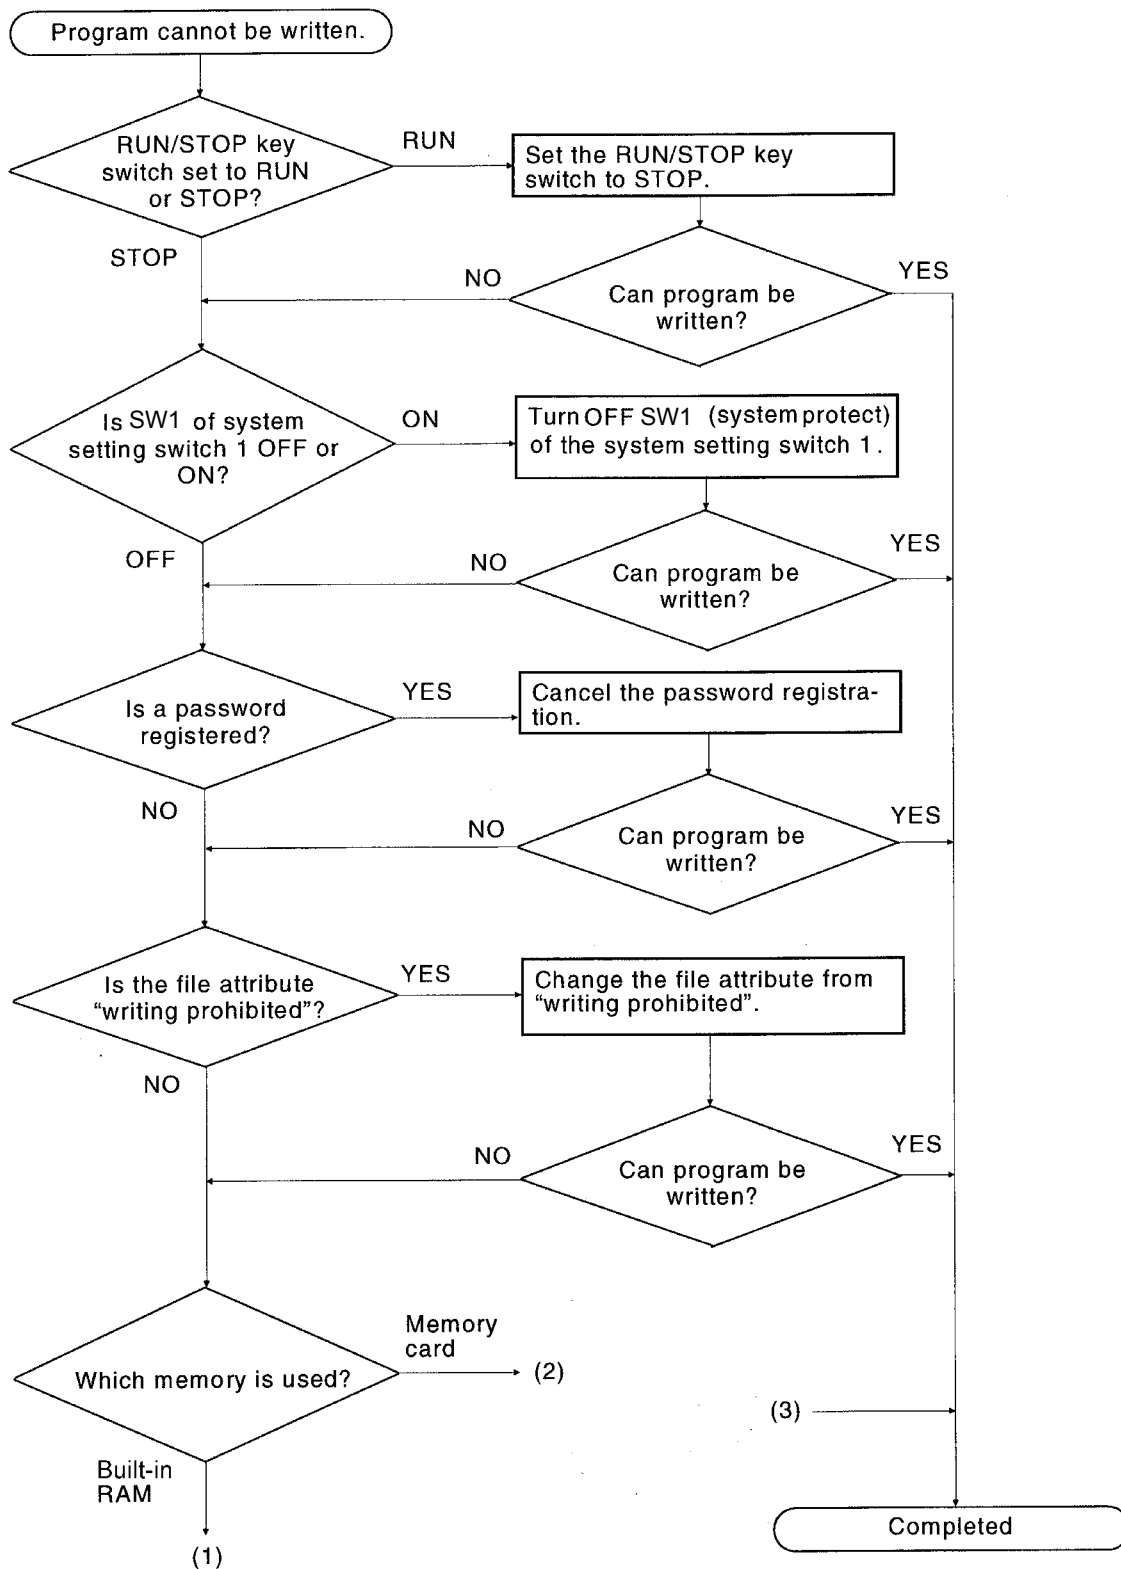


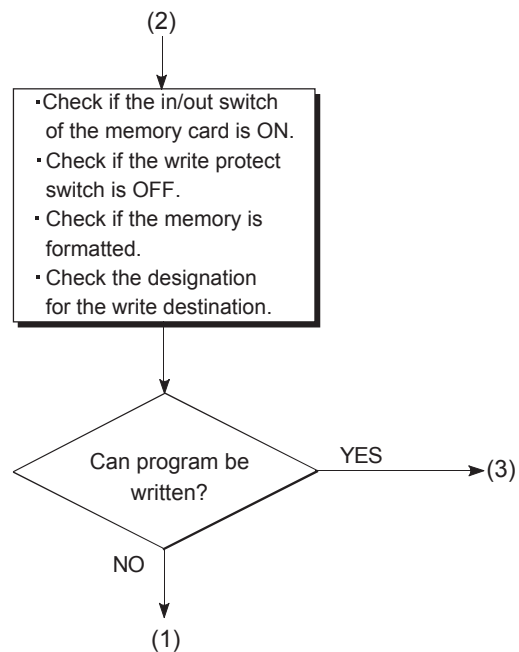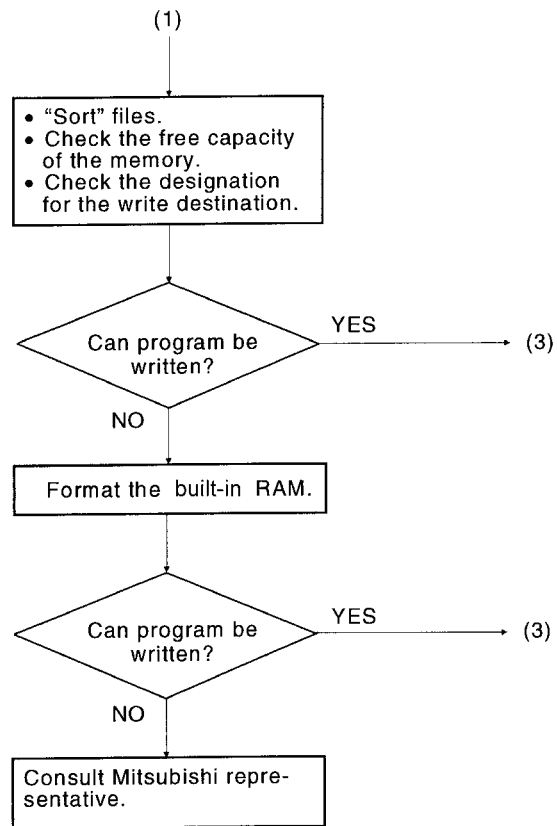

22.2.10 Flow for actions when booting from a memory card is not possible


The flow when the CPU module cannot be booted from a memory card is described.

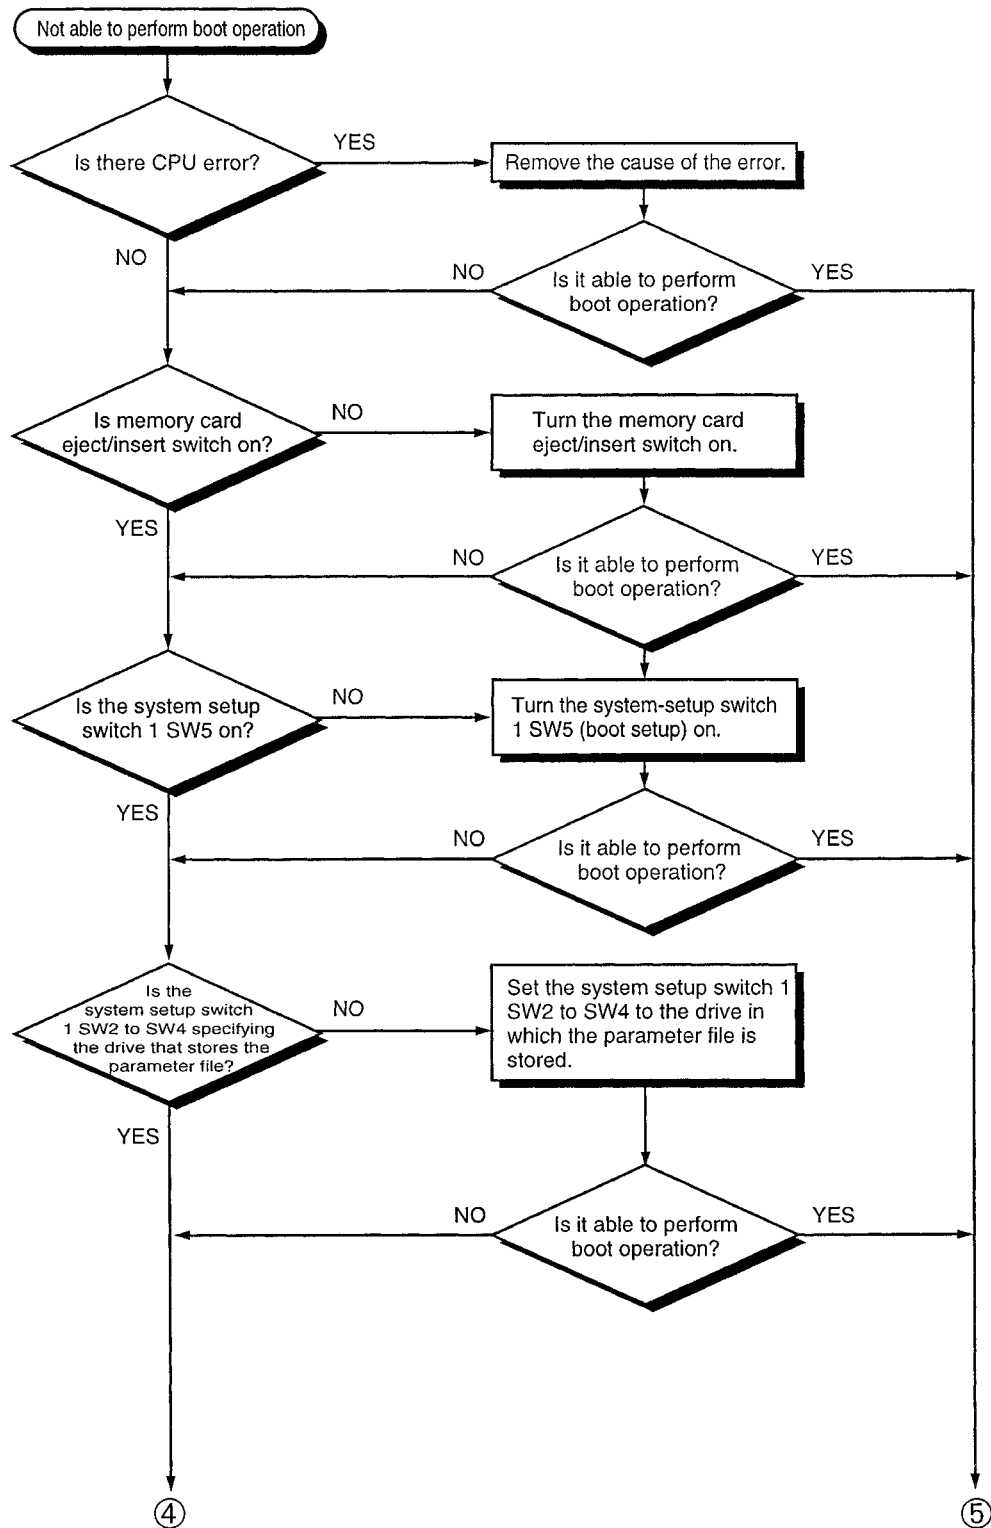

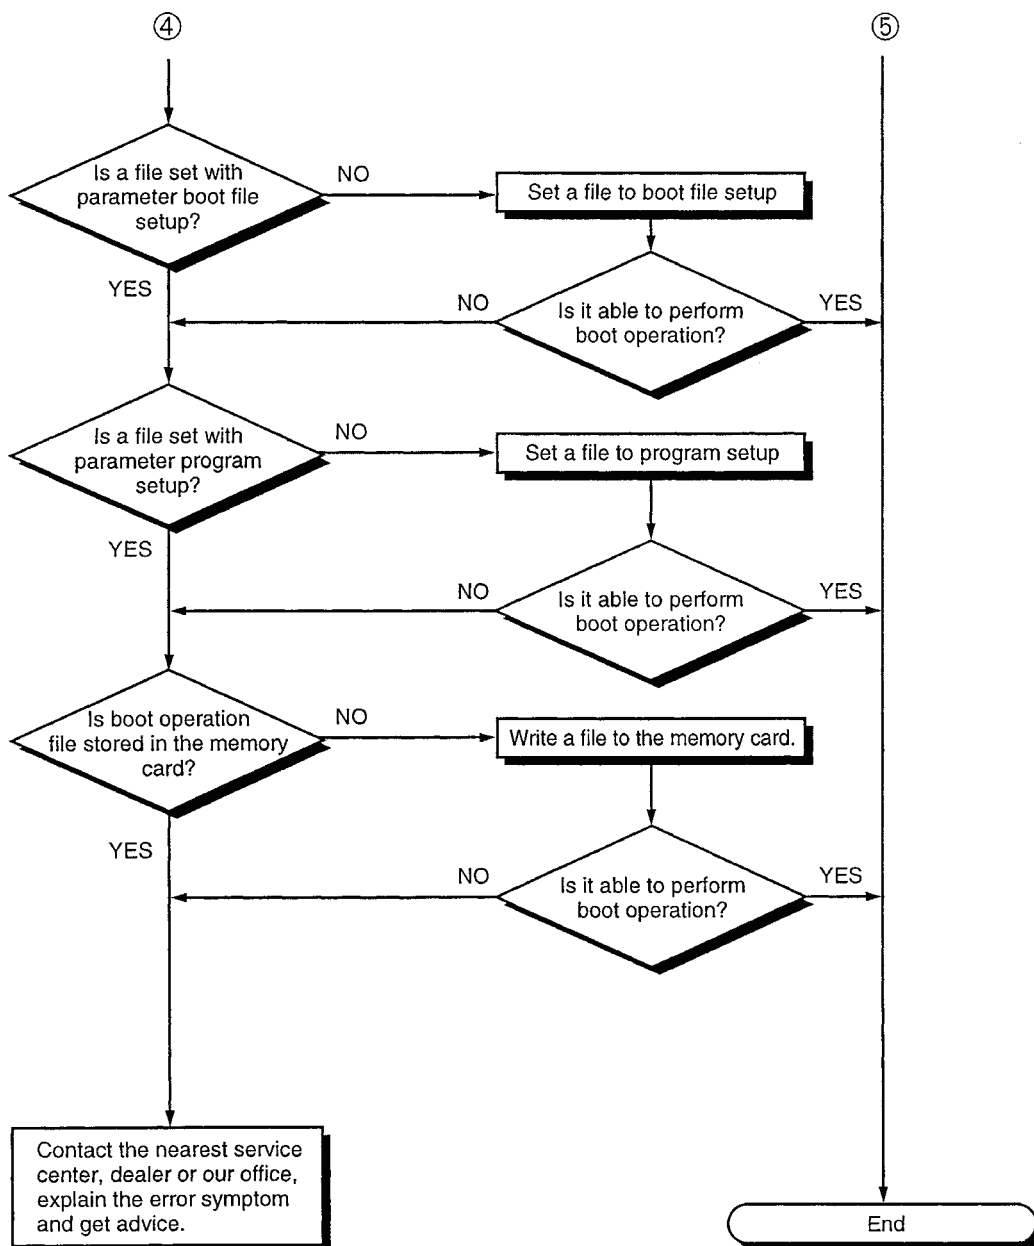

22.2.11 Flow chart used when the CPU module is not started up

The following shows the flow when the CPU module is not started up.

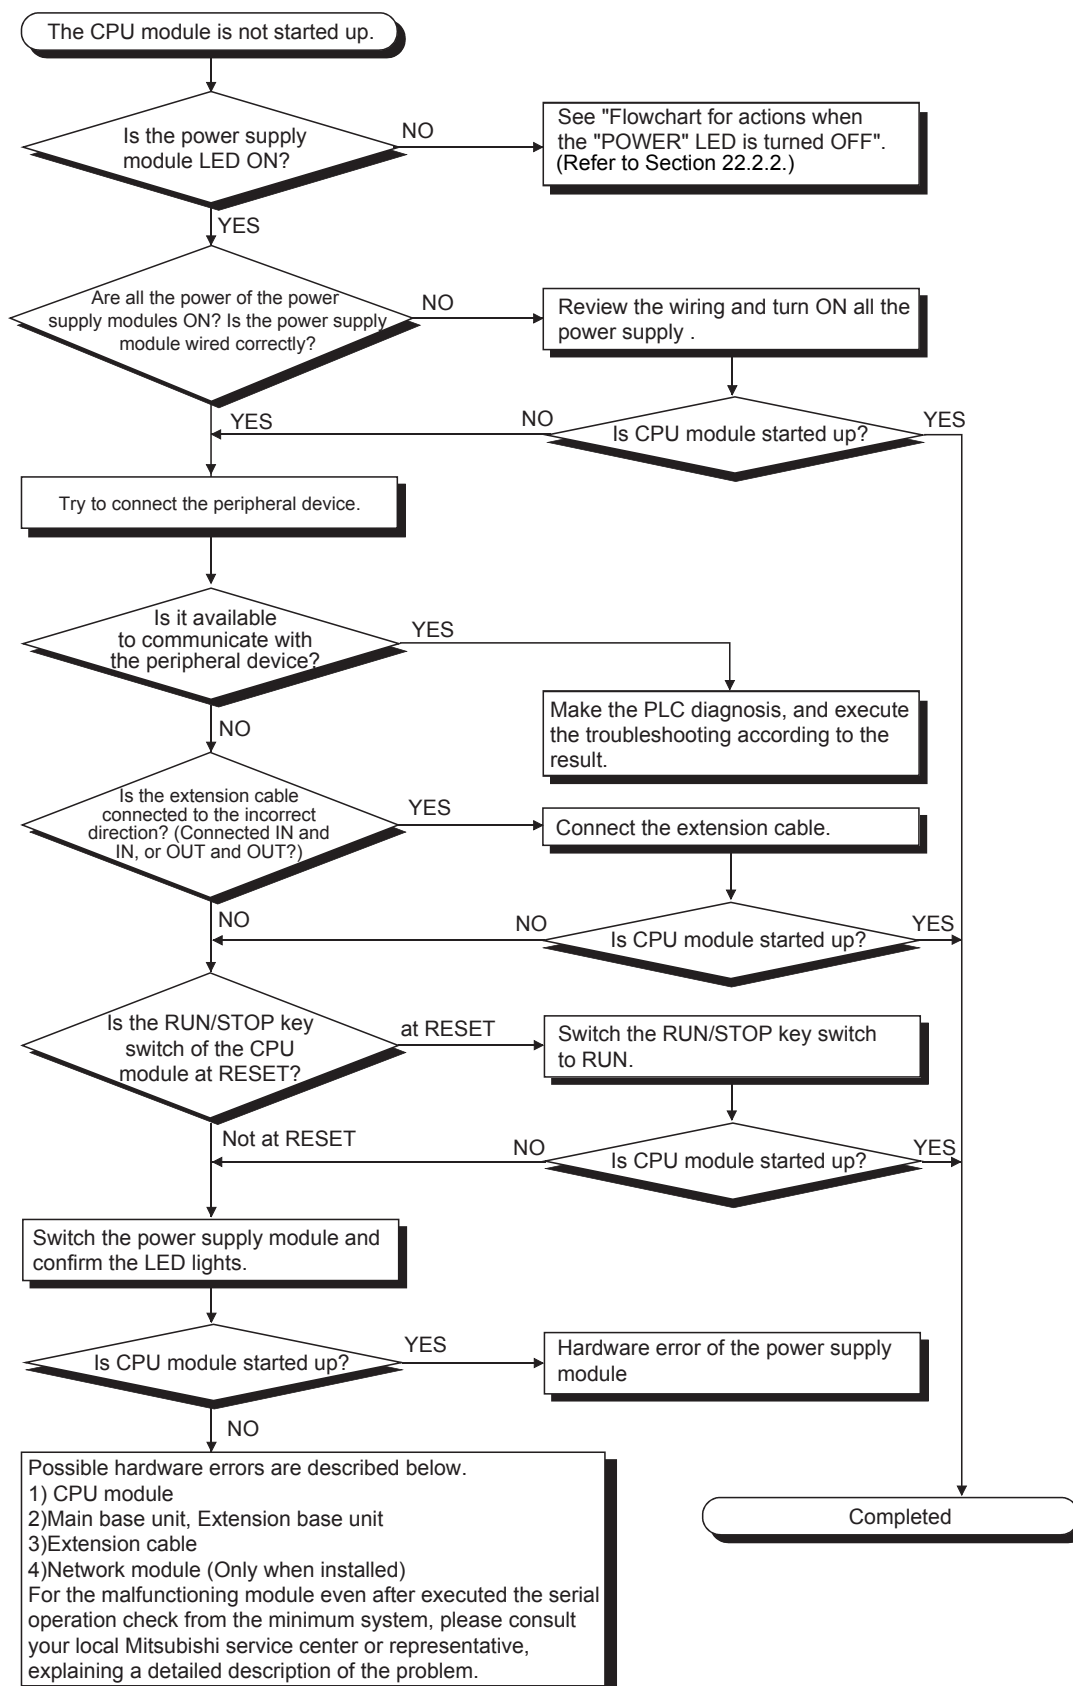

[illegible]

22.3 Error Code List

When an error occurs at PLC power ON, on switching to the RUN status, or during the RUN status, the self-diagnostics function displays the error content (by LED indication, or message display on an LED indicator), and stores the error information at a special relay (SM) and special register (SD).

If an error occurs on a data communication request from peripheral devices, a special function module and the network system to the CPU module, error codes (4000H to 4FFFH) are returned to the request source.

QnACPU errors and corrective actions are described in this section.

(1) How to read the error code lists

The following shows the way of reading the error code lists from Section 22.3.3 (1000 to 1999) to Section 22.3.9 (7000 to 10000).

(a) Error code, common information, and individual information

Alphanumeric characters in the parentheses of the titles indicate the special register numbers where the individual information is stored.

(b) Compatible CPUs

○	: Compatible with all the QnACPU and QCPU.
QCPU	: Compatible with all the Q series CPU module.
Q00J/Q00/Q01	: Compatible with the Basic model QCPU.
Qn(H)	: Compatible with the High Performance model QCPU.
QnPH	: Compatible with the process CPU.
QnPRH	: Compatible with the redundant CPU.
QnA	: Compatible with the QnA series and Q2ASCPU series.
Rem	: Compatible with the MELSECNET/H remote I/O module.
Each CPU module	: Compatible with the listed CPU module. (Example: Q4AR, Q2AS)

22.3.1 Error Codes

There are errors that is detected by the self-diagnostics function of the CPU module, and that is detected while communicating with the CPU module.

The table below shows the link between the type of error detection, the point of error detection and the error codes.

Error Detection Type	Error Detection Point	Error Code	Reference for Error Contents
Detection by the self-diagnostics function of the CPU module	CPU module	1000 to 10000 ^{*1}	Section 22.3.3 to Section 22.3.9
Detection while communicating with the CPU module	CPU module	4000H to 4FFFH	Appendix 5
	Serial communication	7000H to 7FFFH	Serial Communication Module User's Manual
	CC-Link module	B000H to BFFFH	CC-Link System Master/Local Module User's Manual
	Ethernet module	C000H to CFFFH	Ethernet Interface Module User's Manual
	MELSECNET/10 network module	F000H to FFFFH	QnA/Q4AR MELSECNET/10 Network System Reference Manual

^{*1} The error codes of the CPU module are categorizes according to minor errors, moderate errors and major errors.

Minor error: Errors that CPU module such as a battery error continues the operation (Error code: 1300 to 10000)

Moderate error: Errors that CPU module such as a WDT error stops the operation (Error code: 1300 to 10000)

Minor error: Errors that CPU module such as a RAM error stops the operation (Error code: 1000 to 1299)

"The error that the QnACPU continues operation" and "the error that QnACPU stops operation" are determined by "CPU operation status" of the error code list.

22.3.2 Procedure to read an error code

When an error occurs, error codes and error messages can be read with the peripheral devices.

For details on the setting method for each function, refer to the GX Developer Operating Manual or SW□ IVD-GPPQ Operating Manual (Offline).

22.3.3 Error code list (1000 to 1999)

The following shows the error messages from the error code 1000 to 1999, the contents and causes of the errors, and the corrective actions for the errors.

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
1000	MAIN CPU DOWN	—	—	Off	Flicker	Stop	Always	
1010	END NOT EXECUTE	—	—	Off	Flicker	Stop	When an END instruction executed	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 The BAT.ALM LED turns on at BATTERY ERROR.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	1000	Runaway or failure of CPU module or failure of main CPU <ul style="list-style-type: none"> • Malfunctioning due to noise or other reason • Hardware fault 	<ul style="list-style-type: none"> • Take noise reduction measures. • Reset the CPU module and RUN it again. If the same error is displayed again, this suggests a CPU module hardware fault. (Contact your local Mitsubishi representative.) 	QnA
	1010	Entire program was executed without the execution of an END instruction. <ul style="list-style-type: none"> • When the END instruction is executed it is read as another instruction code, e.g. due to noise. • The END instruction has been changed to another instruction code somehow. 	<ul style="list-style-type: none"> • Take noise reduction measures. • Reset the CPU module and RUN it again. If the same error is displayed again, this suggests a CPU module hardware fault. (Contact your local Mitsubishi representative.) 	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
1101	RAM ERROR	—	—	Off	Flicker	Stop	At power ON/ At reset/ When an END instruction executed	
1102							At power ON/ At reset/ When an END instruction executed	
1103							At power ON/ At reset	
1104	RAM ERROR	—	—	Off	Flicker	Stop	At power ON/ At reset	
1105								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 The BAT.ALM LED turns on at BATTERY ERROR.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	1101	The sequence program storing built-in RAM/program memory in the CPU module is faulty.	<ul style="list-style-type: none"> • Take noise reduction measures. • Reset the CPU module and RUN it again. If the same error is displayed again, this suggests a CPU module hardware fault. (Contact your local Mitsubishi representative.) 	QnA
	1102	The work area RAM in the CPU module is faulty.	<ul style="list-style-type: none"> • Take noise reduction measures. • Reset the CPU module and RUN it again. If the same error is displayed again, this suggests a CPU module hardware fault. (Contact your local Mitsubishi representative.) 	QnA
	1103	The device memory in the CPU module is faulty.	<ul style="list-style-type: none"> • Take noise reduction measures. • When indexing is performed, check the value of index register to see if it is within the device range. • Reset the CPU module and RUN it again. If the same error is displayed again, this suggests a CPU module hardware fault. (Contact your local Mitsubishi representative.) 	QnA
	1104	The address RAM in the CPU module is faulty.	<ul style="list-style-type: none"> • Take noise reduction measures. • Reset the CPU module and RUN it again. If the same error is displayed again, this suggests a CPU module hardware fault. (Contact your local Mitsubishi representative.) 	QnA
	1105	The system RAM in the CPU module is faulty.		Q4AR

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
1200	OPE. CIRCUIT ERR.	—	—	Off	Flicker	Stop	At power ON/ At reset	
1201								
1202								
1203	OPE. CIRCUIT ERR.	—	—	Off	Flicker	Stop	When an END instruction executed	
1204								
1205								
1206	OPE. CIRCUIT ERR.	—	—	Off	Flicker	Stop	When instruction executed	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 The BAT.ALM LED turns on at BATTERY ERROR.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	1200	The operation circuit for index modification in the CPU module does not operate normally.	This suggests a CPU module hardware fault. (Contact your local Mitsubishi representative.)	QnA
	1201	The hardware (logic) in the CPU module does not operate normally.		QnA
	1202	The operation circuit for sequence processing in the CPU module does not operate normally.		QnA
	1203	The operation circuit for index modification in the CPU module does not operate normally.		Q4AR
	1204	The hardware (logic) in the CPU module does not operate normally.		Q4AR
	1205	The operation circuit for sequence processing in the CPU module does not operate normally.		QnA
	1206	The DSP operation circuit in the CPU module does not operate normally.		Q4AR

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
1300	FUSE BREAK OFF	Module No. (Slot No.) [For Remote I/O network] Network No./ Station No.	—	Off/ On	Flicker/ On	Stop/ Continue ^{*1}	Always	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 The BAT.ALM LED turns on at BATTERY ERROR.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
1300		There is an output module with a blown fuse.	<ul style="list-style-type: none"> • Check ERR. LED of the output modules and replace the fuse of the module whose LED is lit. • Read the common information of the error using the peripheral device and replace the fuse at the output module corresponding to the numerical value (module No.) reading. Alternatively, monitor special registers SD1300 to SD1331 with the peripheral device and change the fuse of the output module whose bit has a value of "1". • When a GOT is bus-connected to the main base unit or extension base unit, check the connection status of the extension cable and the grounding status of the GOT. 	QnA Q4AR
		<ul style="list-style-type: none"> • There is an output module with a blown fuse. • External power supply for output load is turned off or disconnected. 	<ul style="list-style-type: none"> • Check ERR. LED of the output modules and replace the module whose LED is lit. • Read the common information of the error using the peripheral device and replace the fuse at the output module corresponding to the numerical value (module No.) reading. Alternatively, monitor special registers SD1300 to SD1331 with the peripheral device and change the fuse of the output module whose bit has a value of "1". • Check whether the external power supply for output load is ON or OFF. • When a GOT is bus-connected to the main base unit or extension base unit, check the connection status of the extension cable and the earth status of the GOT. 	Q2AS

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
1310	I/O INT. ERROR	—	—	Off	Flicker	Stop	During interrupt	
1401	SP. UNIT DOWN	Module No. (Slot No.)	—	Off	Flicker	Stop*2	At power ON/ At reset	
1402	SP. UNIT DOWN	Module No. (Slot No.)	Program error location	Off	Flicker	Stop	During execution of FROM/TO instruction set	
1411	CONTROL-BUS. ERR.	Module No. (Slot No.)	—	Off	Flicker	Stop	At power ON/ At reset	
1412	CONTROL-BUS. ERR.	Module No. (Slot No.)	Program error location	Off	Flicker	Stop	During execution of FROM/TO instruction set	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 The BAT.ALM LED turns on at BATTERY ERROR.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	1310	An interruption has occurred although there is no interrupt module.	Any of the mounted modules is experiencing a hardware fault. Therefore, check the mounted modules and change the faulty module. (Contact your local Mitsubishi representative.)	QnA
	1401	When PLC parameter I/O allocation was being made, there was no return signal from the special function module during initial processing stage.(When error is generated, the head I/O number of the special function module that corresponds to the common information is stored.)	The CPU module, base unit and/or the special function module that was accessed is experiencing a hardware fault. (Contact your local Mitsubishi representative.)	QnA
	1402	The special function module was accessed during the execution of a FROM/TO instruction set, but there was no response. (When an error is generated, the program error location corresponding to the individual information is stored.)	The CPU module, base unit and/or the special function module that was accessed is experiencing a hardware fault.(Contact your local Mitsubishi representative.)	QnA
	1411	When performing a parameter I/O allocation the intelligent function module/special function module could not be accessed during initial communications. (On error occurring, the head I/O number of the corresponding intelligent function module/special function module is stored in the common information.)	Reset the CPU module and RUN it again. If the same error is displayed again, the intelligent function module/special function module, CPU module or base unit is faulty. (Contact your local Mitsubishi representative.)	QnA
	1412	The FROM/TO instruction is not executable, due to a control bus error with the intelligent function module/special function module. (On error occurring, the program error location is stored in the individual information.)		QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
1421	SYS. UNIT DOWN	—	—	Off	Flicker	Stop	Always	
1500	AC/DC DOWN	—	—	On	Off	Continue	Always	
1510	DUAL DC DOWN 5V	—	—	On	On	Continue	Always	
1520	DC DOWN 5V	—	—	Off	Flicker	Stop	Always	
1530	DC DOWN 24V	—	—	On	On	Continue	Always	
1600	BATTERY ERROR*2	Drive Name	—	On	Off	Continue	Always	
1601								
1602					On			

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 The BAT.ALM LED turns on at BATTERY ERROR.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	1421	Hardware fault at the system management module AS92R.	This suggests a system management module AS92R hardware fault. (Contact your local Mitsubishi representative.)	Q4AR
	1500	<ul style="list-style-type: none"> • A momentary power supply interruption has occurred. • The power supply went off. 	Check the power supply.	QnA
	1510	The power supply voltage (100 to 240VAC) of either of the two power supply modules on the power supply duplexing extension base unit dropped to or below 85% of the rated voltage. (This can be detected from the control system of the redundant system.)	Check the supply voltage of the power supply module. If the voltage is abnormal then replace the power supply module.	Q4AR
	1520	The voltage(100 to 240VAC) of the power supply module on the extension base unit dropped to or below 85% of the rated voltage. (This can be detected from the control system of the stand-alone system or redundant system.)	Check the supply voltage of the power supply module. If the voltage is abnormal then replace the power supply module.	Q4AR
	1530	The 24 VDC power supplied to the system management module AS92R has dropped below 90% of the rated voltage. (This can be detected from the control system or standby system of the redundant system.)	Check the 24VDC power supplied to the system management module AS92R.	Q4AR
	1600	<ul style="list-style-type: none"> • The battery voltage in the CPU module has dropped below stipulated level. • The lead connector of the CPU module battery is not connected. 	<ul style="list-style-type: none"> • Change the battery. • If the battery is for program memory, standard RAM or for the back-up power function, install a lead connector. 	QnA
	1601	Voltage of the battery on memory card 1 has dropped below stipulated level.	Change the battery.	QnA
	1602	Voltage of the battery on memory card 2 has dropped below stipulated level.	Change the battery.	QnA

22.3.4 Error code list (2000 to 2999)

The following shows the error messages from the error code 2000 to 2999, the contents and causes of the errors, and the corrective actions for the errors.

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
2000	UNIT VERIFY ERR.	Module No. (Slot No.) [For Remote I/ O network] Network No./ Station No.	—	Off/ On	Flicker/ On	Stop/ Continue ^{*1}	When an END instruction executed	
2100	SP. UNIT LAY ERR.	Module No. (Slot No.)	—	Off	Flicker	Stop	At power ON/ At reset	
2101	SP. UNIT LAY ERR.	Module No. (Slot No.)	—	Off	Flicker	Stop	At power ON/ At reset	
2102								
2103	SP. UNIT LAY ERR.	Module No. (Slot No.)	—	Off	Flicker	Stop	At power ON/ At reset	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 Either error stop or continue can be selected for each module by the parameters.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	2000	<p>I/O module information power ON is changed.</p> <ul style="list-style-type: none"> I/O module (or special function module) not installed properly or installed on the base unit. 	<ul style="list-style-type: none"> Read the common information of the error using the peripheral device, and check and/or change the module that corresponds to the numerical value (module number) there. Alternatively, monitor the special registers SD1400 to SD1431 at a peripheral device, and change the fuse at the output module whose bit has a value of "1". When a GOT is bus-connected to the main base unit or extension base unit, check the connection status of the extension cable and the grounding status of the GOT. 	QnA
	2100	In PLC parameter I/O allocation settings, a special function module was allocated to a location reserved for an I/O module. Or, the opposite has happened.	Reset the PLC parameter I/O allocation setting to conform with the actual status of the special function modules.	QnA
	2101	13 or more special function modules (not counting the A(1S)I61) capable of sending an interrupt to the CPU module have been installed.	Keep the number of special function modules that can initiate an interrupt (with the exception of the A(1S)I61 module) to 12 or fewer.	QnA
	2102	Seven or more serial communication modules (excludes A(1S)J71QC24) have been installed.	Keep the number of serial communication modules (excludes A(1S)J71QU24) installed to six or fewer.	QnA
	2103	Two or more A(1S)I61 interrupt modules have been mounted.	Install only 1 A(1S)I61 module.	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
2104	SP. UNIT LAY ERR.	Module No. (Slot No.)	—	Off	Flicker	Stop	At power ON/ At reset	
2105								
2106	SP. UNIT LAY ERR.	Module No. (Slot No.)	—	Off	Flicker	Stop	At power ON/ At reset	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 Either error stop or continue can be selected for each module by the parameters.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU																					
	2104	At the MELSECNET/MINI auto refresh network parameter settings, the module allocation that was set is different from the actual module models at the station numbers in the link system.	Reset the network parameter MELSECNET/MINI auto refresh unit module allocation setting so that it conforms to the station number of the module that is actually linked.	QnA																					
	2105	<p>There are too many special function modules that can use dedicated instructions allocated (number of modules installed). (The total of the figures indicated below is above 1344.)</p> <table><tr><td>(AD59</td><td>modules installed × 5)</td></tr><tr><td>(AD57(S1)/AD58</td><td>modules installed × 8)</td></tr><tr><td>(AJ71C24(S3/S6/S8)</td><td>modules installed × 10)</td></tr><tr><td>(AJ71UC24</td><td>modules installed × 10)</td></tr><tr><td>(AJ71C21(S1)</td><td>modules installed × 29)</td></tr><tr><td>(AJ71PT32-S3/AJ71T32-S3</td><td>modules installed × 125) *</td></tr><tr><td>(AJ71QC24(R2,R4)</td><td>modules installed × 29)</td></tr><tr><td>(AJ71ID1(2)-R4</td><td>modules installed × 8)</td></tr><tr><td>+(AD75</td><td>modules installed × 12)</td></tr><tr><td colspan="2"><hr/></td></tr><tr><td colspan="2">total > 1344</td></tr></table> <p>*: When the expansion mode is used.</p>	(AD59		modules installed × 5)	(AD57(S1)/AD58	modules installed × 8)	(AJ71C24(S3/S6/S8)	modules installed × 10)	(AJ71UC24	modules installed × 10)	(AJ71C21(S1)	modules installed × 29)	(AJ71PT32-S3/AJ71T32-S3	modules installed × 125) *	(AJ71QC24(R2,R4)	modules installed × 29)	(AJ71ID1(2)-R4	modules installed × 8)	+(AD75	modules installed × 12)	<hr/>		total > 1344	
(AD59	modules installed × 5)																								
(AD57(S1)/AD58	modules installed × 8)																								
(AJ71C24(S3/S6/S8)	modules installed × 10)																								
(AJ71UC24	modules installed × 10)																								
(AJ71C21(S1)	modules installed × 29)																								
(AJ71PT32-S3/AJ71T32-S3	modules installed × 125) *																								
(AJ71QC24(R2,R4)	modules installed × 29)																								
(AJ71ID1(2)-R4	modules installed × 8)																								
+(AD75	modules installed × 12)																								
<hr/>																									
total > 1344																									
	2106	<ul style="list-style-type: none">• Five or more AJ71QLP21 & AJ71QBR11 modules are installed.• Three or more AJ71AP21/R21 & AJ71AT21B modules are installed.• The total number of installed AJ71QLP21, AJ71QBR11, AJ71AP21/R21, and AJ71AT21B modules exceeds five.• The same network numbers or identical station numbers exist in the MELSECNET/10 network system.• Two or more master or load stations exist simultaneously at the MELSECNET(II) or MELSECNET/B data link system.	<ul style="list-style-type: none">• Reduce the AJ71QLP21 and AJ71QBR11 modules to four or less.• Reduce the AJ71AP21/R21 and AJ71AT21B modules to two or less.• Reduce the AJ71QLP21, AJ71QBR11, AJ71AP21/R21 and AJ71AT21B modules to a total of four or less.• Check the network Nos. and station Nos.• Check the station Nos.	QnA																					

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
2107	SP. UNIT LAY ERR.	Module No. (Slot No.)	—	Off	Flicker	Stop	At power ON/ At reset	
2108						Stop/ Continue ^{*2}		
2109								
2110	SP. UNIT ERROR	Module No. (Slot No.)	Program error location	Off/ On	Flicker/ On	Stop/ Continue ^{*1}	When instruction executed	
2111								
2112	SP. UNIT ERROR	Module No. (Slot No.)	Program error location	Off/ On	Flicker/ On	Stop/ Continue ^{*1}	When instruction executed/ STOP → RUN	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 Either error stop or continue can be selected for each module by the parameters.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	2107	The start X/Y set in the PLC parameter's I/O assignment settings is overlapped with the one for another module.	Make the PLC parameter's I/O assignment setting again so it is consistent with the actual status of the special function modules.	QnA
	2108	A(1S)J71LP21 or A(1S)J71BR11 for use with the AnUCPU network module has been installed.	Replace the network module to A(1S)J71QLP21 or A(1S)J71QBR11.	QnA
	2109	The control system and standby system module configurations are different when a redundant system is in the backup mode.	Check the module configuration of the standby system.	Q4AR
	2110	<ul style="list-style-type: none"> The location designated by the FROM/TO instruction set is not the special function module. The module that does not include buffer memory has been specified by the FROM/TO instruction. The special function module, Network module being accessed is faulty. Station not loaded was specified using the instruction whose target was the CPU share memory. 	<ul style="list-style-type: none"> Read the individual information of the error using the GX Developer, check the FROM/TO instruction that corresponds to that numerical value (program error location), and correct when necessary. The special function module that was accessed is experiencing a hardware fault. Therefore, change the faulty module. Alternatively, contact your local Mitsubishi representative. 	QnA
	2111	<ul style="list-style-type: none"> The location designated by a link direct device (J□\□) is not a network module. The I/O module (special function module) was nearly removed, completely removed, or mounted during running. 		QnA
	2112	<ul style="list-style-type: none"> The module other than special function module is specified by the special function module dedicated instruction. Or, it is not the corresponding special function module. The module model specified by the special function module dedicated instruction and that specified by the parameter I/O assignment is different. 	<ul style="list-style-type: none"> Read the individual information of the error using a peripheral device, and check the special function module dedicated instruction (network instruction) that corresponds to the value (program error part) to make modification. Set the module model by PLC parameter I/O assignment according to the special function module dedicated instruction setting. Example) Although AJ71QC24N is used actually, AJ71QC24 is set. 	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
2113	SP. UNIT ERROR	FFFF _H (fixed)	Program error location	Off/On	Flicker/On	Stop/Continue ^{*2}	When instruction executed/ STOP → RUN	
2210	BOOT ERROR	Drive name	—	Off	Flicker	Stop	At power ON/ At reset	
2300	ICM. OPE. ERROR	Drive name	—	Off/On	Flicker/On	Stop/Continue ^{*1}	When memory card is inserted or removed	
2301								
2302								
2400	FILE SET ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ At PLC writing	

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 Either error stop or continue can be selected for each module by the parameters.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	2113	Data of special function module to be simulated is not set in the simulation data.	Read the individual information of the error using a peripheral device, and check the special function module / special function module dedicated instruction (network instruction) that corresponds to the value (program error part) to make modification.	QnA
	2210	There is no boot file in the drive designated by the parameter enabled drive switch even though the Boot DIP switch is ON.	Check and correct the valid parameter drive settings made by the DIP switches. Set the boot file to the drive specified by the parameter drive DIP switches.	QnA
	2300	<ul style="list-style-type: none"> • A memory card was removed without switching the memory card in/out switch OFF. • The memory card in/out switch is turned ON although a memory card is not actually installed. 	<ul style="list-style-type: none"> • Remove memory card after placing the memory card in/out switch OFF. • Turn on the card insert switch after inserting a memory card. 	QnA
	2301	<ul style="list-style-type: none"> • The memory card has not been formatted. • Memory card format status is incorrect. 	<ul style="list-style-type: none"> • Format memory card. • Reformat memory card. 	QnA
	2302	A memory card that cannot be used with the CPU module has been installed.	<ul style="list-style-type: none"> • Format memory card. • Reformat memory card. • Check memory card. 	QnA
	2400	The file designated at the PLC file settings in the parameters cannot be found.	<ul style="list-style-type: none"> • Read the individual information of the error using peripheral device, check to be sure that the parameter drive name and file name correspond to the numerical values there (parameter number), and correct. • Create a file created using parameters, and load it to the CPU module. 	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
2401	FILE SET ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ At PLC writing	
2402								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 Either error stop or continue can be selected for each module by the parameters.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	2401	The file specified by parameters cannot be made.	<ul style="list-style-type: none">• Read the individual information of the error using the peripheral device, check to be sure that the parameter drive name and file name correspond to the numerical values there (parameter number), and correct.• Check the space remaining in the memory card.	QnA
	2402	Though the file register has been set in the pairing setting/tracking setting, the file register does not exist.	Confirm the file register and parameter.	Q4AR

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
2410	FILE OPE. ERROR	File name/ Drive name	Program error location	Off/ On	Flicker/ On	Stop/ Continue ^{*1}	When instruction executed	
2411								
2412								
2413								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 Either error stop or continue can be selected for each module by the parameters.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	2410	<ul style="list-style-type: none"> The specified program does not exist in the program memory. This error may occur when the ECALL, EFCALL, PSTOP, PSCAN, POFF or PLOW instruction is executed. The specified file does not exist. 	<ul style="list-style-type: none"> Read the individual information of the error using the peripheral device, check to be sure that the program corresponds to the numerical values there (program location), and correct. Create a file created using parameters, and load it to the CPU module. In case a specified file does not exist, write the file to a target memory and/or check the file specified with the instruction again. 	QnA
	2411	<ul style="list-style-type: none"> The file is the one which cannot be specified by the sequence program (such as comment file). The specified program exists in the program memory, but has not been registered in the program setting of the Parameter dialog box. This error may occur when the ECALL, EFCALL, PSTOP, PSCAN or POFF instruction is executed. 	Read the individual information of the error using the peripheral device, check to be sure that the program corresponds to the numerical values there (program location), and correct.	QnA
	2412	The SFC program file is one that cannot be designated by the sequence program.	Read the individual information of the error using the peripheral device, check to be sure that the program corresponds to the numerical values there (program location), and correct.	QnA
	2413	No data has been written to the file designated by the sequence program.	Read the individual information of the error using the peripheral device, check to be sure that the program corresponds to the numerical values there (program location), and correct. Check to ensure that the designated file has not been write protected.	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
2500	CAN'T EXE. PRG.	File name/ Drive name	—	Off	Flicker	Stop	At power ON/ At reset	
2501								
2502								
2503								
2504								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

*2 Either error stop or continue can be selected for each module by the parameters.

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	2500	<ul style="list-style-type: none"> • There is a program file that uses a device that is out of the range set in the PLC parameter device setting. • After the PLC parameter setting is changed, only the parameter is written into the PLC. 	<ul style="list-style-type: none"> • Read the common information of the error using the peripheral device, check to be sure that the parameter device allocation setting and the program file device allocation correspond to the numerical values there (file name), and correct if necessary. • If PLC parameter device setting is changed, batch-write the parameter and program file into the PLC. 	QnA
	2501	There are multiple program files although "none" has been set at the PLC parameter program settings.	Edit the PLC parameter program setting to "yes". Alternatively, delete unneeded programs.	QnA
	2502	The program file is incorrect. Alternatively, the file contents are not those of a sequence program.	Check whether the program version is * * *.QPG, and check the file contents to be sure they are for a sequence program.	QnA
	2503	There are no program files at all.	<ul style="list-style-type: none"> • Check program configuration. • Check parameters and program configuration. 	QnA
	2504	Two or more SFC normal programs or control programs have been designated.		QnA

22.3.5 Error code list (3000 to 3999)

The following shows the error messages from the error code 3000 to 3999, the contents and causes of the errors, and the corrective actions for the errors.

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
3000	PARAMETER ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN/ At PLC writing	
3001								
3002	PARAMETER ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN/ At PLC writing	
3003	PARAMETER ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power-On/ At reset/ STOP→RUN/ At PLC writing	

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	3000	The PLC parameter settings for timer time limit setting, the RUN-PAUSE contact, the common pointer number, general data processing, number of empty slots, system interrupt settings, baud rate setting, and service processing setting are outside the range that can be used by the CPU module.	<ul style="list-style-type: none"> • Read the individual information of the error using the peripheral device, check the parameter item corresponding to the numerical value (parameter No.), and correct it. • Rewrite corrected parameters to the CPU module, reload the CPU power supply and/or reset the module. • If the same error occurs, it is thought to be a hardware error. (Contact your local Mitsubishi representative.) 	QnA
		The parameter settings in the error individual information (special register SD16) are illegal.		QnA
	3001	The parameter settings are corrupted.		QnA
	3002	When "Use the following file" is selected for the file register in the PLC file setting of the PLC parameter dialog box, the specified file does not exist although the file register capacity has been set.	<ul style="list-style-type: none"> • Read the individual information of the error using the peripheral device, check the parameter item corresponding to the numerical value (parameter No.), and correct it. • Rewrite corrected parameters to the CPU module, reload the CPU power supply and/or reset the module. • If the same error occurs, it is thought to be a hardware error. (Contact your local Mitsubishi representative.) 	QnA
	3003	The number of devices set at the PLC parameter device settings exceeds the possible CPU module range.	<ul style="list-style-type: none"> • Read the individual information of the error using the peripheral device, check the parameter item corresponding to the numerical value (parameter No.), and correct it. • If the error is still generated following the correction of the parameter settings, the possible cause is the memory error of the CPU module's built-in RAM or program memory or the memory card. (Contact your local Mitsubishi representative.) 	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
3004	PARAMETER ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power-On/ At reset/ STOP→RUN/ At PLC writing	
3100	LINK PARA. ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN	
3101	LINK PARA. ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN	
3102	LINK PARA. ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN	

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	3004	The parameter file is incorrect. Alternatively, the contents of the file are not parameters.	Check whether the parameter file version is * * *.QPA, and check the file contents to be sure they are parameters.	QnA
	3100	Although the QnACPU is a control station or master station, the network parameters have not been written.	<ul style="list-style-type: none"> • Correct and write the network parameters. • If the error occurs after correction, it suggests a hardware fault. (Contact your local Mitsubishi representative.) 	QnA
	3101	<ul style="list-style-type: none"> • The network No. specified by a network parameter is different from that of the actually mounted network. • The head I/O No. specified by a network parameter is different from that of the actually mounted I/O unit. • The network class specified by a network parameter is different from that of the actually mounted network. • The network refresh parameter of the MELSECNET/10 is out of the specified area. 	<ul style="list-style-type: none"> • Check the network parameters and mounting status, and if they differ, match the network parameters and mounting status. If any network parameter has been corrected, write it to the CPU module. • Confirm the setting of the number of extension stages of the extension base units. • Check the connection status of the extension base units and extension cables. When the GOT is bus-connected to the main base unit and extension base units, also check their connection status. • If the error occurs after the above checks, the cause is a hardware fault. (Contact your local Mitsubishi representative, explaining a detailed description of the problem.) 	QnA
	3102	<ul style="list-style-type: none"> • The network module detected a network parameter error. 	<ul style="list-style-type: none"> • Correct and write the network parameters. • If the error occurs after correction, it suggests a hardware fault. (Contact your local Mitsubishi representative.) 	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
3103	LINK PARA. ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN	
3104	LINK PARA. ERROR	File name/ Drive name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN	
3105								
3107	LINK PARA. ERROR	File name	Parameter number	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN	

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	3103	<ul style="list-style-type: none"> Although the number of modules has been set to one or greater number in the Ethernet module count parameter setting, the number of actually mounted module is zero. The start I/O No. of the Ethernet network parameter differs from the I/O No. of the actually mounted module. 	<ul style="list-style-type: none"> Correct and write the network parameters. If the error occurs after correction, it suggests a hardware fault. (Contact your local Mitsubishi representative.) 	QnA
		<ul style="list-style-type: none"> AJ71QE71 does not exist in the position of I/O number set by the parameter. I/O number designation is overlapping. Numbers of the network parameter and loaded AJ71QE71 are different. Ethernet (parameter + dedicated instruction) is set to more than five. 		QnA
	3104	<ul style="list-style-type: none"> The Ethernet and MELSECNET/10 use the same network number. The network number, station number or group number set in the network parameter is out of range. The specified I/O number is outside the range of the used CPU module. The Ethernet-specific parameter setting is not normal. 	<ul style="list-style-type: none"> Correct and write the network parameters. If the error occurs after correction, it suggests a hardware fault. (Contact your local Mitsubishi representative.) 	QnA
	3105	The contents of the Ethernet parameter are incorrect.	Write after correcting parameters.	QnA
	3107	<ul style="list-style-type: none"> The CC-Link parameter setting is incorrect. The set mode is not allowed for the version of the mounted CC-Link module. 	Check the parameter setting.	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
3200	SFC PARA. ERROR	File name	Parameter number	Off	Flicker	Stop	STOP→RUN	
3201								
3202								
3203								

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	3200	The parameter setting is illegal. • Though Block 0 was set to "Automatic start" in the SFC setting of the PLC parameter dialog box, Block 0 does not exist.	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	3201	The block parameter setting is illegal.		QnA
	3202	The number of step relays specified in the device setting of the PLC parameter dialog box is less than that used in the program.		QnA
	3203	The execution type of the SFC program specified in the program setting of the PLC parameter dialog box is other than scan execution.		QnA

22.3.6 Error code list (4000 to 4999)

The following shows the error messages from the error code 4000 to 4999, the contents and causes of the errors, and the corrective actions for the errors.

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
4000	INSTRCT. CODE ERR	Program error location	—	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN When instruction executed	
4001								
4002								
4003								
4004								
4010	MISSING END INS.	Program error location	—	Off	Flicker	Stop	At power ON/ At reset/ STOP→RUN	
4020	CAN'T SET(P)	Program error location	—	Off	Flicker	Stop		
4021								
4030	CAN'T SET(I)	Program error location	—	Off	Flicker	Stop		

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	4000	<ul style="list-style-type: none"> The program contains an instruction code that cannot be decoded. An unusable instruction is included in the program. 	Read the common information of the error using a peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4001	The program contains a dedicated instruction for SFC although it is not an SFC program.		QnA
	4002	<ul style="list-style-type: none"> The name of dedicated instruction specified by the program is incorrect. The dedicated instruction specified by the program cannot be executed by the specified module. 		QnA
	4003	The number of devices for the dedicated instruction specified by the program is incorrect.		
	4004	The device which cannot be used by the dedicated instruction specified by the program is specified.		
	4010	There is no END (FEND) instruction in the program.		QnA
	4020	The total number of internal file pointers used by the program exceeds the number of internal file pointers set in the parameters.		QnA
	4021	<ul style="list-style-type: none"> The common pointer Nos. assigned to files overlap. The local pointer Nos. assigned to files overlap. 		QnA
	4030	The allocation pointer Nos. assigned by files overlap.		

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
4100	OPERATION ERROR	Program error location	—	Off/On	Flicker/On	Stop/Continue ^{*1}	When instruction executed	
4101								
4102	OPERATION ERROR	Program error location	—	Off/On	Flicker/On	Stop/Continue ^{*1}	When instruction executed	
4103								
4104								
4107								

^{*1} CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	4100	The instruction cannot process the contained data.	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4101	<ul style="list-style-type: none"> • The number of setting data dealt with the instruction exceeds the applicable range. • The storage data and constant of the device specified by the instruction exceeds the applicable range. • When writing to the host CPU shared memory, the write prohibited area is specified for the write destination address. • The range of storage data of the device specified by the instruction is duplicated. • The device specified by the instruction exceeds the range of the number of device points. • The interrupt pointer No. specified by the instruction exceeds the applicable range. 	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4102	<ul style="list-style-type: none"> • The network No. or station No. specified for the dedicated instruction is wrong. • The link direct device (J□\□) setting is incorrect. • The module No./ network No./number of character strings exceeds the range that can be specified. 	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4103	The configuration of the PID dedicated instruction is incorrect.		QnA
	4104	The number of settings is beyond the range.	Read the common information of the error using peripheral device, and check and correct the program corresponding to that value (program error location).	Q4AR
	4107	Numbers of execution to the CC-Link instruction are beyond 32.	Set the numbers of execution to the CC-Link instruction to 32 or less.	QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
4108	OPERATION ERROR	Program error location	—	Off/On	Flicker/On	Stop/Continue ^{*1}	When instruction executed	
4200	FOR NEXT ERROR	Program error location	—	Off	Flicker	Stop	When instruction executed	
4201	FOR NEXT ERROR	Program error location	—	Off	Flicker	Stop	When instruction executed	
4202								
4203								
4210	CAN'T EXECUTE(P)	Program error location	—	Off	Flicker	Stop	When instruction executed	
4211								
4212								
4213								
4220	CAN'T EXECUTE(I)	Program error location	—	Off	Flicker	Stop	When instruction executed	
4221								
4223								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	4108	The CC-Link parameter is not set when the CC-Link instruction is executed.	Execute the CC-Link instruction after setting the CC-Link parameter.	QnA
	4200	No NEXT instruction was executed following the execution of a FOR instruction. Alternatively, there are fewer NEXT instructions than FOR instructions.	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4201	A NEXT instruction was executed although no FOR instruction has been executed. Alternatively, there are more NEXT instructions than FOR instructions.		QnA
	4202	More than 16 nesting levels are programmed.		QnA
	4203	A BREAK instruction was executed although no FOR instruction has been executed prior to that.	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4210	The CALL instruction is executed, but there is no subroutine at the specified pointer.		QnA
	4211	There was no RET instruction in the executed subroutine program.		QnA
	4212	The RET instruction exists before the FEND instruction of the main routine program.		QnA
	4213	More than 16 nesting levels are programmed.	Keep nesting levels at 16 or under.	QnA
	4220	Though an interrupt input occurred, the corresponding interrupt pointer does not exist.	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4221	An IRET instruction does not exist in the executed interrupt program.		QnA
	4223	The IRET instruction exists before the FEND instruction of the main routine program.		QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
4230	INST. FORMAT ERR.	Program error location	—	Off	Flicker	Stop	When instruction executed	
4231								
4235								
4300	EXTEND INST. ERR.	Program error location	—	Off/On	Flicker/On	Stop/Continue ^{*1}	When instruction executed	
4301								
4400	SFCP. CODE ERROR	Program error location	—	Off	Flicker	Stop	STOP→RUN	
4410	CAN'T SET(BL)	Program error location	—	Off	Flicker	Stop	STOP→RUN	
4411								
4420	CAN'T SET(S)	Program error location	—	Off	Flicker	Stop	STOP→RUN	
4421	CAN'T SET(S)	Program error location	—	Off	Flicker	Stop	STOP→RUN	
4422								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	4230	The number of CHK and CHKEND instructions is not equal.	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4231	The number of IX and IXEND instructions is not equal.		QnA
	4235	The configuration of the check conditions for the CHK instruction is incorrect. Alternatively, a CHK instruction has been used in a low speed execution type program.		QnA
	4300	The designation of a MELSECNET/ MINI-S3 master module control instruction was wrong.	Read the common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4301	The designation of an AD57/AD58 control instruction was wrong.		QnA
	4400	No SFCP or SFCPEND instruction in SFC program.	Write the program to the CPU module again using GX Developer.	QnA
	4410	The block number designated by the SFC program exceeds the range.		QnA
	4411	Block number designations overlap in SFC program.		QnA
	4420	A step number designated in an SFC program exceeds the range.		QnA
	4421	Total number of steps in all SFC programs exceed the maximum.		QnA
	4422	Step number designations overlap in SFC program.		QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
4500	SFCP. FORMAT ERR.	Program error location	—	Off	Flicker	Stop	STOP→RUN	
4501								
4502								
4503								
4504								
4600	SFCP. OPE. ERROR	Program error location	—	Off/ On	Flicker/ On	Stop/ Continue*1	When instruction executed	
4601								
4602								
4610	SFCP. EXE. ERROR	Program error location	—	On	On	Continue	STOP→RUN	
4611								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	4500	The numbers of BLOCK and BEND instructions in an SFC program are not equal.	Write the program to the CPU module again using the peripheral device.	QnA
	4501	The configuration of the STEP* to TRAN* to TSET to SEND instructions in the SFC program is incorrect.		QnA
	4502	The structure of the SFC program is illegal. • STEP1* instruction does not exist in the block of the SFC program.		QnA
	4503	The structure of the SFC program is illegal. • The step specified in the TSET instruction does not exist. • In jump transition, the host step number was specified as the destination step number.	• Write the program to the CPU module again using GX Developer. • Read the common information of the error using GX Developer, and check and correct the error step corresponding to that value (program error location).	QnA
	4504	The structure of the SFC program is illegal. • The step specified in the TAND instruction does not exist.	Write the program to the CPU module again using GX Developer.	QnA
	4600	The SFC program contains data that cannot be processed.	Read common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4601	Exceeds device range that can be designated by the SFC program.		QnA
	4602	The START instruction in an SFC program is preceded by an END instruction.		QnA
	4610	The active step information at presumptive start of an SFC program is incorrect.	Read common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem. The program is automatically subjected to an initial start.	QnA
	4611	Key-switch was reset during RUN when presumptive start was designated for SFC program.		QnA

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
4620	BLOCK EXE. ERROR	Program error location	—	Off	Flicker	Stop	When instruction executed	
4621								
4630	STEP EXE. ERROR	Program error location	—	Off	Flicker	Stop	When instruction executed	
4631								
4632								
4633								

*1 CPU operation can be set in the parameters at error occurrence. (LED indication varies.)

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	4620	Startup was executed at a block in the SFC program that was already started up.	Read common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4621	Startup was attempted at a block that does not exist in the SFC program.	<ul style="list-style-type: none"> • Read the common information of the error using GX Developer, and check and correct the error step corresponding to that value (program error location). • Turn ON if the special relay SM321 is OFF. 	QnA
	4630	Startup was executed at a block in the SFC program that was already started up.	Read common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4631	<ul style="list-style-type: none"> • Startup was attempted at the step that does not exist in the SFC program. Or, the step that does not exist in the SFC program was specified for end. • Forced transition was executed based on the transition condition that does not exist in the SFC program. Or, the transition condition for forced transition that does not exist in the SFC program was canceled. 	<ul style="list-style-type: none"> • Read the common information of the error using the peripheral device, and check and correct the error step corresponding to that value (program error location). • Turn ON if the special relay SM321 is OFF. 	QnA
	4632	There were too many simultaneous active steps in blocks that can be designated by the SFC program.	Read common information of the error using the peripheral device, check error step corresponding to its numerical value (program error location), and correct the problem.	QnA
	4633	There were too many simultaneous active steps in all blocks that can be designated.		QnA

22.3.7 Error code list (5000 to 5999)

The following shows the error messages from the error code 5000 to 5999, the contents and causes of the errors, and the corrective actions for the errors.

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
5000	WDT ERROR	Time (value set)	Time (value actually measured)	Off	Flicker	Stop	Always	
5001	WDT ERROR	Time (value set)	Time (value actually measured)	Off	Flicker	Stop	Always	
5010	PRG. TIME OVER	Time (value set)	Time (value actually measured)	On	On	Continue	Always	
5011								

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	5000	<ul style="list-style-type: none"> The scan time of the initial execution type program exceeded the initial execution monitoring time specified in the PLC RAS setting of the PLC parameter. 	<ul style="list-style-type: none"> Read the individual information of the error from the peripheral device, check its value (time), and shorten the scan time. Change the initial execution monitoring time or the WDT value in the PLC RAS setting of the PLC parameter. Resolve the endless loop caused by jump transition. 	QnA
	5001	<ul style="list-style-type: none"> The scan time of the program exceeded the WDT value specified in the PLC RAS setting of the PLC parameter. 	<ul style="list-style-type: none"> Read the individual information of the error using the peripheral device, check its value (time), and shorten the scan time. Change the initial execution monitoring time or the WDT value in the PLC RAS setting of the PLC parameter. Resolve the endless loop caused by jump transition. 	QnA
	5010	The program scan time exceeded the constant scan setting time specified in the PLC RAS setting of the PLC parameter.	<ul style="list-style-type: none"> Review the constant scan setting time. Review the constant scan setting time and low speed program execution time in the PLC parameter so that the excess time of constant scan can be fully secured. 	QnA
		The low speed program execution time specified in the PLC RAS setting of the PLC parameter exceeded the excess time of the constant scan.		QnA
	5011	The scan time of the low speed execution type program exceeded the low speed execution watch time specified in the PLC RAS setting of the PLC parameter dialog box.	Read the individual information of the error using the peripheral device, check the numerical value (time) there, and shorten scan time if necessary. Change the low speed execution watch time in the PLC RAS setting of the PLC parameter dialog box.	QnA

22.3.8 Error code list (6000 to 6999)

The following shows the error messages from the error code 6000 to 6999, the contents and causes of the errors, and the corrective actions for the errors

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
6000	PRG. VERIFY ERR.	File name	—	Off	Flicker	Stop	Always	
6010	MODE. VERIFY ERR.	—	—	On	On	Continue	Always	
6100	TRUCKINERR	—	—	On	On	Continue	At power ON/ At reset/ STOP→RUN	
6101	TRUCKIN ERR.	—	—	On	On	Continue	When an END instruction executed	
6200	CONTROL EXE.	Reason(s) for system switching	—	On	Off	Continue	Always	
6210	CONTROL WAIT	Reason(s) for system switching	—	On	Off	Continue	Always	

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	6000	The control system and standby system in the redundant system do not have the same programs and parameters. (This can be detected from the standby system of the redundant system.)	Synchronise the programs and parameters of the control system and standby system.	Q4AR
	6010	The operational status of the control system and standby system in the redundant system is not the same. (This can be detected from the standby system of the redundant system.)	Synchronise the operation statuses of the control system and standby system.	Q4AR
	6100	A CPU module tracking memory error was detected during initial. (This can be detected from the control system or standby system of the redundant system.)	Hardware fault of the CPU module. (Please contact your local nearest Mitsubishi or sales representative, explaining a detailed description of the problem. Change the CPU modules in order of the standby system CPU module and control system CPU module.)	Q4AR
	6101	The CPU module detected an error during the handshake for tracking. (This can be detected from the control system or standby system of the redundant system.)	Check the condition of the other stations.	Q4AR
	6200	The standby system in a redundant system is switched to the control system. (This can be detected from the standby system of the redundant system.)	Check the control system condition.	Q4AR
	6210	The control system in a redundant system is switched to the standby system. (This can be detected from the standby system of the redundant system.)	Check the control system condition.	Q4AR

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
6220	CAN'T EXE. CHANGE	Reason(s) for system switching	—	On	On	Continue	At switching request	
6221	CAN'T EXE. CHANGE	Reason(s) for system switching	—	On	On	Continue	At switching request	
6230	DUAL SYS. ERROR	—	—	On	On	Continue	Always	

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	6220	<ul style="list-style-type: none"> • Since the standby system is in an error or similar status in the redundant system, the control system cannot be switched to the standby system. • When an attempt was made to execute system switching, the control system could not be switched to the standby system due to a network error of the control system. (This can be detected from the control system of the redundant system.)	Check the standby system condition.	Q4AR
	6221	Switching is disabled because of a bus switching module error. (This can be detected from the control system of the redundant system.)	This is a bus switching module hardware fault. (Contact your local Mitsubishi representative.)	Q4AR
	6230	The link module mounted on the standby system CPU module is the remote master station.	Check the system configuration status.	

22.3.9 Error code list (7000 to 10000)

The following shows the error messages from the error code 7000 to 10000, the contents and causes of the errors, and the corrective actions for the errors.

Error Code (SD0)	Error Message	Common Information (SD5 to 15)	Individual Information (SD16 to 26)	LED Status		CPU Operation Status	Diagnostic Timing	
				RUN	ERROR			
9000	F****	Program error location	Annunciator number	On	On/Off *2	Continue	When instruction executed	
				USER LED On				
9010	<CHK>ERR ***_***	Program error location	Failure No.	On	Off	Continue	When instruction executed	
				USER LED On				

	Error Code (SD0)	Error Contents and Cause	Corrective Action	Corresponding CPU
	9000	Annunciator (F) was set ON	Read the individual information of the error using the peripheral device, and check the program corresponding to the numerical value (annunciator number).	QnA
	9010	Error detected by the CHK instruction.	Read the individual information of the error using the peripheral device, and check the program corresponding to the numerical value (error number) there.	QnA

22.3.10 Canceling of Errors

Q series CPU module can perform the cancel operation for errors only when the errors allow the CPU module to continue its operation.

To cancel the errors, follow the steps shown below.

- 1) Eliminate the cause of the error.
- 2) Store the error code to be canceled in the special register SD50.
- 3) Energize the special relay SM50 (OFF → ON).
- 4) The error to be canceled is canceled.

After the CPU module is reset by the canceling of the error, the special relays, special registers, and LEDs associated with the error are returned to the status under which the error occurred.

If the same error occurs again after the cancellation of the error, it will be registered again in the error history.

When multiple enunciators(F) detected are canceled, the first one with No. F only is canceled.

Refer to the following manual for details of error canceling.

→ QCPU User's Manual (Function Explanation, Program Fundamentals)

POINT	
(1)	When the error is canceled with the error code to be canceled stored in the SD50, the lower one digit of the code is neglected. (Example) If error codes 2100 and 2101 occur, and error code 2100 to cancel error code 2101. If error codes 2100 and 2111 occur, error code 2111 is not canceled even if error code 2100 is canceled.
(2)	Errors developed due to trouble in other than the CPU module are not canceled even if the special relay (SM50) and special register (SD50) are used to cancel the error. (Example) Since "SP. UNIT DOWN" is the error that occurred in the base unit (including the extension cable), intelligent function module, etc. the error cause cannot be removed even if the error is canceled by the special relay (SM50) and special register (SD50). Refer to the error code list and remove the error cause.

22.4 Resetting Errors

The CPU module allows error resetting only for the errors that does not block the CPU module operation.

The procedure for resetting an error is as follows.

- 1) Eliminate the cause of the error.
- 2) Store the error code to be reset to special register SD50.
- 3) Switch special relay SM50 from OFF to ON.
- 4) The error is reset.

If the CPU module is returned with the error reset, the special relay and special register relating to the error, and the LED/LED indicator return to their state before the error occurred.

If the same error occurs again after the error has been reset, it is recorded in breakdown history again.

To reset multiple detected annunciators, only the first detected F number is reset.

POINT	
	When storing the error code to be reset in SD50 at error reset, the lower one digit of the code number is ignored. Example: When error codes 2100 and 2101 occurred, resetting of error code 2100 results in also resetting of error code 2101. When error codes 2100 and 2111 occurred, resetting of error code 2100 does not result in resetting of error code 2111.

22.5 Fault Examples with I/O Modules

Examples of faults concerning I/O circuits and the corrective actions are explained.

22.5.1 Faults with the input circuit and the corrective actions

The following is an input-circuit fault example and its corrective action.

Table 22.2 Faults with the input circuit and the corrective actions











	Situation	Cause	Countermeasure
Example 1	The input signal does not turn off.	<ul style="list-style-type: none"> Leakage current of input switch (driven by contactless switch, etc.) 	<ul style="list-style-type: none"> Connect the proper resistor so that the input modules terminal to terminal voltage is under the OFF voltage value.  <p>Recommend $\mu 0.1$ to $0.47\mu\text{F} + 47$ to 120Ω (1/2W) for CRs constant.</p>
Example 2	The input signal does not turn off.	<ul style="list-style-type: none"> Drive by limit switch with neon lamp 	<ul style="list-style-type: none"> Same as the example 1. Or, provide a totally independent display circuit separately.
Example 3	The input signal does not turn off.	<ul style="list-style-type: none"> Line capacity C of the leak current twisted pair cable due to line capacity of the wiring cable is about 100PF/m. 	<ul style="list-style-type: none"> Same as the example 1. However, leakage current does not occur when a power supply is on the side of input device as shown below. 
Example 4	The input signal does not turn off.	<ul style="list-style-type: none"> Driven by a switch with LED indication 	<ul style="list-style-type: none"> Connect an appropriate resistance so that voltage between the terminal of the input module and the common is lower than the OFF voltage as shown below.  <p>* An example of calculation of resistor to be connected is provided on the following page.</p>

Table 22.2 Faults with the input circuit and the corrective actions


	Situation	Cause	Countermeasure
Example 5	The input signal does not turn off.	<ul style="list-style-type: none">Sneak path due to the use of two power supplies. 	<ul style="list-style-type: none">Use only one power supply.Connect revolving path preventive diode (figure below). 

Calculation example for Example 4

Consider a switch with LED indicator connected to the A1SX40, giving a leakage current of 3mA when a 24VDC power is turned on.

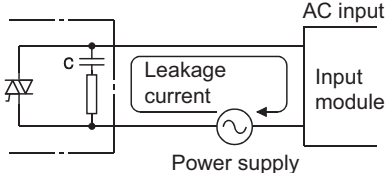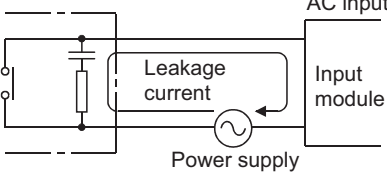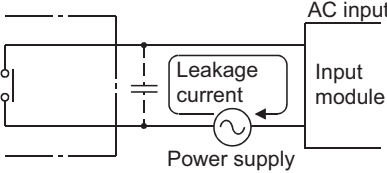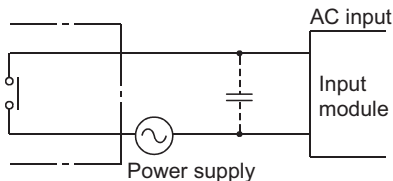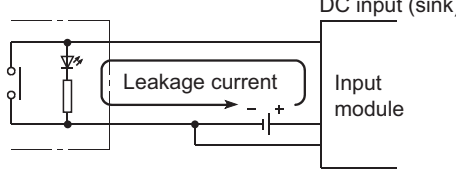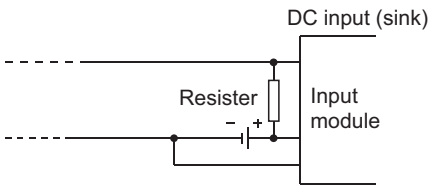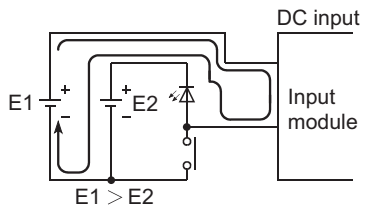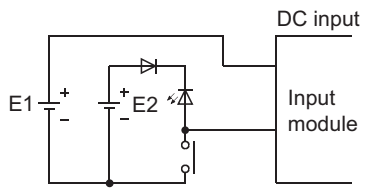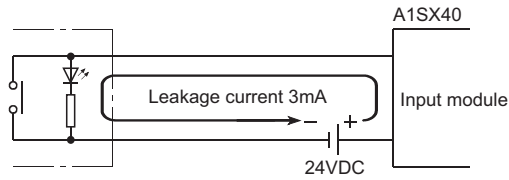

- (1) The 1.7mA OFF current of the A1SX40 is not satisfied. Hence, connect a resistor as shown below.

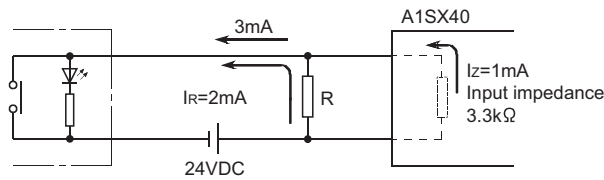

- (2) Calculate the resistor value R as indicated below.
To satisfy the 1.7mA OFF current of the A1SX40, the resistor R to be connected may be the one where 0.63mA or more will flow.
 $I_R : I_Z = Z(\text{Input impedance}) : R$

$$R \leq \frac{I_Z}{I_R} \times Z(\text{Input impedance}) = \frac{1.0}{2.0} \times 3.3 = 1.65[\text{k}\Omega]$$

- (3) Connect a resistor of 1.5(kΩ) and 2 to 3(w) to a terminal which may cause an error, since the power capacity of a resistor is resistor is selected so that will be 3 to 5 times greater than the actual power consumption.
- (4) Also, OFF voltage when resistor R is conned will be as follows.

$$\frac{1}{\frac{1}{1.5[\text{k}\Omega]} + \frac{1}{3.3[\text{k}\Omega]}} \times 3[\text{mA}] = 3.09[\text{V}]$$

- This satisfies 6V or less OFF voltage of A1SX40.

22.5.2 Faults in the output circuit

Faults concerning output circuits and the corrective actions are explained.

Table 22.3 Faults in the output circuit

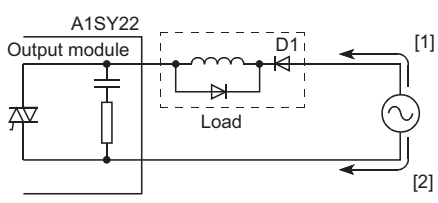

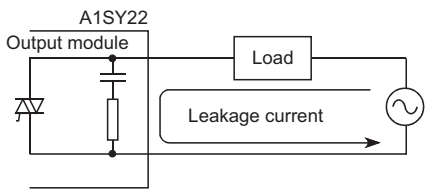

	Situation	Cause	Countermeasure
Example 1	An excessive voltage is applied to the load when output is off. (Triac output)	<p>When the load is subjected to half wave rectification inside (Solenoids have these types.)</p>  <p>• When the polarity of the power supply is (1), C is charged, and when the polarity is (2), the voltage charged in C + voltage of the power supply are applied to the both ends of D1. The maximum value of the voltage is about 2.2E.</p>	<p>• Connect a resistor at several tens Ω to several hundred of $k\Omega$ to the both ends of the load.</p> <p>{ With this kind of usage, there is no problem with the output element, but the diode built-in to the load may deteriorate and burn-out. }</p> 
Example 2	Load does not turn OFF. (Triac output)	<p>• Leak current caused by built-in noise suppressor</p> 	<p>• Connect a resistor to the both ends of the load.</p> <p>{ If the wire distance from the output module to the load is great, then it may have leakage current by line capacity. It is necessary to take precautions. }</p> 

Table22.3 Faults in the output circuit

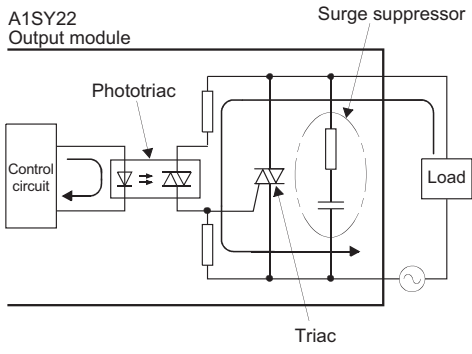

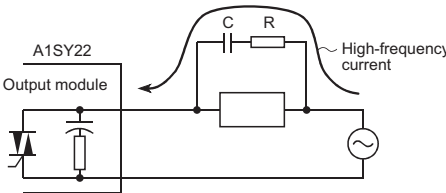

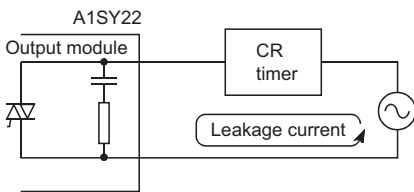

	Situation	Cause	Countermeasure
Example 3	The load is not turned OFF. (Triac output)	<ul style="list-style-type: none"> The load current is lower than the minimum load current.  <ul style="list-style-type: none"> When the load current is lower than the minimum load current of the output module, the triac does not operate since the load current flows into a phototriac as shown below. When an inductive load is connected, the load may not be turned OFF since surge at the time of OFF is applied to the phototriac. 	<ul style="list-style-type: none"> Connect a resistor to both ends of a load so that the load current is higher than the minimum load current. 
Example 4	Load turns OFF with a delay. (Triac output)	<ul style="list-style-type: none"> Leakage current due to surge suppressor for the load. 	<ul style="list-style-type: none"> Disconnect the surge suppressor from across the loads, leaving only the resistance. <p>If the wire distance from the output module to the load is great, then it may have leakage current by line capacity. It is necessary to take precautions.</p>  <p>Guideline of resistance. For 100VAC 5 to 10KΩ, 5 to 3W For 200VAC 10 to 20KΩ, 15 to 10W</p>
Example 5	When load is CR type timer, the time limit fluctuates. (Triac output)		<ul style="list-style-type: none"> Connect a resistance between the CR timer terminals. <p>In some timers, internal circuit may be half wave rectification type, so the caution as to the example 1 is necessary here.</p> <p>If the wire distance from the output module to the load is great, then it may have leakage current by line capacity. It is necessary to take precautions.</p>  <p>The constant value of resistor should be calculated according to the load.</p>

Table22.3 Faults in the output circuit




	Situation	Cause	Countermeasure
Example 6	Load does not turn OFF. (Transistor output with clamp diode)	<ul style="list-style-type: none"> Sneak path due to the use of two power supplies.  <ul style="list-style-type: none"> Sneak path occurs when $E1 < E2$. 	<ul style="list-style-type: none"> Use only one power supply. Connect a diode for a sneak path. <p>(When a relay or similar load is used, a free-wheel diode must be connected across the load.)</p> <p>(Shown by dotted line in the figure at left)</p>
Example 7	<p>When an external switch is connected in parallel between the output and common, the voltage between Y1 and COM1 drops to between 0 and 24V even though the output Y1 which is not connected to the external switch is OFF.</p> <p>Especially when the load L2 is relatively small, (Load current of several mA only) such as LED lamps and photocouplers, the outputs drop.</p> <p>A1SY40 A1SY41 A1SY42</p>	<p>Incorrect output by parasitic transistor (Tr4)</p>  <p>Y2 can turn the load L3 on either from a PC or PB.</p> <p>When PB is ON, Y0 is ON with a PC, and Y1 is OFF:</p> <ol style="list-style-type: none"> (1) L1(current (a)) and L3 (current (b)) turn ON. (2) A potential difference to COM1 occurs in the emitter E of Tr1 to Tr3 since diode D1 is connected between COM1 and the emitter. (3) The transistors A1SY40 to 42, etc., are accompanied by a parasitic transistor (Tr4). (4) The potential difference described in (2) above is supplied between the base (B) of Tr4 and emitter (E), which causes the base current (c) to flow.(Tr4 turns ON.) (5) The current in (4) causes the collector current (d) to flow, and voltage Y1 drops to between 0 and 24V. 	 <p>As shown above, connect diode D2 of $I_F = 1A$ class to output Y2 which is connected to an external switch.</p> <p>(This reverts currents (3) and (4) from flowing.)</p> <p>However, check the operation voltage of L3 as the amount of voltage drop of Y2 at power ON increases for 0.6 to 1V.</p>

Table22.3 Faults in the output circuit





	Situation	Cause	Countermeasure
Example 8	The load is momentarily turned ON when the external supply power is started up. (Transistor output)	<p>Incorrect output due to the floating capacitance (C) between the collector and emitter of the photocoupler</p> <p>(This does not affect normal loads, but in case of highly sensitive loads (such as solid state relays), incorrect outputs may occur.)</p> <p>Photocoupler</p> <p>Output module, Combined module</p>  <p>(1) If the external supply power is suddenly started up, current I_c flows due to the floating capacitance (C) between the collector and emitter of the photocoupler.</p> <p>(2) Current I_c flows to the base of transistor Tr1 in the next stage, and output Y0 turns ON for about 500 μs.</p> 	<p>(1) After checking the external supply power takes at least 10ms to start up when turned it ON/OFF, set the switch SW1 at the primary side of the external supply power.</p>  <p>(2) If setting the switch at the secondary side of the external supply power is required, connect a capacitor and resistor so that the start-up of the power is slowly performed (Longer than 10ms).</p>  <p>R1: Number + Ω *1 *2 Power capacity \geq (External supply power current)² × Resistive value × (3 to 5) C1: Several hundreds of μF, 50 mV</p> <p>*1 For the current consumption of the external supply power, refer to the manual attached to the module to be used.</p> <p>*2 Select the resistance for power capacity in the range of between 3 and 5 times higher than the actual power consumption.</p> <p>Example: R1 = 40 Ω , C1 = 300 μF Calculate the time constant as follows: $C1 \times R1 = 300 \times 10^{-6} \times 40$ $= 12 \times 10^{-3}S$ $= 12ms$</p>

Table22.3 Faults in the output circuit

	Situation	Cause	Countermeasure
Example 9	The load which was turned OFF is turned ON for a moment at power-off. (Transistor output)	<p>The load [2] which was turned OFF may be turned ON due to back electromotive force at the time of power-off [1] if an inductive load is used.</p> <p>Output module, ombined module</p> <p>Source output</p> <p>ON</p> <p>OFF</p> <p>TB1 ON</p> <p>TB2 OFF</p> <p>[2] Load</p> <p>[1] Shut off</p> <p>COM+</p> <p>CTL-</p> <p>Back electromotive force</p> <p>[3]</p> <p>Sink output</p> <p>ON</p> <p>OFF</p> <p>TB1 ON</p> <p>TB2 OFF</p> <p>[2] Load</p> <p>[1] Shut off</p> <p>COM-</p> <p>CTL+</p> <p>Back electromotive force</p> <p>[3]</p>	<p>To prevent the generation of the back electromotive force, connect diode in parallel with load where the back electromotive force has been generated.</p> <p>Source output [3]</p> <p>Sink output [3]</p>



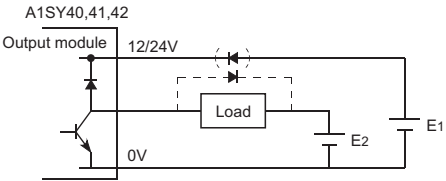
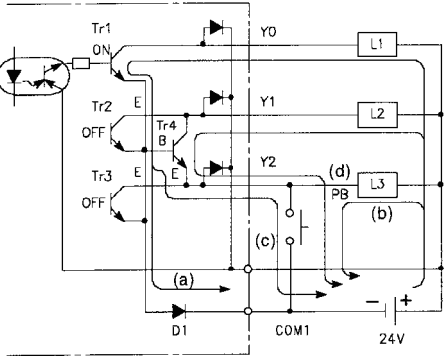
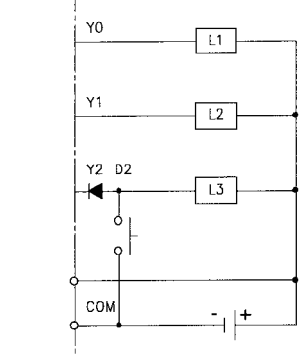






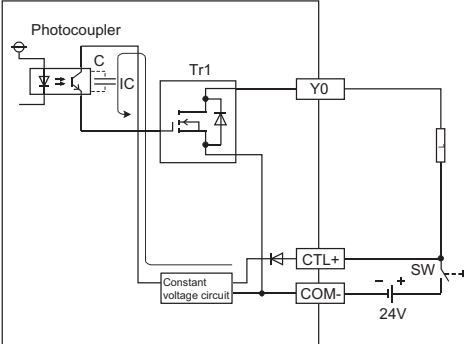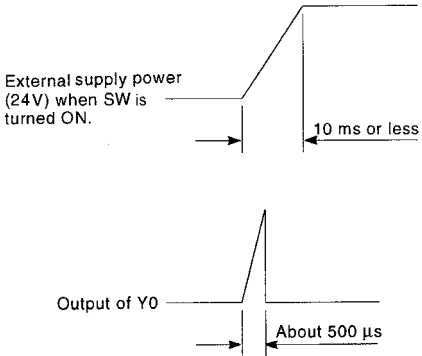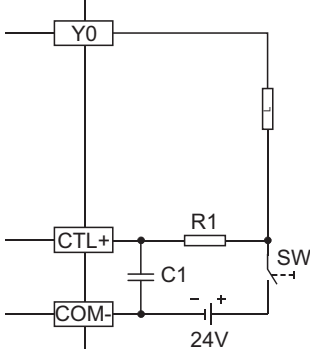
APPENDICES

APPENDIX 1 INSTRUCTION LIST









For details on SFC-related instructions, refer to the QnACPU Programming Manual (SFC).

Appendix 1.1 Sequence Instructions








(1) Contact instructions

Classification	Symbol	Description
Contact		• Logical operation start (N/O contact logical operation start)
		• Logical NOT operation start (N/C contact logical operation start)
		• Logical product (N/O contact series connection)
		• Logical product NOT (N/C contact series connection)
		• Logical sum (N/O contact parallel connection)
		• Logical sum NOT (N/C contact parallel connection)
		• Rising edge pulse operation start
		• Falling edge pulse operation start
		• Rising edge pulse series connection
		• Falling edge pulse series connection
		• Rising edge pulse parallel connection
		• Falling edge pulse parallel connection

(2) Association commands


Classification	Symbol	Description
Association		<ul style="list-style-type: none"> ANDs logical blocks (series connection of blocks).
		<ul style="list-style-type: none"> ORs logical blocks (parallel connection of blocks).
		<ul style="list-style-type: none"> Stores the operation result.
		<ul style="list-style-type: none"> Reads the operation result from MPS.
		<ul style="list-style-type: none"> Reads the operation result from MPS and clears the result.
		<ul style="list-style-type: none"> Inverts the operation result.
		<ul style="list-style-type: none"> Converts the operation result to a rising edge pulse.
		<ul style="list-style-type: none"> Converts the operation result to falling edge pulse.
		<ul style="list-style-type: none"> Converts the operation result to rising edge pulse (stored at Vn).
		<ul style="list-style-type: none"> Converts the operation result to falling edge pulse (stored at Vn).

(3) Output instructions



Classification	Symbol	Description
Output		• Device output
		• Sets a device.*
		• Resets a device.
		• Generates one-program cycle pulse at the rising edge of an input signal.
		• Generates one-program cycle pulse at the falling edge of an input signal.
		• Inverts device output.
		• Converts a direct output to pulse.

* When specifying input (X) for the target device, specify the device number out of the actual input (X) range.



(4) Shift instructions

Classification	Symbol	Description
Shift		• Shifts a device 1 bit.




(5) Master control instructions

Classification	Symbol	Description
Master control		• Master control start
		• Master control reset

(6) End instructions



















Classification	Symbol	Description
Program end		<ul style="list-style-type: none"> Ends the main program.
		<ul style="list-style-type: none"> Ends the sequence program.










(7) Other instructions










Classification	Symbol	Description
Stop		<ul style="list-style-type: none"> Stops sequence operation when the input condition is met. Sequence program execution can be resumed by turning the RUN/STOP key switch to RUN.
No processing	$\overline{(\text{NOP})}$	<ul style="list-style-type: none"> No processing (for program erasure or space)
		<ul style="list-style-type: none"> No processing (for starting a new page during printout)
		<ul style="list-style-type: none"> No processing (for managing the rest of the program as starting from step 0 of page "n")

Appendix 1.2 Basic Instructions

(1) Comparison operation instructions













Classification	Symbol	Description
16-bit data comparison		 <ul style="list-style-type: none"> • Conductive status when $(S1) = (S2)$ • Non-conductive status when $(S1) \neq (S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1) \neq (S2)$ • Non-conductive status when $(S1) = (S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1) > (S2)$ • Non-conductive status when $(S1) \leq (S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1) \leq (S2)$ • Non-conductive status when $(S1) > (S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1) < (S2)$ • Non-conductive status when $(S1) \geq (S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1) \geq (S2)$ • Non-conductive status when $(S1) < (S2)$
32-bit data comparison		 <ul style="list-style-type: none"> • Conductive status when $(S1 + 1, S1) = (S2 + 1, S2)$ • Non-conductive status when $(S1 + 1, S1) \neq (S2 + 1, S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1 + 1, S1) \neq (S2 + 1, S2)$ • Non-conductive status when $(S1 + 1, S1) = (S2 + 1, S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1 + 1, S1) > (S2 + 1, S2)$ • Non-conductive status when $(S1 + 1, S1) \leq (S2 + 1, S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1 + 1, S1) \leq (S2 + 1, S2)$ • Non-conductive status when $(S1 + 1, S1) > (S2 + 1, S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1 + 1, S1) < (S2 + 1, S2)$ • Non-conductive status when $(S1 + 1, S1) \geq (S2 + 1, S2)$
		 <ul style="list-style-type: none"> • Conductive status when $(S1 + 1, S1) \geq (S2 + 1, S2)$ • Non-conductive status when $(S1 + 1, S1) < (S2 + 1, S2)$

Classification	Symbol	Description
Real number data comparison		 <ul style="list-style-type: none">• Conductive status when $(S1 + 1, S1) = (S2 + 1, S2)$• Non-conductive status when $(S1 + 1, S1) \neq (S2 + 1, S2)$
		 <ul style="list-style-type: none">• Conductive status when $(S1 + 1, S1) \neq (S2 + 1, S2)$• Non-conductive status when $(S1 + 1, S1) = (S2 + 1, S2)$
		 <ul style="list-style-type: none">• Conductive status when $(S1 + 1, S1) > (S2 + 1, S2)$• Non-conductive status when $(S1 + 1, S1) \leq (S2 + 1, S2)$
		 <ul style="list-style-type: none">• Conductive status when $(S1 + 1, S1) \geq (S2 + 1, S2)$• Non-conductive status when $(S1 + 1, S1) < (S2 + 1, S2)$
		 <ul style="list-style-type: none">• Conductive status when $(S1 + 1, S1) < (S2 + 1, S2)$• Non-conductive status when $(S1 + 1, S1) \geq (S2 + 1, S2)$
		 <ul style="list-style-type: none">• Conductive status when $(S1 + 1, S1) \leq (S2 + 1, S2)$• Non-conductive status when $(S1 + 1, S1) > (S2 + 1, S2)$

Classification	Symbol	Description
Character string data comparison		<ul style="list-style-type: none"> Compares character strings (S1) and (S2) character by character. <p>Condition for "match": Character string in which all characters match</p> <p>Condition for "larger character string": Character string that includes characters with larger character codes, or the longer character string</p> <p>Condition for "smaller character string": Character string that includes characters with smaller character codes, or the shorter character string</p>
		<p> • Conductive status when (character string S1) = (character string S2)</p> <p>• Non-conductive status when (character string S1) ≠ (character string S2)</p> <p> • Conductive status when (S1 + 1, S1) ≠ (S2 + 1, S2)</p> <p>• Non-conductive status when (S1 + 1, S1) = (S2 + 1, S2)</p> <p> • Conductive status when (character string S1) > (character string S2)</p> <p>• Non-conductive status when (character string S1) ≤ (character string S2)</p>
		<p> • Conductive status when (character string S1) < (character string S2)</p> <p>• Non-conductive status when (character string S1) ≥ (character string S2)</p> <p> • Conductive status when (character string S1) ≥ (character string S2)</p> <p>• Non-conductive status when (character string S1) < (character string S2)</p> <p> • Conductive status when (character string S1) ≤ (character string S2)</p> <p>• Non-conductive status when (character string S1) > (character string S2)</p>

Classification	Symbol	Description
Block data comparison	<div>BKCOMP=(P) S1 S2 D n</div>	<ul style="list-style-type: none">Compares n points of data from (S1) with n points of data from (S2) in 1 word units, and stores the comparison result in the n points starting from the bit device specified by (D).
	<div>BKCOMP<>(P) S1 S2 D n</div>	
	<div>BKCOMP>(P) S1 S2 D n</div>	
	<div>BKCOMP<=(P) S1 S2 D n</div>	
	<div>BKCOMP<(P) S1 S2 D n</div>	
	<div>BKCOMP>=(P) S1 S2 D n</div>	

(2) Arithmetic operation instructions










Classification	Symbol	Description
BIN 16-bit addition/ subtraction	 \rightarrow	• $(D) + (S) \rightarrow (D)$
	 \rightarrow	• $(S1) + (S2) \rightarrow (D)$
	 \rightarrow	• $(D) - (S) \rightarrow (D)$
	 \rightarrow	• $(S1) - (S2) \rightarrow (D)$
BIN 32-bit addition/ subtraction	 \rightarrow	• $(D+1, D) + (S+1, S) \rightarrow (D+1, D)$
	 \rightarrow	• $(S1+1, S1) + (S2+1, S2) \rightarrow (D+1, D)$
	 \rightarrow	• $(D+1, D) - (S+1, S) \rightarrow (D+1, D)$
	 \rightarrow	• $(S1+1, S1) - (S2+1, S2) \rightarrow (D+1, D)$
BIN 16-bit multiplication/division	 \rightarrow	• $(S1) \times (S2) \rightarrow (D+1, D)$
	 \rightarrow	• $(S1)/(S2) \rightarrow$ quotient (D), remainder (D+1)
BIN 32-bit multiplication/division	 \rightarrow	• $(S1+1, S1) \times (S2+1, S2) \rightarrow (D+3, D+2, D+1, D)$
	 \rightarrow	• $(S1+1, S1)/(S2+1, S2) \rightarrow$ quotient (D+1, D), remainder (D+3, D+2)

Classification	Symbol	Description
BCD 4-digit addition/ subtraction	$\boxed{B+(P)} \quad \boxed{S} \quad \boxed{D}$	• $(D) + (S) \rightarrow (D)$
	$\boxed{B+(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1) + (S2) \rightarrow (D)$
	$\boxed{B-(P)} \quad \boxed{S} \quad \boxed{D}$	• $(D) - (S) \rightarrow (D)$
	$\boxed{B-(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1) - (S2) \rightarrow (D)$
BCD 8-digit addition/ subtraction	$\boxed{DB+(P)} \quad \boxed{S} \quad \boxed{D}$	• $(D+1, D) + (S+1, S) \rightarrow (D+1, D)$
	$\boxed{DB+(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1+1, S1) + (S2+1, S2) \rightarrow (D+1, D)$
	$\boxed{DB-(P)} \quad \boxed{S} \quad \boxed{D}$	• $(D+1, D) - (S+1, S) \rightarrow (D+1, D)$
	$\boxed{DB-(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1+1, S1) - (S2+1, S2) \rightarrow (D+1, D)$
BCD 4-digit multiplication/division	$\boxed{B*(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1) \times (S2) \rightarrow (D+1, D)$
	$\boxed{B/(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1)/(S2) \rightarrow \text{quotient } (D), \text{ remainder } (D+1)$
BCD 8-digit multiplication/division	$\boxed{DB*(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1+1, S1) \times (S2+1, S2) \rightarrow (D+3, D+2, D+1, D)$
	$\boxed{DB/(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1+1, S1)/(S2+1, S2) \rightarrow \text{quotient } (D+1, D), \text{ remainder } (D+3, D+2)$
Floating point data addition/subtraction	$\boxed{E+(P)} \quad \boxed{S} \quad \boxed{D}$	• $(D+1, D) + (S+1, S) \rightarrow (D+1, D)$
	$\boxed{E+(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1+1, S1) + (S2+1, S2) \rightarrow (D+1, D)$
	$\boxed{E-(P)} \quad \boxed{S} \quad \boxed{D}$	• $(D+1, D) - (S+1, S) \rightarrow (D+1, D)$
	$\boxed{E-(P)} \quad \boxed{S1} \quad \boxed{S2} \quad \boxed{D}$	• $(S1+1, S1) - (S2+1, S2) \rightarrow (D+1, D)$

Classification	Symbol	Description
Floating point data multiplication/division		• $(S1+1, S1) \times (S2+1, S2) \rightarrow (D+1, D)$
		• $(S1+1, S1)/(S2+1, S2) \rightarrow \text{quotient } (D+1, D)$
Character string data addition		• Associates the character string specified at (S) to the character string specified at (D) and stores the result to devices starting from (D).
		• Associates the character string specified at (S2) to the character string specified at (S1) and stores the result to devices starting from (D).
BIN block addition/subtraction		• Adds n points of data from (S1) and n points of data from (S2) in a batch and stores the result to devices starting from (D).
BIN data increment		• $(D) + 1 \rightarrow (D)$
		• $(D+1, D) + 1 \rightarrow (D)$
BIN data decrement		• $(D) - 1 \rightarrow (D)$
		• $(D+1, D) - 1 \rightarrow (D)$

(3) Data conversion instructions





Classification	Symbol	Description
BCD conversion		<ul style="list-style-type: none"> • (S) $\xrightarrow{\text{BCD conversion}}$ (D) BIN (0 to 9999)
		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{BCD conversion}}$ (D + 1, D) BIN (0 to 99999999)
BIN conversion		<ul style="list-style-type: none"> • (S) $\xrightarrow{\text{BIN conversion}}$ (D) BCD (0 to 9999)
		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{BIN conversion}}$ (D + 1, D) BCD (0 to 99999999)
Floating point → BIN conversion		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{BIN conversion}}$ (D) Real number (–32768 to 32767)
		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{BIN conversion}}$ (D) Real number (–2147483648 to 2147483647)
BIN → floating point conversion		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{Floating decimal point conversion}}$ (D) Real number (–32768 to 32767)
		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{Floating decimal point conversion}}$ (D + 1, D) Real number (–2147483648 to 2147483647)
BIN 16-bit ↔ 32-bit conversion		<ul style="list-style-type: none"> • (S) $\xrightarrow{\text{Conversion to 32-bit data}}$ (D + 1, D) BIN (–32768 to 32767)
		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{16-bit data conversion}}$ (D) BIN (–32768 to 32767)
BIN → gray code conversion		<ul style="list-style-type: none"> • (S) $\xrightarrow{\text{Gray code conversion}}$ (D) BIN (–32768 to 32767)
		<ul style="list-style-type: none"> • (S + 1, S) $\xrightarrow{\text{Gray code conversion}}$ (+1, DD) BIN (–32768 to 32767)

Classification	Symbol	Description
Gray code → BIN conversion		<ul style="list-style-type: none"> • (S) $\xrightarrow{\text{Gray code conversion}}$ (D) Gray code (-32768 to 32767)
		<ul style="list-style-type: none"> • $(S + 1, S)$ $\xrightarrow{\text{Gray code conversion}}$ $(D + 1, D)$ Gray code (-2147483648 to 2147483647)
2's complement		<ul style="list-style-type: none"> • (D) $\xrightarrow{\text{BIN data}}$ (D) BIN data
		<ul style="list-style-type: none"> • $(D + 1, D)$ $\xrightarrow{\text{BIN data}}$ $(D + 1, D)$ BIN data
		<ul style="list-style-type: none"> • $(D + 1, D)$ $\xrightarrow{\text{Real number data}}$ $(D + 1, D)$ Real number data
Block conversion		<ul style="list-style-type: none"> • Converts n points of BIN data from (S) to BCD data in a batch and stores the result to devices starting from (D). 
		<ul style="list-style-type: none"> • Converts n points of BCD data from (S) to BIN data in a batch and stores the result to devices starting from (D). 





(4) Data transfer instructions

Classification	Symbol	Description
16-bit data transfer	<div><div>MOV(P)</div><div>S</div><div>D</div></div>	• (S) \longrightarrow (D)
32-bit data transfer	<div><div>DMOV(P)</div><div>S</div><div>D</div></div>	• (S+1, S) \longrightarrow (D+1, D)
Floating point data transfer	<div><div>EMOV(P)</div><div>S</div><div>D</div></div>	• (S+1, S) \longrightarrow (D+1, D)
Character string data transfer	<div><div>\$MOV(P)</div><div>S</div><div>D</div></div>	• Transfers the character string specified at (S) to devices starting with the device specified at (D).
16-bit data negation transfer	<div><div>CML(P)</div><div>S</div><div>D</div></div>	• $\overline{(S)}$ \longrightarrow $\overline{(D)}$
32-bit data negation transfer	<div><div>DCML(P)</div><div>S</div><div>D</div></div>	• $\overline{(S+1, S)}$ \longrightarrow (D+1, D)
Data block transfer	<div><div>BMOV(P)</div><div>S</div><div>D</div><div>n</div></div>	<div><div>(S)</div><div><div></div><div></div><div></div></div><div>\longrightarrow</div><div><div>(D)</div><div><div></div><div></div><div></div></div><div>n</div></div></div>
Same data block transfer	<div><div>FMOV(P)</div><div>S</div><div>D</div><div>n</div></div>	<div><div>(S)</div><div><div></div></div><div>\longrightarrow</div><div><div>(D)</div><div><div></div><div></div><div></div></div><div>n</div></div></div>
16-bit data exchange	<div><div>XCH(P)</div><div>S</div><div>D</div></div>	• (S) \longleftrightarrow (D)
32-bit data exchange	<div><div>DXCH(P)</div><div>S</div><div>D</div></div>	• (S+1, S) \longleftrightarrow (D+1, D)
Block data exchange	<div><div>BXCH(P)</div><div>S</div><div>D</div><div>n</div></div>	<div><div>(S)</div><div><div></div><div></div><div></div></div><div>\longleftrightarrow</div><div><div>(D)</div><div><div></div><div></div><div></div></div><div>n</div></div></div>
Upper/lower byte swap	<div><div>SWAP(P)</div><div>S</div><div>D</div></div>	<div><div>b15 to b8b7 to b0</div><div>(S) <div><div>8 bits</div><div>8 bits</div></div></div><div><div>b15 to b8b7 to b0</div><div>(D) <div><div>8 bits</div><div>8 bits</div></div></div></div></div>


(5) Program branch instructions

Classification	Symbol	Description
Jump		• Causes a jump to Pn when the input condition is met.
		• Causes a jump to Pn beginning with the scan after the one in which the input condition is met.
		• Causes a jump to Pn unconditionally.
		• Causes a jump to the END instruction when the input condition is met.

(6) Program execution control instructions

Classification	Symbol	Description
Interrupt disable		• Disables execution of interrupt programs.
Interrupt enable		• Cancels the execution disabled status for interrupt programs.
Interrupt disable/ enable setting		• Disables or enables execution of individual interrupt programs.
Return		• Returns from the interrupt program to the sequence program.

(7) I/O refresh instruction













Classification	Symbol	Description
I/O refresh		• Executes partial refresh for the specified I/O part in a scan.













(8) Other convenient instructions

Classification	Symbol	Description
Up/down counter		<p>Cn present value: 0 1 2 3 4 5 6 7 6 5 4 3 2 1 0 -1 -2 -3 -2 -1 0</p> <p>Cn contact: (Active low pulse)</p>
		<p>Cn present value: 0 1 2 3 4 5 4 3 2 1 0 -1</p> <p>Cn contact: (Active low pulse)</p>
Teaching timer		<p>• $(\text{TTMR ON time}) \times n \rightarrow (D)$</p> <p style="text-align: center;">↑</p> <p style="text-align: center;">$n=0:1, \quad n=0:10, \quad n=2:100$</p>
Special timer		<p>• Four bit devices starting with the bit device specified at (D) perform the following operations in accordance with the ON/OFF status of the STMR instruction.</p> <p>(D) + 0: Off delay timer output</p> <p>(D) + 1: One shot timer output after OFF</p> <p>(D) + 2: One shot timer output after ON</p> <p>(D) + 3: On delay timer</p>
Shortest path control		<p>• Rotates a rotary table that is partitioned into $n1$ from the position at which it is stopped to the position specified by (S+1) in the direction that gives the shortest path.</p>
Ramp signal		<p>• Changes the device data specified at (D1) in the range of $n1$ to $n2$ in $n3$ scans.</p>
Pulse density		<p>• Counts the pulse input of the device specified at (S) for the time specified at n and stores the result in the device specified at (D).</p>
Pulse output		<p>• $(n1)\text{Hz} \rightarrow (D)$</p> <p>Outputs "$n2$" times.</p>
Pulse width modulation		<p>(D)</p>
Matrix input		<p>• Consecutively reads the data of n rows of 16 devices starting from the device specified at (S1) and stores it in devices starting from the device specified at (D2).</p>

Appendix 1.3 Application Instructions

(1) Logical operation instructions

Classification	Symbol	Description
Logical product		$\bullet (D) \wedge (S) \rightarrow (D)$
		$\bullet (S1) \wedge (S2) \rightarrow (D)$
		$\bullet (D+1, D) \wedge (S+1, S) \rightarrow (D+1, D)$
		$\bullet (S1+1, S1) \wedge (S2+1, S2) \rightarrow (D+1, D)$
		
Logical sum		$\bullet (D) \vee (S) \rightarrow (D)$
		$\bullet (S1) \vee (S2) \rightarrow (D)$
		$\bullet (D+1, D) \vee (S+1, S) \rightarrow (D+1, D)$
		$\bullet (S1+1, S1) \vee (S2+1, S2) \rightarrow (D+1, D)$
		

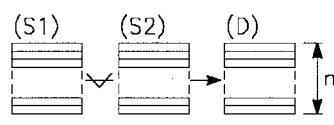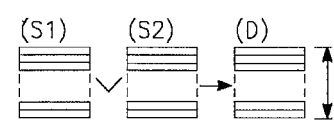Classification	Symbol	Description
Exclusive logical sum		• $(D) \nabla (S) \rightarrow (D)$
		• $(S1) \nabla (S2) \rightarrow (D)$
		• $(D+1, D) \nabla (S+1, S) \rightarrow (D+1, D)$
		• $(S1+1, S1) \nabla (S2+1, S2) \rightarrow (D+1, D)$
		
Not exclusive logical sum		• $\overline{(D) \nabla (S)} \rightarrow (D)$
		• $\overline{(S1) \nabla (S2)} \rightarrow (D)$
		• $\overline{(D+1, D) \nabla (S+1, S)} \rightarrow (D+1, D)$
		• $\overline{(S1+1, S1) \nabla (S2+1, S2)} \rightarrow (D+1, D)$
		











(2) Rotation instructions

Classification	Symbol	Description
Right rotation		<p>Rotates "n" bits to the right.</p>
		<p>Rotates "n" bits to the right.</p>
Left rotation		<p>Rotates "n" bits to the left.</p>
		<p>Rotates "n" bits to the left.</p>
Right rotation		<p>Rotates "n" bits to the right.</p>
		<p>Rotates "n" bits to the right.</p>
Left rotation		<p>Rotates "n" bits to the left.</p>
		<p>Rotates "n" bits to the left.</p>

(3) Shift instructions













Classification	Symbol	Description
n bit shift		
1 bit shift		
1 word shift		

(4) Bit processing instructions

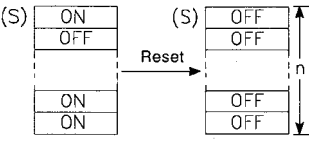Classification	Symbol	Description
Bit set/reset		
		
Bit test		
		
Bit device batch reset		

(5) Data processing instructions











Classification	Symbol	Description
Data search		<p>(S1) (S2) \updownarrow n</p> <p>(D) : Coinciding position (D+1) : Coinciding quantity</p>
		<p>32 bits (S1) (S2) \updownarrow n</p> <p>(D) : Coinciding position (D+1) : Coinciding quantity</p>
Bit check		<p>(S) b15 b0</p> <p>(D): Quantity of 1</p>
		<p>(S+1) (S)</p> <p>(D): Quantity of 1</p>
Decode		<p>8 \rightarrow 256 decode</p> <p>(S) $\xrightarrow{\text{Decode}}$ (D) \updownarrow 2^n bits</p>
Encode		<p>256 \rightarrow 8 decode</p> <p>(S) $\xrightarrow{\text{Encode}}$ (D) \updownarrow n</p>
7-segment decode		<p>(S) b3 b2 b1 b0</p> <p>(D) 7SEG</p>

Classification	Symbol	Description
Dissociation/ Association		<ul style="list-style-type: none"> Dissociates the 16-bit data specified at (S) into 4-bit units, and stores these data in the least significant four bits of n devices starting with the one specified at (D). ($n \leq 4$)
		<ul style="list-style-type: none"> Associates the least significant 4-bit data of n devices starting from the one specified at (S) and stores this data in the device specified at (D). ($n \leq 4$)
		<ul style="list-style-type: none"> Dissociates data of the devices starting with the one specified at (S1) into the specified bits starting with the one specified by (S2), and stores this data in sequence starting at the device specified at (D).
		<ul style="list-style-type: none"> Associates each of the data starting from the one specified at (S1) to the data of the devices starting from the one specified by (S2) and stores the data to the devices in sequence starting at the device specified at (D).
		<ul style="list-style-type: none"> Dissociates the 16-bit data that starts from the device specified at (S) into 8-bit units, and stores the n points of data to the devices in sequence starting from the one specified at (D).
		<ul style="list-style-type: none"> Associates the lower 8 bits of 16-bit data for n points starting from the one specified at (S) to give 16-bit data, and stores the data to the devices in sequence starting from the one specified at (D).
Search		<ul style="list-style-type: none"> Searches the n points of data starting from the device specified at (S) in 16-bit units, and stores the maximum value to the device specified at (D).
		<ul style="list-style-type: none"> Searches the n points of data starting from the device specified at (S) in 16-bit units, and stores the minimum value to the device specified at (D).
		<ul style="list-style-type: none"> Searches the $2 \times n$ points of data starting from the device specified at (S) in 32-bit units, and stores the maximum value to the device specified at (D).
		<ul style="list-style-type: none"> Searches the $2 \times n$ points of data starting from the device specified at (S) in 32-bit units, and stores the minimum value in the device specified at (D).
Sort	 <ul style="list-style-type: none"> S2: Number of comparisons executed at one time D1: Device turned ON on completion of sorting D2: For system use 	<ul style="list-style-type: none"> Sorts n points of data starting from the device specified at (S1) in 16-bit units. [Max. number of scans required: $\{n \times (n - 1)\}/2$ scans]
	 <ul style="list-style-type: none"> S2: Number of comparisons executed at one time D1: Device turned ON on completion of sorting D2: For system use 	<ul style="list-style-type: none"> Sorts $2 \times n$ points of data starting from the device specified at (S1) in 32-bit units. [Max. number of scans required: $\{n \times (n - 1)\}/2$ scans]





(6) Structured program instruction

Classification	Symbol	Description
Repeat		<ul style="list-style-type: none"> Executes the program section between FOR and NEXT n times.
		<ul style="list-style-type: none"> Forcibly ends execution of the program section between FOR and NEXT and causes a jump to Pn.
Subroutine program call		<ul style="list-style-type: none"> Executes the subroutine program Pn when the input condition is met. (S1 to Sn are arguments for the subroutine program. $0 \leq n \leq 5$)
		<ul style="list-style-type: none"> Causes a return from the subroutine program.
		<ul style="list-style-type: none"> Executes no-execution processing for the subroutine program Pn when the input condition is not met.
		<ul style="list-style-type: none"> Executes the subroutine program Pn of the specified program when the input condition is met. (S1 to Sn are arguments for the subroutine program. $0 \leq n \leq 5$)
		<ul style="list-style-type: none"> Executes no-execution processing for the subroutine program Pn of the specified program when the input condition is not met.
		<ul style="list-style-type: none"> Executes link refresh and general data processing.
Ladder indexing	 	<ul style="list-style-type: none"> Indexes each of the devices used in the device qualification ladder.
		<ul style="list-style-type: none"> Stores the qualification value for indexing at IX to IXEND to the devices starting from the one specified at (D).







(7) Table operation instructions

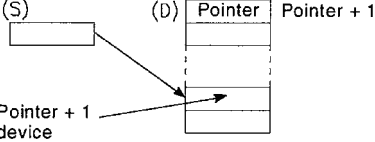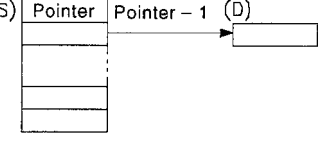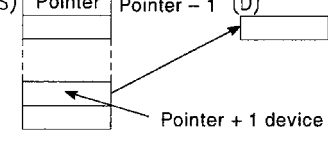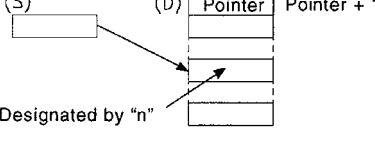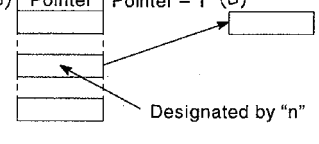Classification	Symbol	Description
Table processing		
		
		
		
		












(8) Buffer memory access instructions

Classification	Symbol	Description
Data read		• Reads data in 16-bit units from special function modules.
		• Reads data in 32-bit units from special function modules.
Data write		• Writes data in 16-bit units to special function modules.
		• Writes data in 32-bit units to special function modules.















(9) Display instructions

Classification	Symbol	Description
ASCII print	* When SM701 is OFF 	• Outputs ASCII codes in the 8 points of devices (16 characters) starting from the one specified at (S) to an output module.
	* When SM701 is ON 	• Outputs ASCII codes in the devices starting from the one specified at (S) and ending at 00H, to an output module.
		• Converts the device comment specified at (S) to ASCII codes and outputs the result to an output module.
Display		• Displays ASCII codes in the 8 points of devices (corresponding to 16 characters) starting from the one specified at (S) on the LED indicator.
		• Displays the comment of the device specified at (S) on the LED indicator.
Reset		• Resets annunciators and LED indication.

(10) Debugging and fault diagnostics instructions

Classification	Symbol	Description
Error check		<ul style="list-style-type: none"> • Executes the CHK instruction when it is executed. • Causes a jump to the step following the step of the CHK instruction when it is not executed.
		<ul style="list-style-type: none"> • When normal → SM80: OFF, SD80: 0 • When abnormal → SM80: ON, SD80: fault No.
		<ul style="list-style-type: none"> • Indicates the start of ladder pattern change for the ladders to be checked with the CHK instruction.
		<ul style="list-style-type: none"> • Indicates the end of ladder pattern change for the ladders to be checked with the CHK instruction.
Status latch		<ul style="list-style-type: none"> • Executes status latch.
		<ul style="list-style-type: none"> • Resets the status latch to enable re-execution of status latch.
Sampling trace		<ul style="list-style-type: none"> • Triggers sampling trace.
		<ul style="list-style-type: none"> • Resets the sampling trace to enable re-execution of sampling trace.
Program trace		<ul style="list-style-type: none"> • Triggers program trace.
		<ul style="list-style-type: none"> • Resets the program trace to enable re-execution of program trace.
		<ul style="list-style-type: none"> • Executes program trace.














(11) Text string processing instructions

Classification	Symbol	Description
BIN ↓ Decimal ASCII		• Converts the 1-word BIN data specified at (S) into 5-digit decimal ASCII values, and stores them to the word devices starting from the one specified at (D).
		• Converts the 2-word BIN data specified at (S) into 10-digit decimal ASCII values, and stores them to the word devices starting from the one specified at (D).
BIN ↓ Hexadecimal ASCII		• Converts the 1-word BIN data specified at (S) into 4-digit hexadecimal ASCII values, and stores them to the word devices starting from the one specified at (D).
		• Converts the 2-word BIN data specified at (S) into 8-digit hexadecimal ASCII values, and stores them to the word devices starting from the one specified at (D).
BCD ↓ ASCII		• Converts the 1-word BCD value specified at (S) into 4-digit decimal ASCII values, and stores them to the word devices starting from the one specified at (D).
		• Converts the 2-word BCD value specified at (S) into 8-digit decimal ASCII values, and stores them to the word devices starting from the one specified at (D).
Decimal ASCII ↓ BIN		• Converts the 5-digit decimal ASCII value specified at (S) to a 1-word BIN value, and stores this to the word device specified at (D).
		• Converts the 10-digit decimal ASCII values specified at (S) to a 2-word BIN value, and stores this to the word device specified at (D).
Hexadecimal ASCII ↓ BIN		• Converts the 4-digit hexadecimal ASCII values specified at (S) to a 1-word BIN value, and stores this to the word device specified at (D).
		• Converts the 8-digit decimal ASCII values designated at (S) to a 2-word BIN value, and stores this at the word device number designated at (D).
ASCII ↓ BCD		• Converts the 4-digit decimal ASCII values specified at (S) to a 1-word BCD value, and stores this to the word device specified at (D).
		• Converts the 8-digit decimal ASCII values specified at (S) to a 2-word BCD value, and stores this to the word devices specified at (D).
Device comment read		• Stores the comment data of the device specified at (S) to the device specified at (D).
Text string length detection		• Stores the length of the character string data (number of characters) that is stored in the device specified at (S) to the device specified at (D).

Classification	Symbol	Description
BIN ↓ Decimal text string		• Converts the 1-word BIN value specified at (S2) into a decimal character string with the total number of digits and number of fraction part digits specified at (S1), and stores it in the device specified at (D).
		• Converts the 2-word BIN value specified at (S2) into a decimal character string with the total number of digits and number of fraction part digits specified at (S1), and stores it in the device specified at (D).
Decimal text string ↓ BIN		• Converts the character string that includes a decimal point specified at (S) to a 1-word BIN value and the number of fraction part digits, and stores them to the devices specified at (D1) and (D2).
		• Converts the character string that includes a decimal point specified at (S) to a 2-word BIN value and the number of fraction part digits, and stores them to the devices specified at (D1) and (D2).
Floating point ↓ Character string		• Converts the floating point data specified at (S) to a character string and stores it in the devices specified at (D).
Character string ↓ Floating decimal point		• Converts the character string specified at (S) to a floating point data and stores it in the devices specified at (D).
Hexadecimal BIN ↓ ASCII		• Converts the 1-word BIN value in the devices starting from the one specified at (S) to hexadecimal ASCII data, and stores them to the word devices starting from the one specified at (D) for n characters.
ASCII ↓ Hexadecimal BIN		• Converts the hexadecimal ASCII data in the devices starting from the one specified at (S) to BIN values for n characters, and stores them to the devices starting from the one specified at (D).
Character string processing		• Stores n characters from the final character of the character string specified at (S) to the devices specified at (D).
		• Stores n characters from the initial character of the character string specified at (S) to the devices specified at (D).
		• Stores the specified number of characters from the position specified at (S2) of the character string specified at (S1) to the devices specified at (D).
		• Stores the character string specified at (S1) for the specified number of characters to the position specified at (S2) of the devices specified at (D).
		• Searches for the character string specified at (S1) from the nth character of the character string specified at (S2) and stores the position where a match is found to (D).
Floating point data ↓ BCD resolution		• Converts the floating point data specified at (S1) to a BCD data with the number of fraction part digits specified at (S2), and stores this data to the devices specified at (D).

Classification	Symbol	Description
BCD ↓ Floating point data	<div>— EREXP(P) S1 S2 D —</div>	<ul style="list-style-type: none">• Converts the BCD data specified at (S1) to a floating point data with the number of fraction part digits specified at (S2) and stores this data to the devices specified at (D).

(12) Special function instructions

Classification	Symbol	Description
Trigonometric function (floating point data)		• $\text{Sin}(S+1, S) \rightarrow (D+1, D)$
		• $\text{Cos}(S+1, S) \rightarrow (D+1, D)$
		• $\text{Tan}(S+1, S) \rightarrow (D+1, D)$
		• $\text{Sin}^{-1}(S+1, S) \rightarrow (D+1, D)$
		• $\text{Cos}^{-1}(S+1, S) \rightarrow (D+1, D)$
		• $\text{Tan}^{-1}(S+1, S) \rightarrow (D+1, D)$
Degree \longleftrightarrow radian conversion		• $(S + 1, S) \rightarrow (D + 1, D)$ Degree \rightarrow radian conversion
		• $(S + 1, S) \rightarrow (D + 1, D)$ Radian \rightarrow degree conversion
		• $\sqrt{(S + 1, S)} \rightarrow (D + 1, D)$
Exponent operation		• $e^{(S + 1, S)} \rightarrow (D + 1, D)$
Natural logarithm		• $\text{Log } e(S + 1, S) \rightarrow (D + 1, D)$
Square root		• $\sqrt{(S)} \rightarrow (D) + 0$ + 1 <div style="display: inline-block; border: 1px solid black; padding: 2px; margin-left: 10px;">Integer part</div> <div style="display: inline-block; border: 1px solid black; padding: 2px; margin-left: 10px;">Fraction part</div>
		• $\sqrt{(S + 1, S)} \rightarrow (D) + 0$ + 1 <div style="display: inline-block; border: 1px solid black; padding: 2px; margin-left: 10px;">Integer part</div> <div style="display: inline-block; border: 1px solid black; padding: 2px; margin-left: 10px;">Fraction part</div>

Classification	Symbol	Description
Trigonometric function	<div><div>BSIN(P)</div><div>S</div><div>D</div></div>	<div><div>• Sin (S) → (D) + 0</div><div>+ 1</div><div>+ 2</div><div><div>Sign</div><div>Integer part</div><div>Fraction part</div></div></div>
	<div><div>BCOS(P)</div><div>S</div><div>D</div></div>	<div><div>• Cos (S) → (D) + 0</div><div>+ 1</div><div>+ 2</div><div><div>Sign</div><div>Integer part</div><div>Fraction part</div></div></div>
	<div><div>BTAN(P)</div><div>S</div><div>D</div></div>	<div><div>• Tan (S) → (D) + 0</div><div>+ 1</div><div>+ 2</div><div><div>Sign</div><div>Integer part</div><div>Fraction part</div></div></div>
	<div><div>BASIN(P)</div><div>S</div><div>D</div></div>	<div><div>• Sin⁻¹ (S) → (D) + 0</div><div>+ 1</div><div>+ 2</div><div><div>Sign</div><div>Integer part</div><div>Fraction part</div></div></div>
	<div><div>BACOS(P)</div><div>S</div><div>D</div></div>	<div><div>• Cos⁻¹ (S) → (D) + 0</div><div>+ 1</div><div>+ 2</div><div><div>Sign</div><div>Integer part</div><div>Fraction part</div></div></div>
	<div><div>BATAN(P)</div><div>S</div><div>D</div></div>	<div><div>• Tan⁻¹ (S) → (D) + 0</div><div>+ 1</div><div>+ 2</div><div><div>Sign</div><div>Integer part</div><div>Fraction part</div></div></div>

(13) Data control instructions

Classification	Symbol	Description
Upper/lower limit control		<ul style="list-style-type: none"> Processes the value specified at (S3) to a data in the range defined by the upper and lower limits set at (S1) and (S2), and stores it to the word device specified at (D). <ul style="list-style-type: none"> When $S3 < S1$ The value at (S1) is stored to (D). When $S1 \leq S3 \leq S2$ The value at (S3) is stored to (D). When $S2 < S3$ The value at (S2) is stored to (D).
		<ul style="list-style-type: none"> Processes the value specified at (S3+1, S3) to a data in the range defined by the upper and lower limits set at (S1+1, S1) and (S2+1, S2), and stores it to the word device specified at (D+1, D). <ul style="list-style-type: none"> When $(S3+1, S3) < (S1+1, S1)$ <ul style="list-style-type: none"> The value at (S1+1, S1) is stored to (D+1, D). When $(S1+1, S1) \leq (S3+1, S3) \leq (S2+1, S2)$ <ul style="list-style-type: none"> The value at (S3+1, S3) is stored to (D+1, D). When $(S2, S2+1) < (S3, S3+1)$ <ul style="list-style-type: none"> The value at (S2+1, S2) is stored to (D+1, D).
Dead zone control		<ul style="list-style-type: none"> Taking the area set by (S1) and (S2) as the dead band, if the input value specified at (S3) is within the dead band, "0" is stored to the word device specified at (D) and if it is outside the dead band, the value obtained by subtracting the dead band upper/lower limit value from the input value is stored to the word device specified at (D). <ul style="list-style-type: none"> When $S1 \leq S3 \leq S2$ $0 \rightarrow D$ When $S3 < S1$ $S3 - S1 \rightarrow D$ When $S3 > S2$ $S3 - S2 \rightarrow D$
		<ul style="list-style-type: none"> Taking the area set by (S1+1, S1) and (S2+1, S2) as the dead band, if the input value specified at (S3+1, S3) is within the dead band, "0" is stored to the word device specified at (D) and if it is outside the dead band, the value obtained by subtracting the dead band upper/lower limit value from the input value is stored to the word device specified at (D). <ul style="list-style-type: none"> When $(S1+1, S1) \leq (S3+1, S3) \leq (S2+1, S2)$ <ul style="list-style-type: none"> $0 \rightarrow (D+1, D)$ When $(S3+1, S3) < (S1+1, S1)$ <ul style="list-style-type: none"> $(S3+1, S3) - (S1+1, S1) \rightarrow (D+1, D)$ When $(S3+1, S3) > (S2+1, S2)$ <ul style="list-style-type: none"> $(S3+1, S3) - (S2+1, S2) \rightarrow (D+1, D)$

Classification	Symbol	Description
Zone control		<ul style="list-style-type: none"> By setting positive and negative bias values for the input value specified at (S3) with (S1) and (S2), calculates the value for S1 + bias, and stores it to the word device specified at (D). <ul style="list-style-type: none"> When $S3 = 0$: $0 \rightarrow D$ When $S3 > 0$: $S3 + S2 \rightarrow D$ When $S3 < 0$: $S3 - S1 \rightarrow D$
		<ul style="list-style-type: none"> By setting positive and negative bias values for the input value specified at (S3+1, S3) with (S1+1, S1) and (S2+1, S2), calculates the value for S1 + bias, and stores it to the word device specified at (D+1, D). <ul style="list-style-type: none"> When $(S3+1, S3) = 0$: $0 \rightarrow (D+1, D)$ When $(S3+1, S3) > 0$: $(S3+1, S3) - (S2+1, S2) \rightarrow (D+1, D)$ When $(S3+1, S3) < 0$: $(S3+1, S3) + (S1+1, S1) \rightarrow (D+1, D)$



(14) Switching instructions

Classification	Symbol	Description
Block No. setting		<ul style="list-style-type: none"> Changes the block No. of an extension file register to the number specified at (S).
		<ul style="list-style-type: none"> Sets the name of a file to be used as a file register.
		<ul style="list-style-type: none"> Sets the name of a file to be used as a comment register.





(15) Clock instructions

Classification	Symbol	Description
Clock data read/write	<div><div>DATE RD(P) D</div></div>	<div><div><div>• (Clock element)→(D) + 0</div><div>+ 1</div><div>+ 2</div><div>+ 3</div><div>+ 4</div><div>+ 5</div><div>+ 6</div></div><div><div>Year</div><div>Month</div><div>Day</div><div>Hour</div><div>Minute</div><div>Second</div><div>Day of the week</div></div></div>
	<div><div>DATE WR(P) S</div></div>	<div><div><div>• (S) + 0</div><div>+ 1</div><div>+ 2</div><div>+ 3</div><div>+ 4</div><div>+ 5</div><div>+ 6</div></div><div><div>Year</div><div>Month</div><div>Day</div><div>Hour</div><div>Minute</div><div>Second</div><div>Day of the week</div></div><div>→ (Clock element)</div></div>
	<div><div>DATE +(P) S1 S2 D</div></div>	<div><div><div>(S1)</div><div>Hour</div><div>Minute</div><div>Second</div></div><div>+</div><div><div>(S2)</div><div>Hour</div><div>Minute</div><div>Second</div></div><div>→</div><div><div>(D)</div><div>Hour</div><div>Minute</div><div>Second</div></div></div>
	<div><div>DATE -(P) S1 S2 D</div></div>	<div><div><div>(S1)</div><div>Hour</div><div>Minute</div><div>Second</div></div><div>-</div><div><div>(S2)</div><div>Hour</div><div>Minute</div><div>Second</div></div><div>→</div><div><div>(D)</div><div>Hour</div><div>Minute</div><div>Second</div></div></div>
	<div><div>SECOND(P) S D</div></div>	<div><div><div>(S)</div><div>Hour</div><div>Minute</div><div>Second</div></div><div>→</div><div><div>(D)</div><div>Second (Lower level)</div><div>Second (Upper level)</div></div></div>
	<div><div>HOUR(P) S D</div></div>	<div><div><div>(S)</div><div>Second (Lower level)</div><div>Second (Upper level)</div></div><div>→</div><div><div>(D)</div><div>Hour</div><div>Minute</div><div>Second</div></div></div>

(16) Instructions for peripheral devices

Classification	Symbol	Description
Input/output to peripheral device		<ul style="list-style-type: none"> Stores the message specified at (S) to the QnACPU. This message is displayed at the peripheral device.
		<ul style="list-style-type: none"> Stores the data input from a peripheral device to the device specified at (D).

(17) Program instructions

Classification	Symbol	Description
Program execution status switch		<ul style="list-style-type: none"> Sets the specified program in the standby status.
		<ul style="list-style-type: none"> Turns OFF the coil of the specified program's OUT instruction and sets the program to the standby status.
		<ul style="list-style-type: none"> Registers the specified program as a scan execution type program.
		<ul style="list-style-type: none"> Registers the specified program as a low-speed execution type program.

(18) Other instructions

Classification	Symbol	Description
WDT reset		<ul style="list-style-type: none"> Resets the WDT in a sequence program.
Timing clock		
Direct read/write in 1 byte unit		
Indirect address set		
Numeral key input from keyboard		<ul style="list-style-type: none"> Fetches ASCII data to the input module specified at (S) for 8 points, converts the data to hexadecimal values, and stores them in the devices starting with the one specified at (D1).

Appendix 1.4 Data Link Instructions

(1) Link refresh instructions





Classification	Symbol	Description
Specified network refresh	<div>J(P).ZCOM Jn</div>	<ul style="list-style-type: none">• Performs link refresh for the network module corresponding to the specified network No. in network n.
	<div>G(P).ZCOM Un</div>	<ul style="list-style-type: none">• Refreshes the network module corresponding to the specified I/O number in network n.

(2) QnA link dedicated instructions



Classification	Symbol	Description
Data read/write from/to other stations		• Reads data from word devices of another station.
		• Writes data to word devices of another station.
Data send/receive to/from other stations		• Sends data (message) to another station.
		• Receives data (message) from another station.
Processing request to other stations		Executes remote RUN/STOP for another station.
Data read/write from/to a special function module at a remote I/O station		Reads data from a special function module installed at a remote station in the MELSECNET/10 network.
		Writes data to a special function module at a remote I/O station in the MELSECNET/10 network.

* (The GP. *** instructions can also be used for the AJ71QC24N)







(3) A series link instructions

Classification	Symbol	Description
Word device read from specified station		<ul style="list-style-type: none"> Reads the data of T, C, D, and W devices of other stations in the MELSECNET(II) or MELSECNET/10 system.
Word device write to specified station		<ul style="list-style-type: none"> Reads the data of T, C, D, and W devices of other stations on the MELSECNET(II) or MELSECNET/10 network.
Data read/write from a special function module at a remote I/O station		<ul style="list-style-type: none"> Reads data from the special function module installed at a remote I/O station in the MELSECNET(II) system.
		<ul style="list-style-type: none"> Writes data to the special function module installed at a remote I/O station in the MELSECNET(II) system.

(4) Routing parameter instructions

Classification	Symbol	Description
Routing information read		<ul style="list-style-type: none"> Reads the data of the transfer destination network with the number specified by n in the routing parameters and stores the data to the devices starting from (D).
Routing information registration		<ul style="list-style-type: none"> Registers the routing data in the devices starting from (S) to the area for the transfer destination network with the number specified by n in the parameters.

Appendix 1.5 PID Control Instructions

Classification	Symbol	Description
PID control data set		Registers the PID control data in the devices starting from the one specified at (S) to the PLC CPU.
PID control execution		Performs PID operation on the basis of the set value (SV) and process value (PV) set in the devices starting from the one specified at (S), and stores the operation result in the manipulated value (MV) area.
PID control status monitor		Displays, in the form of a bar graph, the PID control status of the loop with the number specified at (S1) on the display for the AD57 specified at n. At the start of execution of PID control monitor, static image elements of other than the bar graph and numerical data are displayed by issuing the initial screen display request specified at (S2).
Specified loop operation stop		Stops operation for the loop whose number is specified at n.
Specified loop operation start		Starts operation for the loop whose number is specified at n.
Specified loop parameter change		Changes the operation parameters of the loop whose number is specified at n to the data set in the devices starting from the one whose number is specified at (S).

Appendix 1.6 Special Function Module Instructions

(1) Instructions compatible with all versions

The following instructions can be used for modules with all versions.

Classification	Function	Instruction Symbol
AD61(S1) control instruction	Preset data setting	RVWR1, PVWR2
	Set value data setting for larger/smaller/ matched judgments	SVWR1, SVWR2
	Present value read	PVRD1, PVRD2
AD59(S1) control instruction	Character outputting for the intended number to a printer	PRN
	Character outputting up to the 00H code to a printer	PR
	Data read from memory card	GET
	Data write to memory card	PUT
AJ71C24 (-S3/S6/S8) control instruction	Data send for the specified number of bytes in no-protocol mode	PRN
	Data send up to the 00H code in no-protocol mode	PR
	Data receive in no-protocol mode	INPUT
	Communications status read	SPBUSY
	Send/receive processing forced interruption	SPCLR
AJ71C21(S1) control instruction	Data send for the specified number of bytes	PRN2, PRN4
	Data send up to the 00H code	PR2, PR4
	Data receive	INPUT2, INPUT4
	Data read from RAM memory	GET
	Data write to RAM memory	PUT
	Communication processing forced interruption	SPBUSY

Classification	Function	Instruction Symbol
AJ71PT32-S3 control instruction	Key input from operation box	INPUT
	Data send for the specified number of bytes in no-protocol mode	PRN
	Data send up to the 00H code in no-protocol mode	PR
	Data receive in no-protocol mode	INPUT
	Communications with remote terminal modules	MINI, MINIEND
	Error reset for remote terminal module	MINIERR
	Communications status read	SPBUSY
	Communication processing forced interruption	SPCLR

Classification	Function	Instruction Symbol
AD75 control instruction	Display mode setting	CMODE
	Canvas screen display	CPS1
	VRAM display address change	CPS2
	Canvas data transfer to the VRAM area	CMOV
	Display area clear	CLS
	VRAM area clear	CLV
	Screen scrolling	CSCRU, CSCRD
	Cursor display	CON1, CON2
	Cursor erase	COFF
	Cursor position setting	LOCATE
	Forward/reverse rotation specification for characters	CNOR, CREV
	Forward/reverse rotation switching for characters	CRDSP, SRDSPV
	Character display color specification	COLOR
	Character color change	CCDSP, CCDSPV
	ASCII character display	PR, PRN
	ASCII character write to VRAM	PRV, PRNV
	Character display	EPR, EPRN
	Character write to VRAM	EPRV, EPRNV
	Concatenated display of same character	CR1, CR2, CC1, CC2
	- (minus) display	CINMP
	- (hyphen) display	CINHP
	. (period, decimal point) display	CINPT
	Numeric character display	CIN0 to CIN9
	Alphabet character display	CINA to CINZ
	Space display	CINSP
	Specified column clear display	CINCLR
	ASCII code conversion of specified character strings	INPUT
	VRAM data read	GET
	VRAM data write	PUT
	Display status read	STAT

Classification	Function	Instruction Symbol
AJ71ID□-R4 control instruction	ID controller initial setting	IDINIT1, IDINIT2
	Data read from ID data carrier	IDRD1, IDRD2
	Data write to ID data carrier	IDWD1, IDWD2
	Continuous read from ID data carrier	IDARD1, IDARD2
	Continuous write to ID data carrier	IDAWD1, IDAWD2
	Data compare with ID data carrier	IDCMP1, IDCMP2
	Same data batch write to ID data carrier	IDFILL1, IDFILL2
	Copy between ID data carriers	IDCOPY1, IDCOPY2
	ID data carrier clear	IDCLR1, IDCLR2
	ID data carrier use end	IDOFF1, IDOFF2
	ID data carrier use start	IDON1, IDON2
AJ71QC24 control instruction*	Writes the user registration frame to the E ² PROM for the AJ71QC24N.	PUTE
	Reads the user registration frame from the E ² PROM for the AJ71QC24N.	GETE
	Data send with the dedicated protocol using the "on demand" function	ONDEMAND
	Data send for the specified number of bytes in no-protocol mode	OUTPUT
	Data send in accordance with the send schedule table in no-protocol mode	PRR
	Data receive in no-protocol mode	INPUT
	Data send with the bi-directional protocol	BIDOUT
	Data receive with the bi-directional protocol	BIDIN
	Communication status read	SPBUSY
	Device read from other stations	READ
	Device write to other stations	SWRITE
	Data send to other stations	SEND
	Data receive from other stations	RECV
	Transient transmission request to other stations	REQ

* The AJ71QC24N can be used with QnA link instructions designated for use with special function modules (G(P). ***).

(2) Instructions added after function version B

With function version B, the following instructions can be used in addition to the instructions in (1).

Refer to Section 2.2 for the function version.

Classification	Function	Instruction Symbol
AJ71ID□-R4 control instruction	Comparison read from ID data carrier	IDCRD1, IDCRD2
	Comparison write to ID data carrier	IDCWD1, IDCWD2
	Continuous comparison read from ID data carrier	IDSRD1, IDSRD2
	Continuous comparison write to ID data carrier	IDSWD1, IDSWD2
	Continuous high-speed read from ID data carrier	IDFRD1, IDFRD2
	Continuous high-speed write to ID data carrier	IDFWD1, IDFWD2
CC-Link control instruction	Read from the buffer memory of the intelligent device station	RIRD
	Write to the buffer memory of the intelligent device station	RIWT
	Write to the buffer memory of the intelligent device station(with handshake)	RISEND
	Read from the buffer memory of the intelligent device station (with handshake)	RIRCV
	Read from master station buffer memory for automatic update	RIFR
	Write to master station buffer memory for automatic update	RITO
	Intelligent device station communication	CCL, CCLEND
	Intelligent device station communication status read	SPCBUSY
	Intelligent device station communication processing interrupt	SPCCLR
	Remote register (RWr) read	RDGET
	Remote register (RWw) write	RDPUT
	Remote register (RWr) monitor	RDMON

Classification	Function		Instruction Symbol
AD75 control instruction	1 axis positioning start		PSTART
	Interpolation positioning start		PHOSTA
	OPR start		PZPR
	Current value change request		PADCH
	Forward JOG start/stop		PJOG+
	Reverse JOG start/stop		PJOG-
	Manual pulse generator operation enable/disable		PMPG
	Speed change request		PSPCH
	Axis error reset		PERRST
	Basic parameter setting		PBPSET
	Detail parameter setting		PEPSET
	OPR data setting		POPSET
	Positioning data setting		PPOSET
	Positioning start data setting		PSDSET
	Positioning special start data setting		PSPSET
	Condition data setting		PCTSET
	Error/warning number read		PEWR
	Monitor data read		PMDRD
	Positioning data I/F setting		PIFSET
AJ71QE71 control instruction	Parameter setting		EPRSET
	QnA compatible transmission/receiving instruction	Other station device read	READ SREAD
		Other station device write	WRITE SWRITE
		Data send	SEND
		Data receive	RECV
		Other station transient request	REQ
	A compatible send/receive instruction	Other station device read	ZNRD
		Other station device write	ZNWR

APPENDIX 2 Special Relay List

Special relays, SM, are internal relays whose applications are fixed in the PLC.

For this reason, they cannot be used by sequence programs in the same way as the normal internal relays.

However, they can be turned ON or OFF as needed in order to control the CPU module and remote I/O modules.

The heading descriptions in the following special relay lists are shown in Table App. 2.1.

Table App. 2.1. Explanation of special relay list

Item	Function of Item
Number	• Indicates special register number
Name	• Indicates name of special register
Meaning	• Indicates contents of special register
Explanation	• Discusses contents of special register in more detail
Set by (When set)	<ul style="list-style-type: none"> • Indicates whether the relay is set by the system or user, and, if it is set by the system, when setting is performed. <p><Set by></p> <p>S : Set by system</p> <p>U : Set by user (sequence programs or test operations from GX Developer)</p> <p>S/U : Set by both system and user</p> <p><When set></p> <p>Indicated only for registers set by system</p> <p>Each END : Set during each END processing</p> <p>Initial : Set only during initial processing (when power supply is turned ON, or when going from STOP to RUN)</p> <p>Status change : Set only when there is a change in status</p> <p>Error : Set when error occurs</p> <p>Instruction execution : Set when instruction is executed</p> <p>Request : Set only when there is a user request (through SM, etc.)</p> <p>System switching : Set when system switching is executed.</p>
Corresponding ACPU M9□□□	<ul style="list-style-type: none"> • Indicates the corresponding special relay (M9□□□) of the ACPU. (When the contents are changed, the special relay is represented M9□□□ format change.) • New indicates the special relay newly added to the QnACPU.
Corresponding CPU	<p>Indicates the corresponding CPU module type name.</p> <p>QnA : Indicates the QnA series and Q2ASCPU series.</p> <p>Each CPU module model name: Indicates the relevant specific CPU module. (Example: Q4AR, Q2AS)</p>

For details on the following items, refer to the following manuals:

- Networks → Manual of the corresponding network module
- SFC → QCPU(Q mode)/QnACPU Programming Manual (SFC)

(1) Diagnostic Information

Table App. 2.2. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM0	Diagnostic errors	OFF : No error ON : Error	<ul style="list-style-type: none"> Turns ON if an error occurs as a result of diagnosis. (Includes when an annunciator is ON, and when an error is detected with CHK instruction) Remains ON even if the condition is restored to normal thereafter. 	S (Error)	New	QnA
SM1	Self-diagnostic error	OFF : No self-diagnosis errors ON : Self-diagnosis	<ul style="list-style-type: none"> Turns ON if an error occurs as a result of diagnosis. (Does not include when an annunciator is ON or when an error is detected by the CHK instruction) Remains ON even if the condition is restored to normal thereafter. 	S (Error)	M9008	QnA
SM5	Error common information	OFF : No error common information ON : Error common information	<ul style="list-style-type: none"> When SM0 is ON, turns ON if there is error common information 	S (Error)	New	QnA
SM16	Error individual information	OFF : No error individual information ON : Error individual information	<ul style="list-style-type: none"> When SM0 is ON, turns ON if there is error individual information 	S (Error)	New	QnA
SM50	Error reset	OFF → ON: Error reset	<ul style="list-style-type: none"> Conducts error reset operation 	U	New	QnA
SM51	Battery low latch	OFF : Normal ON : Battery low	<ul style="list-style-type: none"> Turns ON if battery voltage at CPU module or memory card drops below rated value. Remains ON even if the battery voltage returns to normal thereafter. Synchronizes with the BAT. ALARM/BAT. LED. 	S (Error)	M9007	QnA
SM52	Battery low	OFF : Normal ON : Battery low	<ul style="list-style-type: none"> Same as SM51, but turns OFF subsequently when battery voltage returns to normal. 	S (Error)	M9006	QnA
SM53	AC/DC DOWN detection	OFF : AC/DC DOWN not detected ON : AC/DC DOWN detected	<ul style="list-style-type: none"> Turns ON if an instantaneous power failure of within 20ms occurs during use of the AC power supply module. Reset when the power supply is switched OFF, then ON. 	S (Error)	M9005	QnA
			<ul style="list-style-type: none"> Turns ON if an instantaneous power failure of within 1ms occurs during use of the DC power supply module. Reset when the power supply is switched OFF, then ON. 			QnA
SM54	MINI link error	OFF : Normal ON : Error	<ul style="list-style-type: none"> Turns ON if MINI (S3) link error is detected at even one of the installed AJ71PT32 (S3) modules. Remains ON even if the condition is restored to normal thereafter. 	S (Error)	M9004	QnA
SM56	Operation error	OFF : Normal ON : Operation error	<ul style="list-style-type: none"> ON when operation error is generated Remains ON if the condition is restored to normal thereafter. 	S (Error)	M9011	QnA
SM60	Blown fuse detection	OFF : Normal ON : Module with blown fuse	<ul style="list-style-type: none"> Turns ON if there is at least one output module whose fuse has blown. Remains ON if the condition is restored to normal thereafter. Blown fuse status is checked even for remote I/O station output modules. 	S (Error)	M9000	QnA
SM61	I/O module verify error	OFF : Normal ON : Error	<ul style="list-style-type: none"> Turns ON if the I/O module differs from the status registered at power on. Remains ON if the condition is restored to normal thereafter. I/O module verification is also conducted for remote I/O station modules. 	S (Error)	M9002	QnA
SM62	Annunciator detection	OFF : Not detected ON : Detected	<ul style="list-style-type: none"> Goes ON if even one annunciator F goes ON. 	S (Instruction execution)	M9009	QnA
SM80	CHK detection	OFF : Not detected ON : Detected	<ul style="list-style-type: none"> Goes ON if error is detected by CHK instruction. Remains ON if the condition is restored to normal thereafter. 	S (Instruction execution)	New	QnA

Table App. 2.2. Special relay

Number	Name	Meaning	Explanation		Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM90	Startup of monitoring timer for step transition (Enabled only when SFC program exists)	OFF : Not started(monitored timer reset) ON : Started(monitored timer started)	Corresponds to SD90	<ul style="list-style-type: none"> Goes ON when measurement of step transition monitoring timer is commenced. Resets step transition monitoring timer when it goes OFF. 	U	M9108	QnA
SM91			Corresponds to SD91			M9109	
SM92			Corresponds to SD92			M9110	
SM93			Corresponds to SD93			M9111	
SM94			Corresponds to SD94			M9112	
SM95			Corresponds to SD95			M9113	
SM96			Corresponds to SD96			M9114	
SM97			Corresponds to SD97			New	
SM98			Corresponds to SD98			New	
SM99			Corresponds to SD99			New	

(2) System information

Table App. 2.3. Special relay





Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9 □ □ □	Corresponding CPU
SM202	LED OFF command	OFF → ON : LED OFF	• When this relay goes from OFF to ON, the LEDs corresponding to the individual bits at SD202 go off	U	New	QnA
SM203	STOP contact	STOP status	• Goes ON at STOP status	S (Status change)	M9042	QnA
SM204	PAUSE contact	PAUSE status	• Goes ON at PAUSE status	S (Status change)	M9041	QnA
SM205	STEP-RUN contact	STEP-RUN status	• Goes ON at STEP-RUN status	S (Status change)	M9054	QnA
SM206	PAUSE enable coil	OFF : PAUSE disabled ON : PAUSE enabled	• PAUSE status is entered if this relay is ON when the PAUSE contact goes ON	U	M9040	QnA
SM210	Clock data set request	OFF : Ignored ON : Set request	• When this relay goes from OFF to ON and after END instruction execution of subsequent scan, clock data stored in SD210 to SD213 are written to the CPU module.	U	M9025	QnA
SM211	Clock data error	OFF : No error ON : Error	• ON when error is generated in clock data (SD210 to SD213) value, and OFF if no error is detected.	S (Request)	M9026	QnA
SM212	Clock data display	OFF : Ignored ON : Display	• Displays clock data as month, day, hour, minute, and second at the LED display at front of CPU module.(Enabled only for Q3ACPU and Q4ACPU)	U	M9027	Q3A Q4A Q4AR
SM213	Clock data read request	OFF : Ignored ON : Read request	• When this relay is ON, clock data is read to SD210 to SD213 as BCD values.	U	M9028	QnA
SM250	Max. loaded I/O read	OFF : Ignored ON : Read	• When this relay goes from OFF to ON, maximum loaded I/O number is read to SD250.	U	New	QnA
SM251	I/O change flag	OFF : No replacement ON : Replacement	• By turning this relay ON after setting the head I/O number of the replaced I/O module to SD251, the I/O module can be replaced online (with power on). (Only one module can be replaced for each setting.) • Turn this relay ON in the test mode of the program or peripheral device for an I/O module change during RUN, or in the test mode of the peripheral device for an I/O change during STOP. • Do not execute a RUN/STOP mode change until I/O module change is finished.	U	M9094	Q2A(S1) Q3A Q4A Q4AR
SM252	I/O change OK	OFF : Replacement prohibited ON : Replacement enabled	• Goes ON when I/O replacement is OK.	S (END)	New	
SM255	MELSECNET/10 module 1 information	OFF : Operative network ON : Standby network	• Goes ON for standby network(If no designation has been made concerning active or standby, active is assumed.)	S (Initial)	New	QnA
SM256		OFF : Reads ON : Does not read	• For refresh from link to CPU module (B, W, etc.) indicate whether to read from the link module.	U	New	
SM257		OFF : Writes ON : Does not write	• For refresh from CPU module to link (B, W, etc.), designate whether to write to the link module.	U	New	
SM260	MELSECNET/10 module 2 information	OFF : Operative network ON : Standby network	• Goes ON for standby network (If no designation has been made concerning active or standby, active is assumed.)	S (Initial)	New	QnA
SM261		OFF : Reads ON : Does not read	• For refresh from link to CPU module (B, W, etc.) indicate whether to read from the link module.	U	New	
SM262		OFF : Writes ON : Does not write	• For refresh from CPU module to link (B, W, etc.), designate whether to write to the link module.	U	New	
SM265	MELSECNET/10 module 3 information	OFF : Operative network ON : Standby network	• Goes ON for standby network (If no designation has been made concerning active or standby, active is assumed.)	S (Initial)	New	QnA
SM266		OFF : Reads ON : Does not read	• For refresh from link to CPU module (B, W, etc.) indicate whether to read from the link module.	U	New	
SM267		OFF : Writes ON : Does not write	• For refresh from CPU module to link (B, W, etc.), designate whether to write to the link module.	U	New	
SM270	MELSECNET/10 module 4 information	OFF : Operative network ON : Standby network	• Goes ON for standby network (If no designation has been made concerning active or standby, active is assumed.)	S (Initial)	New	QnA
SM271		OFF : Reads ON : Does not read	• For refresh from link to CPU module (B, W, etc.) indicate whether to read from the link module.	U	New	
SM272		OFF : Writes ON : Does not write	• For refresh from CPU module to link (B, W, etc.), designate whether to write to the link module.	U	New	
SM280	CC-Link error	OFF : Normal ON : Error	• Goes ON when a CC-Link error is detected in any of the installed CC-Link module. Remains ON if the condition is restored to normal thereafter.	S (Error)	New	QnA

Table App. 2.3. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM320	Presence/absence of SFC program	OFF : SFC program absent ON : SFC program present	<ul style="list-style-type: none"> Turns ON when an SFC program is registered. OFF when an SFC program is not registered. 	S (Initial)	M9100	QnA
SM321	Start/stop SFC program	OFF : SFC program not executed (stop) ON : SFC program executed (start)	<ul style="list-style-type: none"> Initial value is set at the same value as SM320. (Goes ON automatically if SFC program is present.) Turn this relay from ON to OFF to stop program execution. Turn this relay from OFF to ON to resume program execution. 	S (Initial)/U	M9101form at change	QnA
SM322	SFC program start status	OFF : Initial start ON : Resume start	<ul style="list-style-type: none"> The SFC program starting mode in the SFC setting of the PLC parameter dialog box is set as the initial value. AT initial start: OFF At continued start: ON 	S (Initial)/U	M9102form at change	QnA
SM323	Presence/absence of continuous transition for entire block	OFF : Continuous transition not effective ON : Continuous transition effective	Set the presence/absence of continuous transition for the block where "Continuous transition bit" of the SFC data device has not been set.	U	M9103	QnA
SM324	Continuous transition prevention flag	OFF : When transition is executed ON : When no transition	<ul style="list-style-type: none"> OFF during operation in the continuous transition mode or during continuous transition, and ON when continuous transition is not executed. Always ON during operation in the no continuous transition mode. 	S (Instruction execution)	M9104	QnA
				S (Status change)	New	QnA
SM325	Output mode at block stop	OFF : OFF ON : Preserves	<ul style="list-style-type: none"> Select whether the coil outputs of the active steps are held or not at the time of a block stop. As the initial value, the output mode at a block stop in the parameter is OFF when the coil outputs are OFF, and ON when the coil outputs are held. All coil outputs go OFF when this relay is OFF. Coil outputs are preserved when this relay is ON. 	S (Initial)/U	M9196	QnA
SM326	SFC device clear mode	OFF : Clear device ON : Preserves device	Selects the device status when the stopped CPU is run after the sequence program or SFC program has been modified when the SFC program exists.	U	New	QnA
SM327	Output during end step execution	OFF : Hold step output turned OFF (cleared) ON : Hold step output held	<ul style="list-style-type: none"> Select the device status at the time of switching from STOP to program write to RUN. (All devices except the step relay) 	S (Initial)/U	New	QnA
SM330	Operation mode for low speed execution type program	OFF : Asynchronous mode ON : Synchronous mode	<ul style="list-style-type: none"> Select whether the low speed execution type program will be executed in the asynchronous mode or in the synchronous mode. Asynchronous mode (this relay is turned OFF.) Mode in which the operation of the low speed execution type program is performed continuously within the excess time. Synchronous mode (this relay is turned ON.) Mode in which the operation of the low speed execution type program is not performed continuously and operation is performed from the next scan if there is excess time. 	U	New	QnA

(3) System clocks/counters

Table App. 2.4. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM400	Always ON	ON _____ OFF _____	• Normally is ON	S (Every END processing)	M9036	QnA
SM401	Always OFF	ON _____ OFF _____	• Normally is OFF	S (Every END processing)	M9037	QnA
SM402	After RUN, ON for 1 scan only	ON _____ OFF ← 1 scan	<ul style="list-style-type: none"> After RUN, ON for 1 scan only. This connection can be used for scan execution type programs only. When an initial execution type program is used, this relay turns OFF at the END processing of the scan execution type program in the first scan after RUN. 	S (Every END processing)	M9038	QnA
SM403	After RUN, OFF for 1 scan only	ON ← 1 scan OFF _____	<ul style="list-style-type: none"> After RUN, OFF for 1 scan only. This connection can be used for scan execution type programs only. When an initial execution type program is used, this relay turns OFF at the END processing of the scan execution type program in the first scan after RUN. 	S (Every END processing)	M9039	QnA
SM404	Low speed execution type program ON for 1 scan only after RUN	ON _____ OFF ← 1 scan	<ul style="list-style-type: none"> After RUN, ON for 1 scan only. This connection can be used for low speed execution type programs only. 	S (Every END processing)	New	QnA
SM405	Low speed execution type program After RUN, OFF for 1 scan only	ON ← 1 scan OFF _____	<ul style="list-style-type: none"> After RUN, OFF for 1 scan only. This connection can be used for low speed execution type programs only. 	S (Every END processing)	New	QnA
SM410	0.1 second clock	0.05s _____ 0.05s _____	<ul style="list-style-type: none"> Repeatedly changes between ON and OFF at each designated time interval. When PLC power supply is turned OFF or a CPU module reset is performed, goes from OFF to start. (Note that the ON-OFF status changes when the designated time has elapsed during the execution of the program.) 	S (Status change)	M9030	QnA
SM411	0.2 second clock	0.1s _____ 0.1s _____			M9031	QnA
SM412	1 second clock	0.5s _____ 0.5s _____			M9032	QnA
SM413	2 second clock	1s _____ 1s _____			M9033	QnA
SM414	2n second clock	ns _____ ns _____	<ul style="list-style-type: none"> This relay alternates between ON and OFF at intervals of the time (unit: s) specified in SD414. When PLC power supply is turned OFF or a CPU module reset is performed, goes from OFF to start. (Note that the ON-OFF status changes when the designated time has elapsed during the execution of the program.) 	S (Status change)	M9034form at change	QnA
SM420	User timing clock No.0		<ul style="list-style-type: none"> Relay repeats ON/OFF switching at fixed scan intervals. When PLC power supply is turned ON or a CPU module reset is performed, goes from OFF to start. The ON/OFF intervals are set with the DUTY instruction  <p>n1: ON scan interval n2: OFF scan interval</p>	S (Every END processing)	M9020	QnA
SM421	User timing clock No.1				M9021	
SM422	User timing clock No.2				M9022	
SM423	User timing clock No.3				M9023	
SM424	User timing clock No.4				M9024	
SM430	User timing clock No.5		<ul style="list-style-type: none"> For use with SM420 to SM424 low speed programs 	S (Every END processing)	New	QnA
SM431	User timing clock No.6					
SM432	User timing clock No.7					
SM433	User timing clock No.8					
SM434	User timing clock No.9					

(4) Scan information**Table App. 2.5. Special relay**

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM510	Low speed program execution flag	OFF : Completed or not executed ON : Execution under way.	<ul style="list-style-type: none"> Goes ON when low speed execution type program is executed. 	S (Every END processing)	New	QnA
SM551	Reads module service interval	OFF : Ignored ON : Read	<ul style="list-style-type: none"> When this relay goes from OFF to ON, the module service interval designated by SD550 is read to SD551 to SD552. 	U	New	QnA

(5) Drive information

Table App. 2.6. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9 □ □ □	Corresponding CPU
SM600	Memory card (A) usable flags	OFF : Unusable ON : Use enabled	• ON when memory card (A) is ready for use by user	S (Status change)	New	QnA
SM601	Memory card (A) protect flag	OFF : No protect ON : Protect	• Goes ON when memory card (A) protect switch is ON	S (Status change)	New	QnA
SM602	Drive 1 flag	OFF : No drive 1 ON : Drive 1 present	• Turns ON when the mounted memory card (A) is RAM	S (Status change)	New	QnA
SM603	Drive 2 flag	OFF : No drive 2 ON : Drive 2 present	• Turns ON when the mounted memory card (A) is ROM	S (Status change)	New	QnA
SM604	Memory card (A) in-use flag	OFF : Not used ON : In use	• Goes ON when memory card (A) is in use	S (Status change)	New	QnA
SM605	Memory card (A) remove/insert prohibit flag	OFF : Remove/insert enabled ON : Remove/insert prohibited	• Goes ON when memory card (A) cannot be inserted or removed	U	New	QnA
SM620	Memory card B usable flags	OFF : Unusable ON : Use enabled	• ON when memory card B is ready for use by user	S (Initial)	New	Q2A(S1) Q3A Q4A Q4AR
SM621	Memory card B protect flag	OFF : No protect ON : Protect	• Goes ON when memory card B protect switch is ON	S (Initial)	New	Q2A(S1) Q3A Q4A Q4AR
SM622	Drive 3 flag	OFF : No drive 3 ON : Drive 3 present	• Goes ON when drive 3 (card 2 RAM area) is present	S (Initial)	New	Q2A(S1) Q3A Q4A Q4AR
SM623	Drive 4 flag	OFF : No drive 4 ON : Drive 4 present	• Goes ON when drive 4 (card 2 ROM area) is present	S (Initial)	New	Q2A(S1) Q3A Q4A Q4AR
SM624	Memory card B in-use flag	OFF : Not used ON : In use	• Goes ON when memory card B is in use	S (Status change)	New	Q2A(S1) Q3A Q4A Q4AR
SM625	Memory card B remove/insert prohibit flag	OFF : Remove/insert enabled ON : Remove/insert prohibited	• Goes ON when memory card B cannot be inserted or removed	U	New	Q2A(S1) Q3A Q4A Q4AR
SM640	File register use	OFF : File register not used ON : File register in use	• Goes ON when file register is in use	S (Status change)	New	QnA
SM650	Comment use	OFF : File register not used ON : File register in use	• Goes ON when comment file is in use	S (Status change)	New	QnA
SM660	Boot operation	OFF : Internal memory execution ON : Boot operation in progress	• Goes ON while boot operation is in process • Goes OFF if boot designation switch is OFF	S (Status change)	New	QnA
SM672	Memory card A file register access range flag	OFF : Within access range ON : Outside access range	• Goes ON when access is made to area outside the range of file register of memory card A.(Set within END processing.) • Reset at user program	S/U	New	QnA
SM673	Memory card B file register access range flag	OFF : Within access range ON : Outside access range	• Goes ON when access is made outside the range of file register of memory card B.(Set within END processing.) • Reset at user program	S/U	New	Q2A(S1) Q3A Q4A Q4AR

(6) Instruction-Related Special Relays

Table App. 2.7. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM700	Carry flag	OFF : Carry OFF ON : Carry ON	• Carry flag used in application instruction	S (Instruction execution)	M9012	QnA
SM701	Number of output characters selection	Switching the number of output characters and the output pattern	• Used for the PR, PRC, BINDA, DBINDA, BINHA, DBINHA, BCDDA, DBCDDA, or COMRD instruction • For details, refer to the QCPU (Q Mode)/QnACPU Programming Manual (Common Instructions).	U	M9049	QnA Qn(H) QnPH QnPRH QnU
SM702	Search method	OFF : Search next ON : 2-part search	• Designates method to be used by search instruction. • Data must be arranged for 2-part search.	U	New	QnA
SM703	Sort order	OFF : Ascending order ON : Descending order	• The sort instruction is used to designate whether data should be sorted in ascending order or in descending order.	U	New	QnA
SM704	Block comparison	OFF : Non-match found ON : All match	• Goes ON when all data conditions have been met for the BKCMP instruction.	S (Instruction execution)	New	QnA
SM707	Selection of real number instruction processing type	OFF : Speed oriented ON : Accuracy oriented	• When SM707 is OFF, real number instructions are processed at high speed. • When it is ON, real number instructions are processed with high accuracy.	U	New	Q4AR
SM710	CHK instruction priority ranking flag	OFF : Conditions priority ON : Pattern priority	• Remains as originally set when OFF. • CHK priorities updated when ON.	S (Instruction execution)	New	QnA
SM711	Divided transmission status	OFF : Other than during divided processing ON : During divided processing	• In processing of AD57(S1), goes ON when screen is split for transfer, and goes OFF when split processing is completed	S (Instruction execution)	M9065	QnA
SM712	Transmission processing selection	OFF : Batch processing ON : Divided processing	• In processing of AD57(S1), goes ON when canvas screen is divided for transfer.	S (Instruction execution)	M9066	QnA
SM714	Communication request registration area BUSY signal	OFF : Communication request to remote terminal module enabled ON : Communication request to remote terminal module disabled	• Used to determine whether communications requests to remote terminal modules connected to the AJ71PT32-S3 can be executed or not.	S (Instruction execution)	M9081	QnA
SM715	EI flag	OFF : During DI ON : During EI	• ON when EI instruction is being executed.	S (Instruction execution)	New	QnA
SM736	PKEY instruction execution in progress flag	OFF : Instruction not executed ON : Instruction execution	• ON when PKEY instruction is being executed. Goes OFF when CR is input, or when input character string reaches 32 characters.	S (Instruction execution)	New	QnA
SM737	Keyboard input reception flag for PKEY instruction	OFF : Keyboard input reception enabled ON : Keyboard input reception disabled	• Goes ON when keyboard input is being conducted. Goes when keyboard input has been stored at the CPU.	S (Instruction execution)	New	QnA
SM738	MSG instruction reception flag	OFF : Instruction not executed ON : Instruction execution	• Goes ON when MSG instruction is executed	S (Instruction execution)	New	QnA
SM774	PID bumpless processing (for complete derivative)	OFF : Matched ON : Not matched	• Specifies whether to match the set value (SV) with the process value (PV) or not in the manual mode.	U	New	QnA
SM775	Selection of refresh processing during COM instruction execution	OFF : Performs link refresh ON : Performs no link refresh	• Select whether link refresh processing will be performed or not when only communication with the CPU module is made at the execution of the COM instruction.	U	New	QnA
SM776	Enable/disable local device at CALL	OFF : Local device disabled ON : Local device enabled	• Set whether the local device of the subroutine program called at execution of the CALL instruction is valid or invalid.	U	New	QnA
SM777	Enable/disable local device in interrupt program	OFF : Local device disabled ON : Local device enabled	• Set whether the local device at execution of the interrupt program is valid or invalid.	U	New	QnA
SM780	CC-Link dedicated instruction executable	OFF : CC-Link dedicated instruction executable ON : CC-Link dedicated instruction not executable	• Switches ON when the number of the CC-Link dedicated instructions that can be executed simultaneously reaches 32. Switches OFF when the number goes below 32.	U	New	QnA

(7) Debug

Table App. 2.8. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM800	Sampling trace preparation	OFF : Not ready ON : Ready	• Goes ON when sampling trace is ready	S (Status change)	New	QnA
SM801	Sampling trace start	OFF : Suspend ON : Start	• Sampling trace started when this goes ON • Suspended when OFF (Related special M all OFF)	U	M9047	QnA
SM802	Sampling trace execution in progress	OFF : Suspend ON : Start	• Goes ON during execution of sampling trace	S (Status change)	M9046	QnA
SM803	Sampling trace trigger	OFF → ON: Start	• Sampling trace trigger goes ON when this goes from OFF to ON (Identical to STRA instruction execution status)	U	M9044	QnA
SM804	After sampling trace trigger	OFF : Not after trigger ON : After trigger	• Goes ON after sampling trace trigger	S (Status change)	New	QnA
SM805	Sampling trace completed	OFF : Not completed ON : End	• Goes ON at completion of sampling trace	S (Status change)	M9043	QnA
SM806	Status latch preparation	OFF : Not ready ON : Ready	• Goes ON when status latch is ready	S (Status change)	New	QnA
SM807	Status latch command	OFF → ON: Latch	• Runs status latch command	U	New	QnA
SM808	Status latch completion	OFF : Latch not completed ON : Latch completed	• Comes ON when status latch is completed.	S (Status change)	M9055	QnA
SM809	Status latch clear	OFF → ON: Clear	• Enable next status latch	U	New	QnA
SM810	Program trace preparation	OFF : Not ready ON : Ready	• Goes ON when program trace is ready	S (Status change)	New	QnA
SM811	Start program trace	OFF : Suspend ON : Start	• Program trace started when this goes ON • Suspended when OFF (Related special M all OFF)	S (Status change)	New	QnA
SM812	Program trace execution under way	OFF : Suspend ON : Start	• ON when program trace execution is underway	U	New	QnA
SM813	Program trace trigger	OFF → ON: Start	• Program trace trigger goes ON when this goes from OFF to ON (Identical to PTR A instruction execution status)	S (Status change)	New	QnA
SM814	After program trace trigger	OFF : Not after trigger ON : After trigger	• Goes ON after program trace trigger	S (Status change)	New	QnA
SM815	Program trace completion	OFF : Not completed ON : End	• Goes ON at completion of program trace	S (Status change)	New	QnA
SM820	Step trace preparation	OFF : Not ready ON : Ready	• Goes ON after program trace registration, at ready	S (Status change)	New	QnA
SM821	Step trace starts	OFF : Suspend ON : Start	• Select whether execution of step trace is started or suspended. • When this goes ON, step trace is started • Suspended when OFF (Related special M all OFF)	U	M9182form at change	QnA
SM822	Step trace execution underway	OFF : Suspend ON : Start	• Goes ON when step trace execution is underway • Goes OFF at completion or suspension	S (Status change)	M9181	QnA
SM823	After step trace trigger	OFF : Not after trigger ON : Is after first trigger	• Goes ON if even 1 block within the step trace being executed is triggered. • Goes OFF when step trace is commenced.	S (Status change)	New	QnA
SM824	After Step trace trigger	OFF : Is not after all triggers ON : Is after all triggers	• Goes ON if all blocks within the step trace being executed are triggered. • Goes OFF when step trace is commenced.	S (Status change)	New	QnA
SM825	Step trace completed	OFF : Not completed ON : End	• Goes ON at step trace completion. • Goes OFF when step trace is commenced.	S (Status change)	M9180	QnA
SM826	Sampling trace error	OFF : Normal ON : Errors	• Goes ON if error occurs during execution of sampling trace.	S (Status change)	New	QnA
SM827	Status latch error	OFF : Normal ON : Errors	• Goes ON if error occurs during execution of status latch.	S (Status change)	New	QnA
SM828	Program trace error	OFF : Normal ON : Errors	• Goes ON if error occurs during execution of program trace.	S (Status change)	New	QnA

(8) Latch area**Table App. 2.9. Special relay**

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM900	Power off file	OFF : No power off file ON : Power off file present	<ul style="list-style-type: none"> Goes ON if a file is present during access when power is interrupted. 	S (Status change)/ U	New	QnA
SM910	RKEY registration flag	OFF : Keyboard input notregistered ON : Keyboard input registered	<ul style="list-style-type: none"> Goes ON at registration of keyboard input. OFF if keyboard input is not registered. 	S (Instruction execution)	New	QnA

(9) A to QnA conversion correspondences

Special relays SM1000 to SM1255 are the relays which correspond to ACPU special relays M9000 to M9255 after A to QnA conversion.

These special relays are all set by the system, and cannot be set by the user program.

To turn them ON/OFF by the user program, change the special relays in the program into those of QnACPU.

However, some of SM1084 and SM1200 to SM1255 (corresponding to M9084 and M9200 to M9255 before conversion) can be turned ON/OFF by the user program, if they could be turned ON/OFF by the user program before conversion. For details on the ACPU special relays, see the user's manuals for the individual CPUs, and MELSECNET or MELSECNET/B Data Link System Reference Manuals

The following are additional explanations about the Special Relay for Modification column.

- ① When a special relay for modification is provided, the device number should be changed to the provided QnACPU special relay.
- ② When ☐ is provided, the converted special relay can be used for the device number.
- ③ When ☒ is provided, the device number does not work with QnACPU.

Table App. 2.10. Special relay

ACPU Special Relay	Special Relay after Conversion	Special Relay for Modification	Name	Meaning	Details	Corresponding CPU
M9000	SM1000	—	Fuse blown	OFF : Normal ON : Module with blown fuse	<ul style="list-style-type: none"> Turned on when there is one or more output modules of which fuse has been blown. Remains ON if the condition is restored to normal thereafter. Output modules of remote I/O stations are also checked for fuse condition. 	QnA
M9002	SM1002	—	I/O module verify error	OFF : Normal ON : Error	<ul style="list-style-type: none"> Turned on if the status of I/O module is different from entered status when power is turned on. Remains ON if the condition is restored to normal thereafter. I/O module verification is done also to remote I/O station modules. Reset is enabled only when special registers SD1116 to SD1123 are reset. 	QnA
M9004	SM1004	—	NIML link master module error	OFF : Normal ON : Error	<ul style="list-style-type: none"> Goes ON if MINI (S3) link error is detected at even one of the installed AJ71PT32 (S3) modules. Remains ON if the condition is restored to normal thereafter. 	QnA
M9005	SM1005	—	AC DOWN detection	OFF : AC DOWN not detected ON : AC DOWN detected	<ul style="list-style-type: none"> Turns ON if an instantaneous power failure of within 20ms occurs during use of the AC power supply module. Reset when the power supply is switched OFF, then ON. 	QnA
					<ul style="list-style-type: none"> Turns ON if an instantaneous power failure of within 1ms occurs during use of the DC power supply module. Reset when the power supply is switched OFF, then ON. 	QnA
M9006	SM1006	—	Battery low	OFF : Normal ON : Battery low	<ul style="list-style-type: none"> Turns ON when the battery voltage drops to or below the specified. Turns OFF when the battery voltage returns to normal thereafter. 	QnA
M9007	SM1007	—	Battery low latch	OFF : Normal ON : Battery low	<ul style="list-style-type: none"> Turns ON when the battery voltage drops to or below the specified. Remains ON if the battery voltage returns to normal thereafter. 	QnA
M9008	SM1008	SM1	Self-diagnosis error	OFF : No error ON : Error	<ul style="list-style-type: none"> Turned on when error is found as a result of self-diagnosis. 	QnA
M9009	SM1009	SM62	Annunciator detection	OFF : No F number detected ON : F number detected	<ul style="list-style-type: none"> Turned on when OUT F of SET F instruction is executed. Switched off when SD1124 data is cleared to zero. 	QnA

Table App. 2.10. Special relay

ACPU Special Relay	Special Relay after Conversion	Special Relay for Modification	Name	Meaning	Details	Corresponding CPU
M9011	SM1011	SM56	Operation error flag	OFF : No error ON : Error	<ul style="list-style-type: none"> Turned on when operation error occurs during execution of application instruction. Remains ON if the condition is restored to normal thereafter. 	QnA
M9012	SM1012	SM700	Carry flag	OFF : Carry OFF ON : Carry ON	<ul style="list-style-type: none"> Carry flag used in application instruction. 	QnA
M9016	SM1016	x	Data memory clear flag	OFF : Ignored ON : Output cleared	<ul style="list-style-type: none"> Clears the data memory including the latch range (other than special relays and special registers) in remote run mode from computer, etc. when SM1016 is on. 	–
M9017	SM1017	x	Data memory clear flag	OFF : Ignored ON : Output cleared	<ul style="list-style-type: none"> Clears the unlatched data memory (other than special relays and special registers) in remote run mode from computer, etc. when SM1017 is on. 	–
M9020	SM1020	–	User timing clock No.0		<ul style="list-style-type: none"> Relay which repeats on/off at intervals of predetermined scan. When power is turned on or reset is performed, the clock starts with off. Set the intervals of on/off by DUTY instruction. 	QnA
M9021	SM1021	–	User timing clock No.1			QnA
M9022	SM1022	–	User timing clock No.2			QnA
M9023	SM1023	–	User timing clock No.3			QnA
M9024	SM1024	–	User timing clock No.4		n1: ON scan interval n2: OFF scan interval	QnA
M9025	SM1025	–	Clock data set request	OFF : Ignored ON : Set request present used	<ul style="list-style-type: none"> Writes the clock data stored in SD1025 to SD1028 to the CPU module after the END instruction is executed in the scan in which SM1025 turned from OFF to ON. 	QnA
M9026	SM1026	–	Clock data error	OFF : No error ON : Error	<ul style="list-style-type: none"> Switched on by clock data (SD1025 to SD1028) error 	QnA
M9027	SM1027	–	Clock data display	OFF : Ignored ON : Display	<ul style="list-style-type: none"> Clock data is read from SD1025 to SD1028 and month, day, hour, minute and minute are indicated on the CPU module front LED display. 	Q3A Q4A Q4AR
M9028	SM1028	–	Clock data read request	OFF : Ignored ON : Read request	<ul style="list-style-type: none"> Reads clock data to SD1025 to SD1028 in BCD when SD1028 is on. 	QnA
M9029	SM1029	x	Batch processing of data communications requests	OFF : Batch processing not conducted ON : Batch processing conducted	<ul style="list-style-type: none"> The SM1029 relay is turned on using a sequence program to process all data communication requests accepted during one scan in the END processing of that scan. The batch processing of the data communication requests can be turned on and off during running. The default is OFF (processed one at a time for each END processing in the order in which data communication requests are accepted). 	QnA
M9030	SM1030	–	0.1 second clock		<ul style="list-style-type: none"> 0.1 second, 0.2 second, 1 second and 2 second, clocks are generated. Not turned on or off per scan but turned on and off even during scan if corresponding time has elapsed. Starts with off when PLC power supply is turned on or CPU module reset is performed. 	QnA
M9031	SM1031	–	0.2 second clock			
M9032	SM1032	–	1 second clock			
M9033	SM1033	–	2 second clock			
M9034	SM1034	–	2n minute clock(1 minute clock)*		<ul style="list-style-type: none"> Alternates between ON and OFF according to the seconds specified at SD414. (Default: n = 30) Not turned on or off per scan but turned on and off even during scan if corresponding time has elapsed. Starts with off when PLC power supply is turned on or CPU module reset is performed.. 	QnA
M9036	SM1036	–	Always ON	ON ————— OFF	<ul style="list-style-type: none"> Used as dummy contacts of initialization and application instruction in sequence program. SM1038 and SM1037 are turned on and off without regard to position of key switch on CPU module front. SM1038 and SM1039 are under the same condition as RUN status except when the key switch is at STOP position, and turned off and on. Switched off if the key switch is in STOP position. SM1038 is on for one scan only and SM1039 is off for one scan only if the key switch is not in STOP position. 	QnA
M9037	SM1037	–	Always OFF	ON ————— OFF —————		
M9038	SM1038	–	ON for 1 scan only after RUN			
M9039	SM1039	–	RUN flag(After RUN, OFF for 1 scan only)			

Table App. 2.10. Special relay

ACPU Special Relay	Special Relay after Conversion	Special Relay for Modification	Name	Meaning	Details	Corresponding CPU
M9040	SM1040	SM206	PAUSE enable coil	OFF : PAUSE disabled ON : PAUSE enabled	• When RUN key switch is at PAUSE position or pause contact has turned on and if SM204 is on, PAUSE mode is set and SM206 is turned on.	QnA
M9041	SM1041	SM204	PAUSE status contact	OFF : PAUSE not in effect ON : PAUSE in effect		
M9042	SM1042	SM203	STOP status contact	OFF : STOP not in effect ON : STOP in effect	• Switched on when the RUN key switch or RUN/STOP switch is in STOP position.	QnA
M9043	SM1043	SM805	Sampling trace completed	OFF : Sampling trace in progress ON : Sampling trace completed	• Turned on upon completion of sampling trace performed the number of times preset by parameter after [STRA] instruction is executed. Reset when [STRAR] instruction is executed.	QnA
M9044	SM1044	SM803	Sampling trace	OFF → ON [STRA] Same as execution ON → OFF [STRAR] Same as execution	• Turning on/off SM803 can execute [STRA] / [STRAR] instruction. (SM803 is forcibly turned on/off by a peripheral device.) When switched from OFF to ON: [STRA] instruction When switched from ON to OFF: [STRAR] instruction The value stored in SD1044 is used as the condition for the sampling trace. At scanning, at time → Time (10 ms unit)	QnA
M9045	SM1045	×	Watchdog timer (WDT) reset	OFF : Does not reset WDT ON : Resets WDT	• The SM1015 relay is turned on to reset the WDT when the ZCOM instruction and data communication request batch processing are executed (used when the scan time exceeds 200 ms).	QnA
M9046	SM1046	SM802	Sampling trace	OFF : Trace not in progress ON : Trace in progress	• Switched on during sampling trace.	QnA
M9047	SM1047	SM801	Sampling trace preparations	OFF : Sampling trace suspended ON : Sampling trace started	• Sampling trace is not executed unless SM801 is turned ON. Sampling trace is suspended when SM801 goes OFF.	QnA
M9049	SM1049	SM701	Switching the number of output characters	OFF : Output until NULL code encountered ON : 16 characters output	• When SM701 is OFF, characters up to NULL (00H) code are output. • When SM701 is ON, ASCII codes of 16 characters are output.	QnA
M9051	SM1051	×	CHG instruction execution disable	OFF : Enabled ON : Disable	• Switched ON to disable the CHG instruction. • Switched ON when program transfer is requested. Automatically switched OFF when transfer is complete.	QnA
M9052	SM1052	×	SEG instruction switch	OFF : 7SEG segment display ON : I/O partial refresh	• When SM1052 is ON, the SEG instruction is executed as an I/O partial refresh instruction. When SM1052 is OFF, the SEG instruction is executed as a 7-SEG display instruction.	QnA
M9054	SM1054	SM205	STEP RUN flag	OFF : STEP RUN not in effect ON : STEP RUN in effect	• Switched on when the RUN key switch is in STEP RUN position.	QnA
M9055	SM1055	SM808	Status latch completion flag	OFF : Not completed ON : Completed	• Turned on when status latch is completed. • Turned off by reset instruction.	QnA
M9056	SM1056	×	Main side P, I set request	OFF : Other than when P, I set being requested ON : P, I set being requested	• Provides P, I set request after transfer of the other program (for example subprogram when main program is being run) is complete during run. Automatically switched off when P, I setting is complete.	QnA
M9057	SM1057	×	Sub side P, I set request	OFF : Other than when P, I set being requested ON : P, I set being requested		QnA
M9058	SM1058	×	Main side P, I set completion	Momentarily ON at P, I set completion	• Turned ON once when the P, I set has been completed, and then turned OFF again.	QnA
M9059	SM1059	×	Sub program P, I set completion	Momentarily ON at P, I set completion		QnA
M9060	SM1060	×	Sub program 2 P, I set request	OFF : Other than when P, I set being requested ON : P, I set being requested	• Provides P, I set request after transfer of the other program (for example subprogram when main program is being run) is complete during run. Automatically switched off when P, I setting is complete.	QnA
M9061	SM1061	×	Sub program 3 P, I set request	OFF : Other than when P, I set being requested ON : P, I set being requested		QnA

*: 1 minute clock indicates the name of the special relay (M9034) of the ACPU.

Table App. 2.10. Special relay

ACPU Special Relay	Special Relay after Conversion	Special Relay for Modification	Name	Meaning	Details	Corresponding CPU
M9065	SM1065	SM711	Divided transfer status	OFF : Divided processing not underway ON : During divided processing	• Turned on when canvas screen transfer to AD57(S1)/AD58 is done by divided processing, and turned off at completion of divided processing	QnA
M9066	SM1066	SM712	Transfer processing switch	OFF : Batch transfer ON : Divided transfer	• Turned on when canvas screen transfer to AD57(S1)/AD58 is done by divided processing.	QnA
M9070	SM1070	×	A8UPU/ A8PUJrequired search time*2	OFF : Read time not shortened ON : Read time shortened	• Turned ON to shorten the search time in the A8UPU/ A8PUJ. (In this case, the scan time is extended by 10 %.)	QnA
M9081	SM1081	SM714	Communication request registration area BUSY signal	OFF : Empty spaces in communication request registration area ON : No empty spaces in communication request registration area	• Indication of communication enable/disable to remote terminal modules connected to the AJ71PT32-S3, A2C or A52G.	QnA
M9084	SM1084	×	Error check	OFF : Error check executed ON : No error check	It is set whether the error checks below are performed or not when the END instruction is processed (to set the END instruction processing time). • Check for fuse blown. • Check of battery • Collation check of I/O module	QnA
M9091	SM1091	×	Operation error details flag	OFF : No error ON : Error	• Turns ON when the detail factor of the operation error is stored into SD1091. • Remains ON if the condition is restored to normal thereafter.	QnA
M9094	SM1094	SM251	I/O exchange flag	OFF : Exchanged ON : Not exchanged	• The I/O module can be changed online (with power on) when SM251 is turned ON after the head I/O number of the I/O module is set to SD251. (One module only is allowed to be changed by one setting.) • To be switched on in the program or peripheral device test mode to change the module during CPU RUN. To be switched on in peripheral device test mode to change the module during CPU STOP. • RUN/STOP mode must not be changed until I/O module change is complete.	QnA
M9100	SM1100	SM320	Presence/absence of SFC program	OFF : SFC programs not used ON : SFC programs used	• Turned on if the SFC program is registered. • Turned off if the SFC program is not registered.	QnA
M9101	SM1101	SM321	Start/stop SFC program	OFF : SFC programs stop ON : SFC programs start	• The value in SM320 is set as the initial value. (The relay automatically turns ON when the SFC program is present.) • When this relay turns from ON to OFF, execution of the SFC program stops. • When this relay turns from OFF to ON, execution of the SFC program resumes.	QnA
M9102	SM1102	SM322	SFC program start status	OFF : Initial start ON : Resume start	• The SFC program start mode in the SFC setting of the PLC parameter dialog box is set as the initial value. At initial start: OFF At continue start: ON	QnA

*2: The A8UPU/A8PUJ is not available for the QnACPU.

Table App. 2.10. Special relay

ACPU Special Relay	Special Relay after Conversion	Special Relay for Modification	Name	Meaning			Details	Corresponding CPU
M9103	SM1103	SM323	Presence/absence of continuous transition	OFF : Continuous transition not effective ON : Continuous transition effective			• Set whether continuous transition will be performed for the block where the "continuous transition bit" of the SFC information device is not set.	QnA
M9104	SM1104	SM324	Continuous transition suspension flag	OFF : When transition is completed ON : When no transition			• OFF during operation in the continuous transition mode or during continuous transition, and ON when continuous transition is not executed. • Always ON during operation in the no continuous transition mode.	QnA
M9108	SM1108	SM90	Step transition monitoring timer start (equivalent of SD90)	OFF : Monitoring timer reset ON : Monitoring timer reset start			• Turns ON when the measurement of the step transition monitoring timer is started. Turning this relay OFF resets the step transition monitoring timer.	QnA
M9109	SM1109	SM91	Step transition monitoring timer start (equivalent of SD91)					
M9110	SM1110	SM92	Step transition monitoring timer start (equivalent of SD92)					
M9111	SM1111	SM93	Step transition monitoring timer start (equivalent of SD93)					
M9112	SM1112	SM94	Step transition monitoring timer start (equivalent of SD94)					
M9113	SM1113	SM95	Step transition monitoring timer start (equivalent of SD95)					
M9114	SM1114	SM96	Step transition monitoring timer start (equivalent of SD96)					
M9180	SM1180	SM825	Active step sampling trace completion flag	OFF : Trace started ON : Trace completed			• Set when sampling trace of all specified blocks is completed. Reset when sampling trace is started.	QnA
M9181	SM1181	SM822	Active step sampling trace execution flag	OFF : Trace not being executed ON : Trace execution under way			• Set when sampling trace is being executed. Reset when sampling trace is completed or suspended	QnA
M9182	SM1182	SM821	Active step sampling trace permission	OFF : Trace disable/suspend ON : Trace enable			• Selects sampling trace execution enable/disable. ON: Sampling trace execution is enabled. OFF: Sampling trace execution is disabled. If turned off during sampling trace execution, trace is suspended.	QnA
M9196	SM1196	SM325	Operation output at block stop	OFF : Coil output OFF ON : Coil output ON			• Selects the operation output when block stop is executed. ON: Retains the ON/OFF status of the coil being used by using operation output of the step being executed at block stop. OFF: All coil outputs are turned off. (Operation output by the SET instruction is retained regardless of the ON/OFF status of M9196.)	QnA
M9197	SM1197	×	Switch between blown fuse and I/O verify error display	SM 1197	SM 1198	I/O numbers to be displayed	Switches I/O numbers in the fuse blow module storage registers (SD1100 to SD1107) and I/O module verify error storage registers (SD1116 to SD1123) according to the combination of ON/OFF of the SM1197 and SM1198.	QnA
				OFF	OFF	X/Y0 to 7F0		
				ON	OFF	X/Y800 to FF0		
				OFF	ON	X/Y1000 to 17F0		
M9198	SM1198	×		ON	ON	X/Y1800 to 1FF0		
M9199	SM1199	×	Data recovery of online sampling trace/status latch	OFF : Data recovery disabled ON : Data recovery enabled			• Recovers the setting data stored in the CPU module at restart when sampling trace/status latch is executed. • SM1199 should be ON to execute again. (Unnecessary when writing the data again from peripheral devices.)	QnA

Table App. 2.10. Special relay

ACPU Special Relay	Special Relay after Conversion	Special Relay for Modification	Name	Meaning	Details	Corresponding CPU
M9200	SM1200	—	ZNRD instruction (LRDP instruction for ACPU) reception (for master station)	OFF : Not accepted ON : Accepted	<ul style="list-style-type: none"> Depends on whether or not the ZNRD (word device read) instruction has been received. Used in the program as an interlock for the ZNRD instruction. Use the RST instruction to reset. 	QnA
M9201	SM1201	—	ZNRD instruction (LRDP instruction for ACPU) completion (for master station)	OFF : Not completed ON : End	<ul style="list-style-type: none"> Depends on whether or not the ZNRD (word device read) instruction execution is complete. Used as a condition contact for resetting M9200 and M9201 after the ZNRD instruction is complete. Use the RST instruction to reset. 	QnA
M9202	SM1202	—	ZNWR instruction (LWTP instruction for ACPU) reception (for master station)	OFF : Not accepted ON : Accepted	<ul style="list-style-type: none"> Depends on whether or not the ZNWR (word device write) instruction has been received. Used in the program as an interlock for the ZNWR instruction. Use the RST instruction to reset. 	QnA
M9203	SM1203	—	ZNWR instruction (LWTP instruction for ACPU) completion (for master station)	OFF : Not completed ON : End	<ul style="list-style-type: none"> Depends on whether or not the ZNWR (word device write) instruction execution is complete. Used as a condition contact to reset M9202 and M9203 after the ZNWR instruction is complete. Use the RST instruction to reset. 	QnA
M9204	SM1204	—	ZNRD instruction (LRDP instruction for ACPU) reception (for local station)	OFF : Not completed ON : End	<ul style="list-style-type: none"> On indicates that the ZNRD instruction is complete at the local station. 	QnA
M9205	SM1205	—	ZNWR instruction (LWTP instruction for ACPU) reception (for local station)	OFF : Not completed ON : End	<ul style="list-style-type: none"> On indicates that the ZNWR instruction is complete at the local station. 	QnA
M9206	SM1206	—	Host station link parameter error	OFF : Normal ON : Abnormal	<ul style="list-style-type: none"> Depends on whether or not the link parameter setting of the host is valid. 	QnA
M9207	SM1207	—	Link parameter check results	OFF : Match ON : Mismatch	<ul style="list-style-type: none"> Depends on whether or not the link parameter setting of the master station in tier two matches that of the master station in tier three in a three-tier system. (Valid for only the master station in a three-tier system.) 	QnA
M9208	SM1208	—	Sets master station B and W transmission range (for lower link master stations only)	OFF : Transmits to tier2 and tier 3 ON : Transmits to tier2 only	<ul style="list-style-type: none"> Depends on whether or not the B and W data controlled by higher-link master station (host station) is sent to lower-link local stations (tertiary stations). When SM1208 is OFFB and W of host station is sent to tertiary stations. When SM1208 is ONB and W of host station is not sent to tertiary stations. 	QnA
M9209	SM1209	—	Link parameter check command (for lower link master stations only)	OFF : Executing the check function ON : Check non-execution	<ul style="list-style-type: none"> Set to ON not to match B and W of the higher and lower links. When SM1209 is ON, the link parameters of the higher and lower link are not checked. When SM1209 is OFF, the link parameters of the higher and lower link are checked. 	QnA
M9210	SM1210	—	Link card error (for master station)	OFF : Normal ON : Abnormal	Control is performed depending on whether the link card hardware is faulty or not.	QnA
M9211	SM1211	—	Link module error (for local station use)	OFF : Normal ON : Abnormal	Control is performed depending on whether the link card hardware is faulty or not.	QnA
M9224	SM1224	—	Link status	OFF : Online ON : Offline, station-to-station test, or self-loopback test	Depends on whether the master station is online or offline or is in station-to-station test or self-loopback test mode.	QnA
M9225	SM1225	—	Forward loop error	OFF : Normal ON : Abnormal	Depends on the error condition of the forward loop line.	QnA
M9226	SM1226	—	Reverse loop error	OFF : Normal ON : Abnormal	Depends on the error condition of the reverse loop line.	QnA
M9227	SM1227	—	Loop test status	OFF : Not being executed ON : Forward or reverse loop test execution underway	Depends on whether or not the master station is executing a forward or a reverse loop test.	QnA
M9232	SM1232	—	Local station operation status	OFF : RUN or STEP RUN status ON : STOP or PAUSE status	Control is performed depending on whether a local station is in the STOP or PAUSE mode.	QnA
M9233	SM1233	—	Local station error detect status	OFF : No errors ON : Error detection	Depends on whether or not a local station has detected an error in another station.	QnA

Table App. 2.10. Special relay

ACPU Special Relay	Special Relay after Conversion	Special Relay for Modification	Name	Meaning	Details	Corresponding CPU
M9235	SM1235	—	Local station, remote I/O station parameter error detect status	OFF : No errors ON : Error detection	Depends on whether or not a local or a remote I/O station has detected any link parameter error in the master station	QnA
M9236	SM1236	—	Local station, remote I/O station initial communications status	OFF : No communications ON : Communications underway	Depends on the results of initial communication between a local or remote I/O station and the master station. (Parameter communication, etc.)	QnA
M9237	SM1237	—	Local station, remote I/O station error	OFF : Normal ON : Abnormal	Depends on the error condition of a local or remote I/O station.	QnA
M9238	SM1238	—	Local station, remote I/O station forward or reverse loop error	OFF : Normal ON : Abnormal	Depends on the error condition of the forward and reverse loop lines of a local or a remote I/O station.	QnA
M9240	SM1240	—	Link status	OFF : Online ON : Offline, station-to- station test, or self- loopback test	Depends on whether the local station is online or offline, or is in station-to-station test or self-loopback test mode.	QnA
M9241	SM1241	—	Forward loop line error	OFF : Normal ON : Abnormal	Depends on the error condition of the forward loop line.	QnA
M9242	SM1242	—	Reverse loop line error	OFF : Normal ON : Abnormal	Depends on the error condition of the reverse loop line.	QnA
M9243	SM1243	—	Loopback implementation	OFF : Loopback not being conducted ON : Loopback implementation	Depends on whether or not loopback is occurring at the local station.	QnA
M9246	SM1246	—	Data not received	OFF : Reception ON : No reception	Depends on whether or not data has been received from the master station.	QnA
M9247	SM1247	—	Data not received	OFF : Reception ON : No reception	Depends on whether or not a tier three station has received data from its master station in a three-tier system.	QnA
M9250	SM1250	—	Parameters not received	OFF : Reception ON : No reception	Depends on whether or not link parameters have been received from the master station.	QnA
M9251	SM1251	—	Link relay	OFF : Normal ON : Abnormal	Depends on the data link condition at the local station.	QnA
M9252	SM1252	—	Loop test status	OFF : Not being executed ON : Forward or reverse loop test execution underway	Depends on whether or not the local station is executing a forward or a reverse loop test.	QnA
M9253	SM1253	—	Master station operation status	OFF : RUN or STEP RUN status ON : STOP or PAUSE status	Control is performed depending on whether the master station is in the STOP or PAUSE mode.	QnA
M9254	SM1254	—	Local station other than host station operation status	OFF : RUN or STEP RUN status ON : STOP or PAUSE status	Control is performed depending on whether a local station other than the host is in the STOP or PAUSE mode.	QnA
M9255	SM1255	—	Local station other than host station error	OFF : Normal ON : Abnormal	Depends on whether or not a local station other than the host is in error.	QnA

(10) Process control instructions**Table App. 2.11. Special relay**

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9 □ □ □	Corresponding CPU
SM1500	Hold mode	OFF : No-hold ON : Hold	• Specifies whether or not to hold the output value when a range over occurs for the S.IN instruction range check.	U	New	Q4AR
SM1501	Hold mode	OFF : No-hold ON : Hold	• Specifies whether or not the output value is held when a range over occurs for the S.OUT instruction range check.	U	New	Q4AR

(11) For redundant systems (Host system CPU information *1)

SM1510 to SM1599 are only valid for redundant systems.

All off for standalone systems.

Table App. 2.12. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9 □ □ □	Corresponding CPU
SM1510	Operation mode	OFF : Redundant system backup mode, stand- alone system ON : Redundant system separate mode	• Turns on when the operating mode is redundant system separate.	S (Each END)	New	Q4AR
SM1511	Start mode when power supply is on	OFF : System A fixed mode ON : Previous control system latch mode	• Turns on when the start mode for a redundant system when the power is turned on is the previous control system latch mode.	S (Initial)	New	Q4AR
SM1512	Start mode when CPU is started	OFF : Initial start ON : Hot start	• Turns on when the CPU module operation mode is hot start when the redundant system is started up.	S (Initial)	New	Q4AR
SM1513	Operation status when CPU is started	OFF : Initial start ON : Hot start	• Turns on when the CPU module operation mode is hot start when the redundant system is actually start up.	S (Initial)	New	Q4AR
SM1514	Operation mode at CPU module change	OFF : Initial start ON : Hot start	• Turns on when the operation is hot start when the CPU module operation is switched for a redundant system.	S (Initial)	New	Q4AR
SM1515	Output hold mode	OFF : Output reset ON : Output hold	• Turns on when the output mode during a stop error is output hold.	S (Each END)	New	Q4AR
SM1516	Operation system status	OFF : Control system ON : Standby system	• Turns on when the CPU module operation system status is the standby system.	S (Status change)	New	Q4AR

*1: The information of the host CPU module is stored.

Table App. 2.12. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM1517	CPU module startup status	OFF : Power supply on startup ON : Operation system switch start up	<ul style="list-style-type: none"> Turns on when the CPU module is started up by the operation system switch. Reset using the user program. 	S (Status change)/ U	New	Q4AR
SM1518	Tracking execution mode	OFF : Batch transfer mode ON : Carryover mode	<ul style="list-style-type: none"> When this relay is turned OFF, the start of tracking is delayed until it is executable if the tracking memory is being used at END. When this relay is turned ON, the start of tracking is carried over to next END if the tracking memory is being used at END. 	U	New	Q4AR
SM1520	Data tracking transfer trigger specification	OFF : No trigger ON : Trigger	SM1520 Block 1	U	New	Q4AR
SM1521			SM1521 Block 2			
SM1522			SM1522 Block 3			
SM1523			SM1523 Block 4			
SM1524			SM1524 Block 5			
SM1525			SM1525 Block 6			
SM1526			SM1526 Block 7			
SM1527			SM1527 Block 8			
SM1528			SM1528 Block 9			
SM1529			SM1529 Block 10			
SM1530			SM1530 Block 11			
SM1531			SM1531 Block 12			
SM1532			SM1532 Block 13			
SM1533			SM1533 Block 14			
SM1534			SM1534 Block 15			
SM1535			SM1535 Block 16			
SM1536			SM1536 Block 17			
SM1537			SM1537 Block 18			
SM1538			SM1538 Block 19			
SM1539			SM1539 Block 20			
SM1540			SM1540 Block 21			
SM1541			SM1541 Block 22			
SM1542			SM1542 Block 23			
SM1543			SM1543 Block 24			
SM1544			SM1544 Block 25			
SM1545			SM1545 Block 26			
SM1546			SM1546 Block 27			
SM1547			SM1547 Block 28			
SM1548			SM1548 Block 29			

Table App. 2.12. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM1549	Data tracking transmission link specification	OFF : No trigger ON : Trigger	SM1549 Block 30	U	New	Q4AR
SM1550			SM1550 Block 31			
SM1551			SM1551 Block 32			
SM1552			SM1552 Block 33			
SM1553			SM1553 Block 34			
SM1554			SM1554 Block 35			
SM1555			SM1555 Block 36			
SM1556			SM1556 Block 37			
SM1557			SM1557 Block 38			
SM1558			SM1558 Block 39			
SM1559			SM1559 Block 40			
SM1560			SM1560 Block 41			
SM1561			SM1561 Block 42			
SM1562			SM1562 Block 43			
SM1563			SM1563 Block 44			
SM1564			SM1564 Block 45			
SM1565			SM1565 Block 46			
SM1566			SM1566 Block 47			
SM1567			SM1567 Block 48			
SM1568			SM1568 Block 49			
SM1569			SM1569 Block 50			
SM1570			SM1570 Block 51			
SM1571			SM1571 Block 52			
SM1572			SM1572 Block 53			
SM1573			SM1573 Block 54			
SM1574			SM1574 Block 55			
SM1575			SM1575 Block 56			
SM1576			SM1576 Block 57			
SM1577			SM1577 Block 58			
SM1578			SM1578 Block 59			
SM1579			SM1579 Block 60			
SM1580			SM1580 Block 61			
SM1581			SM1581 Block 62			
SM1582			SM1582 Block 63			
SM1583			SM1583 Block 64			
SM1590	Switching status from the network module	OFF : Normal ON : Switching unsuccessful	<ul style="list-style-type: none"> Turns ON when switching could not be executed normally if the network module had detected a network fault and issued a switching request to the host CPU module. 	S (Error occurs)	New	Q4AR

(12)For redundant system (Other system CPU information *1)

SM1600 to SM1650 only valid for the CPU redundant system backup mode, so they cannot be refreshed during the separate mode.

Either the backup mode or the separate mode is valid for the SM4651 to SM1699.

SM1600 to SM1699 are all turned off for stand-alone system.

Table App. 2.13. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corresponding Host SM□□ *2	Corresponding CPU
SM1600	Diagnosis error	OFF : No error ON : Error	<ul style="list-style-type: none"> Turns on if a error occurs in the diagnosis results. (Including external diagnosis) Remains on even if returns to normal thereafter. 	S (Each END)	SM0	Q4AR
SM1601	Self diagnosis error	OFF : No self diagnosis error ON : Self diagnosis error	<ul style="list-style-type: none"> Turns on when an error occurs in the self-diagnosis results. Remains on even if returns to normal thereafter. 	S (Each END)	SM1	Q4AR
SM1605	Error common information	OFF : No error common information ON : Error common information	<ul style="list-style-type: none"> Turns on when there is error common information and the SM1600 is on. 	S (Each END)	SM5	Q4AR
SM1616	Error individual information	OFF : No error individual information ON : Error individual information	<ul style="list-style-type: none"> Turns on when there is error individual information and the SM1600 is on. 	S (Each END)	SM16	Q4AR
SM1653	STOP contact	STOP status	<ul style="list-style-type: none"> Turns on when in the STOP status. 	S (Each END)	SM203	Q4AR
SM1654	PAUSE contact	PAUSE status	<ul style="list-style-type: none"> Turns on when in the PAUSE status. 	S (Each END)	SM204	Q4AR
SM1655	STEP-RUN contact	STEP-RUN status	<ul style="list-style-type: none"> Turns on when in the STEP-RUN status. 	S (Each END)	SM205	Q4AR

*1 Stores other system CPU diagnostic information and system information.

*2 This shows the special relay(SM□□) for the host system CPU.

(13)For redundant system (tracking)

Either the backup mode or the separate mode is valid for SM1700 to SM1799.

All is turned off for stand-alone system.

Table App. 2.14. Special relay

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU M9 □ □ □	Corresponding CPU
SM1700	Tracking execution flag	OFF : Execution not possible ON : Execution possible	• Turns on when tracking can be normally executed.	S (status change)	New	Q4AR
SM1712	Transfer trigger completion flag	OFF : Transfer uncompleted ON : Transfer completed	SM1712 Block 1	S (status change)	New	Q4AR
SM1713			SM1713 Block 2			
SM1714			SM1714 Block 3			
SM1715			SM1715 Block 4			
SM1716			SM1716 Block 5			
SM1717			SM1717 Block 6			
SM1718			SM1718 Block 7			
SM1719			SM1719 Block 8			
SM1720			SM1720 Block 9			
SM1721			SM1721 Block 10			
SM1722			SM1722 Block 11			
SM1723			SM1723 Block 12			
SM1724			SM1724 Block 13			
SM1725			SM1725 Block 14			
SM1726			SM1726 Block 15			
SM1727			SM1727 Block 16			
SM1728			SM1728 Block 17			
SM1729			SM1729 Block 18			
SM1730			SM1730 Block 19			
SM1731			SM1731 Block 20			
SM1732			SM1732 Block 21			
SM1733			SM1733 Block 22			
SM1734			SM1734 Block 23			
SM1735			SM1735 Block 24			
SM1736			SM1736 Block 25			
SM1737			SM1737 Block 26			
SM1738			SM1738 Block 27			
SM1739			SM1739 Block 28			
SM1740			SM1740 Block 29			
SM1741			SM1741 Block 30			
SM1742			SM1742 Block 31			
SM1743			SM1743 Block 32			
SM1744			SM1744 Block 33			
SM1745			SM1745 Block 34			
SM1746			SM1746 Block 35			
SM1747			SM1747 Block 36			
SM1748			SM1748 Block 37			
SM1749			SM1749 Block 38			
SM1750			SM1750 Block 39			
SM1751			SM1751 Block 40			
SM1752			SM1752 Block 41			
SM1753			SM1753 Block 42			
SM1754			SM1754 Block 43			
SM1755			SM1755 Block 44			
SM1756			SM1756 Block 45			
SM1757			SM1757 Block 46			
SM1758			SM1758 Block 47			
SM1759			SM1759 Block 48			

Table App. 2.14. Special relay

Number	Name	Meaning	Explanation		Set by (When Set)	Corres- ponding ACPU M9□□□	Corresponding CPU
SM1760	Transmission trigger end flag	OFF : Transmission uncompleted ON : Transmission end	SM1760	Block 49	Turns ON only during one scan when the transmission of the corresponding data is completed. S (status change)	New	Q4AR
SM1761			SM1761	Block 50			
SM1762			SM1762	Block 51			
SM1763			SM1763	Block 52			
SM1764			SM1764	Block 53			
SM1765			SM1765	Block 54			
SM1766			SM1766	Block 55			
SM1767			SM1767	Block 56			
SM1768			SM1768	Block 57			
SM1769			SM1769	Block 58			
SM1770			SM1770	Block 59			
SM1771			SM1771	Block 60			
SM1772			SM1772	Block 61			
SM1773			SM1773	Block 62			
SM1774			SM1774	Block 63			
SM1775			SM1775	Block 64			

APPENDIX 3 Special Register List

The special registers, SD, are internal registers with fixed applications in the PLC.

For this reason, it is not possible to use these registers in sequence programs in the same way that normal registers are used.

However, data can be written as needed in order to control the CPU modules and remote I/O modules.

Data stored in the special registers are stored as BIN values if no special designation has been made to the contrary.

The heading descriptions in the following special register lists are shown in Table App. 3.1.

Table App. 3.1. Special register

Item	Function of Item
Number	• Indicates special register number
Name	• Indicates name of special register
Meaning	• Indicates contents of special register
Explanation	• Discusses contents of special register in more detail
Set by (When set)	<ul style="list-style-type: none"> • Indicates whether the relay is set by the system or user, and, if it is set by the system, when setting is performed. <p><Set by></p> <p>S : Set by system</p> <p>U : Set by user (sequence programs or test operations from GX Developer)</p> <p>S/U : Set by both system and user</p> <p><When set></p> <p>Indicated only for registers set by system</p> <p>Each END : Set during each END processing</p> <p>Initial : Set only during initial processing (when power supply is turned ON, or when going from STOP to RUN)</p> <p>Status change : Set only when there is a change in status</p> <p>Error : Set when error occurs</p> <p>Instruction execution : Set when instruction is executed</p> <p>Request : Set only when there is a user request (through SM, etc.)</p> <p>System switching : Set when system switching is executed.</p>
Corresponding ACPU M9□□□	<ul style="list-style-type: none"> • Indicates corresponding special register in ACPU (When the contents are changed, the special register is represented D9□□□ format change.) • New indicates the special register newly added to the QnACPU.
Corresponding CPU	<p>Indicates the relevant CPU module.</p> <p>QnA : Can be applied to QnA series and Q2ASCPU series</p> <p>Each CPU type name : Can be applied only to the specific CPU. (e.g. Q4AR, Q2AS)</p>

For details on the following items, refer to the following manuals:

- Networks → Manual of the corresponding network module
- SFC → QCPU(Q mode)/QnACPU Programming Manual (SFC)

(1) Diagnostic Information

Table App. 3.2. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD0	Diagnostic errors	Diagnosis error code	<ul style="list-style-type: none"> Error codes for errors found by diagnosis are stored as BIN data. Contents identical to latest fault history information. 	S (Error)	D9008 format change	QnA
SD1	Clock time for diagnosis error occurrence	Clock time for diagnosis error occurrence	<ul style="list-style-type: none"> Year (last two digits) and month that SD0 data was updated is stored as BCD 2-digit code. <div> b15 to b8 b7 to b0 (Example) October, 1995 Year (0 to 99) Month (1 to 12) H9510 </div>	S (Error)	New	QnA
SD2			<ul style="list-style-type: none"> The day and hour that SD0 was updated is stored as BCD 2-digit code. <div> b15 to b8 b7 to b0 (Example) 10 a.m. on 25th Day (1 to 31) Hour (0 to 23) H2510 </div>			QnA
SD3			<ul style="list-style-type: none"> The minute and second that SD0 data was updated is stored as BCD 2-digit code. <div> b15 to b8 b7 to b0 (Example) 35 min. 48 sec. Minutes (0 to 59) Seconds (0 to 59) H3548 </div>			QnA
SD4	Error information categories	Error information category code	<p>Category codes which help indicate what type of information is being stored in the common information areas (SD5 through SD15) and the individual information areas (SD16 through SD26) are stored here. The category code for judging the error information type is stored.</p> <div> b15 to b8 b7 to b0 Individual information category codes Common information category codes </div> <ul style="list-style-type: none"> The common information category codes store the following codes: <ul style="list-style-type: none"> 0: No error 1: Unit/module No. 2: File name/Drive name 3: Time (value set) 4: Program error location 5: System switching cause (for Q4ARCPU only) 6: Power supply No. The individual information category codes store the following codes: <ul style="list-style-type: none"> 0: No error 1: (Empty) 2: File name/Drive name 3: Time (value actually measured) 4: Program error location 5: Parameter number 6: Annunciator number 7: CHK instruction failure No. 	S (Error)	New	QnA

Table App. 3.2. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU																																					
SD5	Error common information	Error common information	<ul style="list-style-type: none">Common information corresponding to the error codes (SD0) is stored here.The following five types of information are stored here:The error common information type can be judged by the "common information category code" in SD4. (The values of the "common information category code" stored in SD4 correspond to following 1) to 5.) <p>1) Slot No.</p> <table><tr><th>Number</th><th>Meaning</th></tr><tr><td>SD5</td><td>Slot No. *1</td></tr><tr><td>SD6</td><td>I/O No. *2</td></tr><tr><td>SD7</td><td rowspan="9">(Empty)</td></tr><tr><td>SD8</td></tr><tr><td>SD9</td></tr><tr><td>SD10</td></tr><tr><td>SD11</td></tr><tr><td>SD12</td></tr><tr><td>SD13</td></tr><tr><td>SD14</td></tr><tr><td>SD15</td></tr></table> <p>*1: Definitions of slot No. <Slot No.> Value used to identify the slot of each base unit and the module mounted on that slot.</p> <ul style="list-style-type: none">The I/O slot 0 (slot on the right side of the CPU slot) of the main base unit is defined as the slot of "Slot No. = 0".The slot Nos. are consecutively assigned to the slots of the base units in order of the main base unit and extension base units 1 to 7.When the number of base unit slots has been set in the I/O assignment setting of the PLC parameter dialog box, the slot Nos. are assigned for only the number of set slots. <p>*2: When 0FFFFH is stored into SD6 (I/O No.), the I/O No. cannot be identified due to overlapping I/O No., etc. in the I/O assignment setting of the PLC parameter dialog box. Therefore, identify the error location using SD5.</p> <p>2) File name/Drive name</p> <table><tr><th>Number</th><th>Meaning</th></tr><tr><td>SD5</td><td>Drive</td></tr><tr><td>SD6</td><td rowspan="4">File name (ASCII code: 8 characters)</td></tr><tr><td>SD7</td></tr><tr><td>SD8</td></tr><tr><td>SD9</td></tr><tr><td>SD10</td><td>Extension *3</td><td>2EH(.)</td></tr><tr><td>SD11</td><td colspan="2">(ASCII code: 3 characters)</td></tr><tr><td>SD12</td><td colspan="2" rowspan="4">(Empty)</td></tr><tr><td>SD13</td></tr><tr><td>SD14</td></tr><tr><td>SD15</td></tr></table> <p>(Example) File name = ABCDEFGH. IJK b15 to b8 b7 to b0 42H(B) 41H(A) 44H(D) 43H(C) 46H(F) 45H(E) 48H(H) 47H(G) 49H(I) 2EH(.) 4BH(K) 4AH(J)</p>	Number	Meaning	SD5	Slot No. *1	SD6	I/O No. *2	SD7	(Empty)	SD8	SD9	SD10	SD11	SD12	SD13	SD14	SD15	Number	Meaning	SD5	Drive	SD6	File name (ASCII code: 8 characters)	SD7	SD8	SD9	SD10	Extension *3	2EH(.)	SD11	(ASCII code: 3 characters)		SD12	(Empty)		SD13	SD14	SD15	S (Error)	New	QnA
Number				Meaning																																							
SD5				Slot No. *1																																							
SD6				I/O No. *2																																							
SD7				(Empty)																																							
SD8																																											
SD9																																											
SD10																																											
SD11																																											
SD12																																											
SD13																																											
SD14																																											
SD15																																											
Number				Meaning																																							
SD5				Drive																																							
SD6	File name (ASCII code: 8 characters)																																										
SD7																																											
SD8																																											
SD9																																											
SD10	Extension *3	2EH(.)																																									
SD11	(ASCII code: 3 characters)																																										
SD12	(Empty)																																										
SD13																																											
SD14																																											
SD15																																											
SD6																																											
SD7																																											
SD8																																											
SD9																																											
SD10																																											
SD11																																											
SD12																																											
SD13																																											
SD14																																											
SD15																																											

Table App. 3.2. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU																
SD5	Error common information	Error common information	3) Time (value set) <table><tr><th>Number</th><th>Meaning</th></tr><tr><td>SD5</td><td>Time : 1μs units (0 to 999μs)</td></tr><tr><td>SD6</td><td>Time : 1ms units (0 to 65535ms)</td></tr><tr><td>SD7</td><td rowspan="9">(Empty)</td></tr><tr><td>SD8</td></tr><tr><td>SD9</td></tr><tr><td>SD10</td></tr><tr><td>SD11</td></tr><tr><td>SD12</td></tr><tr><td>SD13</td></tr><tr><td>SD14</td></tr><tr><td>SD15</td></tr></table>	Number	Meaning	SD5	Time : 1μs units (0 to 999μs)	SD6	Time : 1ms units (0 to 65535ms)	SD7	(Empty)	SD8	SD9	SD10	SD11	SD12	SD13	SD14	SD15	S (Error)	New	QnA
Number			Meaning																			
SD5			Time : 1μs units (0 to 999μs)																			
SD6			Time : 1ms units (0 to 65535ms)																			
SD7			(Empty)																			
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5																						
SD6																						
SD7																						
SD8																						
SD9																						
SD10																						
SD11																						
SD12																						
SD13																						
SD14																						
SD15																						
SD5</																						

Table App. 3.2. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU																																	
SD16	Error common information	Error common information	<ul style="list-style-type: none">Individual information corresponding to error codes (SD0) is stored here.There are the following seven different types of information are stored.The error individual information type can be judged by the "individual information category code" in SD4. (The values of the "individual information category code" stored in SD4 correspond to following 1) to 7.)	S (Error)	New	QnA																																	
SD17			1) (Empty) 2) File name/Drive name <div><table><tr><th>Number</th><th>Meaning</th></tr><tr><td>SD16</td><td>Drive</td></tr><tr><td>SD17</td><td rowspan="4">File name (ASCII code: 8 characters)</td></tr><tr><td>SD18</td></tr><tr><td>SD19</td></tr><tr><td>SD20</td></tr><tr><td>SD21</td><td>Extension *3</td><td>2EH(.)</td></tr><tr><td>SD22</td><td colspan="2">(ASCII code: 3 characters)</td></tr><tr><td>SD23</td><td colspan="2" rowspan="4">(Empty)</td></tr><tr><td>SD24</td></tr><tr><td>SD25</td></tr><tr><td>SD26</td></tr></table><div>(Example) File name = ABCDEFGH. IJK b15 to b8 b7 to b0 <table><tr><td>42H(B)</td><td>41H(A)</td></tr><tr><td>44H(D)</td><td>43H(C)</td></tr><tr><td>46H(F)</td><td>45H(E)</td></tr><tr><td>48H(H)</td><td>47H(G)</td></tr><tr><td>49H(I)</td><td>2EH(.)</td></tr><tr><td>4BH(K)</td><td>4AH(J)</td></tr></table></div></div>				Number	Meaning	SD16	Drive	SD17	File name (ASCII code: 8 characters)	SD18	SD19	SD20	SD21	Extension *3	2EH(.)	SD22	(ASCII code: 3 characters)		SD23	(Empty)		SD24	SD25	SD26	42H(B)	41H(A)	44H(D)	43H(C)	46H(F)	45H(E)	48H(H)	47H(G)	49H(I)	2EH(.)	4BH(K)	4AH(J)
Number			Meaning																																				
SD16			Drive																																				
SD17			File name (ASCII code: 8 characters)																																				
SD18																																							
SD19																																							
SD20																																							
SD21			Extension *3				2EH(.)																																
SD22			(ASCII code: 3 characters)																																				
SD23			(Empty)																																				
SD24																																							
SD25																																							
SD26																																							
42H(B)			41H(A)																																				
44H(D)			43H(C)																																				
46H(F)	45H(E)																																						
48H(H)	47H(G)																																						
49H(I)	2EH(.)																																						
4BH(K)	4AH(J)																																						
SD18																																							
SD19																																							
SD20																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							
SD24																																							
SD25																																							
SD26																																							
SD21																																							
SD22																																							
SD23																																							

*3 : Extensions are shown below.

Table App. 3.3. Extension name

SDn Higher 8 bits	SDn+1		Extension Name	File Type
	Lower 8 bits	Higher 8 bits		
51H	50H	41H	QPA	Parameters
51H	50H	47H	QPG	<ul style="list-style-type: none"> • Sequence program • SFC program
51H	43H	44H	QCD	Device comment
51H	44H	49H	QDI	Initial device value
51H	44H	52H	QDR	File register
51H	44H	53H	QDS	Simulation data
51H	44H	4CH	QDL	Local device
51H	54H	44H	QTD	Sampling trace data
51H	54H	4CH	QTL	Status latch data
51H	54H	50H	QTP	Program trace data
51H	54H	52H	QTR	SFC trace file
51H	46H	44H	QFD	Breakdown history data

Table App. 3.2. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD50	Error reset	Error number that performs error rese	<ul style="list-style-type: none">Stores error number that performs error reset	U	New	QnA
SD51	Battery low latch	Bit pattern indicating where battery voltage drop occurred	<ul style="list-style-type: none">All corresponding bits go 1(ON) when battery voltage drops.Subsequently, these remain 1(ON) even after battery voltage has been returned to normal. <div><div>b15to</div><div>b5b4b3b2b1b0</div><div>0</div><div>CPU error</div><div>Memory card A alarm</div><div>Memory card A error</div><div>Memory card B alarm</div><div>Memory card B error</div></div> <ul style="list-style-type: none">In the alarm, data can be held within the time specified for battery low.The error indicates the complete discharge of the battery.	S (Error)	New	QnA
SD52	Battery low	Bit pattern indicating where battery voltage drop occurred	<ul style="list-style-type: none">Same configuration as SD51 aboveTurns to 0 (OFF) when the battery voltage returns to normal thereafter.	S (Error)	New	QnA
SD53	AC/DC DOWN detection	Number of times for AC/DC DOWN detection	<ul style="list-style-type: none">Every time the input voltage falls to or below 85% (AC power)/65% (DC power) of the rating during operation of the CPU module, the value is incremented by 1 and stored in BIN code.	S (Error)	D9005	QnA
SD54	MINI link errors	Error detection state	<div><div>1) When any of X(n+0)/X(n+20), X(n+6)/X(n+26), X(n+7)/X(n+27) and X(n+8)/X(n+28) of the mounted MINI(-S3) turns ON, the bit of the corresponding station turns to 1 (ON).</div><div>2) Turns to 1 (ON) when communication between the mounted MINI(-S3) and CPU module cannot be made.</div></div> <div><div>b15to</div><div>b9b8to</div><div>b0</div><div>8th module</div><div>1st module</div><div>8th module</div><div>1st module</div><div>Information of 2)</div><div>Information of 1)</div></div>	S (Error)	QnA	
SD60	Number of module with blown fuse	Number of module with blown fuse	<ul style="list-style-type: none">Value stored here is the lowest station I/O number of the module with the blown fuse.	S (Error)	QnA	
SD61	I/O module verify error number	I/O module verify error module number	<ul style="list-style-type: none">The lowest I/O number of the module where the I/O module verification number took place.	S (Error)	QnA	

Table App. 3.2. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD62	Annunciator number	Annunciator number	• The first annunciator number (F number) to be detected is stored here.	S (Instruction execution)	D9009	QnA
SD63	Number of annunciators	Number of annunciators	• Stores the number of annunciators searched.	S (Instruction execution)	D9124	QnA
SD64	Table of detected annunciator numbers	Annunciator detection number	When F goes ON due to OUT F or SET F , the F numbers which go progressively ON from SD64 through SD79 are registered. The F numbers turned OFF by RST F are deleted from SD64 - SD79, and the F numbers stored after the deleted F numbers are shifted to the preceding registers. Execution of the LEDR instruction shifts the contents of SD64 to SD79 up by one. (This can also be done by using the INDICATOR RESET switch on the of the Q3A/Q4ACPU.) After 16 annunciators have been detected, detection of the 17th will not be stored from SD64 through SD79.	S (Instruction execution)	D9125	QnA
SD65					D9126	
SD66					D9127	
SD67					D9128	
SD68					D9129	
SD69					D9130	
SD70					D9131	
SD71					D9132	
SD72					New	
SD73					New	
SD74					New	
SD75					New	
SD76					New	
SD77					New	
SD78					New	
SD79					New	
SD80	CHK number	CHK number	• Error codes detected by the CHK instruction are stored as BCD code.	S (Instruction execution)	New	QnA
SD90	Step transition monitoring timer setting value (Enabled only when SFC program exists)	F number for timer set value and time over error	Corresponds to SM90	U	D9108	QnA
SD91			Corresponds to SM91		D9109	
SD92			Corresponds to SM92		D9110	
SD93			Corresponds to SM93		D9111	
SD94			Corresponds to SM94		D9112	
SD95			Corresponds to SM95		D9113	
SD96			Corresponds to SM96		D9114	
SD97			Corresponds to SM97		New	
SD98			Corresponds to SM98		New	
SD99			Corresponds to SM99		New	

(2) System information

Table App. 3.4. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD200	Status of switch	Status of CPU switch	<div><div><div>• The CPU switch status is stored in the following format:</div><div><div><div>b15 to b12</div><div>b11 to b8</div><div>b7 to b4</div><div>b3 to b0</div></div><div><div>3)</div><div>Empty</div><div>2)</div><div>1)</div></div></div></div><div><div>1): CPU switch status</div><div>0: RUN 1: STOP 2: L.CLR</div></div><div><div>2): Memory card switch</div><div>b4 corresponds to memory card A, and b5 corresponds to memory card B. 0: OFF, 1: ON</div></div><div><div>3): DIP switch</div><div>b8 through b12 correspond to SW1 through SW5 of system setting switch 1. b14 and b15 correspond to SW1 and SW2 of system setting switch 2, respectively. OFF at 0; ON at 1</div></div></div>	S (Every END processing)	New	QnA
SD201	LED status	Status of CPU-LED	<div><div><div>• The following bit patterns store the status of the LEDs on the CPU module:</div><div>• 0 is off, 1 is on, and 2 is flicker</div></div><div><div><div>b15 to b12</div><div>b11 to b8</div><div>b7 to b4</div><div>b3 to b0</div></div><div><div>8)</div><div>7)</div><div>6)</div><div>5)</div><div>4)</div><div>3)</div><div>2)</div><div>1)</div></div></div></div> <div><div>1): RUN 5): BOOT</div><div>2): ERROR 6): CARD A (memory card A)</div><div>3): USER 7): CARD B (memory card B)</div><div>4): BAT.ALARM 8): Empty</div></div>	S (Status change)	New	QnA
SD203	Operating status of CPU	Operating status of CPU	<div><div><div>• The CPU operating status is stored as indicated in the following figure:</div><div><div><div>b15 to b12</div><div>b11 to b8</div><div>b7 to b4</div><div>b3 to b0</div></div><div><div>2)</div><div>1)</div></div></div></div><div><div>1): Operating status of CPU</div><div>0: RUN 1: STEP-RUN 2: STOP 3: PAUSE</div></div><div><div>2): STOP/PAUSE cause</div><div>0: Instruction in remote operation program from RUN/STOP switch 1: Remote contact 2: Remote operation from GX Developer/serial communication, etc. 3: Internal program instruction</div></div><div><div>Note: Priority is earliest first</div><div>4: Error</div></div></div>	S (Every END processing)	D9015 format change	QnA

Table App. 3.4. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU																								
SD207	LED display priority ranking	Priorities 1 to 4	<ul style="list-style-type: none">When error is generated, the LED display (flicker) is made according to the error number setting priorities. (The Basic model QCPU supports only the annunciator (error item No. 7)).The Universal model QCPU sets execution/non-execution of LED display of the error corresponding to the each priority ranking when the error occurs.The setting areas for priorities are as follows: <table><tr><td>b15 to b12</td><td>b11 to b8</td><td>b7 to b4</td><td>b3 to b0</td></tr><tr><td>SD207</td><td>Priority 4</td><td>Priority 3</td><td>Priority 2</td></tr><tr><td>SD208</td><td>Priority 8</td><td>Priority 7</td><td>Priority 6</td></tr><tr><td>SD209</td><td></td><td>Priority 10</td><td>Priority 9</td></tr></table>	b15 to b12	b11 to b8	b7 to b4	b3 to b0	SD207	Priority 4	Priority 3	Priority 2	SD208	Priority 8	Priority 7	Priority 6	SD209		Priority 10	Priority 9	U	D9038	QnA								
b15 to b12		b11 to b8		b7 to b4	b3 to b0																									
SD207		Priority 4		Priority 3	Priority 2																									
SD208	Priority 8	Priority 7	Priority 6																											
SD209		Priority 10	Priority 9																											
SD208	Priorities 5 to 8	D9039 format change																												
SD209	Priorities 9 to 10	Default Value SD207 = 4321H SD208 = 8765H (0765H for Redundant CPU) SD209 = 00A9H <ul style="list-style-type: none">No display is made if "0" is set.	New																											
SD210	Clock data	Clock data (year, month)	<ul style="list-style-type: none">The year (last two digits) and month are stored as BCD code as shown below: <table><tr><td>b15 to b12</td><td>b11 to b8</td><td>b7 to b4</td><td>b3 to b0</td></tr><tr><td></td><td></td><td></td><td></td></tr></table> <p>Example: July, 1993 9307_H</p> <p>Year Month</p>	b15 to b12	b11 to b8	b7 to b4	b3 to b0					S (Request)/U	D9025	QnA																
b15 to b12	b11 to b8	b7 to b4	b3 to b0																											
SD211	Clock data	Clock data (day, hour)	<ul style="list-style-type: none">The day and hour are stored as BCD code as shown below: <table><tr><td>b15 to b12</td><td>b11 to b8</td><td>b7 to b4</td><td>b3 to b0</td></tr><tr><td></td><td></td><td></td><td></td></tr></table> <p>Example: 31st, 10 a.m. 3110_H</p> <p>Day Hour</p>	b15 to b12	b11 to b8	b7 to b4	b3 to b0					D9026																		
b15 to b12	b11 to b8	b7 to b4	b3 to b0																											
SD212	Clock data	Clock data (minute, second)	<ul style="list-style-type: none">The minutes and seconds (after the hour) are stored as BCD code as shown below: <table><tr><td>b15 to b12</td><td>b11 to b8</td><td>b7 to b4</td><td>b3 to b0</td></tr><tr><td></td><td></td><td></td><td></td></tr></table> <p>Example: 35 min, 48 s 3548_H</p> <p>Minute Second</p>	b15 to b12	b11 to b8	b7 to b4	b3 to b0					D9027																		
b15 to b12	b11 to b8	b7 to b4	b3 to b0																											
SD213	Clock data	Clock data (day of week)	<ul style="list-style-type: none">The day of the week is stored as BCD code as shown below. <table><tr><td>b15 to b12</td><td>b11 to b8</td><td>b7 to b4</td><td>b3 to b0</td></tr><tr><td></td><td></td><td></td><td></td></tr></table> <p>Example: Friday 0005_H</p> <p>Always set "0".</p> <table><tr><th colspan="2">Day of the week</th></tr><tr><td>0</td><td>Sunday</td></tr><tr><td>1</td><td>Monday</td></tr><tr><td>2</td><td>Tuesday</td></tr><tr><td>3</td><td>Wednesday</td></tr><tr><td>4</td><td>Thursday</td></tr><tr><td>5</td><td>Friday</td></tr><tr><td>6</td><td>Saturday</td></tr></table>	b15 to b12	b11 to b8	b7 to b4	b3 to b0					Day of the week		0	Sunday	1	Monday	2	Tuesday	3	Wednesday	4	Thursday	5	Friday	6	Saturday	S (Request)/U	D9028	QnA
b15 to b12	b11 to b8	b7 to b4	b3 to b0																											
Day of the week																														
0	Sunday																													
1	Monday																													
2	Tuesday																													
3	Wednesday																													
4	Thursday																													
5	Friday																													
6	Saturday																													

Table App. 3.4. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU																								
SD220	LED display data	LED display data	<div>• LED display ASCII data (16 characters) stored here.</div> <div><div>b15to b8 b7to b0</div><table><tr><td>SD220</td><td>15th character from the right</td><td>16th character from the right</td></tr><tr><td>SD221</td><td>13th character from the right</td><td>14th character from the right</td></tr><tr><td>SD222</td><td>11th character from the right</td><td>12th character from the right</td></tr><tr><td>SD223</td><td>9th character from the right</td><td>10th character from the right</td></tr><tr><td>SD224</td><td>7th character from the right</td><td>8th character from the right</td></tr><tr><td>SD225</td><td>5th character from the right</td><td>6th character from the right</td></tr><tr><td>SD226</td><td>3rd character from the right</td><td>4th character from the right</td></tr><tr><td>SD227</td><td>1st character from the right</td><td>2nd character from the right</td></tr></table></div>	SD220	15th character from the right	16th character from the right	SD221	13th character from the right	14th character from the right	SD222	11th character from the right	12th character from the right	SD223	9th character from the right	10th character from the right	SD224	7th character from the right	8th character from the right	SD225	5th character from the right	6th character from the right	SD226	3rd character from the right	4th character from the right	SD227	1st character from the right	2nd character from the right	S (When changed)	New	QnA
SD220				15th character from the right	16th character from the right																									
SD221				13th character from the right	14th character from the right																									
SD222				11th character from the right	12th character from the right																									
SD223				9th character from the right	10th character from the right																									
SD224				7th character from the right	8th character from the right																									
SD225				5th character from the right	6th character from the right																									
SD226				3rd character from the right	4th character from the right																									
SD227				1st character from the right	2nd character from the right																									
SD221																														
SD222																														
SD223																														
SD224																														
SD225																														
SD226																														
SD227																														
SD251	Head I/O number for replacement	Head I/O No. for module replacement	• Stores the upper two digits of the head I/O number of an I/O module that is removed/replaced in the online status (with power on). (Default value: 100H).	U	D9094	Q2A(S1) Q3A Q4A Q4AR																								
SD253	RS422 transmission speed	RS422 transmission speed	• Stores transmission speed of RS422. 0 : 9600bps 1 : 19.2kbps 2 : 38.4kbps	S (When changed)	New	QnA																								

Table App. 3.4. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU	
SD254	MELSECNET/ 10 information	Number of modules installed		• Indicates the number of mounted MELSECNET/10 modules.	S (Initial)	New	QnA
SD255		Information from 1st module	I/O No.	• Indicates I/O number of mounted MELSECNET/10 module			
SD256			Network No.	• Indicates network No. of mounted MELSECNET/10 module			
SD257			Group number	• Indicates group No. of mounted MELSECNET/10 module			
SD258			Station No.	• Indicates station No. of mounted MELSECNET/10 module			
SD259			Standby information	• In the case of standby stations, the module number of the standby station is stored. (1 to 4)			
SD260 to SD264		Information from 2nd module		• Configuration is identical to that for the first module.			
SD265 to SD269		Information from 3rd module		• Configuration is identical to that for the first module.			
SD270 to SD274		Information from 4th module		• Configuration is identical to that for the first module.			
SD280	CC-Link error	Error detection status	<div><div><div>• When Xn0 of the mounted CC-Link module turns ON, the bit of the corresponding station turns to 1 (ON).</div><div>• When either Xn1 or XnF of the mounted CC-Link module turns OFF, the bit of the corresponding station turns to 1 (ON).</div><div>• Turns to 1 (ON) when communication between the mounted CC-Link module and CPU module cannot be made.</div></div><div><div><div>b15to b9 b8to b0</div><div>8th module1st 8th modulemodule1st module</div><div>Information of 2)Information of 1)</div></div></div></div>	S (Error)	New	QnA	
SD290	Device assignment (Same as parameter contents)	Number of points assigned for X		• Stores the number of points currently set for X devices	S (Initial)	New	QnA
SD291		Number of points assigned for Y		• Stores the number of points currently set for Y devices			
SD292		Number of points assigned for M		• Stores the number of points currently set for M devices			
SD293		Number of points assigned for L		• Stores the number of points currently set for L devices			
SD294		Number of points assigned for B		• Stores the number of points currently set for B devices			
SD295		Number of points assigned for F		• Stores the number of points currently set for F devices			
SD296		Number of points assigned for SB		• Stores the number of points currently set for SB devices			
SD297		Number of points assigned for V		• Stores the number of points currently set for V devices			
SD298		Number of points assigned for S		• Stores the number of points currently set for S devices			
SD299		Number of points assigned for T		• Stores the number of points currently set for T device			
SD300		Number of points assigned for ST		• Stores the number of points currently set for ST devices			
SD301		Number of points assigned for C		• Stores the number of points currently set for C devices			
SD302		Number of points assigned for D		• Stores the number of points currently set for D devices			
SD303		Number of points assigned for W		• Stores the number of points currently set for W devices			
SD304		Number of points assigned for SW		• Stores the number of points currently set for SW devices			

Table App. 3.4. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU	
SD340	Ethernet information	No. of modules installed	• Indicates the number of mounted Ethernet module.	S (Initial)	New	QnA	
SD341		Information of 1st module	I/O No.				• Indicates I/O No. of mounted Ethernet module
SD342			Network No.				• Indicates network No. of mounted Ethernet module
SD343			Group No.				• Indicates group No. of mounted Ethernet module
SD344			Station No.				• Indicates station No. of mounted Ethernet module
SD345 to SD346			IP address				• Indicates IP address of mounted Ethernet module
SD347			Error code				• Indicates error code of mounted Ethernet module
SD348 to SD354			Information from 2nd module				• Configuration is identical to that for the first module.
SD355 to SD361		Information from 3rd module	• Configuration is identical to that for the first module.				
SD362 to SD368		Information from 4th module	• Configuration is identical to that for the first module.				
SD380	Ethernet instruction reception status	Instruction reception status of 1st module	<div><div>b15 to b0</div><div><div>0</div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div><div>Not used</div><div>Instruction reception status of channel 1</div><div>Instruction reception status of channel 2</div><div>Instruction reception status of channel 3</div><div>Instruction reception status of channel 4</div><div>Instruction reception status of channel 5</div><div>Instruction reception status of channel 6</div><div>Instruction reception status of channel 7</div><div>Instruction reception status of channel 8</div><div>ON: Received (Channel is being used.) OFF: Not received (Channel is not used.)</div></div> <td>S (Initial)</td> <td>New</td> <td>QnA</td>	S (Initial)	New	QnA	
SD392	Software version	Internal system software version	<div>• Stores the internal system software version in ASCII code.</div> <div><div>Higher byte</div><div>Lower byte</div></div> <div>Stored into lower byte Stored into higher byte</div> <div>For version "A", for example, "41H" is stored.</div> <div>Note: The internal system software version may differ from the version indicated by the version symbol printed on the case.</div>	S (Initial)	D9060	QnA	

(3) System clocks/counters**Table App. 3.5. Special register**

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD412	1 second counter	Number of counts in 1-second units	<ul style="list-style-type: none"> Following programmable controller CPU module RUN, 1 is added each second Count repeats from 0 to 32767 to -32768 to 0 	S (Status change)	D9022	QnA
SD414	2n second clock setting	2n second clock units	<ul style="list-style-type: none"> Stores value n of 2n second clock (Default is 30) Setting can be made between 1 and 32767 	U	New	QnA
SD420	Scan counter	Number of counts in each scan	<ul style="list-style-type: none"> Incremented by 1 for each scan execution after the CPU module is set to RUN. (Not counted by the scan in an initial execution type program.) Count repeats from 0 to 32767 to -32768 to 0 	S (Every END processing)	New	QnA
SD430	Low speed scan counter	Number of counts in each scan	<ul style="list-style-type: none"> Incremented by 1 for each scan execution after the CPU module is set to RUN. Count repeats from 0 to 32767 to -32768 to 0 Used only for low speed execution type programs 	S (Every END processing)	New	QnA

(4) Scan information

Table App. 3.6. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD500	Execution program No.	Program No. in execution	• Program number of program currently being executed is stored as BIN value.	S (Status change)	New	QnA
SD510	Low speed execution type program No.	Low speed execution type program No. in execution	• Program number of low speed execution type program No. currently being executed is stored as BIN value. • Enabled only when SM510 is ON.	S (Every END processing)	New	QnA
SD520	Current scan time	Current scan time (in 1 ms units)	• The current scan time is stored into SD520 and SD521. (Measurement is made in 100 μ s units.) SD520: Stores the ms place. (Storage range: 0 to 65535) SD521: Stores the μ s place. (Storage range: 0 to 900) (Example) When the current scan time is 23.6ms, the following values are stored. SD520 = 23 SD521 = 600	S (Every END processing)	D9017 format change	QnA
SD521		Current scan time (in 100 μ s units)		S (Every END processing)	New	
SD522	Initial scan time	Initial scan time (in 1 ms units)	• Stores the scan time of an initial execution type program into SD522 and SD523. (Measurement is made in 100 μ s units.) SD522: Stores the ms place. (Storage range: 0 to 65535) SD523: Stores the μ s place. (Storage range: 0 to 900)	S (First END processing)	New	QnA
SD523		Initial scan time (in 100 μ s units)				
SD524	Minimum scan time	Minimum scan time (in 1 ms units)	• Stores the minimum value of the scan time except that of an initial execution type program into SD524 and SD525. (Measurement is made in 100 μ s units.) SD524: Stores the ms place. (Storage range: 0 to 65535) SD525: Stores the μ s place. (Storage range: 0 to 900)	S (Every END processing)	D9018 format change	QnA
SD525		Minimum scan time (in 100 μ s units)		S (Every END processing)	New	
SD526	Maximum scan time	Maximum scan time (in 1 ms units)	• Stores the maximum value of the scan time except that of an initial execution type program into SD526 and SD527. (Measurement is made in 100 μ s units.) SD526: Stores the ms place. (Storage range: 0 to 65535) SD527: Stores the μ s place.	S (Every END processing)	D9019 format change	QnA
SD527		Maximum scan time (in 100 μ s units)			New	
SD528	Current scan time for low speed execution type programs	Current scan time (in 1 ms units)	• Stores the current scan time of a low speed execution type program into SD528 and SD529. (Measurement is made in 100 μ s units.) SD528: Stores the ms place. (Storage range: 0 to 65535) SD529: Stores the μ s place. (Storage range: 0 to 900)	S (Every END processing)	New	QnA
SD529		Current scan time (in 100 μ s units)				
SD532	Minimum scan time for low speed execution type programs	Minimum scan time (in 1 ms units)	• Stores the minimum value of the scan time of a low speed execution type program into SD532 and SD533. (Measurement is made in 100 μ s units.) SD532: Stores the ms place. (Storage range: 0 to 65535) SD533: Stores the μ s place. (Storage range: 0 to 900)	S (Every END processing)	New	QnA
SD533		Minimum scan time (in 100 μ s units)				
SD534	Maximum scan time for low speed execution type programs	Maximum scan time (in 1 ms units)	• Stores the maximum value of the scan time except that of the first scan of a low speed execution type program into SD534 and SD535. (Measurement is made in 100 μ s units.) SD534: Stores the ms place. (Storage range: 0 to 65535) SD535: Stores the μ s place. (Storage range: 0 to 900)	S (Every END processing)	New	QnA
SD535		Maximum scan time (in 100 μ s units)				
SD540	END processing time	END processing time (in 1 ms units)	• Stores the time from the end of a scan execution type program to the start of the next scan into SD540 and SD541. (Measurement is made in 100 μ s units.) SD540: Stores the ms place. (Storage range: 0 to 65535) SD541: Stores the μ s place. (Storage range: 0 to 900) (Storage range: 0 to 900)	S (Every END processing)	New	QnA
SD541		END processing time (in 100 μ s units)				
SD542	Constant scan wait time	Constant scan wait time (in 1 ms units)	• Stores the wait time for constant scan setting into SD542 and SD543. (Measurement is made in 100 μ s units. (For the Universal model QCPU, in 1 μ s units.)) SD542: Stores the ms place. (Storage range: 0 to 65535) SD543: Stores the μ s place. (Storage range: 0 to 900 (For the Universal model QCPU, storage range is 0 to 999))	S (Every END processing)	New	QnA
SD543		Constant scan wait time (in 100 μ s units)				

Table App. 3.6. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD544	Cumulative execution time for low speed execution type programs	Cumulative execution time for low speed execution type programs (in 1 ms units)	<ul style="list-style-type: none"> Stores the cumulative execution time of a low speed execution type program into SD544 and SD545. (Measurement is made in 100 μs units.) SD544: Stores the ms place. (Storage range: 0 to 65535) SD545: Stores the μs place. (Storage range: 0 to 900) Cleared to 0 after the end of one low speed scan. 	S (Every END processing)	New	QnA
SD545		Cumulative execution time for low speed execution type programs (in 100 μ s units)				
SD546	Execution time for low speed execution type programs	Execution time for low speed execution type programs (in 1 ms units)	<ul style="list-style-type: none"> Stores the execution time of a low speed execution type program during one scan into SD546 and SD547. (Measurement is made in 100 μs units.) SD546: Stores the ms place. (Storage range: 0 to 65535) SD547: Stores the μs place. (Storage range: 0 to 900) Stored every scan. 	S (Every END processing)	New	QnA
SD547		Execution time for low speed execution type programs (in 100 μ s units)				
SD548	Scan execution type program execution time	Scan execution type program execution time (in 1 ms units)	<ul style="list-style-type: none"> Stores the execution time of a scan execution type program during one scan into SD548 and SD549. (Measurement is made in 100 μs units.) SD548: Stores the ms place. (Storage range: 0 to 65535) SD549: Stores the μs place. (Storage range: 0 to 900) Stored every scan. 	S (Every END processing)	New	QnA
SD549		Scan execution type program execution time (in 100 μ s units)				
SD550	Service interval measurement module	Unit/module No.	<ul style="list-style-type: none"> Sets I/O number for module that measures service interval. 	U	New	QnA
SD551	Service interval time	Module service interval (in 1 ms units)	<ul style="list-style-type: none"> Stores the service interval for the module specified in SD550 into SD551 and SD552 when SM551 is turned ON. (Measurement is made in 100 μs units.) SD551: Stores the ms place. (Storage range: 0 to 65535) SD552: Stores the μs place. (Storage range: 0 to 900) 	S (Request)	New	QnA
SD552		Module service interval (in 100 μ s units)				

(5) Drive information

Table App. 3.7. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD600	Memory card A types	Memory card A types	<ul style="list-style-type: none">Indicates the type of memory card A installed. <div><div>b15 to b8b7 to b4b3 to b0</div><div>0</div><div><div>Drive 1 (RAM) type</div><div>0: Does not exist 1: SRAM</div></div><div><div>Drive 2 (ROM) type</div><div>0: Does not exist 2: E²PROM 3: Flash ROM</div></div></div>	S (Initial and card removal)	New	QnA
SD602	Drive 1 (Memory card RAM) capacity	Drive 1 capacity	<ul style="list-style-type: none">Drive 1 capacity is stored in 1 k byte units.(Empty capacity after format is stored.)	S (Initial and card removal)	New	QnA
SD603	Drive 2 (Memory card ROM) capacity	Drive 2 capacity	<ul style="list-style-type: none">Drive 2 capacity is stored in 1 k byte units.	S (Initial and card removal)	New	QnA
SD604	Memory card A use conditions	Memory card A use conditions	<ul style="list-style-type: none">The use conditions for memory card A are stored as bit patterns. (In use when ON)The significance of these bit patterns is indicated below: <div><div>b0 : Boot operation (QBT) b1 : Parameters (QPA) b2 : Device comments (QCD) b3 : Device initial value (QDI) b4 : File register (QDR) b5 : Sampling trace (QTD) b6 : Status latch (QTL) b7 : Program trace (QTP)</div><div>b8 : Simulation data (QDS) b9 : CPU fault history (QFD) b10 : SFC trace (QTR) b11 : Local device (QDL) b12 : Not used b13 : Not used b14 : Not used b15 : Not used</div></div>	S (Status change)	New	QnA
SD620	Memory card B types	Memory card B types	<ul style="list-style-type: none">Indicates memory card B type installed <div><div>b15 to b8b7 to b4b3 to b0</div><div>0</div><div><div>Drive 3 (RAM)</div><div>0: Does not exist 1: SRAM</div></div><div><div>Drive 4 (ROM)</div><div>0: Does not exist 2: E²PROM 3: Flash ROM</div></div></div>	S (Initial/Card installation and removal)	New	Q2A(S1) Q3A Q4A Q4AR
SD622	Drive 3 (Standard RAM) capacity	Drive 3 capacity	<ul style="list-style-type: none">Drive 3 capacity is stored in 1 k byte units. (Empty capacity after format is stored.)	S (Initial/Card installation and removal)	New	Q2A(S1) Q3A Q4A Q4AR
SD623	Drive 4 (Standard ROM) capacity	Drive 4 capacity	<ul style="list-style-type: none">Drive 4 capacity is stored in 1 k byte units. (Empty capacity after format is stored.)	S (Initial/Card installation and removal)	New	Q2A(S1) Q3A Q4A Q4AR
SD624	Memory card B use conditions	Memory card B use conditions	<ul style="list-style-type: none">The use conditions for memory card B are stored as bit patterns. (In use when ON)The significance of these bit patterns is indicated below: <div><div>b0 : Boot operation (QBT) b1 : Parameters (QPA) b2 : Device comments (QCD) b3 : Device initial value (QDI) b4 : File register (QDR) b5 : Sampling trace (QTD) b6 : Status latch (QTL) b7 : Program trace (QTP)</div><div>b8 : Simulation data (QDS) b9 : CPU fault history (QFD) b10 : SFC trace (QTS) b11 : Local device (QDL) b12 : Local device (QDL) b13 : Not used b14 : Not used b15 : Not used</div></div>	S (Status change)	New	Q2A(S1) Q3A Q4A Q4AR
SD640	File register drive	Drive number:	<ul style="list-style-type: none">Stores drive number being used by file register	S (Status change) *10	New	QnA

Table App. 3.7. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD641	File register file name	File register file name	• Stores file register file name (with extension) selected at parameters or by use of QDRSET instruction as ASCII code.	S (Status change)	New	QnA
SD642						
SD643						
SD644						
SD645						
SD647	File register capacity	File register capacity	• Stores the data capacity of the currently selected file register in 1 k word units.	S (Status change)	New	QnA
SD648	File register block number	File register block number	• Stores the currently selected file register block number.	S (Status change)	D9035	QnA
SD650	Comment drive	Comment drive number	• Stores the comment drive number selected at the parameters or by the QCDSET instruction.	S (Status change)	New	QnA
SD651	Comment file name	Comment file name	• Stores the comment file name (with extension) selected at the parameters or by the QCDSET instruction in ASCII code.	S (Status change)	New	QnA
SD652						
SD653						
SD654						
SD655						
SD656						
SD660	Boot operation designation file	Boot designation file drive number	• Stores the drive number where the boot designation file (*.QBT) is being stored.	S (Initial)	New	QnA
SD661		File name of boot designation file	• Stores the file name of the boot designation file (*.QBT).	S (Initial)	New	QnA
SD662						
SD663						
SD664						
SD665						
SD666						

(6) Instruction-Related Registers

Table App. 3.8. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU																				
SD705	Mask pattern	Mask pattern	• During block operations, turning SM705 ON makes it possible to use the mask pattern being stored at SD705 (or at SD705 and SD706 if double words are being used) to operate on all data in the block with the masked values.	U	New	QnA																				
SD706																										
SD714	Number of empty communication request registration areas	0 to 32	• Stores the number of empty blocks in the communications request area for remote terminal modules connected to the MELSECNET/MINI-S3.	S (During execution)	D9081	QnA																				
SD715	IMASK instruction mask pattern	Mask pattern	• Patterns masked by use of the IMASK instruction are stored in the following manner: <table><tr><td></td><td>b15</td><td></td><td>b1</td><td>b0</td></tr><tr><td>SD715</td><td>I15</td><td>to</td><td>I1</td><td>I0</td></tr><tr><td>SD716</td><td>I31</td><td>to</td><td>I17</td><td>I16</td></tr><tr><td>SD717</td><td>I47</td><td>to</td><td>I33</td><td>I32</td></tr></table>		b15		b1	b0	SD715	I15	to	I1	I0	SD716	I31	to	I17	I16	SD717	I47	to	I33	I32	S (During execution)	New	QnA
				b15		b1	b0																			
SD715				I15	to	I1	I0																			
SD716				I31	to	I17	I16																			
SD717	I47	to	I33	I32																						
SD716																										
SD717																										
SD718	Accumulator	Accumulator	• For use as replacement for accumulators used in A series programs.	S/U	New	QnA																				
SD719																										
SD730	No. of empty areas for CC-Link communication request register area	0 to 32	• Stores the number of empty registration area for the request for communication with the intelligent device station connected to A(1S)J61QBT61.	S (During execution)	New	QnA																				
SD736	PKEY input	PKEY input	• Special register that temporarily stores keyboard data input by means of the PKEY instruction.	S (During execution)	New	QnA																				

Table App. 3.8. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD738	Message storage	Message storage	<ul style="list-style-type: none"> Stores the message designated by the MSG instruction. 	S (During execution)	New	QnA
SD739						
SD740						
SD741						
SD742						
SD743						
SD744						
SD745						
SD746						
SD747						
SD748						
SD749						
SD750						
SD751						
SD752						
SD753						
SD754						
SD755						
SD756						
SD757						
SD758						
SD759						
SD760						
SD761						
SD762						
SD763						
SD764						
SD765						
SD766						
SD767						
SD768						
SD769						
SD780	Remaining No. of simultaneous execution of CC-Link dedicated instruction	0 to 32	<ul style="list-style-type: none"> Stores the remaining number of simultaneous execution of the CC-Link dedicated instructions. 	U	New	QnA

(7) Debug

Table App. 3.9. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU																												
SD806	Status latch file name	Status latch file name	<ul style="list-style-type: none">Stores file name (with extension) from point in time when status latch was conducted as ASCII code. <table><tr><td></td><td>b15 to b8</td><td>b7 to b0</td></tr><tr><td>SD806</td><td>2nd character</td><td>1st character</td></tr><tr><td>SD807</td><td>4th character</td><td>3rd character</td></tr><tr><td>SD808</td><td>6th character</td><td>5th character</td></tr><tr><td>SD809</td><td>8th character</td><td>7th character</td></tr><tr><td>SD810</td><td>1st character of the extension</td><td>2EH(.)</td></tr><tr><td>SD811</td><td>3rd character of the extension</td><td>2nd character of the extension</td></tr></table>		b15 to b8	b7 to b0	SD806	2nd character	1st character	SD807	4th character	3rd character	SD808	6th character	5th character	SD809	8th character	7th character	SD810	1st character of the extension	2EH(.)	SD811	3rd character of the extension	2nd character of the extension	S (During execution)	New	QnA							
				b15 to b8	b7 to b0																													
SD806				2nd character	1st character																													
SD807				4th character	3rd character																													
SD808				6th character	5th character																													
SD809				8th character	7th character																													
SD810	1st character of the extension	2EH(.)																																
SD811	3rd character of the extension	2nd character of the extension																																
SD807																																		
SD808																																		
SD809																																		
SD810																																		
SD811																																		
SD812	Status latch step	Status latch step	<ul style="list-style-type: none">Stores step number from point in time when status latch was conducted. <table><tr><td>SD812</td><td>Pattern *1</td></tr><tr><td>SD813</td><td>Block No.</td></tr><tr><td>SD814</td><td>Step No./transition condition No.</td></tr><tr><td>SD815</td><td>Sequence step No. (L)</td></tr><tr><td>SD816</td><td>Sequence step No. (H)</td></tr></table> <p>*1: Contents of pattern data</p> <table><tr><td>15</td><td>14</td><td>to</td><td>4</td><td>3</td><td>2</td><td>1</td><td>0</td><td>← (Bit number)</td></tr><tr><td>0</td><td>0</td><td>to</td><td>0</td><td>0</td><td>*</td><td>*</td><td>*</td><td></td></tr></table> <p>(Not used)</p> <p>SFC block designation present (1)/absent (0)</p> <p>SFC step designation present (1)/absent (0)</p> <p>SFC transition designation present (1)/absent (0)</p>	SD812	Pattern *1	SD813	Block No.	SD814	Step No./transition condition No.	SD815	Sequence step No. (L)	SD816	Sequence step No. (H)	15	14	to	4	3	2	1	0	← (Bit number)	0	0	to	0	0	*	*	*		S (During execution)	D9055 format change	QnA
SD812				Pattern *1																														
SD813				Block No.																														
SD814				Step No./transition condition No.																														
SD815				Sequence step No. (L)																														
SD816				Sequence step No. (H)																														
15	14	to	4	3	2	1	0	← (Bit number)																										
0	0	to	0	0	*	*	*																											
SD813																																		
SD814																																		
SD815																																		
SD816																																		

(8) Latch area

Table App. 3.10. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD900	Drive where power was interrupted	Access file drive number during power loss	• Stores drive number if file was being accessed during power loss.	S (Status change)	New	QnA
SD901	File name active during power loss	Access file name during power loss	• Stores file name (with extension) in ASCII code if file was being accessed during power loss. b15 to b8 b7 to b0 SD901 2nd character 1st character SD902 4th character 3rd character SD903 6th character 5th character SD904 8th character 7th character SD905 1st character of the extension 2EH(.) SD906 3rd character of the extension 2nd character of the extension	S (Status change)	New	QnA
SD902						
SD903						
SD904						
SD905						
SD906						
SD910	RKEY input	RKEY input	• Stored in sequence that PU key code was entered. b15 to b8 b7 to b0 SD910 2nd character 1st character SD911 4th character 3rd character SD912 6th character 5th character SD913 8th character 7th character SD914 10th character 9th character SD915 12th character 11th character SD916 14th character 13th character SD917 16th character 15th character SD918 18th character 17th character SD919 20th character 19th character SD920 22nd character 21st character SD921 24th character 23rd character SD922 26th character 25th character SD923 28th character 27th character SD924 30th character 29th character SD925 32nd character 31st character	S (During execution)	New	QnA
SD911						
SD912						
SD913						
SD914						
SD915						
SD916						
SD917						
SD918						
SD919						
SD920						
SD921						
SD922						
SD923						
SD924						
SD925						

(9) A to QnA conversion

ACPU special registers D9000 to D9255 correspond to QnA special registers SD1000 to SD1255 after A to Q/QnA conversion.

These special registers are all set by the system, and cannot be set by the user program.

To set data by the user program, correct the program for use of the QnACPU special registers.

However, some of SD1200 to SD1255 (corresponding to D9200 to 9255 before conversion) can be set by the user program if they could be set by the user program before conversion.

For details on the ACPUs special registers, refer to the user's manual for the corresponding CPU, and MELSECNET or MELSECNET/B Data Link System Reference Manuals.

REMARK

Supplemental explanation on "Special Register for Modification" column

- ① For the device numbers for which a special register for modification is specified, modify it to the special register for QnACPU.
- ② For the device numbers for which ☐ is specified, special register after conversion can be used.
- ③ Device numbers for which ☒ is specified do not function for QnACPU.

Table App. 3.11. Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																
D9000	SD1000	—	Fuse blown	Number of module with blown fuse	<ul style="list-style-type: none">When fuse blown modules are detected, the first I/O number of the lowest number of the detected modules is stored in hexadecimal. (Example: When fuses of Y50 to 6F output modules have blown, "50" is stored in hexadecimal)To monitor the number by peripheral devices, perform monitor operation given in hexadecimal. (Cleared when all contents of SD1100 to SD1107 are reset to 0.)Fuse blow check is executed also to the output modules of remote I/O stations.	QnA																																																
D9001	SD1001	—	Fuse blown	Number of module with blown fuse	<ul style="list-style-type: none">Stores the module numbers corresponding to setting switch numbers or base slot numbers when fuse blow occurred. <table><tr><th colspan="2">AJ02 I/O module</th><th colspan="2">Extension base unit</th></tr><tr><th>Setting switch</th><th>Stored data</th><th>Base unit slot No.</th><th>Stored data</th></tr><tr><td>0</td><td>0</td><td>0</td><td>4</td></tr><tr><td>1</td><td>1</td><td>1</td><td>5</td></tr><tr><td>2</td><td>2</td><td>2</td><td>6</td></tr><tr><td>3</td><td>3</td><td>3</td><td>7</td></tr><tr><td>4</td><td>4</td><td></td><td></td></tr><tr><td>5</td><td>5</td><td></td><td></td></tr><tr><td>6</td><td>6</td><td></td><td></td></tr><tr><td>7</td><td>7</td><td></td><td></td></tr></table> <ul style="list-style-type: none">For the remote I/O station, the value of (module I/O No./10H) + 1 is stored.	AJ02 I/O module		Extension base unit		Setting switch	Stored data	Base unit slot No.	Stored data	0	0	0	4	1	1	1	5	2	2	2	6	3	3	3	7	4	4			5	5			6	6			7	7			QnA								
AJ02 I/O module		Extension base unit																																																				
Setting switch	Stored data	Base unit slot No.	Stored data																																																			
0	0	0	4																																																			
1	1	1	5																																																			
2	2	2	6																																																			
3	3	3	7																																																			
4	4																																																					
5	5																																																					
6	6																																																					
7	7																																																					
D9002	SD1002	—	I/O module verify error	I/O module verify error module number	<ul style="list-style-type: none">If I/O modules, of which data are different from data entered, are detected when the power is turned on, the first I/O number of the lowest number unit among the detected units is stored in hexadecimal. (Storing method is the same as that of SD1000.)To monitor the number by peripheral devices, perform monitor operation given in hexadecimal. (Cleared when all contents of SD1116 to SD1123 are reset to 0.)I/O module verify check is executed also to the modules of remote I/O terminals.	QnA																																																
D9004	SD1004	—	MINI link master module errors	Stores setting status made at parameters	<ul style="list-style-type: none">Error status of the MINI(S3) link detected on loaded AJ71PT32(S3) is stored. <table><tr><td colspan="8">b15 to b8</td><td colspan="8">b7 to b0</td></tr><tr><td>8th</td><td>7th</td><td>6th</td><td>5th</td><td>4th</td><td>3rd</td><td>2nd</td><td>1st</td><td>8th</td><td>7th</td><td>6th</td><td>5th</td><td>4th</td><td>3rd</td><td>2nd</td><td>1st</td></tr><tr><td colspan="8"><div>↑</div><div>Bits which correspond to faulty AJ71PT32(S3) are turned on.</div></td><td colspan="8"><div>↑</div><div>Bits which correspond to the signals of AJ71PT32(S3), shown below, are turned on as the signals are turned on.</div><ul style="list-style-type: none">Hardware error (X0/X20)MINI(S3) link error detection (X6/X26)MINI(S3) link communication error (X7/X27)</td></tr></table>	b15 to b8								b7 to b0								8th	7th	6th	5th	4th	3rd	2nd	1st	8th	7th	6th	5th	4th	3rd	2nd	1st	<div>↑</div> <div>Bits which correspond to faulty AJ71PT32(S3) are turned on.</div>								<div>↑</div> <div>Bits which correspond to the signals of AJ71PT32(S3), shown below, are turned on as the signals are turned on.</div> <ul style="list-style-type: none">Hardware error (X0/X20)MINI(S3) link error detection (X6/X26)MINI(S3) link communication error (X7/X27)								QnA
b15 to b8								b7 to b0																																														
8th	7th	6th	5th	4th	3rd	2nd	1st	8th	7th	6th	5th	4th	3rd	2nd	1st																																							
<div>↑</div> <div>Bits which correspond to faulty AJ71PT32(S3) are turned on.</div>								<div>↑</div> <div>Bits which correspond to the signals of AJ71PT32(S3), shown below, are turned on as the signals are turned on.</div> <ul style="list-style-type: none">Hardware error (X0/X20)MINI(S3) link error detection (X6/X26)MINI(S3) link communication error (X7/X27)																																														
D9005	SD1005	—	AC DOWN counter	Number of times for AC DOWN	<ul style="list-style-type: none">When the AC power supply module is used, 1 is added at occurrence of an instantaneous power failure of within 20ms. (The value is stored in BIN code.) It is reset when the power supply is switched from OFF to ON.	QnA																																																
					<ul style="list-style-type: none">When the DC power supply module is used, 1 is added at occurrence of an instantaneous power failure of within 1ms. (The value is stored in BIN code.) It is reset when the power supply is switched from OFF to ON.	QnA																																																
D9008	SD1008	SD0	Self-diagnostic error	Self-diagnostic error number	<ul style="list-style-type: none">When error is found as a result of self-diagnosis, error number is stored in BIN code.	QnA																																																

Table App. 3.11. Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU
D9009	SD1009	SD62	Annunciator detection	F number at which external failure has occurred	<ul style="list-style-type: none">When one of F0 to 2047 is turned on by [OUT F] or [SET F], the F number, which has been detected earliest among the F numbers which have turned on, is stored in BIN code.SD62 can be cleared by [RST F] or [LEDR] instruction. If another F number has been detected, the clearing of SD62 causes the next number to be stored in SD62.	Q2AS Q2A
					<ul style="list-style-type: none">When one of F0 to 2047 is turned on by [OUT F] or [SET F], the F number, which has been detected earliest among the F numbers which have turned on, is stored in BIN code.SD62 can be cleared by executing [RST F] or [LEDR] instruction or moving INDICATOR RESET switch on CPU module front to ON position. If another F number has been detected, clearing of SD62 stores the next F number into SD62.	Q3A Q4A Q4AR
D9015	SD1015	SD203	Operating status of CPU	Operating status of CPU	<ul style="list-style-type: none">The operation status of CPU as shown below are stored in SD203. <div><div><div>b15 to b12</div><div>b11 to b8</div><div>b7 to b4</div><div>b3 to b0</div></div><div><div><div>Remote RUN/STOP by computer</div><div>0 RUN</div><div>1 STOP</div><div>2 PAUSE*1</div></div><div><div>Status in program</div><div>0 Except below</div><div>1 <div>STOP</div><div>Instruction execution</div></div></div><div><div><div>CPU key switch</div><div>0 RUN</div><div>1 STOP</div><div>2 PAUSE*1</div><div>3 STEP RUN</div></div><div><div>(Remains the same in remote RUN/STOP mode.)</div><div>Remote RUN/STOP by parameter setting</div><div>0 RUN</div><div>1 STOP</div><div>2 PAUSE*1</div></div></div></div><p>*1: When the CPU module is in RUN mode and SM1040 is off, the CPU module remains in RUN mode if changed to PAUSE mode.</p></div>	QnA
D9016	SD1016	×	Program number	0: Main program (ROM) 1: Main program (RAM) 2: Subprogram 1 (RAM) 3: Subprogram 2 (RAM) 4: Subprogram 3 (RAM) 5: Subprogram 1 (ROM) 6: Subprogram 2 (ROM) 7: Subprogram 3 (ROM) 8: Main program (E ² PROM) 9: Subprogram 1 (E ² PROM) A: Subprogram 2 (E ² PROM) B: Subprogram 3 (E ² PROM)	<ul style="list-style-type: none">Indicates which sequence program is run presently. One value of 0 to B is stored in BIN code.	QnA
D9017	SD1017	SD520	Scan time	Minimum scan time (10 ms units)	<ul style="list-style-type: none">If scan time is smaller than the content of SD520, the value is newly stored at each END. Namely, the minimum value of scan time is stored into SD520 in BIN code.	QnA
D9018	SD1018	SD524	Scan time	Scan time (10 ms units)	<ul style="list-style-type: none">At every END, the scan time is stored in BIN code and always rewritten.	QnA
D9019	SD1019	SD526	Scan time	Maximum scan time (10 ms units)	<ul style="list-style-type: none">If scan time is larger than the content of SD526, the value is newly stored at each END. Namely, the maximum value of scan time is stored into SD526 in BIN code.	QnA

Table App. 3.11. Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																
D9020	SD1020	x	Constant scan	Constant scan time (User sets in 10 ms units)	<ul style="list-style-type: none">Sets the interval between consecutive program starts in multiples of 10 ms. 0 : No setting 1 to 200 : Set. Program is executed at intervals of (set value) × 10 ms.	QnA																
D9021	SD1021	—	Scan time	Scan time (1 ms units)	<ul style="list-style-type: none">At every END, the scan time is stored in BIN code and always rewritten.	QnA																
D9022	SD1022	SD412	1 second counter	Count in units of 1s.	<ul style="list-style-type: none">When the PC CPU starts running, it starts counting 1 every second.It starts counting up from 0 to 32767, then down to -32768 and then again up to 0. Counting repeats this routine.	QnA																
D9025	SD1025	—	Clock data	Clock data (year, month)	<ul style="list-style-type: none">The year (last two digits) and month are stored as BCD code as shown below. <div><div>b15 to b12b11 to b8b7 to b4b3 to b0</div><div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div><div>Example: 1987, July H8707</div><div>YearMonth</div></div>	QnA																
D9026	SD1026	—	Clock data	Clock data (day, hour)	<ul style="list-style-type: none">The day and hour are stored as BCD code as shown below. <div><div>b15 to b12b11 to b8b7 to b4b3 to b0</div><div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div><div>Example: 31st, 10 a.m. H3110</div><div>DayHour</div></div>	QnA																
D9027	SD1027	—	Clock data	Clock data (minute, second)	<ul style="list-style-type: none">The minute and second are stored as BCD code as shown below. <div><div>b15 to b12b11 to b8b7 to b4b3 to b0</div><div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div><div>Example: 35 min, 48 sec. H3548</div><div>MinuteSecond</div></div>	QnA																
D9028	SD1028	—	Clock data	Clock data (day of week)	<ul style="list-style-type: none">The day of the week is stored as BCD code as shown below. <div><div>b15 to b12b11 to b8b7 to b4b3 to b0</div><div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div><div>Example: Friday H0005</div><div>Always set "0".</div><div><table><tr><th colspan="2">Day of the week</th></tr><tr><td>0</td><td>Sunday</td></tr><tr><td>1</td><td>Monday</td></tr><tr><td>2</td><td>Tuesday</td></tr><tr><td>3</td><td>Wednesday</td></tr><tr><td>4</td><td>Thursday</td></tr><tr><td>5</td><td>Friday</td></tr><tr><td>6</td><td>Saturday</td></tr></table></div></div>	Day of the week		0	Sunday	1	Monday	2	Tuesday	3	Wednesday	4	Thursday	5	Friday	6	Saturday	QnA
Day of the week																						
0	Sunday																					
1	Monday																					
2	Tuesday																					
3	Wednesday																					
4	Thursday																					
5	Friday																					
6	Saturday																					
D9035	SD1035	SD648	Extension file register	Use block No.	<ul style="list-style-type: none">Stores the block No. of the extension file register being used in BCD code.	QnA																
D9036	SD1036	x	Extension file registerfor designation of device number	Device number when individual devices from extension file register are directly accessed	<ul style="list-style-type: none">Designate the device number for the extension file register for direct read and write in 2 words at SD1036 and SD1037 in BIN data. Use consecutive numbers beginning with R0 of block No. 1 to designate device numbers. <div><div>Extension file register</div><div><div>0 to 16383</div><div>Block No.1 area</div><div>16384 to</div><div>Block No.2 area</div><div></div><div></div></div><div>SD1037,SD1036</div><div>Device No. (BIN data)</div></div>	QnA																
D9037	SD1037	x				QnA																


Table App. 3.11. Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU
D9038	SD1038	SD207	LED display priority ranking	Priorities 1 to 4	<div><div><div><div>b15 to b12</div><div>b11 to b8</div><div>b7 to b4</div><div>b3 to b0</div></div><div><div>SD207</div><div>Priority 4</div><div>Priority 3</div><div>Priority 2</div><div>Priority 1</div></div><div><div>SD208</div><div></div><div>Priority 7</div><div>Priority 6</div><div>Priority 5</div></div></div></div> <div><ul style="list-style-type: none">Sets priority of ERROR LEDs which illuminate (or flicker) to indicate errors with error code numbers.Configuration of the priority setting areas is as shown below.<div><ul style="list-style-type: none">For details, refer to the applicable CPUs User's Manual and the ACPU Programming manual (Fundamentals).</div></div>	QnA
D9039	SD1039	SD208		Priorities 5 to 7		QnA
D9044	SD1044	×	For sampling trace	Step or time during sampling trace	<div><ul style="list-style-type: none">Turned on/off with a peripheral device.<div>When STRA or STRAR is executed, the value stored in SD1044 is used as the sampling trace condition.</div><div>At scanning-----0</div><div>At time-----Time (10 msec unit)</div><div>The value is stored into SD1044 in BIN code.</div></div>	QnA
D9049	SD1049	×	Work area for SFC	Block number of extension file register	<div><ul style="list-style-type: none">Stores the block number of the expansion file register which is used as the work area for the execution of a SFC program in a binary value.Stores "0" if an empty area of 16K bytes or smaller, which cannot be expansion file register No. 1, is used or if SM320 is OFF.</div>	QnA
D9050	SD1050	×	SFC program error number	Error code generated by SFC program	<div><ul style="list-style-type: none">Stores error code of errors occurred in the SFC program in BIN code.<div>0 : No error</div><div>80: SFC program parameter error</div><div>81: SFC code error</div><div>82: Number of steps of simultaneous execution exceeded</div><div>83: Block start error</div><div>84: SFC program operation error</div></div>	QnA
D9051	SD1051	×	Error block	Block number where error occurred	<div><ul style="list-style-type: none">Stores the block number in which an error occurred in the SFC program in BIN code.<div>In the case of error 83 the starting block number is stored.</div></div>	QnA
D9052	SD1052	×	Error step	Step number where error occurred	<div><ul style="list-style-type: none">Stores the step number, where error code 84 occurred in an SFC program, in BIN value.Stores "0" when error code 80, 81 or 82 occurred.Stores the block stating step number when error code 83 occurs.</div>	QnA
D9053	SD1053	×	Error transition	Transition condition number where error occurred	<div><ul style="list-style-type: none">Stores the transition condition number, where error code 84 occurred in an SFC program, in BIN value.<div>Stores "0" when error code 80, 81, 82 or 83 occurred.</div></div>	QnA
D9054	SD1054	×	Error sequence step	Sequence step number where error occurred	<div><ul style="list-style-type: none">Stores the sequence step number of transfer condition and operation output in which error 84 occurred in the SFC program in BIN code.</div>	QnA
D9055	SD1055	SD812	Status latch execution step number	Status latch step	<div><ul style="list-style-type: none">Stores the step number when status latch is executed.Stores the step number in a binary value if status latch is executed in a main sequence program.Stores the block number and the step number if status latch is executed in a SFC program.<div><div><div>Block No. (BIN)</div><div>Step No. (BIN)</div></div><div><div>← Upper 8 bits →</div><div>← Lower 8 bits →</div></div></div></div>	QnA
D9060	SD1060	SD392	Software version	Software version of internal software	<div><ul style="list-style-type: none">Stores the software version of the internal system in ASCII code.<div><div><div>Upper byte</div><div>Lower byte</div></div><div>Stored into lower byte</div><div>Undefined value in higher byte</div><div>For version "A", for example, "41H" is stored.</div></div><div>Note: The software version of the initial system may differ from the version indicated by the version information printed on the rear of the case.</div></div>	QnA
D9072	SD1072	×	PLC communication check	Data check of serial communication module	<div><ul style="list-style-type: none">In the self-loopback test of the serial communication module, the serial communication module writes/reads data automatically to make communication checks.</div>	QnA
D9081	SD1081	SD714	Number of empty blocks in communications request registration area	Number of empty blocks in communications request registration area	<div><ul style="list-style-type: none">Stores the number of empty blocks in the communication request registration area to the remote terminal module connected to the MELSECNET/MINI-S3 master unit, A2CCPU or A52GCPU.</div>	QnA

Table App. 3.11. Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																																																																						
D9085	SD1085	x	Register for setting time check value	1 s to 65535 s	<ul style="list-style-type: none">Sets the time check time of the data link instructions (ZNRD, ZNWR) for the MELSECNET/10.Setting range : 1 s to 65535 s (1 to 65535)Setting unit: 1 sDefault value : 10 s (If 0 has been set, default 10 s is applied)	QnA																																																																																																						
D9090	SD1090	x	Number of special functions modules over	Number of special functions modules over	<ul style="list-style-type: none">For details, refer to the manual of each microcomputer program package.	QnA																																																																																																						
D9091	SD1091	x	Detailed error code	Self-diagnosis detailed error code	<ul style="list-style-type: none">Stores the detail code of cause of an instruction error.	QnA																																																																																																						
D9094	SD1094	SD251	Head I/O number of I/O module to be replaced	Head I/O number of I/ O module to be replaced	<ul style="list-style-type: none">Stores the first two digits of the head I/O number of the I/O module, which will be dismantled/mounted online (with power on), in BIN value. Example) Input module X2F0→ H2F	QnA																																																																																																						
D9100	SD1100	—	Fuse blown module	Bit pattern in units of 16 points, indicating the modules whose fuses have blown	<ul style="list-style-type: none">Output module numbers (in units of 16 points), of which fuses have blown, are entered in bit pattern. (Preset output module numbers when parameter setting has been performed.) <div><div>b15b14b13b12b11b10b9b8b7b6b5b4b3b2b1b0</div><table><tr><td>SD1100</td><td>0</td><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td></td><td></td><td></td><td></td><td>(YCO)</td><td></td><td></td><td></td><td>(YBO)</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1101</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td>SD1107</td><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td><td>0</td></tr><tr><td></td><td></td><td></td><td></td><td>(YB0)</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td>(YB30)</td><td></td><td></td><td></td></tr></table><div>↑ Indicates fuse blow.</div></div>	SD1100	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	0					(YCO)				(YBO)									SD1101	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	SD1107	0	0	0	0	1	0	0	0	0	0	0	0	1	0	0	0					(YB0)									(YB30)				QnA																	
SD1100	0				0	0	1	0	0	0	1	0	0	0	0	0	0	0	0																																																																																									
							(YCO)				(YBO)																																																																																																	
SD1101	0				0	0	0	0	0	0	0	0	0	0	0	0	0	0	0																																																																																									
SD1107	0				0	0	0	1	0	0	0	0	0	0	0	1	0	0	0																																																																																									
							(YB0)									(YB30)																																																																																												
D9101	SD1101																																																																																																											
D9102	SD1102																																																																																																											
D9103	SD1103																																																																																																											
D9104	SD1104																																																																																																											
D9105	SD1105																																																																																																											
D9106	SD1106																																																																																																											
D9107	SD1107				<ul style="list-style-type: none">Fuse blow check is executed also to the output module of remote I/O station. (If normal status is restored, clear is not performed. Therefore, it is required to perform clear by user program.)																																																																																																							
D9108	SD1108	—	Step transfer monitoring timer setting	Timer setting valve and the F number at time out	<ul style="list-style-type: none">Set the value of the step transition monitoring timer and the annunciator number (F number) that will be turned ON when the monitoring timer times out. <div><div>b15to b8b7to b0</div><div><div></div><div></div></div><div>F number setting (02 to 255)Timer time limit setting (1 to 255 s:(1 s units))</div></div> <ul style="list-style-type: none">By turning ON any of SM1108 to SM1114, the monitoring timer starts. If the transition condition following a step which corresponds to the timer is not established within set time, set annunciator (F) is turned on.)	QnA																																																																																																						
D9109	SD1109																																																																																																											
D9110	SD1110																																																																																																											
D9111	SD1111																																																																																																											
D9112	SD1112																																																																																																											
D9113	SD1113																																																																																																											
D9114	SD1114																																																																																																											
D9116	SD1116	—	I/O module verification error	Bit pattern, in units of 16 points, indicating the modules with verification errors.	<ul style="list-style-type: none">When I/O modules, of which data are different from those entered at power-ON, have been detected, the I/O module numbers (in units of 16 points) are entered in bit pattern. (Preset I/O module numbers set in parameters when parameter setting has been performed.) <div><div>b15b14b13b12b11b10b9b8b7b6b5b4b3b2b1b0</div><table><tr><td>SD1116</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td></tr><tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td>(XY)</td></tr><tr><td>SD1117</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td>(Y90)</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1123</td><td>0</td><td>0</td><td>0</td><td>0</td><td>1</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td></tr><tr><td></td><td></td><td></td><td></td><td></td><td>(XY)</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr></table><div>↑ Indicates an I/O module verify error.</div></div> <ul style="list-style-type: none">I/O module verify check is executed also to remote I/O station modules. (If normal status is restored, clear is not performed. Therefore, it is required to perform clear by user program.)	SD1116	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1																	(XY)	SD1117	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0								(Y90)										SD1123	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0						(XY)												QnA
SD1116	0				0	0	0	0	0	0	0	0	0	0	0	0	0	0	1																																																																																									
																			(XY)																																																																																									
SD1117	0				0	0	0	0	0	1	0	0	0	0	0	0	0	0	0																																																																																									
										(Y90)																																																																																																		
SD1123	0				0	0	0	1	0	0	0	0	0	0	0	0	0	0	0																																																																																									
								(XY)																																																																																																				
D9117	SD1117																																																																																																											
D9118	SD1118																																																																																																											
D9119	SD1119																																																																																																											
D9120	SD1120																																																																																																											
D9121	SD1121																																																																																																											
D9122	SD1122																																																																																																											
D9123	SD1123																																																																																																											

Table App. 3.11. Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																																																																																																												
D9124	SD1124	SD63	Number of annunciator detections	Number of annunciator detections	<ul style="list-style-type: none">When one of F0 to 255 (F0 to 2047 for AuA and AnU) is turned on by [SET F] 1 is added to the contents of SD63. When [RST F] or [LEDR] instruction is executed, 1 is subtracted from the contents of SD63. (If the INDICATOR RESET switch is provided to the CPU module, pressing the switch can execute the same processing.)Quantity, which has been turned on by [SET F] is stored into SD63 in BIN code. The value of SD63 is maximum 8.	QnA																																																																																																																																												
D9125	SD1125	SD64	Annunciator detection number	Annunciator detection number	<ul style="list-style-type: none">When any of F0 to 2047 is turned on by [SET F], the annunciator numbers (F numbers) that are turned on in order are registered into D9125 to D9132.The F number turned off by [RST F] is erased from any of D9125 to D9132, and the F numbers stored after the erased F number are shifted to the preceding registers. <p>By executing [LEDR] instruction, the contents of SD64 to SD71 are shifted upward by one. (For A3N, A3HCPU, it can be performed by use of INDICATOR RESET switch on front of CPU module.)</p> <p>When there are 8 annunciator detections, the 9th one is not stored into SD64 to SD71 even if detected.</p> <div><div>SET SET SET RST SET SET SET SET SET SET SET SET F50 F25 F99 F25 F15 F70 F65 F38 F110 F151 F210 LEDR</div><table><tr><td>SD62</td><td>0</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>99</td></tr><tr><td>SD63</td><td>0</td><td>1</td><td>2</td><td>3</td><td>2</td><td>3</td><td>4</td><td>5</td><td>6</td><td>7</td><td>8</td><td>8</td><td>8</td></tr><tr><td>SD64</td><td>0</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>50</td><td>99</td></tr><tr><td>SD65</td><td>0</td><td>0</td><td>25</td><td>25</td><td>99</td><td>99</td><td>99</td><td>99</td><td>99</td><td>99</td><td>99</td><td>99</td><td>15</td></tr><tr><td>SD66</td><td>0</td><td>0</td><td>0</td><td>99</td><td>0</td><td>15</td><td>15</td><td>15</td><td>15</td><td>15</td><td>15</td><td>15</td><td>70</td></tr><tr><td>SD67</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>70</td><td>70</td><td>70</td><td>70</td><td>70</td><td>70</td><td>65</td></tr><tr><td>SD68</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>65</td><td>65</td><td>65</td><td>65</td><td>65</td><td>38</td></tr><tr><td>SD69</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>38</td><td>38</td><td>38</td><td>38</td><td>110</td></tr><tr><td>SD70</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>110</td><td>110</td><td>110</td><td>151</td></tr><tr><td>SD71</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>0</td><td>151</td><td>151</td><td>210</td></tr></table></div>	SD62	0	50	50	50	50	50	50	50	50	50	50	50	99	SD63	0	1	2	3	2	3	4	5	6	7	8	8	8	SD64	0	50	50	50	50	50	50	50	50	50	50	50	99	SD65	0	0	25	25	99	99	99	99	99	99	99	99	15	SD66	0	0	0	99	0	15	15	15	15	15	15	15	70	SD67	0	0	0	0	0	0	70	70	70	70	70	70	65	SD68	0	0	0	0	0	0	0	65	65	65	65	65	38	SD69	0	0	0	0	0	0	0	0	38	38	38	38	110	SD70	0	0	0	0	0	0	0	0	0	110	110	110	151	SD71	0	0	0	0	0	0	0	0	0	0	151	151	210	QnA
SD62	0	50			50	50	50	50	50	50	50	50	50	50	99																																																																																																																																			
SD63	0	1			2	3	2	3	4	5	6	7	8	8	8																																																																																																																																			
SD64	0	50			50	50	50	50	50	50	50	50	50	50	99																																																																																																																																			
SD65	0	0			25	25	99	99	99	99	99	99	99	99	15																																																																																																																																			
SD66	0	0			0	99	0	15	15	15	15	15	15	15	70																																																																																																																																			
SD67	0	0			0	0	0	0	70	70	70	70	70	70	65																																																																																																																																			
SD68	0	0	0	0	0	0	0	65	65	65	65	65	38																																																																																																																																					
SD69	0	0	0	0	0	0	0	0	38	38	38	38	110																																																																																																																																					
SD70	0	0	0	0	0	0	0	0	0	110	110	110	151																																																																																																																																					
SD71	0	0	0	0	0	0	0	0	0	0	151	151	210																																																																																																																																					
D9126	SD1126	SD65																																																																																																																																																
D9127	SD1127	SD66																																																																																																																																																
D9128	SD1128	SD67																																																																																																																																																
D9129	SD1129	SD68																																																																																																																																																
D9130	SD1130	SD69																																																																																																																																																
D9131	SD1131	SD70																																																																																																																																																
D9132	SD1132	SD71																																																																																																																																																

(10)Special register list dedicated for QnA

Table App. 3.12. Special register

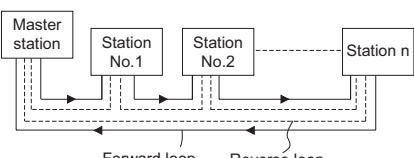
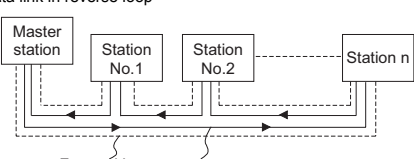
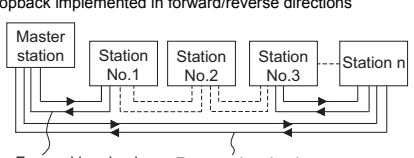
ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																																																				
D9200	SD1200	—	ZNRD instruction processing result (LRDP for ACPU)	0 : Normal end 2 : ZNRD instruction setting fault 3 : Error at relevant station 4 : Relevant station ZNRD execution disabled	Stores the execution result of the ZNRD (word device read) instruction • ZNRD instruction setting faultFaulty setting of the ZNRD instruction constant, source, and/or destination. • Corresponding station errorOne of the stations is not communicating. • ZNRD cannot be executed in the corresponding station The specified station is a remote I/O station.	QnA																																																																																				
D9201	SD1201	—	ZNWR instruction processing result (LWTP for ACPU)	0 : Normal end 2 : ZNWR instruction setting fault 3 : Error at relevant station 4 : Relevant station ZNWR execution disabled	Stores the execution result of the ZNWR (word device write) instruction. • ZNWR instruction setting faultFaulty setting of the ZNWR instruction constant, source, and/or destination. • Corresponding station errorOne of the stations is not communicating. • ZNWR cannot be executed in the corresponding station The specified station is a remote I/O station.	QnA																																																																																				
D9202	SD1202	—	Local station link type	Stores conditions for up to numbers 1 to 16	Stores whether the slave station corresponds to MELSECNET or MELSECNET II. • Bits corresponding to the MELSECNET II stations become "1." • Bits corresponding to the MELSECNET stations or unconnected become "0."	QnA																																																																																				
D9203	SD1203	—		Stores conditions for up to numbers 17 to 32	<table><tr><th>Device number</th><th>b15</th><th>b14</th><th>b13</th><th>b12</th><th>b11</th><th>b10</th><th>b9</th><th>b8</th><th>b7</th><th>b6</th><th>b5</th><th>b4</th><th>b3</th><th>b2</th><th>b1</th><th>b0</th></tr><tr><td>SD1202</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1203</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1241</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1242</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></table> • If a local station goes down during the operation, the contents before going down are retained. Contents of SD1224 to SD1227 and SD1228 to SD1231 are ORed. If the corresponding bit is "0", the corresponding bit of the special register above becomes valid. • If the host (master) station goes down, the contents before going down are also retained.	Device number	b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1202	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1203	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1241	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1242	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49
Device number	b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																										
SD1202	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																										
SD1203	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																										
SD1241	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																										
SD1242	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																										
D9204	SD1204	—	Link status	0 : Forward loop, during data link 1 : Reverse loop, during data link 2 : Loopback implemented in forward/reverse directions 3 : Loopback implemented only in forward direction 4 : Loopback implemented only in reverse direction 5 : Data link disabled	Stores the present path status of the data link. • Data link in forward loop  • Data link in reverse loop  • Loopback implemented in forward/reverse directions 	QnA																																																																																				

Table App. 3.12.Special register

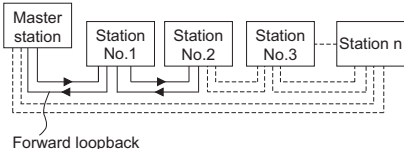
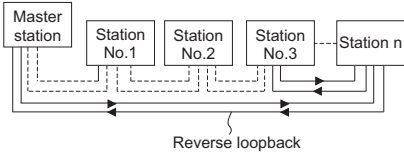
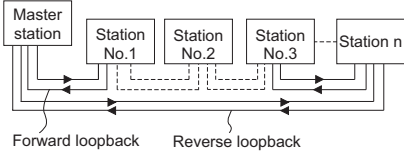
ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																																																																					
D9204	SD1204	—	Link status	0 : Forward loop, during data link 1 : Reverse loop, during data link 2 : Loopback implemented in forward/reverse directions 3 : Loopback implemented only in forward direction 4 : Loopback implemented only in reverse direction 5 : Data link disabled	<ul style="list-style-type: none">• Loopback in forward loop only  <p>Forward loopback</p> <ul style="list-style-type: none">• Loopback in reverse loop only  <p>Reverse loopback</p>	QnA																																																																																																					
				QnA																																																																																																							
D9205	SD1205	—	Station implementing loopback	Station that implemented forward loopback	 <p>Forward loopback Reverse loopback</p> <p>In the above example, 1 is stored into D9205 and 3 into D9206. If data link returns to normal status (data link in forward loop), values in D9205 and D9206 remain 1 and 3. To return them to "0", therefore, use a sequence program or perform reset operation.</p>	QnA																																																																																																					
D9206	SD1206	—	Station implementing loopback	Station that implemented reverse loopback		QnA																																																																																																					
D9210	SD1210	—	Number of retries	Stored as cumulative value	Stores the number of retry times due to transmission error. Count stops at maximum of "FFFFH". To return the value to "0", perform reset operation.	QnA																																																																																																					
D9211	SD1211	—	Number of times loop selected	Stored as cumulative value	Stores the number of times the loop line has been switched to reverse loop or loopback. Count stops at maximum of "FFFFH". To return the value to "0", perform reset operation.	QnA																																																																																																					
D9212	SD1212	—	Local station operation status	Stores conditions for up to numbers 1 to 16	Stores the local station numbers which are in STOP or PAUSE mode. <table border="1"><thead><tr><th rowspan="2">Device number</th><th colspan="16">Bit</th></tr><tr><th>b15</th><th>b14</th><th>b13</th><th>b12</th><th>b11</th><th>b10</th><th>b9</th><th>b8</th><th>b7</th><th>b6</th><th>b5</th><th>b4</th><th>b3</th><th>b2</th><th>b1</th><th>b0</th></tr></thead><tbody><tr><td>SD1212</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1213</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1214</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1215</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></tbody></table> <p>When a local station is switched to STOP or PAUSE mode, the bit corresponding to the station number in the register becomes "1". Example: When station 7 switches to STOP mode, b6 in SD1212 becomes "1", and when SD1212 is monitored, its value is "64 (40H)".</p>	Device number	Bit																b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1212	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1213	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1214	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1215	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49	QnA
Device number	Bit																																																																																																										
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																										
SD1212	L16	L15	L14	L13		L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																																										
SD1213	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																																											
SD1214	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																																											
SD1215	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																																											
D9213	SD1213	—	Local station operation status	Stores conditions for up to numbers 17 to 32																																																																																																							
D9214	SD1214	—	Local station operation status	Stores conditions for up to numbers 33 to 48																																																																																																							
D9215	SD1215	—	Local station operation status	Stores conditions for up to numbers 49 to 64																																																																																																							
D9216	SD1216	—	Local station error detect status	Stores conditions for up to numbers 1 to 16	Stores the local station numbers which are in error. <table border="1"><thead><tr><th rowspan="2">Device number</th><th colspan="16">Bit</th></tr><tr><th>b15</th><th>b14</th><th>b13</th><th>b12</th><th>b11</th><th>b10</th><th>b9</th><th>b8</th><th>b7</th><th>b6</th><th>b5</th><th>b4</th><th>b3</th><th>b2</th><th>b1</th><th>b0</th></tr></thead><tbody><tr><td>SD1216</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1217</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1218</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1219</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></tbody></table> <p>If a local station detects an error, the bit corresponding to the station number becomes "1". Example: When station 6 and 12 detect an error, b5 and b11 in SD1216 become "1", and when SD1216 is monitored, its value is "2080 (820H)".</p>	Device number	Bit																b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1216	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1217	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1218	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1219	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49	QnA
Device number	Bit																																																																																																										
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																										
SD1216	L16	L15	L14	L13		L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																																										
SD1217	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																																											
SD1218	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																																											
SD1219	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																																											
D9217	SD1217	—	Local station error detect status	Stores conditions for up to numbers 17 to 32																																																																																																							
D9218	SD1218	—	Local station error detect status	Stores conditions for up to numbers 33 to 48																																																																																																							
D9219	SD1219	—	Local station error detect status	Stores conditions for up to numbers 49 to 64																																																																																																							

Table App. 3.12.Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																																																																						
D9220	SD1220	—	Local station parameters non-conforming; remote I/O station I/O assignment error	Stores conditions for up to numbers 1 to 16	<p>Stores the local station numbers which contain mismatched parameters or of remote station numbers for which incorrect I/O assignment has been made.</p> <table><tr><th>Device number</th><th colspan="16">Bit</th></tr><tr><td></td><td>b15</td><td>b14</td><td>b13</td><td>b12</td><td>b11</td><td>b10</td><td>b9</td><td>b8</td><td>b7</td><td>b6</td><td>b5</td><td>b4</td><td>b3</td><td>b2</td><td>b1</td><td>b0</td></tr><tr><td>SD1220</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1221</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1222</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1223</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></table>	Device number	Bit																	b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1220	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1221	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1222	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1223	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49	QnA
Device number	Bit																																																																																																											
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																											
SD1220	L16	L15	L14	L13		L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																																											
SD1221	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																																												
SD1222	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																																												
SD1223	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																																												
D9221	SD1221	—	Local station parameters non-conforming; remote I/O station I/O assignment error	Stores conditions for up to numbers 17 to 32																																																																																																								
D9222	SD1222	—	Local station parameters non-conforming; remote I/O station I/O assignment error	Stores conditions for up to numbers 33 to 48																																																																																																								
D9223	SD1223	—	Local station parameters non-conforming; remote I/O station I/O assignment error	Stores conditions for up to numbers 49 to 64																																																																																																								
D9224	SD1224	—	Local station and remote I/O station initial communications underway	Stores conditions for up to numbers 1 to 16	<p>Stores the local or remote station numbers while they are communicating the initial data with their relevant master station.</p> <table><tr><th>Device number</th><th colspan="16">Bit</th></tr><tr><td></td><td>b15</td><td>b14</td><td>b13</td><td>b12</td><td>b11</td><td>b10</td><td>b9</td><td>b8</td><td>b7</td><td>b6</td><td>b5</td><td>b4</td><td>b3</td><td>b2</td><td>b1</td><td>b0</td></tr><tr><td>SD1224</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1225</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1226</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1227</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></table>	Device number	Bit																	b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1224	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1225	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1226	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1227	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49	QnA
Device number	Bit																																																																																																											
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																											
SD1224	L16	L15	L14	L13		L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																																											
SD1225	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																																												
SD1226	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																																												
SD1227	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																																												
D9225	SD1225	—	Local station and remote I/O station initial communications underway	Stores conditions for up to numbers 17 to 32																																																																																																								
D9226	SD1226	—	Local station and remote I/O station initial communications underway	Stores conditions for up to numbers 33 to 48																																																																																																								
D9227	SD1227	—	Local station and remote I/O station initial communications underway	Stores conditions for up to numbers 49 to 64																																																																																																								
D9228	SD1228	—	Local station and remote I/O station error	Stores conditions for up to numbers 1 to 16	<p>Stores the local or remote station numbers which are in error.</p> <table><tr><th>Device number</th><th colspan="16">Bit</th></tr><tr><td></td><td>b15</td><td>b14</td><td>b13</td><td>b12</td><td>b11</td><td>b10</td><td>b9</td><td>b8</td><td>b7</td><td>b6</td><td>b5</td><td>b4</td><td>b3</td><td>b2</td><td>b1</td><td>b0</td></tr><tr><td>SD1228</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1229</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1230</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1231</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></table>	Device number	Bit																	b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1228	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1229	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1230	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1231	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49	QnA
Device number	Bit																																																																																																											
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																											
SD1228	L16	L15	L14	L13		L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																																											
SD1229	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																																												
SD1230	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																																												
SD1231	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																																												
D9229	SD1229	—	Local station and remote I/O station error	Stores conditions for up to numbers 17 to 32																																																																																																								
D9230	SD1230	—	Local station and remote I/O station error	Stores conditions for up to numbers 33 to 48																																																																																																								
D9231	SD1231	—	Local station and remote I/O station error	Stores conditions for up to numbers 49 to 64																																																																																																								

Table App. 3.12.Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																																																																																																																																																																																																																																																																																		
D9232	SD1232	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 1 to 8	<div>Stores the local or remote station number at which a forward or reverse loop error has occurred</div> <table><tr><th>Device number</th><th colspan="16">Bit</th></tr><tr><th></th><th>b15</th><th>b14</th><th>b13</th><th>b12</th><th>b11</th><th>b10</th><th>b9</th><th>b8</th><th>b7</th><th>b6</th><th>b5</th><th>b4</th><th>b3</th><th>b2</th><th>b1</th><th>b0</th></tr><tr><td>SD1232</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R8</td><td>L/R7</td><td>L/R6</td><td>L/R5</td><td>L/R4</td><td>L/R3</td><td>L/R2</td><td>L/R1</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1233</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R16</td><td>L/R15</td><td>L/R14</td><td>L/R13</td><td>L/R12</td><td>L/R11</td><td>L/R10</td><td>L/R9</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1234</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R24</td><td>L/R23</td><td>L/R22</td><td>L/R21</td><td>L/R20</td><td>L/R19</td><td>L/R18</td><td>L/R17</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1235</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R32</td><td>L/R31</td><td>L/R30</td><td>L/R29</td><td>L/R28</td><td>L/R27</td><td>L/R26</td><td>L/R25</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1236</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R40</td><td>L/R39</td><td>L/R38</td><td>L/R37</td><td>L/R36</td><td>L/R35</td><td>L/R34</td><td>L/R33</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1237</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R48</td><td>L/R47</td><td>L/R46</td><td>L/R45</td><td>L/R44</td><td>L/R43</td><td>L/R42</td><td>L/R41</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1238</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R56</td><td>L/R55</td><td>L/R54</td><td>L/R53</td><td>L/R52</td><td>L/R51</td><td>L/R50</td><td>L/R49</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>SD1239</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td><td>R</td><td>F</td></tr><tr><td></td><td>L/R64</td><td>L/R63</td><td>L/R62</td><td>L/R61</td><td>L/R60</td><td>L/R59</td><td>L/R58</td><td>L/R57</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr></table> <div>"F" in the above table indicates a forward loop line, and "R" a reverse loop line. The bit of the device number corresponding to the station number of the local station or remote I/O station that has a forward loop line or reverse loop line error. Example: When the forward loop line of station 5 has an error, b8 of SD1232 become "1", and when SD1232 is monitored, its value is "256 (100H)".</div>	Device number	Bit																	b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1232	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R8	L/R7	L/R6	L/R5	L/R4	L/R3	L/R2	L/R1									SD1233	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R16	L/R15	L/R14	L/R13	L/R12	L/R11	L/R10	L/R9									SD1234	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R24	L/R23	L/R22	L/R21	L/R20	L/R19	L/R18	L/R17									SD1235	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R32	L/R31	L/R30	L/R29	L/R28	L/R27	L/R26	L/R25									SD1236	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R40	L/R39	L/R38	L/R37	L/R36	L/R35	L/R34	L/R33									SD1237	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R48	L/R47	L/R46	L/R45	L/R44	L/R43	L/R42	L/R41									SD1238	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R56	L/R55	L/R54	L/R53	L/R52	L/R51	L/R50	L/R49									SD1239	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F		L/R64	L/R63	L/R62	L/R61	L/R60	L/R59	L/R58	L/R57									QnA
Device number	Bit																																																																																																																																																																																																																																																																																																																							
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																																																																																																																																																																																																																																							
SD1232	R	F	R	F		R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																							
	L/R8	L/R7	L/R6	L/R5		L/R4	L/R3	L/R2	L/R1																																																																																																																																																																																																																																																																																																															
SD1233	R	F	R	F		R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																							
	L/R16	L/R15	L/R14	L/R13		L/R12	L/R11	L/R10	L/R9																																																																																																																																																																																																																																																																																																															
SD1234	R	F	R	F		R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																							
	L/R24	L/R23	L/R22	L/R21		L/R20	L/R19	L/R18	L/R17																																																																																																																																																																																																																																																																																																															
SD1235	R	F	R	F		R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																							
	L/R32	L/R31	L/R30	L/R29	L/R28	L/R27	L/R26	L/R25																																																																																																																																																																																																																																																																																																																
SD1236	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																								
	L/R40	L/R39	L/R38	L/R37	L/R36	L/R35	L/R34	L/R33																																																																																																																																																																																																																																																																																																																
SD1237	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																								
	L/R48	L/R47	L/R46	L/R45	L/R44	L/R43	L/R42	L/R41																																																																																																																																																																																																																																																																																																																
SD1238	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																								
	L/R56	L/R55	L/R54	L/R53	L/R52	L/R51	L/R50	L/R49																																																																																																																																																																																																																																																																																																																
SD1239	R	F	R	F	R	F	R	F	R	F	R	F	R	F	R	F																																																																																																																																																																																																																																																																																																								
	L/R64	L/R63	L/R62	L/R61	L/R60	L/R59	L/R58	L/R57																																																																																																																																																																																																																																																																																																																
D9233	SD1233	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 9 to 16																																																																																																																																																																																																																																																																																																																				
D9234	SD1234	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 17 to 24																																																																																																																																																																																																																																																																																																																				
D9235	SD1235	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 25 to 32																																																																																																																																																																																																																																																																																																																				
D9236	SD1236	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 33 to 40																																																																																																																																																																																																																																																																																																																				
D9237	SD1237	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 41 to 48																																																																																																																																																																																																																																																																																																																				
D9238	SD1238	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 49 to 56																																																																																																																																																																																																																																																																																																																				
D9239	SD1239	—	Local station and remote I/O station loop error	Stores conditions for up to numbers 57 to 64																																																																																																																																																																																																																																																																																																																				
D9240	SD1240	—	Number of times communications errors detected	Stores cumulative total of receive errors	Stores the number of times the following transmission errors have been detected: CRC, OVER, AB. IF Count is made to a maximum of FFFFH. To return the value to "0", perform reset operation.	QnA																																																																																																																																																																																																																																																																																																																		
D9241	SD1241	—	Local station link type	Stores conditions for up to numbers 33 to 48	Stores whether the slave station corresponds to MELSECNET or MELSECNET II. • Bits corresponding to the MELSECNET II stations become "1." • Bits corresponding to the MELSECNET stations or unconnected become "0."	QnA																																																																																																																																																																																																																																																																																																																		
D9242	SD1242			Stores conditions for up to numbers 49 to 64	• If a local station goes down during the operation, the contents before going down are retained. Contents of SD1224 to SD1227 and SD1228 to SD1231 are ORed. If the corresponding bit is "0", the corresponding bit of the special register above becomes valid. • If the host (master) station goes down, the contents before going down are also retained.																																																																																																																																																																																																																																																																																																																			
D9243	SD1243	—	Station number information for host station	Stores station number (0 to 64)	Allows a local station to confirm its own station number	QnA																																																																																																																																																																																																																																																																																																																		
D9244	SD1244	—	Number of link device stations	Stores number of slave stations	Indicates the number of slave stations in one loop.	QnA																																																																																																																																																																																																																																																																																																																		
D9245	SD1245	—	Receive error detection count	Stores cumulative total of receive errors	Stores the number of times the following transmission errors have been detected: CRC, OVER, AB. IF Count is made to a maximum of FFFFH. To return the value to "0", perform reset operation.	QnA																																																																																																																																																																																																																																																																																																																		

Table App. 3.12. Special register

ACPU Special Register	Special Register after Conversion	Special Register for Modification	Name	Meaning	Details	Corresponding CPU																																																																																																					
D9248	SD1248	—	Local station operation status	Stores conditions for up to numbers 1 to 16	<div>Stores the local station number which is in STOP or PAUSE mode.</div> <table><tr><th rowspan="2">Device number</th><th colspan="16">Bit</th></tr><tr><th>b15</th><th>b14</th><th>b13</th><th>b12</th><th>b11</th><th>b10</th><th>b9</th><th>b8</th><th>b7</th><th>b6</th><th>b5</th><th>b4</th><th>b3</th><th>b2</th><th>b1</th><th>b0</th></tr><tr><td>SD1248</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1249</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1250</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1251</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></table> <div>The bit corresponding to the station number which is in STOP or PAUSE mode, becomes "1". Example: When local stations 7 and 15 are in STOP mode, b6 and b14 of SD1248 become "1", and when SD1248 is monitored, its value is "16448 (4040H)".</div>	Device number	Bit																b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1248	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1249	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1250	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1251	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49	QnA
Device number	Bit																																																																																																										
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																										
SD1248	L16	L15	L14	L13		L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																																										
SD1249	L32	L31	L30	L29		L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																																										
SD1250	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																																											
SD1251	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																																											
D9249	SD1249	—	Local station operation status	Stores conditions for up to numbers 17 to 32																																																																																																							
D9250	SD1250	—	Local station operation status	Stores conditions for up to numbers 33 to 48																																																																																																							
D9251	SD1251	—	Local station operation status	Stores conditions for up to numbers 49 to 64																																																																																																							
D9252	SD1252	—	Local station error conditions	Stores conditions for up to numbers 1 to 16	<div>Stores the local station number other than the host, which is in error.</div> <table><tr><th rowspan="2">Device number</th><th colspan="16">Bit</th></tr><tr><th>b15</th><th>b14</th><th>b13</th><th>b12</th><th>b11</th><th>b10</th><th>b9</th><th>b8</th><th>b7</th><th>b6</th><th>b5</th><th>b4</th><th>b3</th><th>b2</th><th>b1</th><th>b0</th></tr><tr><td>SD1252</td><td>L16</td><td>L15</td><td>L14</td><td>L13</td><td>L12</td><td>L11</td><td>L10</td><td>L9</td><td>L8</td><td>L7</td><td>L6</td><td>L5</td><td>L4</td><td>L3</td><td>L2</td><td>L1</td></tr><tr><td>SD1253</td><td>L32</td><td>L31</td><td>L30</td><td>L29</td><td>L28</td><td>L27</td><td>L26</td><td>L25</td><td>L24</td><td>L23</td><td>L22</td><td>L21</td><td>L20</td><td>L19</td><td>L18</td><td>L17</td></tr><tr><td>SD1254</td><td>L48</td><td>L47</td><td>L46</td><td>L45</td><td>L44</td><td>L43</td><td>L42</td><td>L41</td><td>L40</td><td>L39</td><td>L38</td><td>L37</td><td>L36</td><td>L35</td><td>L34</td><td>L33</td></tr><tr><td>SD1255</td><td>L64</td><td>L63</td><td>L62</td><td>L61</td><td>L60</td><td>L59</td><td>L58</td><td>L57</td><td>L56</td><td>L55</td><td>L54</td><td>L53</td><td>L52</td><td>L51</td><td>L50</td><td>L49</td></tr></table> <div>The bit corresponding to the station number which is in error, becomes "1". Example: When local station 12 is in error, b11 of SD1252 becomes "1", and when SD1252 is monitored, its value is "2048 (800H)".</div>	Device number	Bit																b15	b14	b13	b12	b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0	SD1252	L16	L15	L14	L13	L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1	SD1253	L32	L31	L30	L29	L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17	SD1254	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33	SD1255	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49	QnA
Device number	Bit																																																																																																										
	b15	b14	b13	b12		b11	b10	b9	b8	b7	b6	b5	b4	b3	b2	b1	b0																																																																																										
SD1252	L16	L15	L14	L13		L12	L11	L10	L9	L8	L7	L6	L5	L4	L3	L2	L1																																																																																										
SD1253	L32	L31	L30	L29		L28	L27	L26	L25	L24	L23	L22	L21	L20	L19	L18	L17																																																																																										
SD1254	L48	L47	L46	L45	L44	L43	L42	L41	L40	L39	L38	L37	L36	L35	L34	L33																																																																																											
SD1255	L64	L63	L62	L61	L60	L59	L58	L57	L56	L55	L54	L53	L52	L51	L50	L49																																																																																											
D9253	SD1253	—	Local station error conditions	Stores conditions for up to numbers 17 to 32																																																																																																							
D9254	SD1254	—	Local station error conditions	Stores conditions for up to numbers 33 to 48																																																																																																							
D9255	SD1255	—	Local station error conditions	Stores conditions for up to numbers 49 to 64																																																																																																							

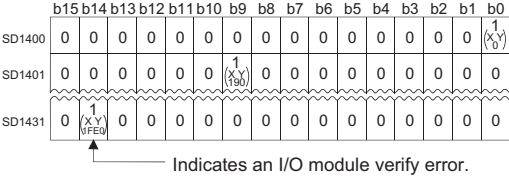
(11) Fuse blown module

Table App. 3.13. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corresponding ACPU D9□□□	Corresponding CPU
SD1300	Fuse blown module	Bit pattern in units of 16 points, indicating the modules whose fuses have blown 0 : No blown fuse 1 : Blown fuse present	<div><div><div><div><div><div></div><div>b15</div></div><div><div>b14</div><div>b13</div></div><div><div>b12</div><div>b11</div></div><div><div>b10</div><div>b9</div></div><div><div>b8</div><div>b7</div></div><div><div>b6</div><div>b5</div></div><div><div>b4</div><div>b3</div></div><div><div>b2</div><div>b1</div></div><div><div>b0</div><div></div></div></div></div><div><div><div><div><div></div><div>SD1300</div></div><div><div>0</div><div>0</div><div>0</div><div>1 (YCD)</div><div>0</div><div>0</div><div>0</div><div>1 (Y9B)</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div></div></div><div><div><div><div><div></div><div>SD1301</div></div><div><div>1 (Y1F0)</div><div>0</div><div>0</div><div>0</div><div>0</div><div>1 (Y1A0)</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div></div></div><div><div><div><div><div></div><div>SD1331</div></div><div><div>0</div><div>0</div><div>0</div><div>0</div><div>1 (Y1F B0)</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>0</div><div>1 (Y1F 30)</div><div>0</div><div>0</div><div>0</div><div>0</div></div></div></div><div><div><div></div><div>↑</div><div>Indicates fuse blow.</div></div></div></div></div><div><div><div></div><div>• The numbers of output modules whose fuses have blown are input as a bit pattern (in units of 16 points). (If the module numbers are set by parameter, the parameter-set numbers are stored.)</div><div></div><div>• Also detects blown fuse condition at remote station output modules</div></div></div></div><div><div><div></div><div>• Not cleared even if the blown fuse is replaced with a new one. This flag is cleared by error resetting operation.</div></div></div></div><div><div><div></div><div>S (Error)</div></div></div></div><div><div><div></div><div>D9100</div></div><div><div></div><div>D9101</div></div><div><div></div><div>D9102</div></div><div><div></div><div>D9103</div></div><div><div></div><div>D9104</div></div><div><div></div><div>D9105</div></div><div><div></div><div>D9106</div></div><div><div></div><div>D9107</div></div><div><div></div><div>New</div></div><div><div></div><div>New</div></div><div><div></div><div>New</div></div></div><div><div></div><div>QnA</div></div></div></div>			

(12) I/O module verification

Table App. 3.14. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD1400	I/O module verify error	Bit pattern, in units of 16 points, indicating the modules with verification errors. 0 : No I/O verification errors 1 : I/O verification error present	<ul style="list-style-type: none"> When the I/O modules whose I/O module information differs from that registered at power-ON are detected, the numbers of those I/O modules are entered in bit pattern. (If the I/O numbers are set by parameter, the parameter-set numbers are stored.) Also detects I/O module information.  <ul style="list-style-type: none"> Not cleared even if the blown fuse is replaced with a new one. This flag is cleared by error resetting operation. 	S (Error)	D9116	QnA
SD1401					D9117	
SD1402					D9118	
SD1403					D9119	
SD1404					D9120	
SD1405					D9121	
SD1406					D9122	
SD1407					D9123	
SD1408					New	
SD1409 to SD1430					New	
SD1431					New	

(13) Process control instructions

Table App. 3.15. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD1500 SD1501	Basic period	Basic period time	<ul style="list-style-type: none"> Set the basic period (1 second units) use for the process control instruction using floating point data. Floating point data = SD1501 SD1500	U	New	Q4AR
SD1502	Process control instruction detail error code	Process control instruction detail error code	<ul style="list-style-type: none"> Shows the detailed error contents for the error that occurred in the process control instruction. 	S (Error)	New	Q4AR
SD1503	Process control instruction generated error location	Process control instruction generated error location	<ul style="list-style-type: none"> Shows the error process block that occurred in the process control instruction. 	S (Error)	New	Q4AR

(14)For redundant systems (Host system CPU information *1)

SD1510 to SD1599 are only valid for redundant systems.

They are all set to 0 for stand-alone systems.

Table App. 3.16. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD1512	Operation mode during CPU module start up	Hot start switch power out time	• Shows the power out time (S) during the automatic switch from hot start to initial start in the operation mode when the CPU module is started up.	S (Initial)	New	Q4AR
SD1590	Switch request network No.	Request source network No.	• Stores the request source at work No. when the SM1590 is turned on.	S (Error)	New	Q4AR

(15)For redundant systems (Other system CPU information *1)

SD1600 to SD1659 is only valid during the back up mode for redundant systems, and refresh cannot be done when in the separate mode.

SD1651 to SD1699 are valid in either the backup mode or separate mode.

When a stand-alone system SD1600 to SD1699 are all 0.

Table App. 3.17. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU SD□□*2	Corresponding CPU
SD1600	Diagnosis error	Diagnosis error No.	<ul style="list-style-type: none"> Stores as BIN code the error No. of the error that occurred during the other system CPU module diagnosis. Stores the latest error currently occurring. 	S (Each END)	SD0	Q4AR
SD1601	Diagnosis error occurrence time	Diagnosis error occurrence time	<ul style="list-style-type: none"> SD1600 stores the updated date and time. Stores each of the BCD two digits. Refer to SD1 to SD3 for the storage status. (SD1 → SD1601, SD2 → SD1602, SD3 → SD1603) 	S (Each END)	SD1 to SD3	Q4AR
SD1602						
SD1603						
SD1604	Error information classification	Error information classification	<ul style="list-style-type: none"> Stores the error comment information/individual information classification code. Refer to SD4 for the storage status. 	S (Each END)	SD4	Q4AR
SD1605	Error common information	Error common information	<ul style="list-style-type: none"> Stores the common information for the error code. Refer to SD5 to SD15 for the storage status. (SD5 → SD1605, SD6 → SD1606, SD7 → SD1607, SD8 → SD1608, SD9 → SD1609, SD10 → SD1610, SD11 → SD1611, SD12 → SD1612, SD13 → SD1613, SD14 → SD1614, SD15 → SD1615) 	S (Each END)	SD5 to SD15	Q4AR
SD1606						
SD1607						
SD1608						
SD1609						
SD1610						
SD1611						
SD1612						
SD1613						
SD1614						
SD1615						
SD1616	Error individual information	Error individual information	<ul style="list-style-type: none"> Stores the individual information for the error code. Refer to SD16 to SD26 for the storage status. (SD16 → SD1616, SD17 → SD1617, SD18 → SD1618, SD19 → SD1619, SD20 → SD1620, SD21 → SD1621, SD22 → SD1622, SD23 → SD1623, SD24 → SD1624, SD25 → SD1625, SD26 → SD1626) 	S (Each END)	SD16 to SD26	Q4AR
SD1617						
SD1618						
SD1619						
SD1620						
SD1621						
SD1622						
SD1623						
SD1624						
SD1625						
SD1626						
SD1650	Switch status	CPU module switch status	<ul style="list-style-type: none"> Stores the CPU module switch status. Refer to SD200 for the storage status. (SD1650 → SD200) 	S (Each END)	SD200	Q4AR
SD1651	LED status	CPU module-LED status	<ul style="list-style-type: none"> Stores the CPU module's LED status. Shows 0 when turned off, 1 when turned on, and 2 when flicking. Refer to SD201 for the storage status. (SD1651 → SD201) 	S (Each END)	SD201	Q4AR
SD1653	CPU module operation status	CPU module operation status	<ul style="list-style-type: none"> Stores the CPU module operation status. Refer to SD203 for the storage status. (SD1653 → SD203) 	S (Each END)	SD203	Q4AR

*1 : Stores other system CPU module diagnostics information and system information.

*2 : Shows the special register (SD□□) for the host system CPU module.

(16)For redundant systems (Trucking)

SD1700 to SD1779 is valid only for redundant systems.

These are all 0 for stand-alone systems.

Table App. 3.18. Special register

Number	Name	Meaning	Explanation	Set by (When Set)	Corres- ponding ACPU D9□□□	Corresponding CPU
SD1700	Tracking error detection count	Tracking error detection count	• When the tracking error is detected, count is added by one.	S(Error)	New	Q4AR

APPENDIX 4 PRECAUTIONS FOR UTILIZING THE EXISTING MELSEC-A SERIES PROGRAM FOR Q2ASCPU

To utilize a sequence program, created for AnNCPU, AnACPU, or AnUCPU, for Q2ASCPU, convert it using the "A→QnA Conversion" option of the "Option" menu in the file maintenance mode of the GPP function.

For details on the GPP function operations, refer to the GX Developer Operating Manual or SW□IVD-GPPQ Operating Manual (Offline).

For details on instructions and devices, refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).

The instructions, devices, and comments, etc. indicated below may require modification in each mode after conversion.

Appendix 4.1 Instructions

An□CPU Instruction	Instruction after A→QnA Conversion	Corrective Action
BMOVR instruction Program example: LEDA BMOVR LEDC D10 LEDC D100 SUB K10 LEDR	OUT SM1255 LEDC D10 LEDC D100 OUT SM1255 LEDR	Modify the instruction to a BMOV instruction. BMOV ZR100 ZR1000 K10
BXCHR instruction Program example: LEDA BXCHR LEDC D10 LEDC D100 SUB K10 LEDR	OUT SM1255 LEDC D10 LEDC D100 OUT SM1255 LEDR	Modify the instruction to a BXCH instruction. BXCH ZR100 ZR1000 K10
CHG instruction	OUT SM1255	Since the Q2ASCPU does not have the main/subsequence program system, it has no CHG instructions. Delete OUT SM1255 as it is not necessary. Modify the main/subsequence program after conversion and set new parameters. (Refer to Appendix 4.5)
CHK instruction Program example: CHK M10 X100	CHK	Refer to Appendix 4.12
CLC instruction Program example: CLC	RST SM1012	Modify the instruction to SM700, special relay for carry flag. RST SM700

An□CPU Instruction	Instruction after A→QnA Conversion	Corrective Action
AnA/AnUCPU dedicated instruction IX instruction	OUT SM1255	Refer to Appendix 4.12
LEDA instruction (excluding dedicated instructions for AnACPU, AnUCPU) Program example: LEDA ABCDEFGH	OUT SM1255	Modify the instruction to an LED instruction. \$MOV "ABCDEFGH" D0 \$MOV "IJKLMNOP" D10 \$+ D0 D10 D20 LED D20
LEDB instruction (excluding dedicated instructions for AnACPU, AnUCPU) Program example: LEDB IJKLMNOP	OUT SM1255	LED display is performed after adding the right 8 characters and the left 8 characters.
LRDP instruction Program example: LRDP K3 D10 D100 K10	OUT SM1255	Modify the instruction to a ZNRD instruction. J.ZNRD J0 K3 D10 D100 K10 M0
LWTP instruction Program example: LWTP K3 D10 D100 K10	OUT SM1255	Modify the instruction to a ZNWR instruction. J.ZNWR J0 K3 D10 D100 K10 M0
OUT instruction Program example: The number of counter points or the device by which the set value is used is set by parameter. Number of counter points: 512 Setting val. stored dev. start: D3000 OUT C0 K10 OUT C256 D3000	OUT C0 K10 OUT C256 D3000	After conversion, the parameters will be set as defaults, so they must be set again if using an interrupt counter.
RFRP instruction Program example: RFRP H100 K10 W100 K10	OUT SM1255	Modify the instruction to an RFRP instruction for QnACPU. U.RFRP U10 K10 W100 K10 M0
RTOP instruction Program example: RTOP H100 K10 W100 K10	OUT SM1255	Modify the instruction to an RTOP instruction for Q2ACPU. U.RTOP U10 K10 W100 K10 M0
SCMP instruction Program example: LEDA SCAP LEDC D10 LEDC D100 LEDC M0 LEDR	OUT SM1255 LEDC D10 LEDC D100 LEDC M0	Modify the instruction to an instruction using AND\$= and OUT instructions. AND\$= D0 D100 OUT M0

An□CPU Instruction	Instruction after A→QnA Conversion	Corrective Action
SEG instruction (When used as a partial refresh instruction) Program example: SET M9052 SEG K4Y10 K4B1	SET SM1052 SEG K4Y10 K4B1	Modify the instruction to an RFS instruction. RFS Y10 H8
STC instruction Program example: STC	SET SM1012	Modify the instruction to SM700, special relay for carry flag. SET SM700
SUB instruction	OUT SM1255	As the Q2ASCPU cannot store any microcomputer program, it has no SUB instructions. Delete OUT SM1255 as it is not necessary. Change the microcomputer program for the AnNCPU or A3HCPU to the sequence program using Q2ASCPU instructions. (Refer to Appendix 4.6)
ZRRD instruction Program example: DMOV K8000 D9036 LEDA ZRRD	DMOV K8000 SD1036 OUT SM1255	Modify the instruction to an MOV instruction. MOV ZR8000 SD718 SD718 is the device resulting from converting accumulator A0.
ZRWR instruction Program example: DMOV K8000 D9036 LEDA ZRWR	DMOV K8000 SD1036 OUT SM1255	Modify the instruction to an MOV instruction. MOV SD718 ZR8000 SD718 is the device resulting from converting accumulator A0.

(a) Instructions for which program modification is unnecessary after conversion

An□CPU Instruction	Instruction after A → QnA Conversion
ASC instruction Program example: ASC ABCDEFGH D10	\$MOV ABCDEFGH D10 Note: Since the \$MOV instruction has 00H appended at the end, 5 data register words (for 9 characters) must be secured.
DFLOAT instruction Program example: LEDA DFLOAT LEDC D10 LEDC D100 LEDR	DFLT D10 D100
DOUT instruction Program example: LEDA DOUT LEDC Y10 LEDR	OUT DY10
DRCL instruction Program example: DRCL K8	DRCL SD718 K8 SD718 is the device resulting from converting accumulator A0.
DRCR instruction Program example: DRCR K8	DRCR SD718 K8 SD718 is the device resulting from converting accumulator A0.
DROL instruction Program example: DROL K8	DROL SD718 K8 SD718 is the device resulting from converting accumulator A0.
DROR instruction Program example: DROR K8	DROR SD718 K8 SD718 is the device resulting from converting accumulator A0.
DRST instruction Program example: LEDA DRST LEDC Y10 LEDR	RST DY10

App - 114

An□CPU Instruction	Instruction after A→QnA Conversion
ROR instruction Program example: ROR K8	ROR SD718 K8 SD718 is the device resulting from converting accumulator A0.
SADD instruction Program example: LEDA SADD LEDC D10 LEDC D100 LEDC D200 LEDR	\$+ D10 D100 D200
SER instruction Program example: SER D10 D100 K5	SER D10 D100 SD718 K5 SD718 is the device resulting from converting accumulator A0.
SMOV instruction Program example: LEDA SMOV LEDC D10 LEDC D100 LEDR	\$MOV D10 D100
SUM instruction Program example: SUM D10	SUM D10 SD718 SD718 is the device resulting from converting accumulator A0.
ZRRDB instruction Program example: DMOV K8000 D9036 LEDA ZRRDB	DMOV K8000 SD1036 ZRRDB SD1036 SD718 SD1036 is the device resulting from converting the special register D9036. SD718 is the device resulting from converting accumulator A0.
ZRWRB instruction Program example: DMOV K8000 D9036 LEDA ZRWRB	DMOV K8000 SD1036 ZRWRB SD1036 SD718 SD1036 is the device resulting from converting the special register D9036. SD718 is the device resulting from converting accumulator A0.

An□CPU Instruction	Instruction after A→QnA Conversion
<p>AnA/AnUCPU dedicated instruction LEDA/LEDB instruction name SUB/LEDC device 1 SUB/LEDC device n LEDR</p> <p>Program example 1: SIN instruction LEDA SIN LEDC D10 LEDC D100 LEDR</p> <p>Program example 2: DSER instruction LEDA DSER LEDC D10 LEDC D100 SUB K5 LEDR</p>	<p>Instruction name device 1 device n</p> <p>SIN D10 D100</p> <p>DSER D10 D100 SD718 K5 SD718 is the device resulting from converting accumulator A0.</p>
<p>AnA/AnUCPU special function module dedicated instruction LEDA/LEDB instruction name SUB/LEDC device 1 SUB/LEDC device n LEDR</p> <p>Program example: LEDA SVWR1 SUB H2 LEDC D10 LEDR</p>	<p>Enter "G." before the instruction. G. instruction name device Un device n</p> <p>G.SVWR1 U2 D10</p>
<p>AnA/AnUCPU data link dedicated instruction LEDA/LEDB instruction name SUB/LEDC device 1 SUB/LEDC device n LEDR</p> <p>Program example: LEDA LRDP SUB K12 LEDC D10 LEDC D100 SUB K5 LEDC M0 LEDR</p>	<p>Enter "J." before the instruction. J. instruction name <u>J0</u> device 1 device n ↑ Network for using MELSECNET II</p> <p>OUT SM1255 J.ZNRD J0 K12 D10 D100 K5M0</p>

An□CPU Instruction	Instruction after A→ QnA Conversion
Index register Z, Z1 to Z6, V, V1 to V6 Index register double word $\frac{Vn}{Upper} \cdot \frac{Zn}{Lower}$	Z→ Z0 Z1 to Z6→ Z1 to Z6 V→ Z7 V1 to V6→ Z8 to Z13 $\frac{Zn+1}{Upper} \cdot \frac{Zn}{Lower}$ If an index register is used for destination of double word operation or single word multiplication/division, the relation of upper and lower levels may be broken, causing a problem.

Appendix 4.2 Device

(a) Only devices within the Q2ASCPU range are converted.

An□CPU Device		Device after A→QnA Conversion
X□□□		Same as to left
Y□□□		Same as to left
M□□□	M/L/S is determined by the parameter settings.	Same as to left
L□□□		Same as to left
S□□□		Same as to left (Correct to M□□□.)
M9000 to M9255		SM1000 to SM1255
B□□□		Same as to left
T (low-speed timer)	Low-speed/high-speed/retentive is determined by parameter setting.	Same as to left
T (high-speed timer)		Same as to left
T (retentive timer)		ST□□□
C□□□		Same as to left
F□□□		Same as to left
D□□□		Same as to left
D9000 to D9255		SD1000 to SD1255
W□□□		Same as to left
R□□□		Same as to left
Z□		Z → Z0 Z1 to Z6→ Z1 to Z6
V□		V → Z7 V1 to V6→ Z8 to Z13
A0,A1		SD718,SD719
P□□□		Same as to left*
I□□		Same as to left
N□		Same as to left
K□□□		Same as to left
H□□□		Same as to left

REMARK

* When P254 is used as the CHK instruction pointer, P254 can be converted to P254 as is.
(Refer to Appendix 4.12)

- (b) Devices that are outside the Q2ASCPU range are converted to SM1255 if they are bit devices and to SD1255 if they are word devices.

Appendix 4.3 Parameters

The following parameter settings only are converted to Q2ASCPU use.

- Latch range setting
Converted to the "latch clear key valid" range.
The latch clear key invalid range is made blank (no setting).
- MELSECNET (II, /10) setting
For the MELSECNET setting when the ACPU is an AnN or AnA, the number of modules are stored after conversion, but the network refresh parameters are not converted.
- I/O assignment
Only the head I/O No. is made blank; all other items are converted.
- MELSECNET/MINI auto refresh setting
If only I/O assignment was set in the parameters and MELSECNET/MINI auto refresh settings have not been made, the MELSECNET/MINI data link operates with the default values.

The following items are set for the Q2ASCPU default. If settings have been made, make the settings again.


- RUN-PAUSE contacts :No setting
- Output at STOP → RUN :Before operation
- Interrupt counter No. :No setting
- WDT setting :200ms
- Operation mode when there is an error :STOP (All items)

Appendix 4.4 Timer and Interrupt Counter Operations

(1) Timer

- (a) The ACPU turns timer coils ON/OFF on execution of the OUT instruction, and updates timer current values and turns contacts ON/OFF on execution of the END instruction. In contrast, the Q2ASCPU turns timer coils ON/OFF, updates current values, and turns contacts ON/OFF on execution of the OUT instruction. Note that after conversion, the turning of contacts ON/OFF may be up to one scan faster.

Example: Timing for turning contact ON

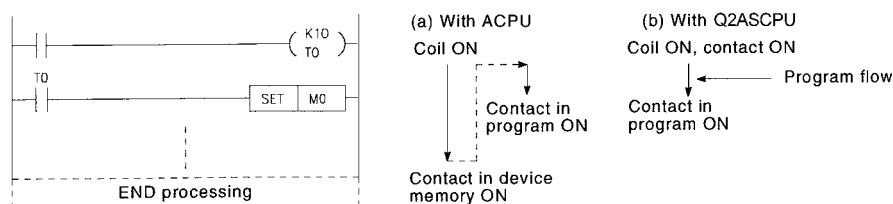

In the case of ACPU, a timer contact will turn ON quickly if it is located in the first step. In the case of Q2ASCPU, it will turn ON quickly if it is located in the step following OUT T.

- (b) Note that processing differs as follows when the set value of a timer is set to K0:
- For ACPU, count is in infinite units (timer does not count up).
 - For Q2ASCPU, the timer counts up instantaneously.

(2) Interrupt counter


Interrupt counters for Q2ASCPU count the number of interrupt occurrences. However, the counter contact does not turn ON even when the count has reached the set value.

The operation of interrupt counters for ACPU differs according to the CPU type.

- (a) Interrupt counters for A3HCPU, AnACPU, or AnUCPU count the number of interrupts occurrences. When the count reaches the set value, the counter contact turns ON.

In order to achieve the same operation as with interrupt counters for A3HCPU, AnACPU, and AnUCPU when using a Q2ASCPU, the program must be modified after conversion.

An example modification is shown below.

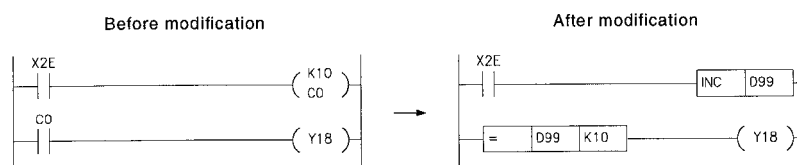

- (b) Interrupt counters for AnCPU and AnNCPU operate as counters used in interrupt programs.

To achieve the same operation as with interrupt counters for AnCPU or AnNCPU when using a Q2ASCPU, the program modification is not needed after conversion.

When ordinary counters are used in an interrupt program with Q2ASCPU, they operate in the same way as with AnNCPU.

Appendix 4.5 Sequence Programs, Statements, Notes

After conversion by A → QnA conversion, sequence programs are stored in the set file. If a subsequence program is included, the main/subsequence program must be modified. There are two types of modification, as indicated below:

- (a) When executing the main sequence program and subsequence program alternately, modify the parameters and programs as follows.

1) Modification of parameters


Set file names of the main sequence program and subsequence program in program setting in "Auxiliary setting" in the parameter mode. Select scan execution for the main sequence program and standby execution for the subsequence program.

2) Modification of the sequence program


- The CHG instruction that switches between main sequence and subsequence programs is converted to OUT SM1255 after A → QnA conversion. Modify this OUT SM1255 to the PSCAN instruction which converts another sequence program to an scan execution type program.
- Next, add the GOEND instruction that executes a jump to the END instruction to the following step.
- Next, add the PSTOP instruction, which converts another sequence program to a standby execution type program, to the first step of the sequence program.

This enables execution of the subsequence program from the main sequence program, and disables execution of the main sequence program when the subsequence program is executed.

- Main sequence program

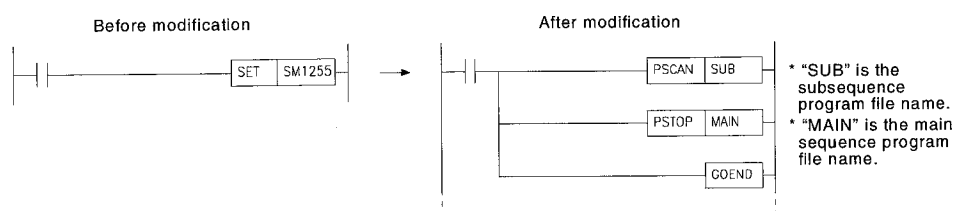

- Subsequence program

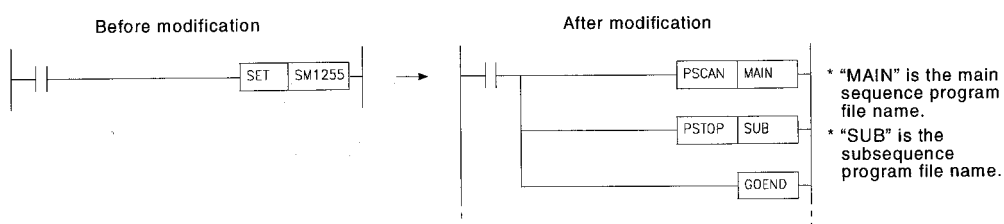

- (b) To execute the main sequence program and subsequence program serially as one program, modify the parameters and program as follows.
- 1) Modification of parameters
Set the file names in the order of main sequence program and subsequence program in program setting in "Auxiliary setting" in the parameter mode.
Select scan execution as the execution type for both the main sequence program and the subsequence program.
 - 2) Modification of the sequence program
 - The CHG instruction that switches between main sequence and subsequence programs is converted to OUT SM1255 after A → QnA conversion. Delete it as it is not required for Q2ASCPU.
 - If the same interrupt program or pointer is used for the main sequence program or subsequence program, use only one interrupt program or pointer.

REMARK

AnACPU executes END processing on switching from execution of the main sequence program to execution of the subsequence program, and also executes END processing after execution of the subsequence program.
Note that END processing is executed only after execution of the second program when a Q2ASCPU executes two programs consecutively.

Statements and notes are entered in the sequence program file after A → QnA conversion.

No modification is required after conversion.

Appendix 4.6 Microcomputer programs

Microcomputer programs and utility software packages cannot be converted as the Q2ASCPU has no microcomputer mode.

When a microcomputer program or utility software package is used with the ACPU, a SUB instruction (microcomputer program call instruction) is written in the sequence program to execute it. The SUB instruction is converted to OUT SM1255 after A → QnA conversion; delete it as it is not necessary.

In the case of user-created microcomputer programs, convert processing contents of the microcomputer programs to sequence programs using operation instructions added for Q2ASCPU.

When using a utility software package of the following, convert processing contents of the utility software package to a sequence program using operation instructions added for Q2ASCPU.

- SW□□□-AD57P Refer to the QnACPU Programming Manual (AD57 Instructions).
 - SW□□□-UTLP-FN0 Refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).
 - SW□□□-UTLP-FN1 Refer to the QCPU (Q mode)/QnACPU Programming Manual (Common Instructions).
 - SW□□□-UTLP-PID Refer to the QCPU (Q mode)/QnACPU Programming Manual (PID Control Instructions).
 - SW□□□-SIMA
 - SW□□□-UTLP-FD1
 - SW□□□-SAPA
- } Unusable

Appendix 4.7 Comments

Conversions are made for the device range of Q2ASCPU. Devices outside the range are not converted.

Appendix 4.8 Constant Scan Function, Error Check Function

When using the constant scan function or error check function for ACPUs, special registers or special relays are set.

In contrast, for Q2ASCPUs, these functions are set with parameters. To use these functions after conversion, make settings in "PLC RAS" in the parameter mode.

Appendix 4.9 I/O control mode

The I/O control mode for Q2ASCPU is refresh mode (direct I/O is enabled depending on the device).

- As the I/O control mode for A2US is the refresh mode as with Q2ASCPU, there are no problems with the input timing of inputs (X) or the output timing of outputs (Y).
- In the case of A1SCPU, and A2SCPU, I/O control mode is fixed or selected to direct mode, and the input timing for inputs (X) and output timing for outputs (Y) differs from that for the refresh mode.
- Modifying programs that generate pulses from SET/RST instructions by using direct devices

Modify programs which, in the direct mode, output pulse output to the external using SET/RST instructions to programs that use direct output devices for Q2ASCPU.


Appendix 4.10 Data Link System

- AnUCPU data link systems
The network settings in the AnUCPU parameters can be converted by A → QnA conversion. Parameter modifications after conversion are not needed.
- CPU modules other than AnUCPU
The link settings in the CPU module parameters cannot be converted by A → QnA conversion. Link settings must be made in the parameters after conversion.

Appendix 4.11 Index Register Processing

For Q2ASCPU, the contents of index registers change when program processing transfers between the main sequence program and interrupt programs.

- Transfer of program processing from main sequence program to interrupt program
The contents of the index registers of the main sequence program are saved, and then these contents are passed to the interrupt program.
- Transfer of program processing from interrupt program to main sequence program
The index registers in the interrupt program are cleared, and the saved main sequence program contents are written to them.

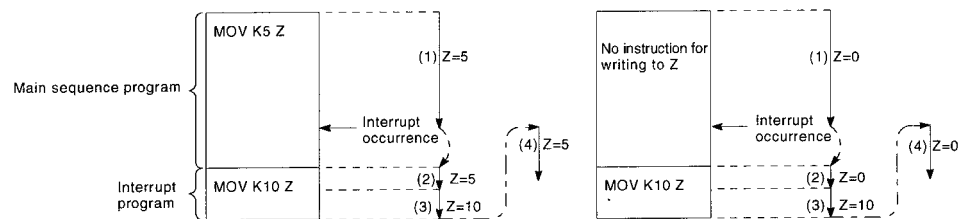

For ACPU, processing differs according to the CPU module type.

- The processing for A2USCPU is the same as for Q2ASCPU, and no program modification is required after conversion.
- In the case of A1SCPU, and A2SCPU, when program processing is transferred from an interrupt program to the main program, the data updated in the interrupt program are passed on to the main program.

When passing a value written to the index register in an interrupt program on to the main sequence program, for example, modify the program so that the value is passed on via a data register.

Appendix 4.12 CHK Instruction, IX Instruction

(1) CHK instruction

The CHK instruction operates as a fault check instruction for Q2ASCPU.

For ACPU, there are two types of processing depending on the CPU type.


- Fault check..... AnCPU, AnNCPU (direct I/O control mode),
A3HCPU, AnACPU, AnUCPU
- Bit device output inversion..... AnNCPU (refresh I/O control mode)

After conversion, program modification is required for each processing.

[For fault check]

Modify the CJ instruction in the step before the CHK instruction to a CHKST instruction.


The CHK instruction pointer (P254) and the CJ instruction destination pointer are converted to pointers with the same number. As the above pointers are not used for Q2ASCPU, delete them.

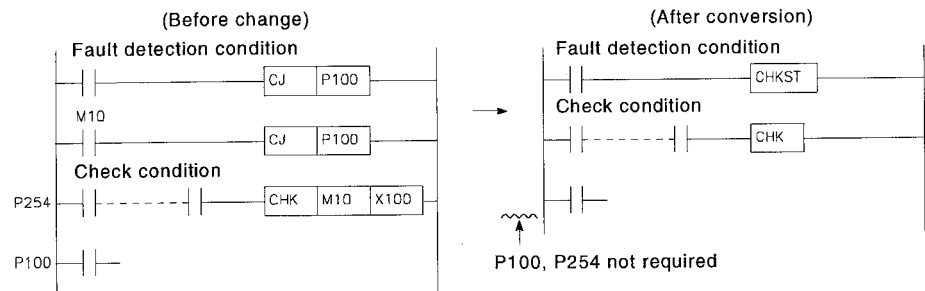

[For bit device output inversion]

The Q2ASCPU has the FF instruction for inverting bit device outputs.

Modify the CHK instruction to the FF instruction.



(2) IX instruction

The IX instruction is converted, but not executed. Modify the program so that all the devices that are objects of the IX instruction are subject to indexing.

Appendix 4.13 Accessing File Register R with Instructions

For Q2ASCPU, no error will occur even if an instruction for accessing file registers outside the setting range is executed.

When reading data, FFFFH is stored to the storage device. When writing data, the instruction is executed but no data is stored in the file register.

For ACPU, execution of such an instruction causes an error.

The capacity of file register R is set by parameter. It is therefore necessary to check the capacities of file registers before executing instructions that access file registers, such as the MOV instruction and + instruction.

APPENDIX 5 ERROR CODES RETURNED TO THE REQUEST SOURCE IN GENERAL DATA PROCESSING

With the Q2ASCPU, when an error occurs while general data processing is requested from a peripheral device, a special function module, or a network system, the error code is returned to the source of the general data processing request.

POINT	
	<p>Since this error code is not an error detected by the Q2ASCPU self-diagnostics function, it is not stored to special relay SD0.</p> <p>If the request source is a peripheral device, the message or the error code is displayed.</p> <p>If the request source is a special function module or a network system, the error code corresponding to the requested processing is returned.</p>

Appendix 5.1 Error Codes

The error code's numbers depends on the location where the error has been detected. The correspondences between the locations where errors are detected and the error codes are indicated in the table below.

Location Where an Error is Detected	Error Code	Reference for Error Contents
CPU module	4000H to 4FFFH	App Appendix 5.2
Serial communication module, etc.	7000H to 7FFFH	Serial Communication Module User's Manual, etc.
CC-Link module	B000H to BFFFH	Control & Communication Link System Master/Local Module User's Manual
Ethernet module	C000H to CFFFH	Ethernet Interface Module User's Manual
MELSECNET/10 network module	F000H to FFFFH	For QnA/Q4AR MELSECNET/10 Network System Reference Manual

Appendix 5.2 Error Contents of Error Codes Detected by the CPU Module (4000H to 4FFFH)

The error contents of error codes detected by the CPU module (4000H to 4FFFH), and the messages displayed on the peripheral device are indicated in the table below.

Error Code (Hexadecimal)	Error	Error Contents	Message Displayed at Peripheral Device	Corrective Action
4000H	CPU module-related error	Sum check error	Message (1) is displayed.	Check the connection between the CPU module and connection cable.
4001H		Remote request that cannot be handled is performed.	Message (1) is displayed.	Check the requested remote operation.
4002H		Command to which a global request is not allowed is performed.	Message (1) is displayed.	Check the requested command.
4003H		Since the Q2ASCPUsystem is protected, the request contents cannot be performed.	Execution is not allowed during system protection.	Turn the Q2ASCPU system protect switch OFF.
4004H		The data volume is too large for the specified request.	Cannot execute in excess of capacity.	Reduce the data volume so that it can be handled with the request.
4005H		Password has not been cancelled.	Password has not been cancelled.	Cancel the set password.
4006H		CID is different from the Q2ASCPU data.	Message (1) is displayed.	Check the CID.
4007H		The Q2ASCPU is not BUSY. (Buffer is not empty.)	Message (1) is displayed.	Re-perform the request after the elapse of an arbitrary time period.
4008H				
4010H	CPU module mode error	The request contents cannot be performed because the Q2ASCPU is in RUN.	Cannot execute when PLC is in RUN mode.	Perform the request after setting the Q2ASCPU to STOP.
4011H		The request contents cannot be performed because the Q2ASCPU is not in STEP-RUN.	Cannot execut while PLC is not in STEP RUN mode.	Perform the request after setting the Q2ASCPU to STEP-RUN.
4012H		The request contents cannot be performed because the Q2ASCPU is in STEP-RUN.	Not executed due to STEP-RUN of PLC.	Perform the request after setting the Q2ASCPU to RUN/STOP.

Error Code (Hexadecimal)	Error	Error Contents	Message Displayed at Peripheral Device	Corrective Action
4021H	CPU module file-related error	Designated drive memory does not exist or is abnormal.	The target drive contains a fault.	Check the status of the designated drive memory.
4022H		The file with designated file name, and file No. does not exist.	The file name does not exist.	Check the designated file name and file No.
4023H		The file name and file No. of the designated file do not match.	Cannot access files.	Delete the file and create a new one.
4024H		The designated file cannot be accessed by the user.	This file cannot be handled.	Do not access the designated file.
4025H		The designated file is processing a request from another source.	Alert (1) is displayed.	Forcibly perform the request. Or perform the request again after other processing has completed.
4026H		The keyword set for target drive memory has to be designated.	Keyword doesn't match.	Access by designating the keyword set for the target drive memory.
4027H		The designated range exceeds the file range.	File capacity is not enough.	Check the designated range, and access within the permissible range.
4028H		The same file has already existed.	Alert (2) is displayed.	Forcibly perform the request. Or change the file name and then perform the request.
4029H		The capacity of the designated file is not secured.	File capacity is not enough.	Review the capacity of the designated file. Or sort the designated drive memory and re-perform.
402AH		The designated cluster No. does not exist.	Cannot access files.	Check the designated cluster No., and access by designating a cluster No. within the number of clusters of the designated drive memory.
402BH		The request contents cannot be performed with the designated drive memory.	Cannot access files.	Do not make requests which caused an error to the designated drive memory.
402CH		The request contents cannot be currently performed.	Cannot access files.	Re-perform after the elapse of an arbitrary time period.
4030H	CPU module device designation error	The designated device name cannot be handled.	Device is invalid.	Check the designated device name.
4031H		The designated device No. is out of range.	Device No. is out of range.	Check the designated device No.
4032H		A mistake in the designated device qualification.	Device is invalid.	Check the method for qualification of the designated device.
4033H		The designated device is for system use and cannot be written to.	Device is invalid.	Do not write data to the designated device, or turn it ON/OFF.

Error Code (Hexadecimal)	Error	Error Contents	Message Displayed at Peripheral Device	Corrective Action
4040H	Special function module designation error	The designated special function module cannot perform the request contents.	The unit does not exist.	Do not make requests which caused an error to the designated special function module.
4041H		Access range exceeds the buffer memory range of the designated special function module.	The # of devices is too large.	Check the head address and number of accessed points, and access within the actual ranges at the special function module.
4042H		Access to the designated special function module is not possible.	The corresponding unit is faulty.	Check if the designated special function module normally operates.
4043H		The special function module is not at the designated position.	The unit does not exist.	Check the head I/O No. of the designated special function module.
4044H		A control bus error has occurred.	The corresponding unit is faulty.	Check if there is a fault in the hardware of the special function module or other modules.
4045H		Setting required for simulation has not been made.	Data error	Make settings for the simulation.
4046H		The head number of the device or the number of device points designated for simulation is not in 16-point units.	Device No. is not in 16 units.	Check the head number and number of device points and then modify them to 16-point units.
4050H	Protect error	Request contents cannot be performed because the write protect switch of the memory card is ON.	Cannot execute as the memory protect switch is ON.	Turn the write protect switch of the memory card OFF.
4051H		The designated device memory cannot be accessed.	Wrong ROM	Check the following and take corrective action. • Whether the memory is usable • Whether the designated drive memory correctly installed
4052H		Data cannot be written to the designated file because its attribute is read only.	Write is prohibited.	Do not write data to the designated file. Or change the file attribute.
4053H		An error occurred when writing data to the designated drive memory.	Cannot write correctly in ROM.	Check the designated drive memory. Or replace the target drive memory and then rewrite the data.
4054H		An error occurred when deleting data from the designated drive memory.	Cannot erase ROM correctly.	Check the designated drive memory. Or replace the target drive memory and then delete the data again.

Error Code (Hexadecimal)	Error	Error Contents	Message Displayed at Peripheral Device	Corrective Action
4060H	Online registration error	The CPU module system area for registering monitor conditions is being used by another device.	Alert (1) is displayed.	When monitoring of the other device has completed, perform the monitoring again. Or increase the system area of the built-in RAM using a format with an option.
4061H		Communications failed.	Not registered.	Re-perform communications.
4062H		Another device is monitoring using the detailed condition for monitoring.	Alert (1) is displayed.	Do not use the detailed condition for monitoring from the designated device. Or cancel the monitoring detailed condition for other device and perform the monitoring again.
4063H		The number of registrations for file lock is greater than 16.	Cannot access files.	Reduce the number of registrations to 16 or less.
4064H		Incorrect setting contents.	Setting is incorrect.	Check the set contents.
4065H		Device I/O information differs from parameters.	Does not match the parameter.	Check the parameters. Or check the data.
4066H		A keyword that differs from the one set for the designated drive memory was specified.	Keyword doesn't match.	Check the designated keyword.
4067H		The designated monitor file has not been secured.	File capacity is not enough.	Secure the monitor file, then perform monitoring.
4068H		The designated command cannot be registered or cancelled since it is in execution.	Unable to execute due to on going process.	Re-perform the command after requests from other devices has been completed.
4069H		Condition has already satisfied at device.	Setting is incorrect.	Check the monitor condition. Or perform monitor registration again and then monitor.
406AH		Drive other than No.1 to 3 has been designated.	Drive specification is incorrect.	Check the designated drive and specifies a correct drive.
4070H	Ladder verification	The program before modification differs from the registered program.	Program does not match.	Check the registered program and match the program to it.

Error Code (Hexadecimal)	Error	Error Contents	Message Displayed at Peripheral Device	Corrective Action
4080H	Other error	Data error	Data is faulty.	Check the requested data contents.
4081H		The searched target cannot be detected.	Cannot find the find target.	Check the data to be searched.
4082H		The designated command cannot be performed since it is in execution.	Unable to execute due to on going process.	Re-perform the command after requests from other devices has been completed.
4083H		An attempt was made to perform a program not registered in the parameters.	Not registered.	Register the program to be performed to the parameters.
4084H		The designated pointer P, I cannot be detected.	Cannot find the find target.	Check the data to be searched.
4085H		Pointer P, I designation is not possible because the program is not registered in the parameters.	Not registered.	Register the program to be performed in the parameters, then designate the pointer P, I.
4086H		An attempt was made to add a pointer P, I that have already existed.	Device ranges are duplicated.	Check the pointer No. to be added and change it.
4087H		The number of pointers designated is too great.	No pointer exists.	Check and correct the designated pointer.
4088H		The designated step No. is not at the head of the instruction.	Execution position is incorrect.	Check and correct the designated step No.
4089H		The END instruction was inserted/deleted while the CPU module had been in RUN.	Setting is incorrect.	Insert/Delete the instruction after setting the CPU module to STOP.
408AH		The file capacity has been exceeded by performing write during RUN.	File capacity is not enough.	Set the CPU module to STOP and then write the program.
408BH		Cannot perform a remote request.	Data error.	Set the CPU module to the state for performing a remote request, then reissue the request.

Error Code (Hexadecimal)	Error	Error Contents	Message Displayed at Peripheral Device	Corrective Action
4090H	Online registration error during SFC STEP RUN	Too many block break points.	Setting is out of range.	Check and correct the set number.
4091H		The number of registered block break points is incorrect.	Setting is out of range.	Check and correct the set number.
4092H		Too many step break points.	Setting is out of range.	Check and correct the set number.
4093H		The number of registered step break points is incorrect.	Setting is out of range.	Check and correct the set number.
4094H		An attempt was made to perform a request during block continuous processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
4095H		An attempt was made to perform a request during block forced execution processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
4096H		An attempt was made to perform a request during step continuous processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
4097H		An attempt was made to perform a request during step forced execution processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
4098H		An attempt was made to perform a request during one step continuous processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
4099H		An attempt was made to perform a request during one step forced execution processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
409AH		An attempt was made to perform a request during block forced end processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
409BH		An attempt was made to perform a request during step forced end processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
409CH		An attempt was made to perform a request during holding step reset processing.	Unable to execute due to on going process.	Reissue the request after the processing has been completed.
409DH		A block No. with no created block or out-of-range block No. has been designated.	Setting is incorrect.	Check and correct the set contents.
409EH		A step No. for which no step has been created was designated.	Setting is incorrect.	Check and correct the set contents.
409FH		The designated number of cycles is out of range.	Setting is out of range.	Check and correct the set number.

Error Code (Hexadecimal)	Error	Error Contents	Message Displayed at Peripheral Device	Corrective Action
40A0H	SFC device designation error	Out-of-range block No. is designated.	Setting is incorrect.	Check and correct the set contents.
40A1H		Designation exceeds the range for the number of blocks.	Setting is out of range.	Check and correct the set number.
40A2H		Out-of-range step No. is designated.	Setting is incorrect.	Check and correct the set contents.
40A3H		Designation exceeds the range for number of steps.	Setting is out of range.	Check and correct the set number.
40A4H		Out-of-range sequence step No. is designated.	Setting is incorrect.	Check and correct the set contents.
40A5H		The designated device is out of range.	Setting is out of range.	Check and correct the set number.
40A6H		The block designation pattern or step designation pattern was incorrect.	Setting is incorrect.	Check and correct the set contents.
40B0H	SFC file- related error	The designated drive is incorrect.	Setting is incorrect.	Check and correct the set contents.
40B1H		The designated program does not exist.	The file name does not exist.	Check and correct the designated file name.
40B2H		The designated program was not an SFC program.	This file cannot be handled.	Check and correct the designated file name.
40B3H		The SFC dedicated instruction exists in the write during RUN area.	Setting is incorrect.	Check and correct the set contents.
4A00H	Link-related error	The designated station cannot be accessed because no routing parameters have been set to the relevant station.	Routing parameter does not exist.	Set the routing parameters for accessing to the designated station in the relevant station.
4A01H		No network with the No. set in the routing parameters exists.	The network I/O does not exist.	Check and correct the routing parameters set at the relevant station.
4A02H		Cannot access to the designated station.	Link unit error.	Check if an error has occurred at the network module/link module, or if the online state has not been established.
4B00H	Target- related error	An error occurred at the access target station or the relay station.	The corresponding unit is faulty.	Check and correct the error at the designated access target station or the relay station for the access station.

REMARK

(1) Message (1)

Cannot communicate with PC. Error ## = ****

An error code is displayed in ****.

(2) Alert (1)

Execution was initiated from other station
Essentially, cannot initiate execution.
Do you want to initiate execution?

Yes<Y> No<N>


(3) Alert (2)

The file 'PARAM<Parameter>' already exists.
Do you want to overwrite it?


Yes<Y> No<N>

APPENDIX 6 EXTERNAL DIMENSIONS

Appendix 6.1 Q2AS(H)CPU(S1) module

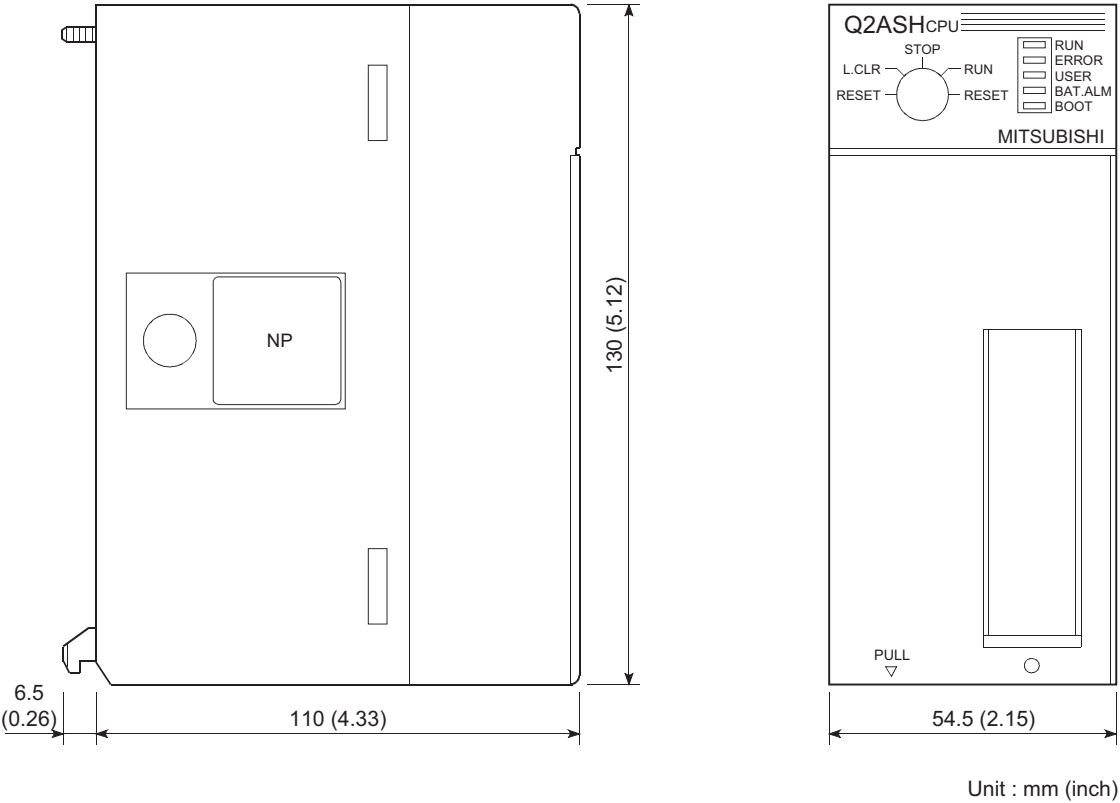


Appendix 6.2 A1S61PN, A1S62PN and A1S63P power supply modules

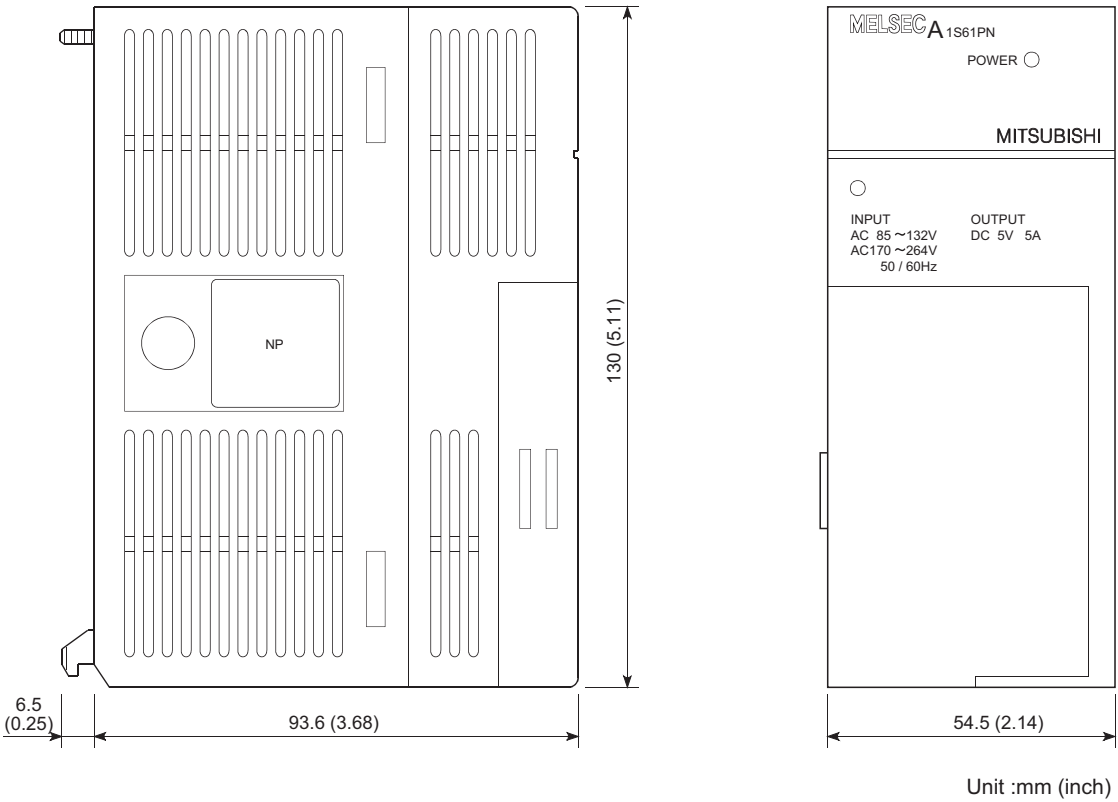


Appendix 6.3 Main Base Unit


(1) A1S32B main base unit

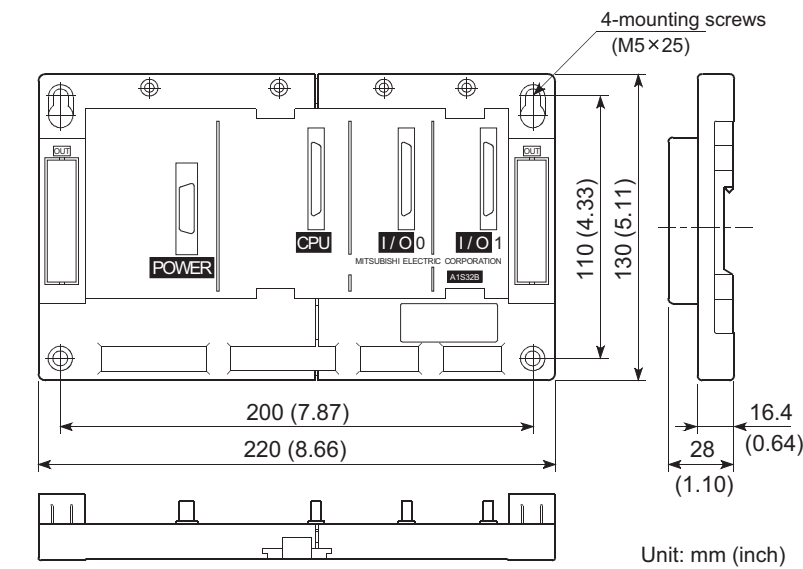


(2) A1S33B main base unit

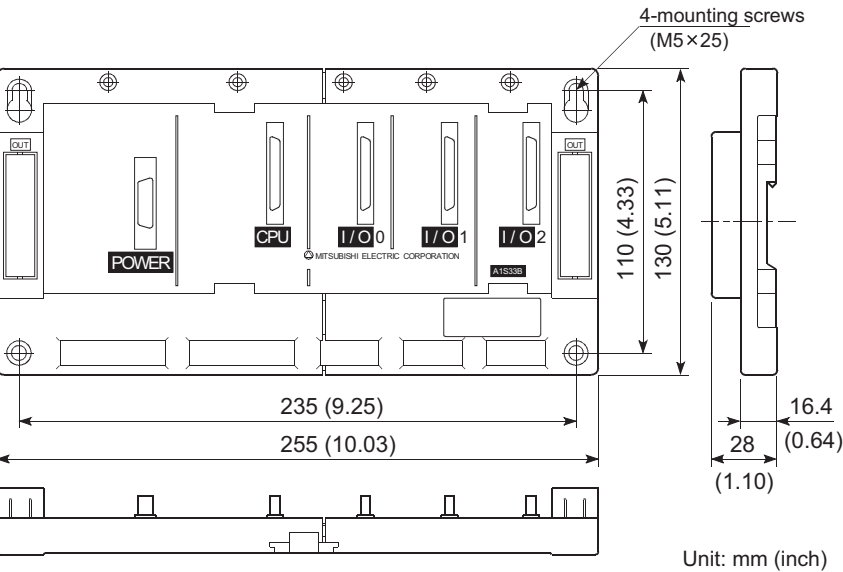

(3) A1S35B main base unit

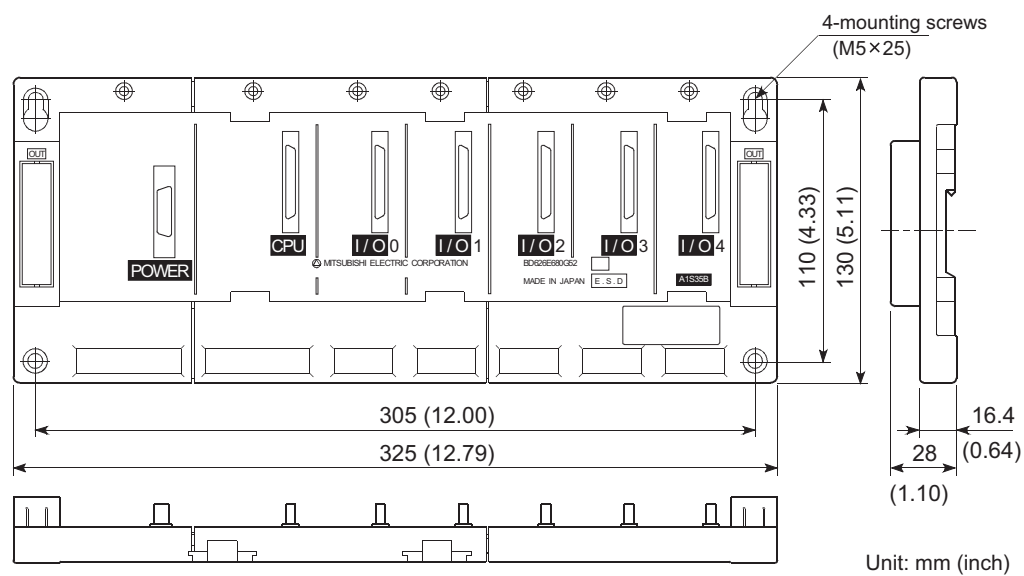


(4) A1S38B, A1S38HB main base units

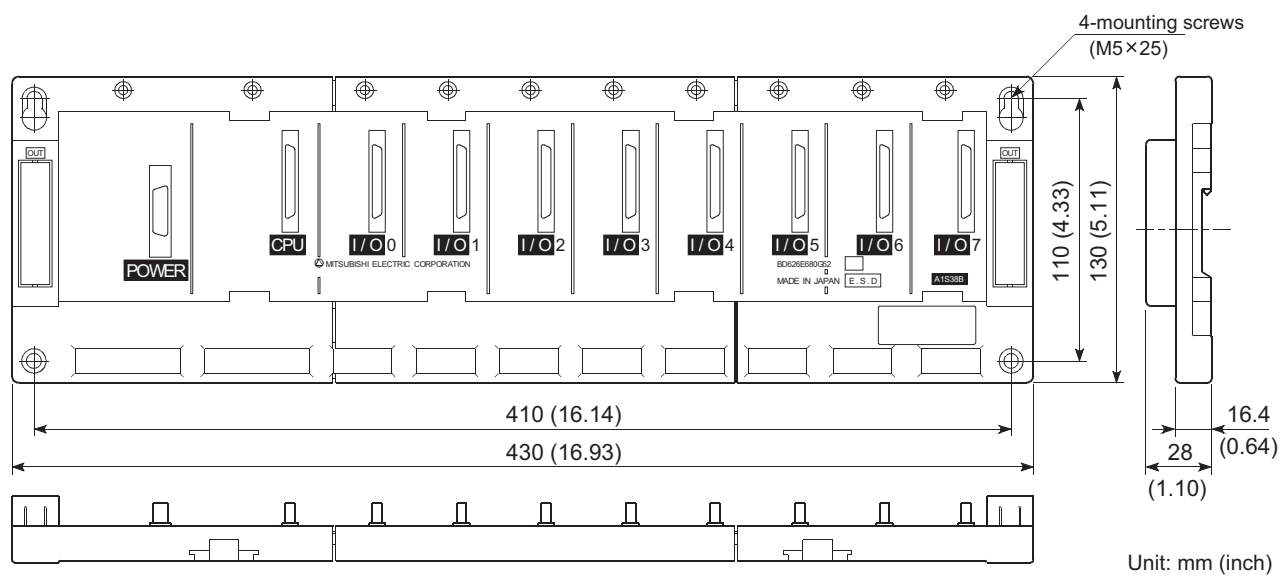


Appendix 6.4 Extension Base Unit


(1) A1S65B extension base unit

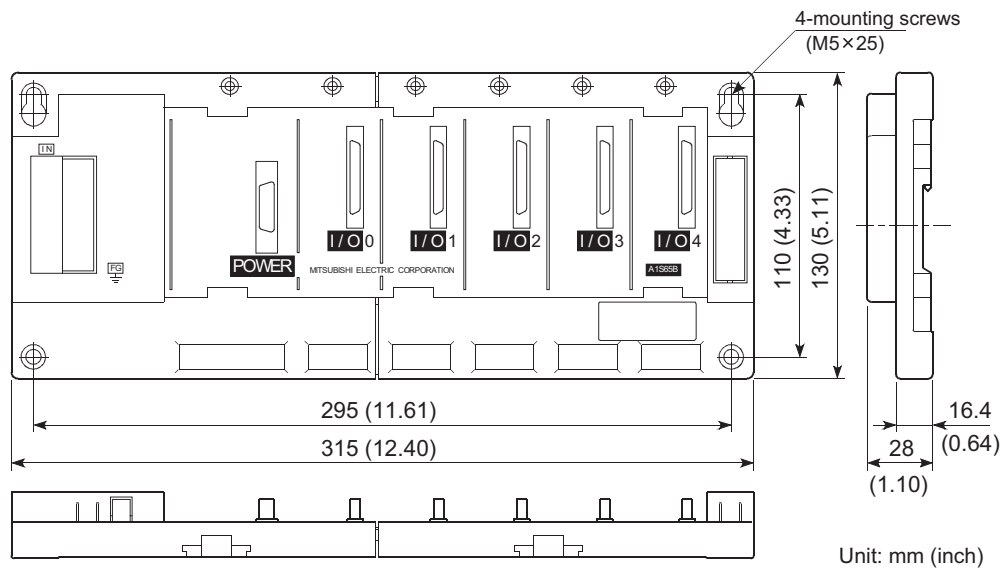


(2) A1S68B extension base unit

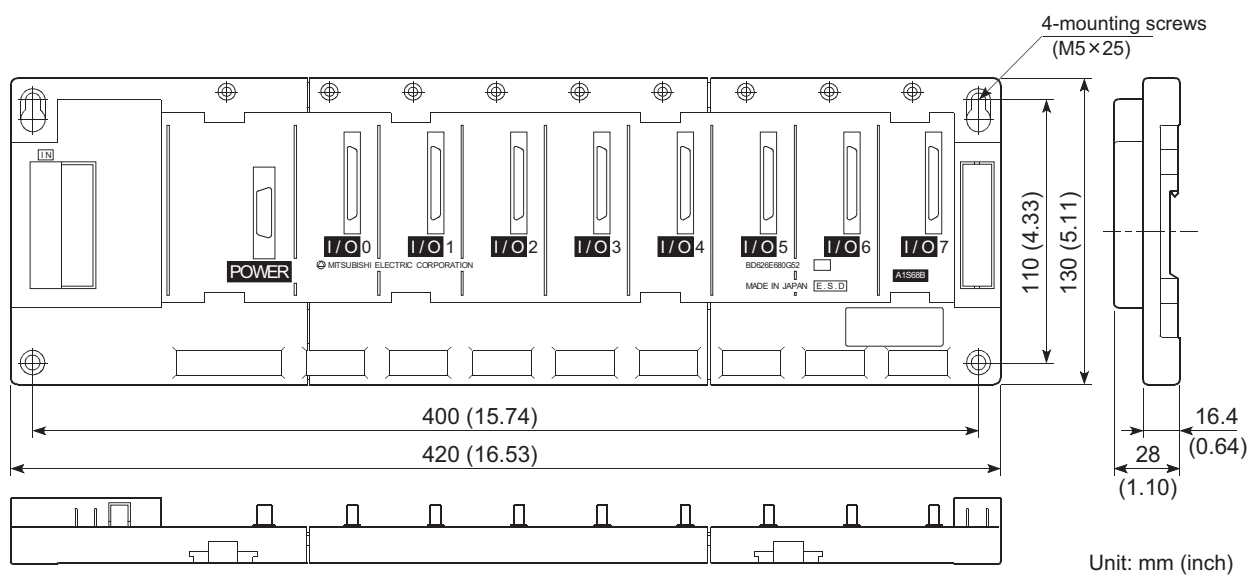


(3) A1S52B extension base unit

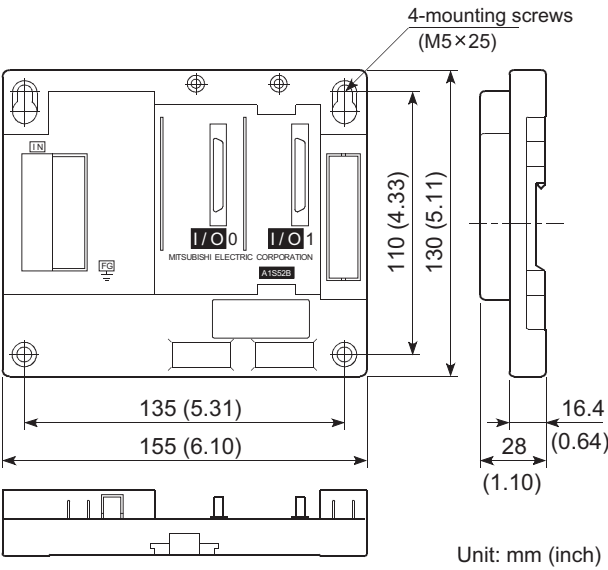


(4) A1S55B extension base unit

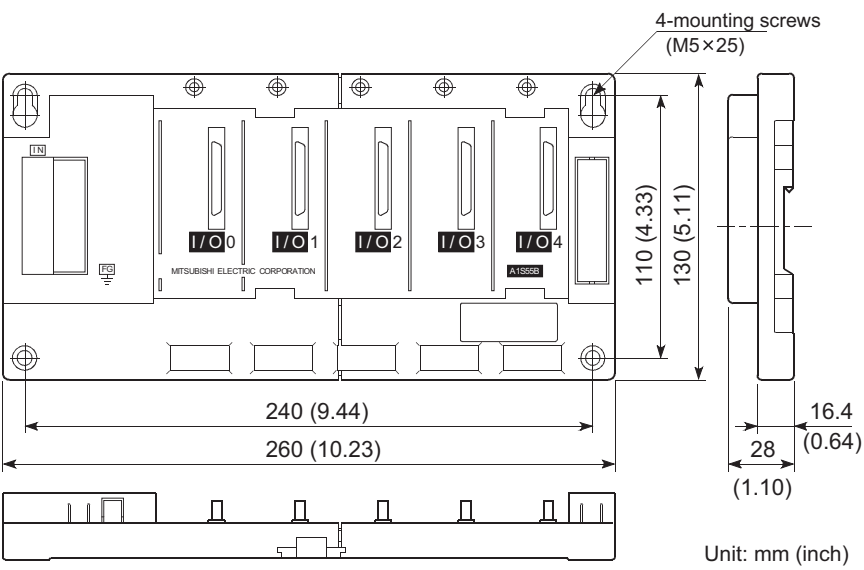


(5) A1S58B extension base unit

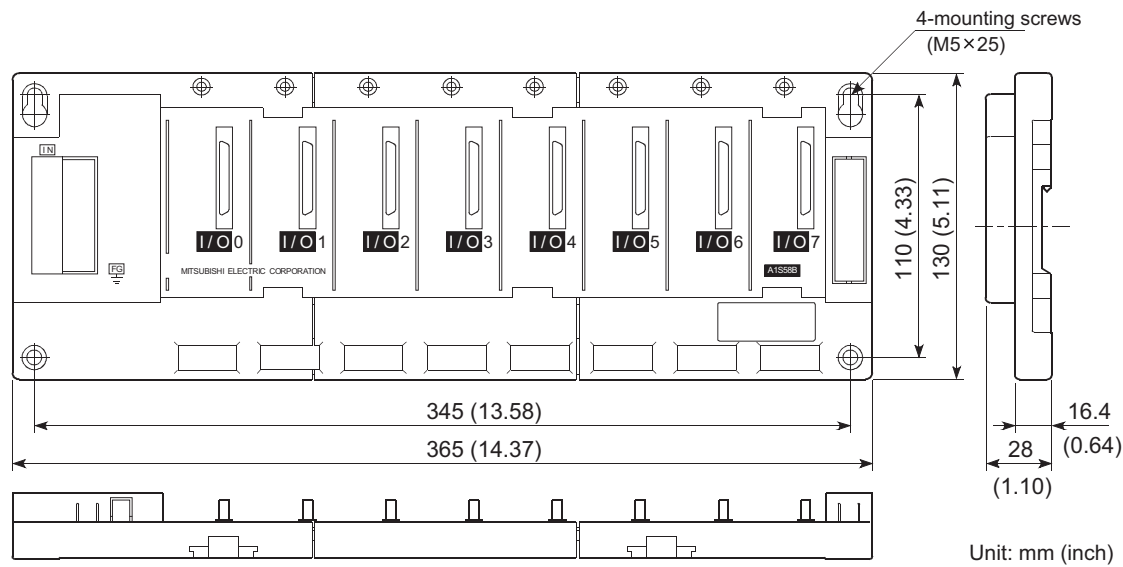


(6) A1S65B-S1 extension base unit

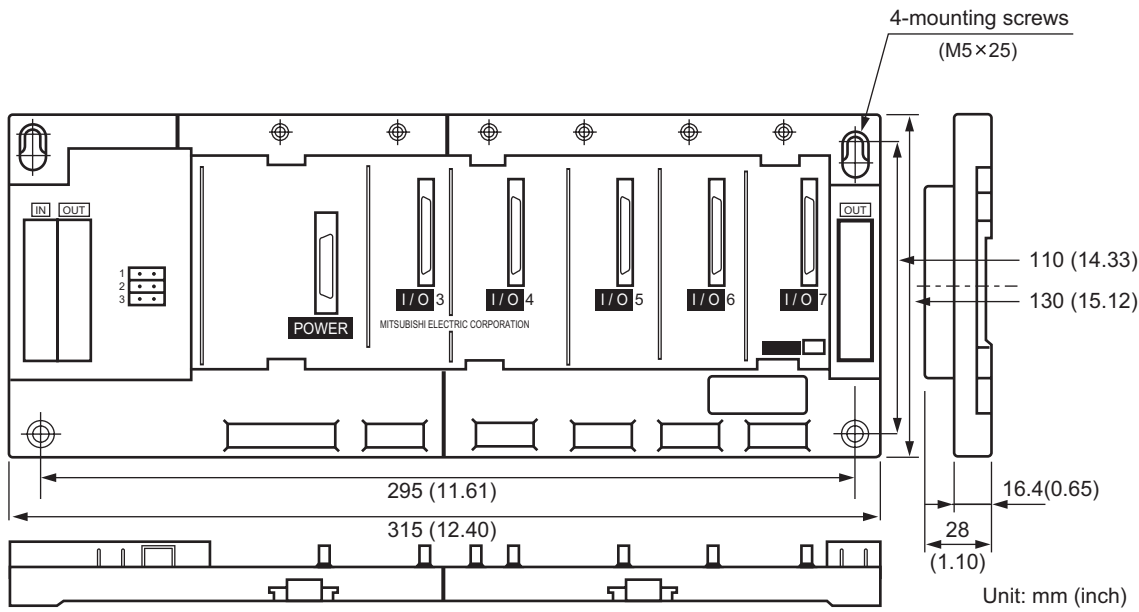


(7) A1S68B-S1 extension base unit

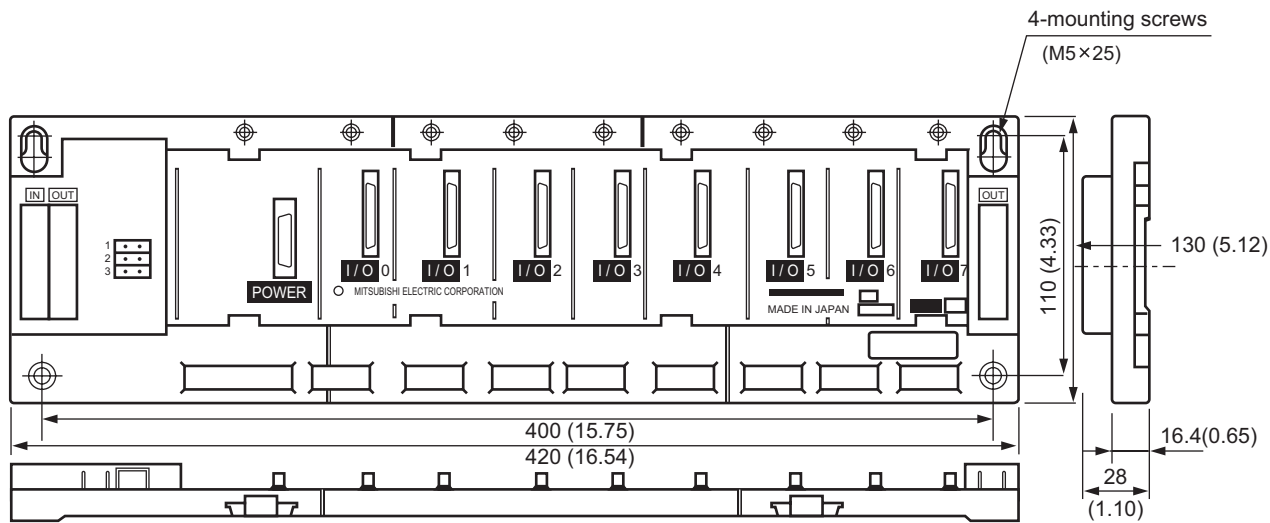


(8) A1S52B-S1 extension base unit

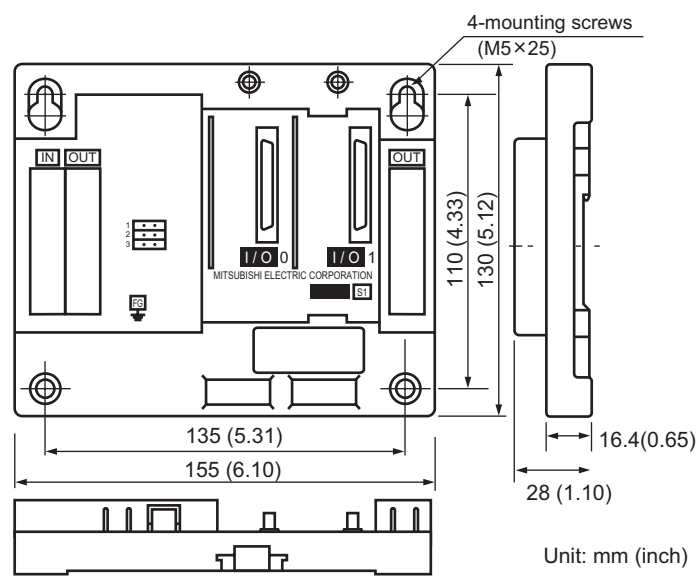

(9) A1S55B-S1 extension base unit

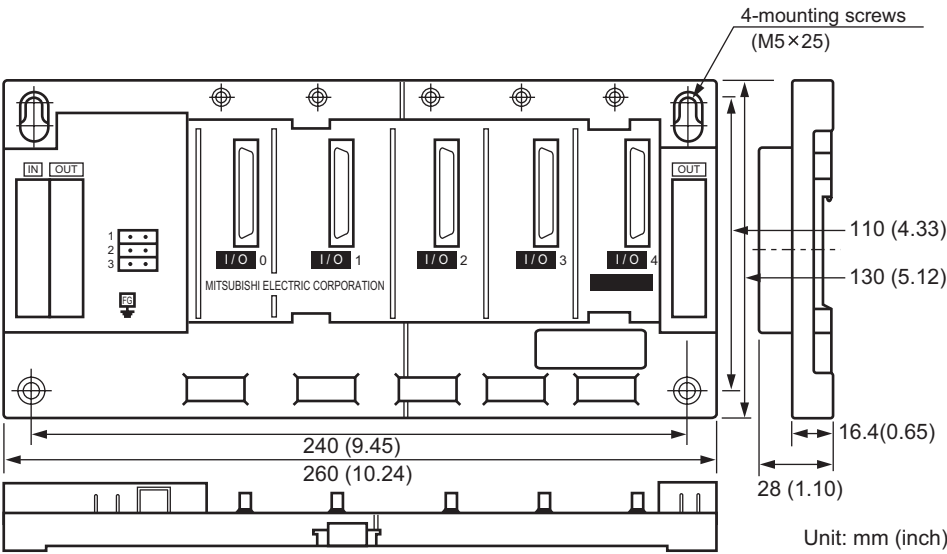

(10) A1S58B-S1 extension base unit

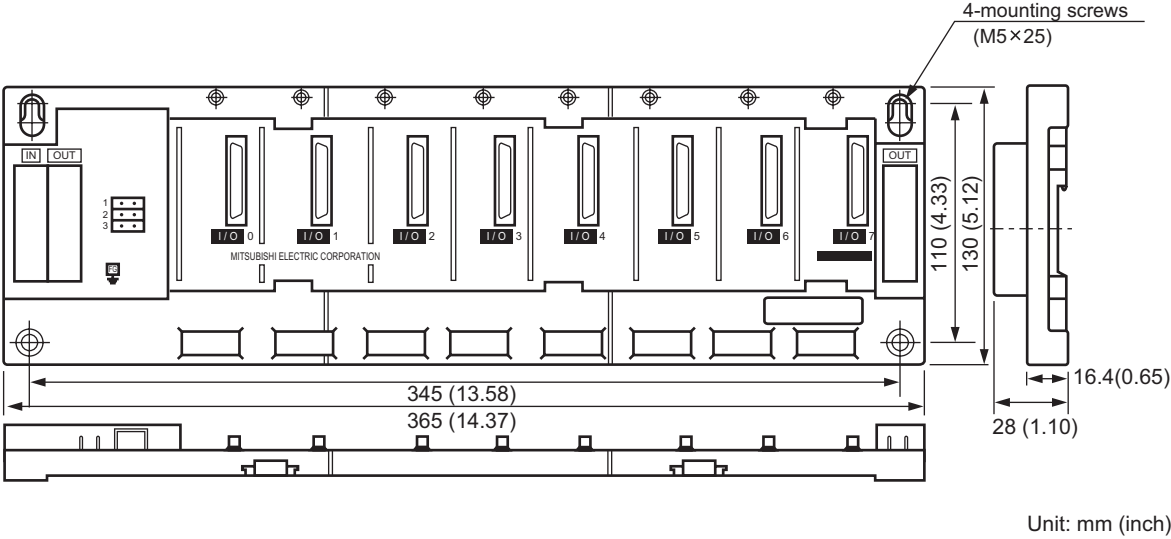

APPENDIX 7 USE OF LOCAL DEVICE FOR SUBROUTINE/INTERRUPT PROGRAM STORAGE FILE (FUNCTION VERSION B OR LATER)

When the subroutine/interrupt program is executed, the local device for the subroutine/interrupt program storage files can be used.

To use the local device in the storage destination file for the subroutine/interrupt program, set the special relays below:


- Subroutine program : SM776
- Interrupt program : SM777

(1) Switching of local device with special relay ON/OFF


	SM776	SM777
OFF	Operation is performed at the local device of the call source file of the subroutine program.	Operation is performed at the local device of the file executed before execution of the interrupt program.
ON	Operation is performed at the local device of the file where the subroutine program is stored.	Operation is performed at the local device of the file where the interrupt program is stored.

(a) Operation for subroutine program


[SM776 operation: OFF without function version B or with function version B]

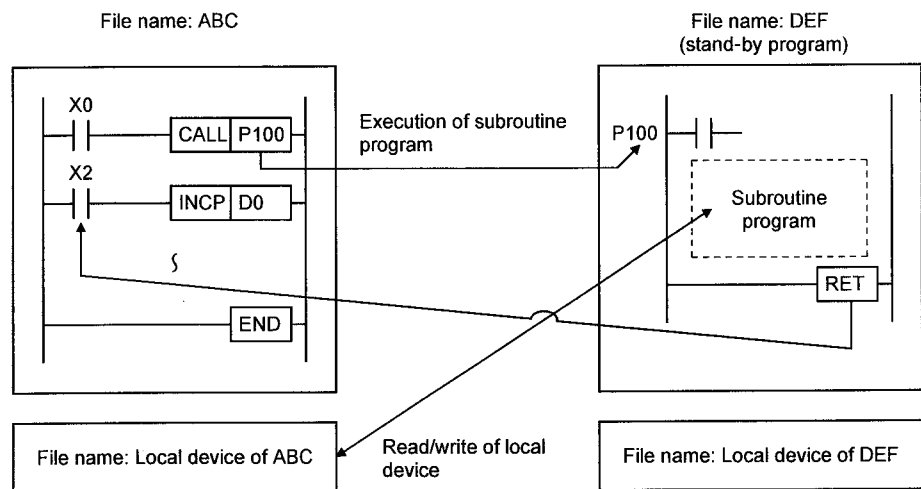


[SM776 operation: ON with function version B]

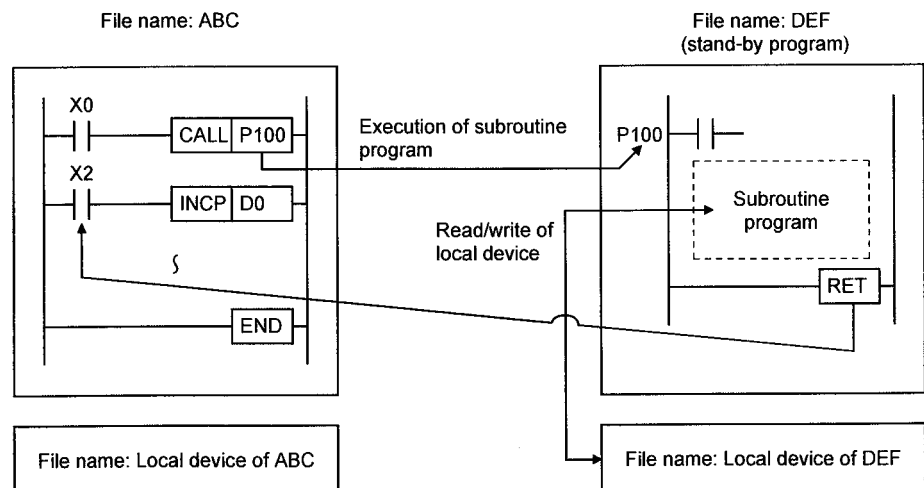

(b) Operation for interrupt program
[SM776 operation: OFF without function version B or with function version B]

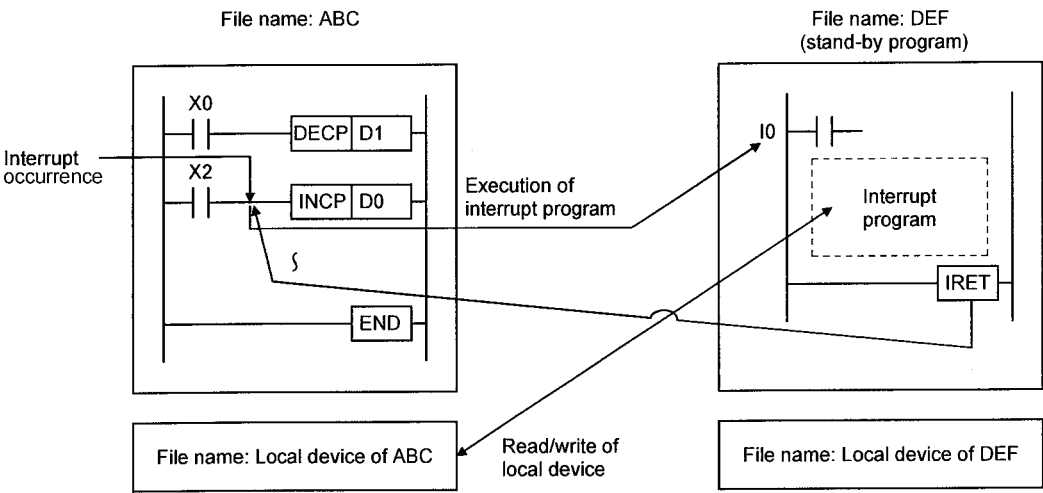

[SM776 operation: ON with function version B]

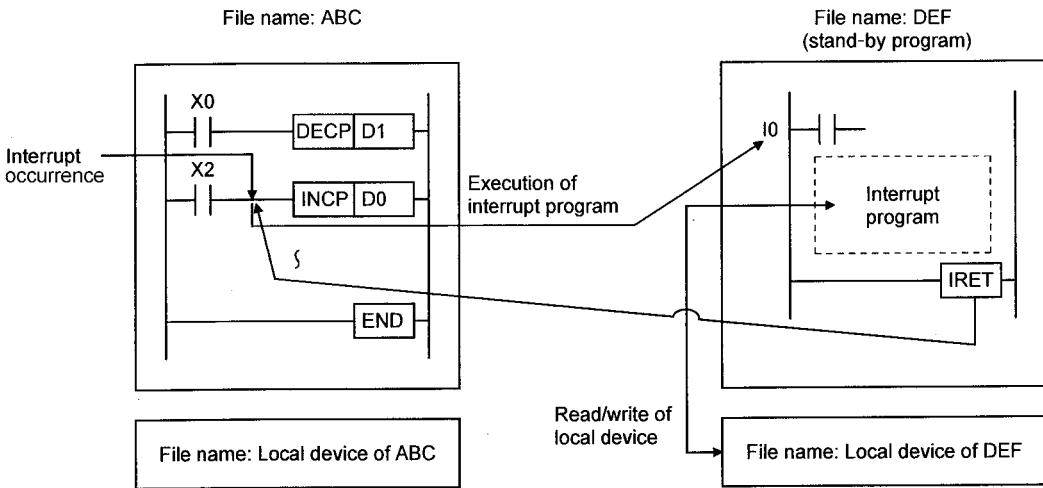

(2) Precautions

- (a) When the SM776 is ON, the local device data can be read while the subroutine program is called. Furthermore, the data will be escaped after performing the RET instruction.

When the SM777 is ON, the local device data is read before performing the interrupt program. The data will be escaped after performing the IRET instruction.

Therefore, when SM776 and SM777 are ON, the scan time is extended by the time below after the subroutine program/interrupt program is executed once.

- Q2ASCPU(S1) $F560\{1.3 \times (\text{Number of words in the local device}) [\mu s]\}$
- Q2ASHCPU(S1) $F220\{0.8 \times (\text{Number of words in the local device}) [\mu s]\}$

- (b) ON/OFF of SM776 and SM777 is set for each CPU module.
It cannot be set for each file.

- (c) When ON/OFF of SM776 and SM777 is changed during execution of the sequence program, the control is performed with the changed information.

APPENDIX 8 NETWORK RELAY FROM ETHERNET MODULE
(FUNCTION VERSION B OR LATER)

This is the network system that mixes Ethernet with MELSECNET/10. The network allows communicating data with the Q2ASCPU in other station via many Ethernet or MELSECNET/10.

To perform the network relay from the Ethernet module, the Ethernet module with function version B or later is required.

- (1) Access range
- Table 8.1 shows the access range of the network relay from the computer/peripheral device with the system:

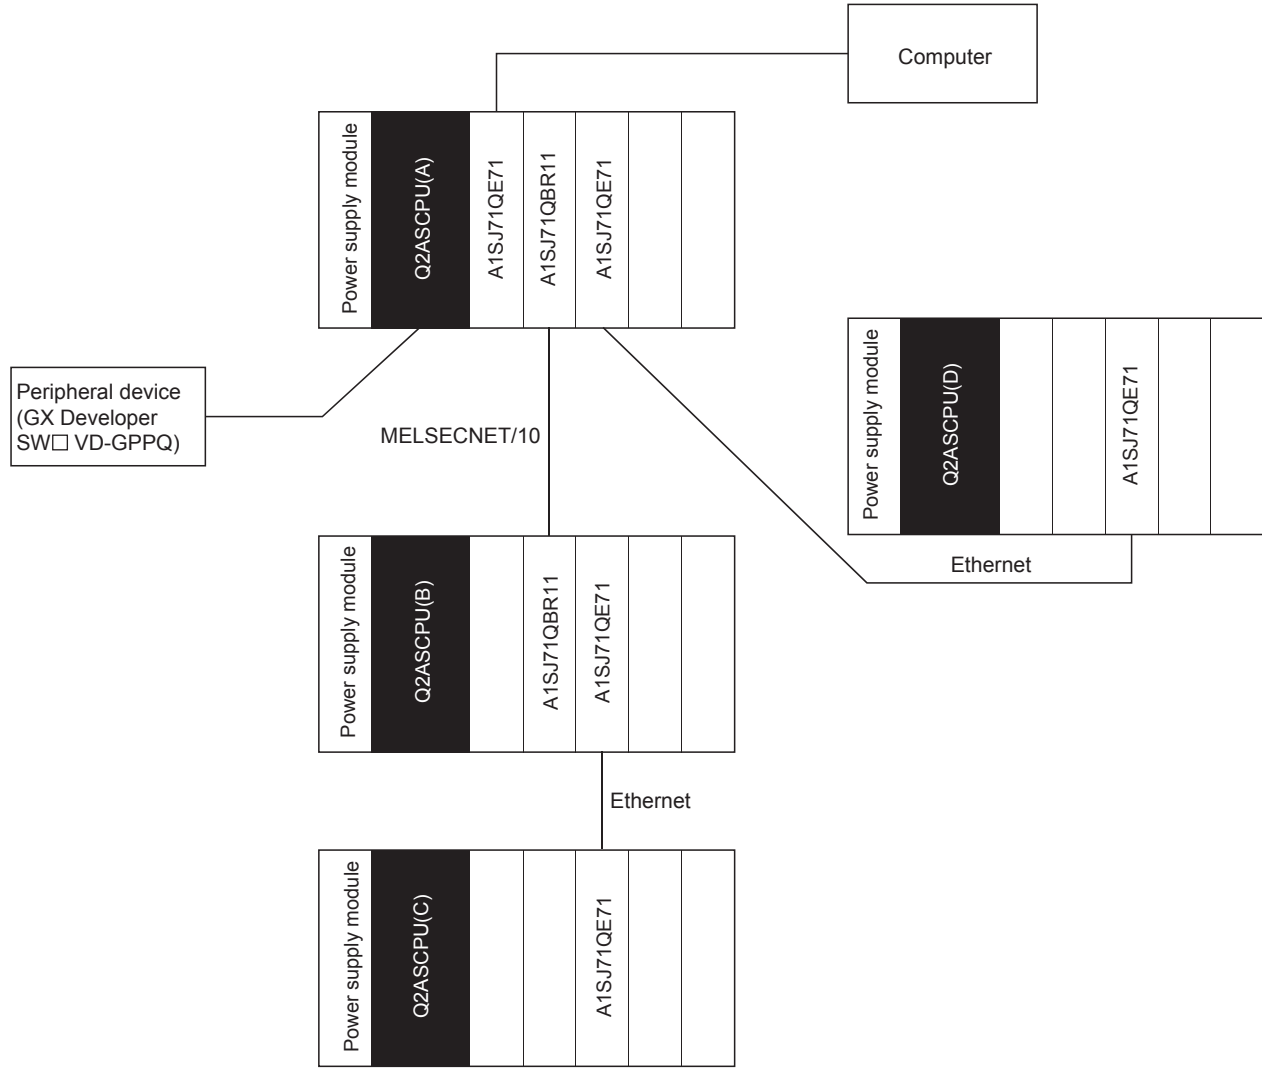


Table 8.1 Comparison table of access range from Ethernet module

Access to	Route	Q2ASCPU "with" Function Version		Q2ASCPU "without" Function Version	
		A	B	A	B
Host access	(Computer)→ Q2ASCPU(A)	○	○	○	○
Other station access in host network (MELSECNET/10)	(Computer)→ Q2ASCPU(B)	○	○	○	○
Other station access of other network (From MELSECNET/10 to Ethernet)	(Computer)→ Q2ASCPU(C)	○	×	×	×
Other station access in host network (Ethernet)	(Computer)→ Q2ASCPU(D)	○	×	×	×
Host access	(Peripheral device) → Q2ASCPU(A)	○	○	○	○
Other station access in host network (MELSECNET/10)	(Peripheral device) → Q2ASCPU(B)	○	○	○	○
Other station access of other network (From MELSECNET/10 to Ethernet)	(Peripheral device) → Q2ASCPU(C)	○	×	×	×
Other station access in host network (Ethernet)	(Peripheral device) → Q2ASCPU(D)	○	×	×	×

○ : Access allowed, × : Access not allowed

A : Ethernet module has indication of the function version.

B : Ethernet module does not have indication of the function version.

(2) Precautions

- (a) With combination of Ethernet module and MELSECNET/10, maximum 7 relays can be performed.
- (b) The following shows other station access with or without setting for other station access:
 - When other station access valid module is set, the set module is used for relay.
 - When other station access valid module is not set, the relay is as follows:
When MELSECNET/10 is available: 1st of MELSECNET/10 is relayed.
When MELSECNET/10 is not available: 1st of Ethernet is relayed.
- (c) When parameters are not registered in the Ethernet module, the Q2ASCPU stores the default parameters in all AJ71QE71.
When multiple Ethernet modules are installed, settings are made in the order of 1st station and 2nd station and so on counting from the Q2ASCPU side.

- (d) Table 8.2 shows operation of the Q2ASCPU for online/offline of the Ethernet module.

Table 8.2 Operation of Q2ASCPU for online/offline of Ethernet module

Ethernet Parameter	Ethernet Module Status	Q2ASCPU Operation
With	Online	Communication with external device is performed with the specified parameter.
	Offline	The Q2ASCPU does not show an error, but communication with external device is not performed.
Without	Online	Communication with external device is performed with the default parameter.
	Offline	The Q2ASCPU does not show an error, but communication with external device is not performed.

- (e) Set the Ethernet module and MELSECNET/10 not to overlap their Network No.s each other. Same network No. cannot be set for them.
The following shows the number of the Ethernet modules and the MELSECNET(/10, /II) modules that can be mounted on one Q2ASCPU:
- (Ethernet module) ≤ 4
 - [(MELSECNET/10) + (MELSECNET/II)] ≤ 4
- (f) When the Ethernet parameters are set for the Ethernet module without function version B, error code "3103" (No Ethernet module in the I/O number set with the parameter) appears and the system stops due to an error.

APPENDIX 9 Q2AS(H)CPU(S1) PROCESSING TIME

The Q2AS(H)CPU(S1) processing time is explained below.

Appendix 9.1 Overview of the Q2AS(H)CPU(S1) Scan Time

The Q2AS(H)CPU(S1) scan time comes to the total of the following values.

- I/O refresh processing
- Total values of instruction execution time
- END processing

(1) I/O refresh time

(a) I/O data refresh time between the following modules, which is mounted in the Q2AS(H)CPU(S1) main base unit, extension base unit.

- Input module
- Output module
- Special function module

(b) I/O refresh time can be calculated in the following formula.

$$(\text{I/O refresh time}) = (\text{I/O points} \div 16) \times N1 + (\text{Output points} \div 16) \times N2$$

For N1 and N2, refer to the following table.

CPU module	N1	N2
Q2ASCPU(S1)	5.2 μ s	5.0 μ s
Q2ASHCPU(S1)	4.4 μ s	4.3 μ s

(2) Instruction execution time

(a) The processing time of each instruction used for the Q2AS(H)CPU(S1) program. For the processing time of each instruction, refer to the following manual.

- QCPU (Q mode)/QnACPU Programming Manual (Common Instructions)

(b) Since interrupt/fixed-cycle execution type program have overhead time, add the overhead time to the instruction execution time.

(3) END processing

(a) The Q2AS(H)CPU(S1) common processing time except for above (1) ,(2).

(b) The following table shows values of the END processing time.

	CPU module	END Proc Time
With error check (SM1084 = OFF)	Q2ASCPU(S1)	1.7ms
	Q2ASHCPU(S1)	0.7ms
Without error check (SM1084 = ON)	Q2ASCPU(S1)	1.2ms
	Q2ASHCPU(S1)	0.5ms

Appendix 9.2 Causes of Increasing Scan Time

The following shows the functions that increase the Q2AS(H)CPU(S1) scan time. When using the following functions, add the values calculated in Appendix 9.1 to the following values.

- MELSECNET/10 refresh
- MELSECNET/MINI-S3 refresh
- CC-Link auto refresh
- Sampling trace
- Monitor using GX Developer
- Local device
- Multiple program execution
- Installation/removal of memory card
- File register whose file name is the same as the program

(1) MELSECNET/10 refresh

Refresh time between the Q2AS(H)CPU(S1) and MELSECNET/10 network module.

For MELSECNET/10 refresh time, refer to the following manual.

- QnA/Q4AR MELSECNET/10 Network System Reference Manual

(2) MELSECNET/MINI-S3 refresh

Refresh time between the Q2AS(H)CPU(S1) and MELSECNET/MINI(S3) network module.

For MELSECNET/MINI (S3) refresh time, refer to the following manual.

- MELSECNET/MINI-S3 Master Module User's Manual

(3) CC-Link auto refresh

Refresh time between the Q2AS(H)CPU(S1) and CC-Link master/local module.

For the auto refresh processing time of CC-Link, refer to the following manual.

- Control & Communication Link System Master/Local Module type AJ61QBT11/A1SJ61QBT11 User's Manual

(4) Sampling trace

(a) Processing time in the case of sampling trace execution

Sampling trace data are set using GX Developer, and the processing time is added when the sampling trace is executed.

- (b) The following table shows the processing time when internal relay 50 points as a bit device, data register 50 points as a word device are set for sampling trace data.

CPU module	Processing Time
Q2ASCPU(S1)	3.2ms
Q2ASHCPU(S1)	1.2ms

(5) Monitor using GX Developer

Processing time in the case of monitoring by GX Developer

The processing time is added when monitoring by GX Developer.

(a) The following table shows the processing time when data register 64 points are set for registration monitor:

CPU module	Processing Time
Q2ASCPU(S1)	0.46ms
Q2ASHCPU(S1)	0.18ms

(b) The following shows the processing time when monitor conditions are set.

CPU module	Processing Time	
	Agreement in Designated Step	Agreement in Designated Device
Q2ASCPU(S1)	0.38ms	0.38ms
Q2ASHCPU(S1)	0.15ms	0.15ms

(6) Local device

Processing time when the local device is used

The processing time is added when the local device is used.

CPU module	Processing Time
Q2ASCPU(S1)	$3.0 \times (n - 1) + 2.8\text{ms}$
Q2ASHCPU(S1)	$1.1 \times (n - 1) + 1.1\text{ms}$

Condition: local device setting: 1 k point, n: number of program files

(7) Multiple program execution

Overhead time of each program execution when the Q2AS(H)CPU(S1) performs multiple programs. The processing time is added when several programs are executed..

CPU module	Processing Time
Q2ASCPU(S1)	$0.21 \times n \text{ ms}$
Q2ASHCPU(S1)	$0.08 \times n \text{ ms}$

Condition: n: number of program files

(8) File register

Processing time when the file register is used

The processing time is added when the file register is used.

CPU module	Processing Time
Q2ASCPU(S1)	$0.87 \times (n - 1) + 0.74\text{ms}$
Q2ASHCPU(S1)	$0.32 \times (n - 1) + 0.28\text{ms}$

Condition: n: number of program files

APPENDIX 10 TRANSPORTATION PRECAUTIONS

When transporting lithium batteries, make sure to treat them based on the transportation regulations.

Appendix 10.1 Relevant Models

The batteries used for Q2ASCPU are classified as shown in the table below:

Product Name	Model Name	Description	Handled as
QnA series battery	A6BAT	Lithium battery alone	Non-dangerous goods
QnA series memory card	Q1MEM-128S, Q1MEM-128SE, Q1MEM-1MS, Q1MEM-1MSE, Q1MEM-256S, Q1MEM-256SE, Q1MEM-2MS, Q1MEM-512S, Q1MEM-512SE, Q1MEM-64S, Q1MEM-64SE	Packed with lithium coin battery (BR2325)	

Appendix 10.2 Transportation Guidelines

Products are packed properly in compliance with the transportation regulations prior to shipment. When repacking any of the unpacked products to transport it to another location, make sure to observe the IATA Dangerous Goods Regulations, IMDG Code and other local transportation regulations.

For details, please consult your transportation company.

APPENDIX 11 Handling of Batteries and Devices with Built-in Batteries in EU Countries

This section describes the precautions for disposing of used batteries in EU countries and exporting batteries and/or devices with built-in batteries to EU countries.

Appendix 11.1 Disposal precautions

In EU countries, there is a separate collection system for used batteries. Dispose of batteries properly at the local community waste collection/recycling center.

The following symbol is printed on the batteries and packaging of batteries and devices with built-in batteries used for Mitsubishi programmable controllers.



Symbol mark

Note: This symbol mark is for EU countries only.

The symbol mark is specified in the EU directive 2006/66/EC Article 20
AgInformation for end usersAh and Annex II.

The symbol mark indicates that batteries need to be disposed of separately from other wastes.

Appendix 11.2 Exportation precautions

In accordance with the enforcement of the new EU Battery Directive (2006/66/EC), the following must be required when marketing or exporting batteries and/or devices with builtin batteries to EU countries.

- To print the symbol mark on batteries, devices, or their packaging
- To explain the symbol mark in the manuals of the products

(1) Printing the symbol mark

To market or export batteries and/or devices with built-in batteries, which have no symbol, to EU member states on September 26, 2008 or later, print the symbol shown on the previous page on the batteries, devices, or their packaging.

(2) Explaining the symbol mark in the manuals

To export devices incorporating Mitsubishi programmable controller to EU countries on September 26, 2008 or later, provide the latest manuals that include the explanation of the symbol mark.

If no Mitsubishi manuals or any old manuals without the explanation of the symbol mark are provided, separately attach an explanatory note regarding the symbol mark to each manual of the devices.

POINT	
	<ul style="list-style-type: none">• The requirements apply to batteries and/or devices with built-in batteries manufactured before the enforcement date of the new EU Battery Directive.

INDEX

[A]

Accessing File Register R with Instructions	App-131
Accuracy of scan time	12-6,12-8,12-14
Additional Functions of Q2ASCPU	2-5
Allowable period of momentary power failure...	4-3
Annunciator [F]	3-20,4-2
Application instructions.....	App-17
Application standards of extension base modules	17-4
Applications of Memory Cards.....	14-2
Auto refresh	7-1
Auto Refresh Setting of CC-Link	7-8

[B]

Base Unit	
Base unit allocation.....	5-2
External dimensions of installing base unit	App-143
Installation and Removal of Modules	19-12
Installing the Base Units	19-10
Parts names.....	17-7
Basic instructions.....	App-5
Battery	
Battery Replacement	21-3
Battery replacement procedure.....	21-7
Battery replacement timing	21-3,21-5
Battery Specifications (CPU Module and Memory Card Batteries).....	18-4
Installing Batteries (CPU Module and Memory Card Batteries).....	18-7
Battery life	21-5
When a PLC is Reoperated After Stored with the Battery Over the Battery Life.....	21-12
When Reoperating a PLC After Storing it with a Battery Unconnected	21-11
Battery transportation	App-162
Boot file setting	13-7
Boot operation	14-2,22-11

[C]

Calculation of Heat	19-8
Category II	20-11
Causes of Increasing Scan Time.....	App-159
CHK Instruction, IX Instruction	App-130

Circuit

Fail-Safe Circuit	19-5,19-6
System design circuit example	19-3
Clearing file register	12-27
Clock data read	10-10
Clock Function	10-8
Comments.....	App-125
COMMENTS THAT CAN BE STORED IN Q2ASCPU	11-1
Common pointer.....	12-17,13-1
Constant Scan.....	10-2
Constant scan	4-1
Constant Scan Function, Error Check Function	App-126
Control Method.....	4-1
Counter [C].....	4-2
CPU module	
External Dimensions.....	App-141
Installation and Removal	19-12
Performance specifications.....	4-1
Current consumption	4-3

[D]

Dairy Inspection	21-1
Data Clear Processing	12-27
Data link instructions	App-38
Data Link Systems	App-128
Data register [D]	4-2
Debugging by several people.....	8-61
DEBUGGING FUNCTION	
Debugging by several people	8-61
Simultaneous execution of write during RUN by several people	8-63
Simultaneous monitoring by several people	8-62
Device	
Annunciator [F]	4-2
Counter [C]	4-2
Data register [D].....	4-2
Edge relay [V]	4-2
File register [R, ZR].....	4-2
Function input [FX].....	4-2
Function output [FY]	4-2
Function register [FD]	4-2
Index register [Z].....	4-2

Internal relay [M]	4-2	External Dimensions	App-141
Interrupt pointer [I]	4-2	CPU module	App-141
Latch relay [L]	4-2	Extension Base Unit	App-145
Link direct device	4-2	Main Base Unit	App-143
Link register [W]	4-2	POWER SUPPLY MODULE	
Link relay [B]	4-2	App-141, App-142
Pointer [P]	4-2		
Retentive timer [ST]	4-2	[F]	
Special function module direct device	4-3	Fail-Safe	
Special link register [SW]	4-2	Fail-Safe Circuit	19-5
Special link relay [SB]	4-2	Fail-safe measures	19-5
Special register [SD]	4-2	Fault Examples with I/O Modules	22-73
Special relay [SM]	4-2	Faults in the output circuit	22-75
Step relay [S]	4-2	Faults with the input circuit and the corrective	
Timer [T]	4-2	actions	22-73
Device comment	11-5	Features	2-1
Initial device value comment	11-8	Ferrite core	20-8
Device points	4-2	File register [R]	4-2
Device	13-3	File title	11-4
Drive title	11-3	For MELSECNET/MINI-S3	7-1
		Format	18-3
[E]		Function List	
Edge relay [V]	4-2	COMMENTS THAT CAN BE STORED IN	
EMC DIRECTIVES	20-1	QnACPU	11-1
END processing	12-23	List of other functions	10-1
Equipment configuration in an independent system		MAINTENANCE FUNCTION	9-1
.....	3-1	List of debugging function	8-1
Error		Function version	8-12, App-151, App-155
Interruption due to error detection	9-8	Fundamentals of Troubleshooting	22-1
LED indication due to an error	9-8		
Operation mode when there is an error		[G]	
.....	9-15, 13-3	GOT	3-19
Resetting error	9-9		
Resetting errors	22-72	[H]	
Error Code		High-speed timer [T]	4-2
Error Code List	22-15		
Error Codes	22-16, App-132	[I]	
Error Contents of Error Codes Detected by the		Index Register Processing	App-129
CPU Module (4000H to 4FFFH)	App-133	Index register [Z]	4-2
Procedure to read an error code	22-16	Initial execution type program	12-4
ERROR CODES RETURNED TO THE REQUEST		Initial execution WDT time	12-6
SOURCE IN GENERAL DATA PROCESSING		Initial processing	12-22
.....	App-132	Installation and Removal of the Dustproof Cover	
Error history	9-10	19-15
Execution time measurement	8-19	Installation Environment	19-7
Execution Types	12-1	Instruction List	
Extension		Sequence instructions	App-1
Extension Base Unit	App-145	Internal current consumption	4-3
Extension Cable Specification List	17-3		

Internal relay [M]	4-2
Interrupt	
Interrupt counter	App-121
Interrupt module	3-19
Interrupt pointer [I]	4-2
Interruption due to error detection	9-8
I/O assignment	5-4
I/O control mode	4-1, App-127
I/O module	
Refresh processing of I/O module	12-22
I/O number	
Example of I/O Number Assignment	5-9
I/O number assignment	5-2
I/O signal	
About I/O Numbers	5-1

[K]

Key input operation	10-22
Keyword Registration	9-12

[L]

Latch clear operation	15-5
Latch Function	10-5
Latch relay [L]	4-2
Latch (power failure compensation) range	4-3
LED	
When the "RUN" LED is flashing	22-5
Flow chart used when "ERROR" LED is ON or flashing	22-6
Flow for actions when the "BAT.ARM" LED is turned ON	22-7
Flow for actions when the "POWER" LED is turned OFF	22-3
Flow for actions when the "RUN" LED is turned OFF	22-4
LED Name	16-5
When the "USER" LED is ON	22-7
LED indication	9-15
Lightning surge absorber	19-19
Link direct device	4-2
Link register [W]	4-2
Link relay [B]	4-2
Local device	
Data clear of local device	12-27
Monitor test of local device (function version B or later)	8-12
Use of local device (Function version B or later)	App-151
Local pointer	12-17

LOW VOLTAGE DIRECTIVES	20-1, 20-10
low-speed END processing	12-14
Low-speed execution type program	12-9
Low-speed execution monitoring time	12-15
Low-speed scan time	12-14
Low-speed timers [T]	4-2, 13-1

[M]

Main Base Unit	App-143
Main base unit for high-speed access (A38HB)	17-2
Maximum number of extension stages	3-3, 3-4
Memory capacity	4-1
Memory card	
Handling Memory Cards	18-3
Installing the batterie to the memory card	18-7
Installing/Removing A Memory Card	18-8
Memory card battery specifications	18-4
Memory Card Specifications	18-1
Part Names of Memory Card	18-6
Microcomputer program	App-124
[(delete)]	
Installation	19-13
Removal	19-14
Monitor	
Monitor function	8-2
Monitoring condition setting	8-2

[N]

Network module	1-2
NETWORK RELAY FROM ETHERNET MODULE (FUNCTION VERSION B OR LATER)	App-155
Noise filter	20-9
Precautions	
Handling precautions	17-6, 18-5
Number of files	4-1
Points occupied by empty slot	5-4
Number of I/O device points	4-1
Number of I/O points	4-1

[O]

Operation for message display	10-21
Operation processing for momentary power failure	12-26
Overview of added functions	2-7
OVERVIEW OF PROCESSING PERFORMED BY THE Q2ASCPU	12-1
Overview of the Q2AS(H)CPU(S1) Scan Time	App-158

[P]

Parameter	13-1, App-120
Partial execution	8-44
Part Names	15-2
Parts names	15-2, 16-5, 17-7
PAUSE status operation processing	12-24
Periodic inspection	21-2
PID Control Instructions	App-41
PLC name	11-1
Pointer [P]	4-2
Common pointer [P]	12-17, 13-1
Interrupt pointer [I]	4-2, 9-8, 12-18
Local pointer [P]	12-17
POWER SUPPLY MODULE	
External dimensions of power supply module	App-141, App-142
Parts names	16-5
Power supply module selection	16-3
Precautions	
CPU module handling precautions	16-4
DESIGN PRECAUTIONS	A-1
DISPOSAL PRECAUTIONS	A-7
Installation precautions	19-10
Precautions for using coaxial cables	20-4
PRECAUTIONS FOR UTILIZING THE EXISTING MELSEC-A SERIES PROGRAM FOR Q2ASCPU	App-110
Precautions when configuring the system ..	3-19
Precautions When Connecting Uninterruptible Power Supply Module (UPS)	19-23
Precautions when using the MELSEC-AnS series PLC	20-10
STARTUP AND MAINTENANCE	
PRECAUTIONS	A-5
Transportation Precautions	App-162
USER PRECAUTIONS	A-19
WIRING PRECAUTIONS	A-4, 19-17
Priority setting	9-17
Processing speed	4-1
Processing Time	App-158
Program capacity	4-1
Program Execution Types	12-1
Program monitor list	8-19
Program setting	12-1
Program Trace Function	8-48
Programming language	4-1

[Q]

QnAS(H)CPU(S1) Processing Time	App-158
--------------------------------------	---------

Q2ASCPU memory block diagram	3-23
------------------------------------	------

[R]

Reading module access time intervals	10-23
Reading/Writing Data from a Q2ASCPU Using FROM/TO Instructions	6-2
Reading/Writing Data from/to the Q2ASCPU Using Special Direct Devices	6-3
Refresh mode	4-1, App-127
Reinforced insulation	20-13
Relationship between remote operation and CPU module RUN/STOP key switch	10-20
Relationship between Switch Operations and LEDs	15-4
Relevant Models	App-162
Remote latch clear	10-19
Remote operation	10-12
Remote PAUSE	10-16
Remote RESET	10-18
Remote RUN/PAUSE contacts	4-3
Remote RUN/STOP	10-12
Remote STEP-RUN	10-15
Retentive timer [ST]	4-2
RUN status operation processing	12-24

[S]

Sampling Trace Function	8-25
Scan execution type program	12-7
Scan time measurement	8-23
Selecting Memory Card Capacity	14-3
Self-diagnostics function	9-4
Sequence Programs, Statements, Notes	App-122
Setting of the Output (Y) Status When Switching from STOP to RUN	10-7
Setting Switch	
Switch setting when using a memory card ..	18-3
Simulation Function	8-57
Simultaneous execution of write during RUN by several people	8-63
Simultaneous monitoring by several people ..	8-62
Skip function	8-47
Low speed program execution time	13-3
Special Direct Devices	6-3
Special Function Module Instructions	App-42
Special link register [SW]	4-2
Special link relay [SB]	4-2

Special module

Processing for Data Communication Requests from a Special Function Module	6-5
Special Function Module Instructions	App-42
Special register [SD]	4-2
Special relay [SM]	4-2
SPECIFICATIONS	15-1

Specifications

Battery Specifications (CPU Module and Memory Card Batteries)	18-4
Extension cable specifications	17-3
Memory card battery specifications	18-4
Memory Card Specifications	18-1
Performance specifications	4-1
SPECIFICATIONS	15-1

Standards

EMC DIRECTIVES	20-1
LOW VOLTAGE DIRECTIVES	20-1,20-10
Standby type program	12-16
Statements/notes	11-7
Status Latch Function	8-35
Step execution	8-42
Step operation	8-41
Step relay [S]	4-2
STEP-RUN status operation processing	12-24
STOP status operation processing	12-24
Structured programs	2-2
System area	8-11,8-62
SYSTEM CONFIGURATION	3-1
Equipment configuration in an independent system	3-1
Precautions when configuring the system ..	3-19
Q2ASCPU memory block diagram	3-23
System Configuration Overview	3-3
System display	9-14
System Equipment	3-5
System interrupt	13-1
System protect	9-11

[T]

Terminal Operation	10-21
Timer and Interrupt Counter Operations ..	App-121
Timer limit setting	13-1
Timer [T]	4-2
Transportation Guidelines	App-163
TROUBLESHOOTING	22-2
Troubleshooting flowchart	
When the "RUN" LED is flashing	22-5

Flow for actions when booting from a memory card is not possible	22-11
Flow for actions when the CPU module is not started up	22-13
Flow for actions when the output module's output load does not turn ON	22-8
Flow for actions when the program cannot be written	22-9
Flow for actions when the "BAT.ARM" LED is turned ON	22-7
Flow for actions when the "POWER" LED is turned OFF	22-3
Flow for actions when the "RUN" LED is turned OFF	22-4
When the "USER" LED is ON	22-7

[W]

Watchdog timer (WDT)	9-2
WDT(Watchdog Timer)	9-2
Weight	4-3
Extension cable	17-3
Memory card	18-1,18-2
Wiring	
Wiring I/O equipment	19-20
Wiring to the module terminals	19-22
Wiring I/O equipment	19-20
Wiring to the module terminals	19-22
Write	
Simultaneous execution of write during RUN by several people	8-63
Write during RUN	8-15
Writing clock data to the clock devices	10-9
Write during RUN	8-15

Numerics

5VDC internal power consumption	4-3
Troubleshooting flowchart	
Flow for actions when the "ERROR LED" is turned ON/flashing	22-6

[illegible]

WARRANTY

Please confirm the following product warranty details before using this product.

1. Gratis Warranty Term and Gratis Warranty Range

If any faults or defects (hereinafter "Failure") found to be the responsibility of Mitsubishi occurs during use of the product within the gratis warranty term, the product shall be repaired at no cost via the sales representative or Mitsubishi Service Company. However, if repairs are required onsite at domestic or overseas location, expenses to send an engineer will be solely at the customer's discretion. Mitsubishi shall not be held responsible for any re-commissioning, maintenance, or testing on-site that involves replacement of the failed module.

[Gratis Warranty Term]

The gratis warranty term of the product shall be for one year after the date of purchase or delivery to a designated place.

Note that after manufacture and shipment from Mitsubishi, the maximum distribution period shall be six (6) months, and the longest gratis warranty term after manufacturing shall be eighteen (18) months. The gratis warranty term of repair parts shall not exceed the gratis warranty term before repairs.

[Gratis Warranty Range]

- (1) The range shall be limited to normal use within the usage state, usage methods and usage environment, etc., which follow the conditions and precautions, etc., given in the instruction manual, user's manual and caution labels on the product.
- (2) Even within the gratis warranty term, repairs shall be charged for in the following cases.
 1. Failure occurring from inappropriate storage or handling, carelessness or negligence by the user. Failure caused by the user's hardware or software design.
 2. Failure caused by unapproved modifications, etc., to the product by the user.
 3. When the Mitsubishi product is assembled into a user's device, Failure that could have been avoided if functions or structures, judged as necessary in the legal safety measures the user's device is subject to or as necessary by industry standards, had been provided.
 4. Failure that could have been avoided if consumable parts (battery, backlight, fuse, etc.) designated in the instruction manual had been correctly serviced or replaced.
 5. Failure caused by external irresistible forces such as fires or abnormal voltages, and Failure caused by force majeure such as earthquakes, lightning, wind and water damage.
 6. Failure caused by reasons unpredictable by scientific technology standards at time of shipment from Mitsubishi.
 7. Any other failure found not to be the responsibility of Mitsubishi or that admitted not to be so by the user.

2. Onerous repair term after discontinuation of production

- (1) Mitsubishi shall accept onerous product repairs for seven (7) years after production of the product is discontinued. Discontinuation of production shall be notified with Mitsubishi Technical Bulletins, etc.
- (2) Product supply (including repair parts) is not available after production is discontinued.

3. Overseas service

Overseas, repairs shall be accepted by Mitsubishi's local overseas FA Center. Note that the repair conditions at each FA Center may differ.

4. Exclusion of loss in opportunity and secondary loss from warranty liability

Regardless of the gratis warranty term, Mitsubishi shall not be liable for compensation of damages caused by any cause found not to be the responsibility of Mitsubishi, loss in opportunity, lost profits incurred to the user by Failures of Mitsubishi products, special damages and secondary damages whether foreseeable or not, compensation for accidents, and compensation for damages to products other than Mitsubishi products, replacement by the user, maintenance of on-site equipment, start-up test run and other tasks.

5. Changes in product specifications

The specifications given in the catalogs, manuals or technical documents are subject to change without prior notice.

6. Product application

- (1) In using the Mitsubishi MELSEC programmable logic controller, the usage conditions shall be that the application will not lead to a major accident even if any problem or fault should occur in the programmable logic controller device, and that backup and fail-safe functions are systematically provided outside of the device for any problem or fault.
- (2) The Mitsubishi programmable logic controller has been designed and manufactured for applications in general industries, etc. Thus, applications in which the public could be affected such as in nuclear power plants and other power plants operated by respective power companies, and applications in which a special quality assurance system is required, such as for Railway companies or Public service purposes shall be excluded from the programmable logic controller applications. In addition, applications in which human life or property that could be greatly affected, such as in aircraft, medical applications, incineration and fuel devices, manned transportation, equipment for recreation and amusement, and safety devices, shall also be excluded from the programmable logic controller range of applications. However, in certain cases, some applications may be possible, providing the user consults their local Mitsubishi representative outlining the special requirements of the project, and providing that all parties concerned agree to the special circumstances, solely at the users discretion.

Model Q2AS (H) CPU (S1)

User's Manual

MODEL	Q2ASCPU-U-E
MODEL CODE	13J858
SH(NA)-3599-G(0809)MEE	



HEAD OFFICE : TOKYO BUILDING, 2-7-3 MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN
NAGOYA WORKS : 1-14, YADA-MINAMI 5-CHOME, HIGASHI-KU, NAGOYA, JAPAN

When exported from Japan, this manual does not require application to the
Ministry of Economy, Trade and Industry for service transaction permission.

Specifications subject to change without notice.